



# Solenoid Valves F Series



New Easy Assembly Type Manifold (internal wiring connector type) for the F10/F15! Now easier to use.



Solenoid shared with F Series for low wattage and shorter total length. Tandem solenoid specifications, IP specifications, and serial transmission type added.



# **SOLENOID VALVES F SERIES**

# F10, F15, F18 SERIES

# Contents

Features — 2	Operating Principles and Indicated Codes —	—19
Variations — 8	Handling Instructions and Precautions	<b>-2</b>
Energy Saving Proposals Using the F Series of Solenoid Valves— 13	Exploded Views of Split Type Manifold and Easy Build Type Manifold ——	<b>—3</b>
Materials for Selecting F Series Solenoid Valves and Air Cylinders –14	Serial Transmission Type Product Configuration —	<b>-4</b>
Safety Precautions ————————————————————————————————————	Serial Transmission Type List of Specifications	<b>—4</b> :




Solenoid valve F10 series	59
List of Specifications	60
Order Codes	66
Dimensions —	118



Solenoid valve F15 series	155
List of Specifications	156
Order Codes —	162
Dimensions —	216



253
254
259
278



Series Specification Confirmation Form ————————————————————————————————————	29	J	ſ	1	ı
---	----	---	---	---	---



# Solenoid Valves F Series Easy Assembly Type **Easy Assembly Type Manifold**

A new connector type manifold has been added to the F10/F15 series solenoid valves.

This allows for easy addition, removal, and assembly, as the internal wiring is connected simply by linking the manifold bases.

Direction conversion is possible without connector disassembly. A knob can be turned 90 degrees to change the direction of the wiring.

Negative common specifications type can also be selected.

Internal wiring connector

Connecting rod

Patent pending

between left and right.

Direction convertible by 90 degree Flat cable connector D-sub connector

The degree of freedom has been increased for supply/exhaust ports.

With one-side piping, the position of fitting blocks can be switched Base piping and direct piping changes are also possible, as before.

> An optional stop valve can be selected for the non-plug-in type.

# **Connector wiring**

For both single wiring and double wiring, simply connecting a valve base assembly enables the valve signals on the wiring side to be assigned in order. No wiring work is required at all.

### Internal wiring example

	Station 1 Double wiring	Station 2 Single wiring	Station 3 Double wiring stn. 3	Station 4 Double wiring
Wiring type (flat cable connector, etc.)	(1)14(SA) (2)12(SB) com	(3)14(SA) com	(4)14(SA) (5)12(SB) com	(6)14(SA) (7)12(SB) com
(1)—(2)—(3)—(4)—(5)—(6)—(7)—(8)———————————————————————————————				

(with single wiring and double wiring mixed)


### Internal wiring connectors




Internal wiring connector

# Method for adding and removing manifolds (see page 36 and page 37 for details)


① Remove the connecting screw from the right end block. (If there is a DIN rail, loosen the DIN rail fixing screw.)

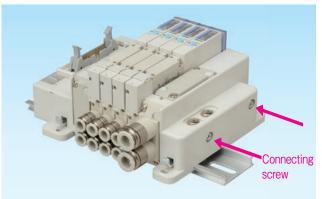

3 Remove the valve from the connecting rod.

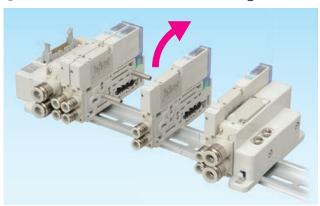

②Disassemble the manifold into two sides while pushing the lever on the DIN bracket. (only when there is a DIN bracket)

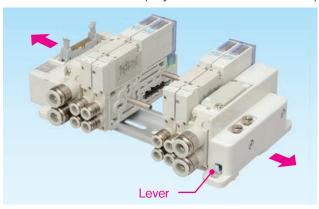

- When adding:Install the connecting rod included with the valve to add, and insert the valve to add.
- (5) When removing: Remove the valve, and switch the connecting rod to the new length.
- ⑥Return the right end block to its original position and tighten the connecting screw. Then, tighten the DIN rail fixing screw.

### Two installation methods available

Select either DIN rail mounting or direct mounting (using the four main unit mounting holes).





# The intermediate piping block can now be selected when ordering.




- ·Reduce risk of flow rate shortage.
- •Three different air pressures can be supplied by using port isolators.

# Solenoid Valves F Series




# The F Series is the Result of a Focus on Usability.

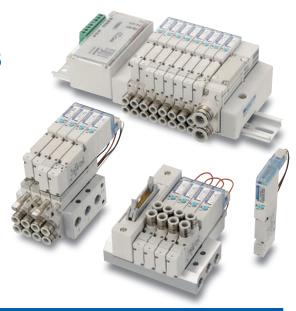


# 1 Single or double dual use valve

• With the F series 2-position valves, you can use a manual override to select either the single solenoid valve or the double solenoid valve function. Note: A dedicated single solenoid valve is also available.








%2-position valve (Excluding T0 type)

# 2 Employs dual use fittings

- Koganei's unique dual use fittings can be connected to two different types of tubes with differing outer diameters.
- No need to waste time selecting fittings based on the tube size.

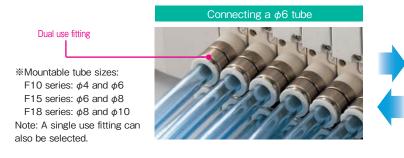




The same fitting as in the left photograph

# 3 Allows the fitting block to be changed for either base piping or direct piping

Since the direction of the fitting blocks can be changed after purchase, the user is free to change the piping direction.

(Excluding monoblock manifold F type, and PC board manifold F type)







Before use, be sure to read the "Safety Precautions" on p.16.


# 4 Easy assembly type manifold has newly been added (F10/F15)

This allows for easy addition, removal, and assembly, as the internal wiring is connected simply by linking the manifold bases.



# 5 The intermediate piping block can now be selected when ordering (F10/F15 easy assembly type manifold)

The easy assembly type manifold (F10/F15) supports large flow rate consumption. Three different air pressures can be supplied by setting two port isolators.

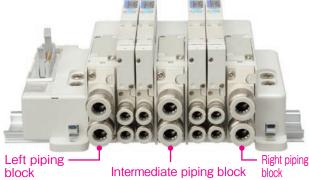

# 6 Color identification for positive/negative common (F10/F15 easy assembly type manifold)

• The F10/F15 easy assembly type manifold enables color identification of specifications via a small window on the solenoid side of the valve base, which indicates the positive common, negative common, single wiring, and double wiring.





Gray: Negative common double wiring

Pink: Negative common single wiring

# 7 Easy replacement of wiring blocks (F10/F15 easy assembly type manifold)

 Loosen the two screws of the wiring block assembly.



2 Remove the connector from the piping block left.



③ Insert the connector to the piping block left.



Tighten the two screws of the wiring block assembly to complete the procedure.




# 8 Tandem 3-port valve (4-position)

- Two 3-port valve functions in one valve body.
- Using F series valves as an air-operated valve or for single-acting cylinder control saves space.
- Allows combined mounting with 5-port valve.




	Model	4 (A) side	2 (B) side	Symbol
NEW	F10	Normally closed (NC)	Normally closed (NC)	14(SA) 4(A) 2(B) 12(SB) 5(R1) 1(P) 3(R2)
NEW	F10  TB F15  TB F18  TB	Normally open (NO)	Normally open (NO)	14(SA) 4(A) 2(B) 12(SB) 5(R1) 1(P) 3(R2)
NEW	F10	Normally closed (NC)	Normally open (NO)	14(SA) 4(A) 2(B) 12(SB) 5(R1) 1 3(R2)

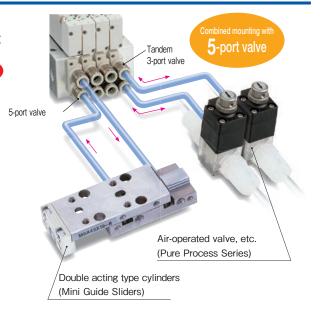


# 9 Wire-saving type provided for monoblock manifold (F10/F15)

- •Wire-saving type is also available for monoblock manifold A and F types. Slim and compact.
- Wiring specifications for flat cable connector and D-sub connector can be selected.

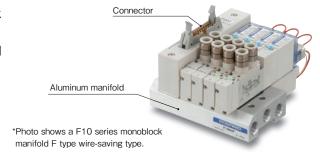


# 10 Stop valve (optional) (F10/F15 monoblock manifold/easy assembly type manifold)

- Enables replacement of valves without stopping operation of various devices and instrumentation lines.
- Stop valve enables the opening and closing of each unit's flow path without shutting off the main air supply.



# 11 Back pressure prevention valve (optional) (F10/F15)

Prevents back pressure problems caused when operating single acting cylinders, etc.

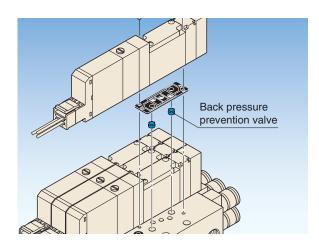



### Back pressure prevention valve


Two back pressure prevention valves are mounted on the manifold side. This prevents cylinder malfunctions caused by the exhaust air from other valves.

Remark: Standard with F18 split manifolds.

Not provided with F18 monoblock manifolds.

# 12 Slim and compact

### Monoblock manifold F type (F10/F15)



\*Photo shows F10 series.


# 13 Optional IP65 protective structure


•Waterproof seal has been adopted in the plug connector and solenoid to comply with the requirements for an IP65 protective structure. Supports a wide variety of environments.

Applicable product range

- ·Single valve unit
- ·Monoblock manifold A type
- ·Monoblock manifold F type
- ·Split Manifold Non-Plug-in Type
- Easy assembly type Non-Plugin Type







# 14 Support for various types of serial transmission (F10/F15/F18)

Compatible devices with serial

transmission manifold

For OMRON B7A Link Terminal

For CC-Link (16 outputs)

For CC-Link (32 outputs)

For DeviceNet (16 outputs)

For DeviceNet (32 outputs)


For CompoNet (16 outputs)

For EtherCAT (16 outputs)

For EtherCAT (32 outputs)

For EtherNet/IP (16 outputs)

For EtherNet/IP (32 outputs)

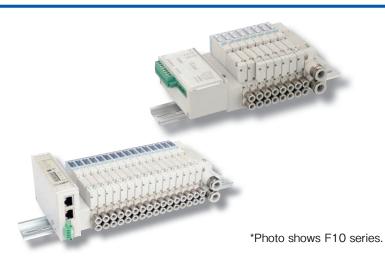

# **Product Range**

# Solenoid Valves F10 Series

- ●Valve width: 10 mm [0.394 in.]
- Sonic conductance C: 0.97 dm<sup>3</sup>/(s/bar) (Cv: 0.27)
- Applicable cylinder bore sizes:  $\phi$ 20 [0.787 in.] to  $\phi$ 50 [1.969 in.]

# Solenoid Valves F15 series



- ■Valve width: 15 mm [0.591 in.]
- Sonic conductance C: 2.05dm<sup>3</sup>/(s/bar) (Cv: 0.57)
- Applicable cylinder bore sizes:  $\phi$ 40 [1.575 in.] to  $\phi$ 80 [3.150 in.]

# Solenoid Valvea F18 Series

- Valve width: 18 mm [0.709 in.]
- Sonic conductance C: 3.48dm<sup>3</sup>/(s/bar) [Cv: 0.97]
- Applicable cylinder bore sizes:  $\phi$ 50 [1.969 in.] to  $\phi$ 100 [3.937 in.]

# Single Valve Unit (F10/F15/F18)

Valves can be used as single units by attaching inlet port blocks. Mounting brackets are also available.

### Outlet port specifications With sub-base For single valve unit or manifold use

	Series	Female	male thread   With female thread block		Female thread   With female thread block   With dual use fitting blo			ing block	k With single use fitting block				
		Rc1/8 NPT1/8	Rc1/4 NPT1/4	M5 10-32 UNF	Rc1/8 NPT1/8	Rc1/4 NPT1/4	φ4 & φ6	φ6 & φ8	φ8 & φ10	φ4	φ6	φ8	φ10
•	F10	•		•			•			•	•		
	F15	•			•			•			•	•	
	F18												











# Monoblock Manifold A Type (Base Piping Type) (F10/F15/F18)

This base piping type manifold offers easy maintenance and cost performance.

Replacing the outlet block enables its use as a direct piping type manifold. Using a pre-wired common terminal plug connector greatly reduces wiring work.









# Monoblock Manifold F Type (Direct Piping Type) (F10/F15/F18)

The direct piping type manifold offers excellent cost performance.

Using a pre-wired common terminal plug connector greatly reduces wiring work.







F10 Series Order codes	Page 72
F10 Series Dimensions	Page 122
F15 Series Order codes	Page 170
F15 Series Dimensions	Page 221
F18 Series Order codes	Page 263
F18 Series	Page 282

# Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type) (F10/F15)

Wiring appointing include the flat column Wiring appointing include the flat column include the flat c

Wiring specifications include the flat cable connector mounting type and the D-sub connector mounting type.





F10 Series Order codes	Page 76
F10 Series Dimensions	Page 123
F15 Series Order codes	Page 174
F15 Series Dimensions	Page 222

# Monoblock Manifold F Type, Wire-Saving Type (Direct Piping Type) (F10/F15)

Wire-saving type of monoblock manifold F type.

Wiring specifications include the flat cable connector mounting type and the D-sub connector mounting type.







# PC Board Manifold (F10/F15)

A MIL type 20-pin flat cable connector is installed on the monoblock manifold to achieve both wiring savings and cost performance. Combined use of the PC wiring system and wiring specification -F201 allows for more effective wiring savings.







# Split Manifold Non-Plug-in Type (F10/F15/F18)

Enables easy addition or removal of manifold blocks. This system offers more flexibility in conforming to changes in specifications.










F10 Series Order codes	Page 86
F10 Series Dimensions	Page 126
F15 Series Order codes	Page 184
F15 Series Dimensions	Page 225
F18 Series Order codes	Page 266
F18 Series Dimensions	Page 283

# Split Manifold Plug-in Type

Manifold conforms to reducing wiring work. Adding on wiring allows adding manifold units. Combined use of the PC wiring system and wiring specification -F201 offers more effective wiring savings.










### Wiring Specifications



Flat cable connectortop surface (vertical) wiring type Note



Flat cable connector side surface (horizontal) wiring type Note





D-sub connector top surface (vertical) wiring type Note



D-sub connector side surface (horizontal) wiring type Note



Terminal block

Note: You can change the connector direction.

Photograph shows flat cable connector.

connector and D-sub connector, the no power supply terminal type is also available.

Caution: For the F18 series, neither the connector side surface (horizontal) wiring type nor the no power supply terminal type is available.

Remark: You can also select the wiring position (wiring block) for right-side mounting.

# Split Manifold Serial Transmission Type (F10/F15/F18)



Integrated type



Stand-alone type

- ●For CC-Link For OMBON B7A Link Terminal For CompoNet
  - For DeviceNet ●For EtherCAT
  - For EtherNet/IP

\*For details, see p. 42-44.

F10 Series Order codes	Page 96
F10 Series Dimensions	Page 137
F15 Series Order codes	Page 194
F15 Series Dimensions	Page 236
F18 Series Order codes	Page 274
F18 Series Dimensions	Page 287



For EtherCAT For EtherNet/IP

Remark: You can also select the wiring position (transmission block) for right-side mounting.

# Easy Assembly Type Manifold Non-Plug-in Type (F10/F15)

Enables easy addition or removal of manifold blocks. Direct mounting (mounting without DIN rail) is selectable.









F10 Series Order codes	Page 100
F10 Series Dimensions	Page 144
F15 Series Order codes	Page 198
F15 Series	Page 242

# Easy Assembly Type Manifold Plug-in Type (F10/F15)

Manifold conforms to reducing wiring work, and enables easy addition or removal of manifold blocks. Direct mounting (mounting without DIN rail) is selectable.

Combination use of five wiring specifications offers more effective wiring savings.









F10 Series Order codes	Page 106
F10 Series Dimensions	Page 145
F15 Series Order codes	Page 204
F15 Series Dimensions	Page 244

### Wiring Specifications(F10/F15)



Flat cable connectortop surface (vertical) wiring type Note



Flat cable connector side surface (horizontal) wiring type Note



D-sub connector top surface (vertical) wiring type Note



D-sub connector side surface (horizontal) wiring type Note



Terminal block

Photograph shows D-sub connector.

For the flat cable connector and D-sub connector, the no power supply terminal type is also available.

Note: You can easily change the connector direction. Patent pending

# Easy Assembly Type Manifold Serial Transmission Type (F10/F15)



- ●For CC-Link
- ●For CompoNet
- ●For DeviceNet
- ●For EtherCAT
- ●For EtherNet/IP

%For details, see p. 42-44.

F10 Series Order codes	Page 112
F10 Series Dimensions	Page 151
F15 Series Order codes	Page 210
F15 Series Dimensions	Page 249




For EtherCAT For EtherNet/IP

# **Energy-Saving Proposal Using the Solenoid Valves F Series**

# Comparison of Power Consumption (Reference)

With the cylinder conditions operating 5 seconds in the extended side and 5 seconds in the retraced side, and an operating time of 12 hours per day, five days per week, and 50 weeks per year, the power consumption for one year is calculated. (Annual power consumption: Power consumption per hour × 12 hours × 5 days × 50 weeks)

### Case 1: when single solenoid is used (0.4W: Standard type)



### Case 2: when single solenoid is used (0.1W: Low current type)



# ■ Case 3: when double solenoid is used (0.4W: Standard type)


<Pulse control using self-holding function>



Results for calculation of power consumption under the above conditions, and power consumption graph

Colomoid	Dower concumption (M)	Energizing time (s)		Number of operations	Electric energy per hour	Annual electric energy (kWh) and annual
Solenoid	Power consumption (W)	SA: ON	SB: ON	per hour (cycles)	(Wh)	electric energy cost
Single solenoid (standard type)	0.4	5	-	360	0.200	0.6 [13.2 yen]
Single solenoid (low-current type)	Starting: 0.4/holding: 0.1	5	-	360	0.052	0.156 [3.43 yen]
Double solenoid (standard type)	0.4	0.05	0.05	360	0.004	0.012 [0.264 yen]

Remarks: Comparison with a new type DC 24 V solenoid. When power costs 22 yen/kWh.

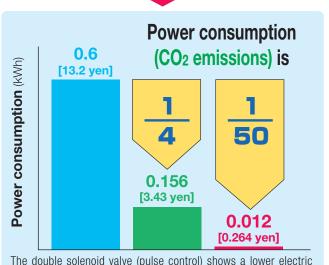

The double solenoid valve (pulse control) shows a lower electric energy result. Note that with higher operation frequency, this difference will narrow somewhat.

With use of 0.1W low-current type, the power consumption is reduced to 1/4.

### **Furthermore**

- If pulse control is performed using a double solenoid, power consumption can be sharply reduced.
- Solenoid valves F series is single/ double dual use valves.
- Since the single solenoid and double solenoid are the same price Note, it also enables cost benefits.


Note: For 2-position valve. Excluding T0 type.

# Criteria for Selection: Solenoid Valve and Air Cylinders (1)

### 1. Cylinder and valve selection

## Select bore size of the cylinder according to the required cylinder thrust.

# Decide valve size according to the cylinder bore size and speed.

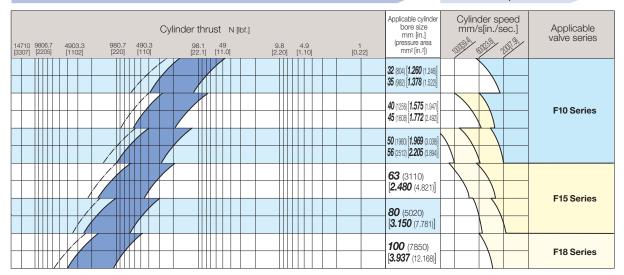

### How to Use the Diagram

### 1. Selection of Cylinder Bore size

Select the cylinder bore size so that the load is within the \_\_\_\_\_ of the diagram. Where the requirements call for 0.5MPa [73psi.] of operating air pressure and 98.1N [22.1lbf.] of thrust, three cylinder bore sizes can be selected,  $\phi$ 20 (load ratio of 70%),  $\phi$ 25 (load ratio of 50%), and  $\phi$ 32 (load ratio of 30%).

### 2. Selection of Applicable Valve


With the required cylinder speed set at 400mm/s [15.748 in./sec.], the load ratio at the bore size  $\phi$ 32 [1.260 in.] is about 50%, and the applicable valve is therefore F10 series. At bore size  $\phi$ 35 [1.378 in.], as well, where the load ratio is about 50%, the applicable valve is F10 series. And when the load ratio is about 50% for the bore size  $\phi$ 63 [2.480 in.], the applicable valve should be F15 series.

### 3. Selection Precautions

For high-speed operations or for other cases where a constant operating speed is required whereas the load has some variation, select a larger cylinder bore size where the load ratio is 50% or less. For valve, piping, and fitting sizes, as well, select sizes that provide enough margin.

# Air pressure 0.3MPa [44psi.] Air pressure 0.7MPa [102psi.] Load ratio = Load Theoretical thrust

2. Selection of F.R.L.Combinations



# 3. Selection of Piping and Fitting Sizes

For F.R.L. combinations, watch the flow rate characteristics graph in order to select sizes that let pressure fall to 10% or to 0.05 MPa [7.25 psi.] or less when the system is at maximum flow (total air volume). Use the same criteria for selecting air filters, regulators, and lubricators. Moreover, when the flow is small, ensure that the flow exceeds the lubricator's minimum flow rate for drips.

Select piping and fitting sizes that fit the piping connection port sizes for the equipment, and avoid over-throttling with bushings or other equipment. In addition, use of quick fittings, which do not have a throttle on the inner diameter, can assure adequate flow volume and prevent pressure drops.

### Reference

### Actual air cylinder thrust

$$F_A = F \times \eta = \frac{\pi D^2}{4} \times P \times \eta$$

### For valve/F.R.L. unit selection

### Air cylinder air flow rate

$$Q_1 = \frac{\pi \ D^2}{4} \ \ x \ Lx \frac{60}{t} \ \ x \frac{P+0.1}{0.1} \ x \ 10^{-6}$$

### Air flow rate of piping from valve to cylinder

$$Q_2 = \frac{\pi \ d^2}{4} \ x \ \ell x \frac{60}{t} x \frac{P}{0.1} x 10^{-6}$$

### Total air flow ratea

$$Q_3 = Q_1 + Q_2$$

### For compressor selection

### Air cylinder air consumption

$$q_1 = \frac{\pi D^2}{4} \times L \times 2 \times n \frac{P + 0.1}{0.1} \times 10^{-6}$$

### Air consumption of piping from valve to cylinder

$$q_2 = \frac{\pi \ d^2}{4} \times {\bf \ell} \times 2 \times n \frac{P}{0.1} \times 10^{-6}$$

### Total air consumption

$$q_3 = q_1 + q_2$$

: Bore size mm

: Piping inner diameter mm

: Theoretical cylinder thrust

: Actual cylinder thrust

: Cylinder stroke mm

: Piping length mm

: Number of cylinder reciprocations per minute times/min

: Air pressure MPa

Q1 : Air flow rate required for cylinder [2/min (ANR)]

Q2 : Air flow rate required for piping [2/min (ANR)]

Q<sub>3</sub> : Total air flow rate [*l*/min (ANR)]

: Cylinder air consumption [\$\mathcal{\ell}{\text{min}} \text{ (ANR)}]

: Air consumption of piping  $[\ell/\min$  (ANR)] : Total air consumption  $[\ell/\min$  (ANR)]

Q3

:Time required for one cylinder stroke s

: Cylinder thrust efficiency (approx. 70%, but 50% or lower for high speed)

### Criteria for Selection: Solenoid Valve and Air Cylinders (2)

### Cylinder thrust (Theoretical value)

N [lbf.] Cylinder bore Rod dia. Operating Operation Pressure area Air pressure MPa [psi.] size mm [in.] mm [in.] direction mm<sup>2</sup> [in.<sup>2</sup>] 0.9 [131] Note tvpe 0.1 [15] 0.2 [24] 0.3 [44] 0.4 [58] 0.5 [73] 0.6 [87] 0.7 [102] 0.8 [116] No 2.5 [0.098] 1 [0.039] Single acting push type 4.9 [0.0076] 0.8 [0.18] 1.3 [0.29] 2.2 [0.49] 1.7 [0.38] 2.2 [0.49] 4 [0.157] 2 [0.079] Single acting push type 12.6 [0.0195] 3.5 [0.79] 4.8 [1.08] 6.0 [1.35] 15.9 [0.0246] 3.2 [0.72] 4.8 [1.08] 6.4 [1.44] 8.0 [1.80] 9.5 [2.14] 11.1 [2.50] 4.5 [0.177] 2 [0.079] acting type Pull side 12.8 [0.0198] 2.6 [0.58] 3.8 [0.85] 5.1 [1.15] 6.4 [1.44] 7.7 [1.73] 9.0 [2.02] Single acting push type 15.9 [0.0246] 1.9 [0.43] 3.5 [0.79] 5.1 [1.15] 6.6 [1.48] 8.2 [1.84] Single acting push type 28.3 [0.0439] 5.0 [1.12] 7.8 [1.75] 10.7 [2.41] 13.5 [3.03] 16.3 [3.66] Single acting pull type 21.2 [0.0329] 2.9 [0.65] 5.0 [1.12] 7.1 [1.60] 9.2 [2.07] 11.3 [2.54] 6 [0.236] 3 [0.118] Double Push side 28.3 [0.0439] 5.7 [1.28] 8.5 [1.91] 11.3 [2.54] 14.2 [3.19] 17 [3.82] 19.8 [4.45] Pull side 4.2 [0.94] 6.4 [1.44] 8.5 [1.91] 10.6 [2.38] 12.7 [2.85] 14.8 [3.33] 21.2 [0.0329] acting type 9.8 [2.20] 17.7 [3.98] 25.5 [5.73] 33.4 [7.51] 41.2 [9.26] Single acting push type 78.5 [0.1217] 49.1 [11.0] 7.3 [1.64] 33.7 [7.58] 66 [0.102] 13.9 [3.12] 20.5 [4.61] 27.1 [6.09] 40.3 [9.06] Single acting pull type 4 [0.157] 10 [0.394] Double 15.7 [3.53] 39.3 [8.83] 47.1 [10.6] Push side 78.5 [0.1217] 7.9 [1.78] 23.6 [5.31] 31.4 [7.06] 55 [12.4] acting type Pull side 66 [0.102] 6.6 [1.48] 13.2 [2.97] 19.8 [4.45] 26.4 [5.93] 33 [7.42] 39.6 [8.90] 46.2 [10.4] Single acting push type 201 [0.312] 30.4 [6.83] 50.5 [11.4] 70.6 [15.9] 90.7 [20.4] 110.8 [24.91] 130.9 [29.43] Single acting pull type 181 [0.281] 26.4 [5.93] 44.5 [10.0] 62.6 [14.1] 80.7 [18.1] 98.8 [22.2] 116.9 [26.28] 16 [0.630] 5 [0.197] 20.1 [4.52] 40.2 [9.04] 60.3 [13.6] 80.4 [18.1] 100.5 [22.59] 140.7 [31.63] Double Push side 201 [0.312] 120.6 [27.11] 18.1 [4.07] 36.2 [8.14] 54.3 [12.2] 72.4 [16.3] 90.5 [20.3] 126.7 [28.48] acting type Pull side 181 [0.281] 108.6 [24.41] Single acting push type 314 [0.487] 24.6 [5.53] 56 [12.6] 87.4 [19.6] 118.8 [26.71] 150.2 [33.76] 181.6 [40.82] 213 [47.88] 244.4 [54.94] 20 [0.787] 8 [0.315] Push side 314 [0.487] 31.4 [7.06] 62.8 [14.1] 94.2 [21.2] 125.6 [28.23] 157 [35.29] 188.4 [42.35] 219.8 [49.41] 251.2 [56.47] acting type Pull side 264 [0.409] 26.4 [5.93] 52.8 [11.9] 79.2 [17.8] 105.6 [23.74] 132 [29.67] 158.4 [35.61] 184.8 [41.54] 211.2 [47.48] 237.6 [53.41] Single acting push type 490 [0.760] 98 [22.0] 147 [33.0] 196 [44.1] 245 [55.1] 294 [66.1] 343 [77.1] 392 [88.1] 441 [99.1] 25 [0.984] 10 [0.394] Double 490 [0.760] 49 [11.0] 98 [22.0] 147 [33.0] 196 [44.1] 245 [55.1] 294 [66.1] 343 [77.1] 392 [88.1] 441 [99.1] Push side 412 [0.639] 41.2 [9.26] 82.4 [18.5] 123.6 [27.79] 164.8 [37.05] 206 [46.31] 247.2 [55.57] 288.4 [64.83] 329.6 [74.09] 370.8 [83.36] acting type Pull side Single acting push type 804 [1.246] 161 [36.2] 241 [54.2] 322 [72.4] 402 [90.4] 482 [108] 563 [127] 643 [145] 724 [163] 32 [1.260] 12 [0.472] Double 804 [1.246] 161 [36.2] 241 [54.2] 402 [90.4] 563 [127] 643 [145] 724 [163] Push side 80 [18.0] 322 [72.4] 482 [108] 690 [1.070] 207 [46.5] 345 [77.6] 483 [109] 552 [124] acting type Pull side 69 [15.5] 138 [31.0] 276 [62.0] 414 [93.1] 621 [140] 1256 [1.947] 251 [56.4] 377 [84.7] 628 [141] 879 [198] 1005 [225.9] 1130 [254.0] Single acting push type 502 [113] 754 [169] 40 [1.575] 16 [0.630] Double Push side 1256 [1.947] 126 [28.3] 251 [56.4] 377 [84.7] 502 [113] 628 [141] 754 [169] 879 [198] 1005 [225.9] 1130 [254.0] acting type Pull side 1055 [1.635] 106 [23.8] 211 [47.4] 317 [71.3] 422 [94.9] 528 [119] 633 [142] 739 [166] 844 [190] 950 [214] Double Push side 1963 [3.043] 196 [44.1] 393 [88.3] 589 [132] 785 [176] 982 [221] 1178 [264.8] 1374 [308.9] 50 [1.969] 16 [0.630] acting type Pull side 1762 [2.731] 176 [39.6] 352 [79.1] 529 [119] 705 [158] 881 [198] 1057 [237.6] 1233 [277.2] Push side 3117 [4.831] 312 [70.1] 623 [140] 935 [210] 1247 [280.3] 1559 [350.5] 1870 [420.4] 2182 [490.5] 2494 [560.7] 2805 [630.6] 63 [2.480] 20 [0.787] 2803 [4.345] 280 [62.9] 1121 [252.0] 1402 [315.2] 1682 [378.1] 1962 [441.1] 2242 [504.0] 2523 [567.2] acting type Pull side 561 [126] 841 [189] Push side 5026 [7.790] 503 [113] 1005 [225.9] 1508 [339.0] 2010 [451.8] 2513 [564.9] 3016 [678.0] 3518 [790.8] 4021 [903.9] 80 [3.150] 25 [0.984] 3175 [713.7] acting type Pull side 4536 [7.031] 454 [102] 907 [204] 1361 [306.0] 1814 [407.8] 2268 [509.8] 2722 [611.9] 3629 [815.8] 4082 [917.6] Push side 7853 [12.172] 785 [176] 1571 [353.2] 2356 [529.6] 3141 [706.1] 3927 [882.8] 4712 [1059] 5497 [1236] 6282 [1412] 7068 [1589] 100 [3.937] 30 [1.181] acting type Pull side 7147 [11.078] 715 [161] 1429 [321.2] 2144 [482.0] 2859 [642.7] 3574 [803.4] 4288 [963.9] 5003 [1125] 5718 [1285] 6432 [1446] 12271 [19.020] 1227 [275.8] 2454 [551.7] 3681 [827.5] 4908 [1103] 6136 [1379] 7363 [1655] 8590 [1931] 9817 [2207] 11044 [2483]

2251 [506.0]

3376 [758.9]

4502 [1012]

5627 [1265]

1125 [252.9]

Note: This air pressure is not available for Solenoid Valves F series

Pull side

11254 [17.443]

Double

acting type

**125 [4.921]** 36 [1.417]

7878 [1771]

9003 [2024]

10129 [2277]

6752 [1518]

Before selecting and using the products, please read all the "Safety Precautions" carefully to ensure proper product use. The Safety Precautions described below are to help you use the product safely and correctly, and to prevent injury or damage to you, other people, and assets.

Be sure to observe these safety precautions together with the following safety regulations of ISO4414 (Pneumatic fluid power General rules and safety requirements for systems and their components), and JIS B 8370 (General rules relating to systems).

The directions are ranked according to degree of potential danger or damage: "DANGER", "WARNING", "CAUTION" and "ATTENTION."

<u></u> <b>⚠</b> DANGER	Indicates situations that can be clearly predicted as dangerous.  Death or serious injury may result if the situation is not avoided.  It could also result in damage or destruction of assets.
<b>⚠</b> WARNING	Indicates situations that, while not immediately dangerous, could become dangerous. Death or serious injury may result if the situation is not avoided. It could also result in damage or destruction of assets.
<b>A</b> CAUTION	Indicates situations that, while not immediately dangerous, could become dangerous. Failure to avoid the situation creates the risk of minor or semi-serious injury. It could also result in damage or destruction of assets.
<b>ATTENTION</b>	While there is little chance of injury, this content refers to points that should be observed for appropriate use of the product.

- This product was designed and manufactured for use in general industrial machinery.
- When selecting and handling equipment, the system designer or another person with sufficient knowledge and experience should always read the "Safety Precautions", "catalog", "instruction manual", and other literature before commencing operation. Improper handling is dangerous.
- After reading the instruction manual, catalog, and other documentation, always place them in a location that allows easy availability for reference to users of this product.
- Whenever transferring or lending the product to another person, always attach the catalog, instruction manual, and other information to the product where they are easily visible in order to ensure that the new user can use the product safely and properly. The danger, warning and caution items listed under these "Safety Precautions" do not cover all possible contingencies. Read the
- catalog and instruction manual carefully, and always keep safety first.

# **DANGER**

- Do not use for the purposes listed below:
  - 1. Medical equipment related to maintenance or management of human lives or bodies.
  - 2. Mechanical devices or equipment designed for the purpose of moving or transporting people.
  - 3. Critical safety components in mechanical devices.
  - This product has not been planned or designed for purposes that require advanced stages of safety. It could cause injury to human life.
- Do not use in locations with or near dangerous substances such as flammable or ignitable substances. This product is not explosion-proof. It could ignite or burst into flames.
- When attaching the product, always firmly support and secure them (including workpieces) in place. Dropping or falling of the product or improper operation could result in injury.
- Persons who use a pacemaker, etc., should keep a distance of at least 1 meter [3.28 ft.] away from the product. There is a possibility that the pacemaker will malfunction due to the strong magnet built into the product.
- Never attempt to modify the product. It could result in abnormal operation leading to injury, etc.
- Never attempt inappropriate disassembly, assembly or repair of the product's basic construction, or of its performance or functions. This could result in injury, electric shock, fire, etc.
- Do not splash water on the product. Spraying it with water, washing it, or using it underwater could result in malfunction of the product leading to injury, electric shock, fire, etc.
- While the product is in operation, avoid touching it with your hands or otherwise approaching too close. In addition, do not make any adjustments to the interior or to the attached mechanisms (manual override, connecting and disconnecting of wiring connectors, adjustment of pressure switches, or release or connection of piping tubes or plugs) while in operation. The actuator can move suddenly, possibly resulting in injury.

# **WARNING**

- Do not use the product in excess of its specification range. Such use could result in product breakdowns, function stop, damage or drastically reduce the operating life.
- Before supplying air or electricity to the device and before starting operation, always conduct a safety check of the area of machine operation. Unintentional supply of air or electricity could possibly result in electric shock, or in injury caused by contact with moving parts.

- Do not touch the terminal and the miscellaneous switches, etc., while the device is powered on. There is a possibility of electric shock and abnormal operation.
- Do not throw the product into fire. The product could explode and/or release toxic gases.
- Do not sit on the product, place your foot on it, or place other objects on it. Accidents such as falling or tripping over the product could result in injury. Dropping the product could result in injury, or also damage or break it resulting in abnormal or erratic operation, or runaway, etc.
- When conducting any kind of operation for the product, such as maintenance, inspection, repair, or connection/disconnection or replacement of piping, always turn off the air supply completely and confirm that residual pressure inside the product or in piping connected to the product is zero before proceeding. In particular, be aware that residual air will still be in the air compressor, vaccum pump or air storage tank. The actuator could abruptly move if residual air pressure remains inside the piping, causing injury.
- Before commencing normal operation, always release the lock of the locking type manual override, and confirm that the manual override is in the normal position and that the main valve is in the proper switching position, and only then commence the operation. Failure to do so could lead to erroneous operation.
- Always shut OFF the power before wiring operations. Wiring with the power ON could result in electric shock.
- Always apply the specified voltage to the solenoid. Applying the wrong voltage could result in failure to perform the intended function, and could damage or burn the product itself.
- Avoid scratching the cords of lead wires, etc. Letting the cords be subject to scratching, excessive bending, pulling, rolling up, or being placed under heavy objects or squeezed between two objects, may result in current leaks or defective continuity that lead to fire, electric shock, or abnormal operation.
- Do not pull out the connectors while the power is ON. Also, do not apply unnecessary stress on the connector. It could result in erratic equipment operation that could lead to personal injury, equipment breakdown, or electrical shock, etc.
- Always check the Catalog to ensure that the product wiring and piping is done correctly. Errors in wiring and piping could lead to abnormal operation of the actuators, etc.
- In the first operation after the equipment has been idle for 48 hours or more, or has been in storage, there is a possibility that contacting parts have got stuck, resulting in equipment operation delays or sudden movements. For these first operations, always run a test operation before use to check that operating performance is normal.

- In low frequency use (more than 30 days between uses), there is a possibility that contacting parts may have stuck toghter, resulting in equipment operation delays or sudden movements that could lead to personal injury. Run a test operation at least once every 30 days to confirm that movement is normal.
- For double solenoid type (excluding the Tandem 3-port valve), do not apply current through both solenoids simultaneously. It is impossible in such a situation to maintain the correct valve position, and the equipment may operate in an unintended direction, leading to the possibility of equipment breakdown or personal injury.
- Do not use the solenoid valves or the wiring that controls them, near power lines where large electrical currents are flowing, or in locations subject to high magnetic fields or power surges. Such application could lead to unintended operation.
- The solenoid valve can generate surge voltage and electromagnetic waves when the switch is turned OFF, affecting the operations of surrounding equipment. Use solenoids with surge suppression, or take countermeasures in the electrical circuits for surges or electromagnetic waves.
- Do not use the product where ozone may be generated, such as near ocean beaches or other places subject to direct sunlight or mercury lamps. Ozone can cause rubber parts to deteriorate, which can lead to degraded performance and functions, or to equipment stoppages. (Excludes items where measures against ozone have been taken.)
- Do not use any media other than shown on the specifications. Use of non-specified media could lead to functional shutdown after a short period, to sudden performance drops, or to shorter operating life.
- If mounting the solenoid valve inside a control panel, or if energizing it for long periods, provide heat radiation measures to ensure that temperatures surrounding the solenoid valve always remain within the specified temperature range. In addition, if energizing continuously over long periods, rising temperatures due to generation of heat in the coil can lead to a decline in solenoid valve performance and operating life, and have adverse effects on nearby equipment. As a result, when the solenoid valve is continuously energized over long periods of time, or when the solenoid valve is energized for longer periods than it is non-energized on any day, a good suggestion is to keep the solenoid valve in a normally open (NO) specification as one possible method of reducing the amount of time the valve is energized. For details, consult us.
- After wiring operations, always check to ensure that no wiring connection errors exist before turning ON the power.
- Do not collect the exhaust lines for air cylinders, etc. with pilot exhaust lines for solenoid valves into the same piping, etc. Interference in the exhaust could result in erratic operation.
- When using the valve in a manifold, be aware when operating an air cylinder or performing air blowing operations that back pressure could cause erratic operations of the cylinder or erroneous air delivery from the air blow port. Caution is particularly needed when using valves with 3-position exhaust center specification, when operating single acting cylinders, or when operating a cylinder and blowing air using the same manifold. If there are concerns in this area, take such countermeasures as using individual exhaust spacers or back pressure prevention valves.

# / CAUTION

- When mounting the product, leave room for adequate working space around it. Failure to ensure adequate working space will make it more difficult to conduct daily inspections or maintenance, which could eventually lead to system shutdown or damage to the product.
- For mounting or transport of heavy products, use a lift, supporting tool, or several people, to provide firm support, and proceed with due caution to ensure personal safety.
- Do not bring magnetic media, within 1 meter [3.28 ft.] of the product. There is the possibility that the data on the magnetic media will be destroyed due to the magnetism of the magnet.
- If leakage current is flowing in the control circuit, there is a possibility of the product performing an unintended operation. Take measures against current leaking in the control circuit, to ensure that the leakage current value does not exceed the allowed range in the product specifications.
- Do not block the product's breathing holes. Pressure changes occur due to changes in volume during operation. Blocking the breathing holes destroys the pressure balance, and could cause failure of the intentional operation, equipment damage, or personal injury.
- Do not use the solenoid valve in locations subject to large electrical

- currents or magnetic fields. It could result in erratic operation.
- Oily materials from the compressor (excluding the oil-free compressor). can cause drastic deterioration in product performance, and even a functional shutdown. Always install a mist filter before pneumatic equipment to remove the oily component.
- The properties of the lubrication oil can change when used in dry air where dew point temperatures is lower than -20° C [-4° F]. It could result in degraded performance or in functional shutdown.
- Do not use the product in locations that are subjected to direct sunlight (ultraviolet ray), to dust, salt, or iron powder, high temperature, high humidity or in media or ambient atmospheres that include organic solvents, phosphate ester type hydraulic oil, sulfur dioxide, chlorine gas, acids, etc. It could lead to an early shutdown of some functions or a sudden degradation of performance, and result in reduced operating life. For materials used, see Major Parts and Materials.
- Always carefully wash your hands after touching oil or grease used in the valves. If you smoke a cigarette while there is oil or grease remains on your hands, oil or grease transferred to the cigarette could catch fire and emit toxic gases.

# **ATTENTION**

- When considering the possibility of using this product in situations or environments not specifically noted in the Catalog or Instruction Manual, or in applications where safety is an important requirement, such as in an airplane facility, combustion equipment, leisure equipment, safety equipment and other places where human life or assets may be greatly affected, take adequate safety precautions such as application with enough margins for ratings and performance or fail-safe measures. Be sure to consult us with such applications.
- Always check the Catalog and other reference materials for product wiring and plumbing setup.
- Install a muffler, etc. on the exhaust port. It is effective in reducing exhaust noise.
- When handling the product, wear protective gloves, safety glasses, safety shoes, etc. to keep safety.
- When the product can no longer be used or is no longer needed, dispose of it appropriately as industrial waste in accordance with the Waste Disposal and Public Cleaning Law, and other ordinances and regulations imposed by local government authorities. As incineration disposal of oil or grease used in the valves will generate corrosive, toxic hydrofluoric acid (HF), dispose of these compounds in an acid-resistant incinerator with toxic removal facilities. For large volumes, use a registered industrial waste disposer.
- Pneumatic equipment can exhibit degraded performance and function over its operating life. Always conduct daily inspections of the pneumatic equipment, and confirm that all requisite system functions are satisfied, to prevent accidents from happening.
- Air leaks from the valve are not zero. For application of requiring holding pressure (including vacuum) inside the pressure vessel, consider adequate margin of capacity and holding time in design of the system.
- When using a valve for air blowing, use an external pilot specification. With the internal pilot specification, air blowing can cause a pressure drop that could affect valve operations.
- For inquiries about the product, consult your nearest Koganei sales office, or Koganei overseas department. The address and telephone number is shown on the back cover of this catalog.

# **OTHERS**

- Always observe the following items.
  - 1. When using this product in pneumatic systems, always use genuine KOGANEI parts or compatible parts (recommended parts).
    - When conducting maintenance and repairs, always use genuine KOGANEI parts or compatible parts (recommended parts). Always observe the required methods and procedure.
  - 2. Do not attempt inappropriate disassembly or assembly of the product relating to basic configurations, or its performance or functions.

Koganei cannot be responsible if these items are not properly observed.



### **General Precautions**

### Mounting

- 1. While any mounting direction is allowed, be sure to avoid strong shocks or vibrations applied directly to the body.
- 2. Avoid using in the locations and environment listed below, as it could result in malfunction of the valve. If use in such conditions is unavoidable, always provide a cover or other adequate protective measures.
  - Location directly exposed to water drops or oil drops
  - Environment where a valve body is subject to dew condensation
  - Location directly exposed to machining chips, dust, etc
- 3. In piping connection with valves, flush the tube completely (by blowing compressed air) before piping. Intrusion of machining chips or sealing tape, rust, etc., generated during plumbing could result in air leaks and other defective operations.
- 4. Never use the valve with the 4(A) and 2(B) ports vented to the atmosphere.
- 5. When mounting a valve inside a control panel, or when energizing time is long, make adequate consideration for ventilation and other heat dissipation measures.
- 6. When adding or subtracting units in the manifold, or replacing a fitting block, be sure to tighten to within the specified tightening torque range.

### Media

- 1. Use air for the media. For the use of any other media, consult
- 2. Air used for the cylinder should be clean air that contains no deteriorated compressor oil, etc. Install an air filter (filtration of 40 µm or less) near the valve to remove collected liquid or dust. In addition, drain the air filter periodically.
- 3. When supply pressure is low, use piping for the 1(P) port with sufficient tube size.

### Lubrication

Can be used without lubrication due to the factory lubricant (grease). When the pneumatic products require lubrication, use Turbine Oil Class 1 (ISO VG32) or the equivalent. In addition, cutting off oil feed while an operation is in progress could lead to malfunction due to the dissipation of the factory lubricant (grease). As a result, always keep the oil feed running continuously. However, use caution since excessive oil feed can also be a cause of malfunction. Avoid using spindle oil or machine oil.

### Atmosphere

The product cannot be used when the media or ambient atmosphere contains any of the substances listed below. Organic solvents, phosphate ester type hydraulic oil, sulphur dioxide, chlorine gas, or acids, etc.

### Wiring


After wiring, check that there is no error in the wiring connections.

### Piping

Since the 1(P), 3(R2), and 5(R1) ports are on both ends of the manifold, piping direction can be selected depending on the application (in monoblock manifolds).

At shipping, plugs are temporarily screwed in ports at one end, but are not firmly tightened. Regardless of which end piping is connected, always remove the plugs, use sealing tape or apply other sealing agent, and securely tighten the plugs into the unused ports.

- 1. Sealing tape wrapping method
- 1) Before piping, perform air blowing (flushing) or cleaning to eliminate any machining chips, cutting oil, or dust, etc., remaining inside the pipes.
- ②When screwing in piping or fittings, caution should be taken to avoid letting machining chips or sealing materials from entering into the valves. When using sealing tape, wrap it so that 1.5~2 screw threads remain.



### Prevention of erratic operation in the manifold type

When using a manifold-type valve to operate an air cylinder, or to perform air blowing or similar operations, erratic operation due to exhaust interference or malfunction due to insufficient flow rate could occur. When using the manifold type valves, be sure to take the following measures beforehand.


1. Erratic operation due to large exhaust flow rate

Cause: When a large-bore cylinder is operating, or multiple cylinders are operating at the same time, the exhaust air in the collective exhaust can flow backward through the exhaust ports of other solenoid valves. This could lead to an obstruction of the operations of other cylinders and may cause erratic operation in single acting cylinders or an Air Hand module due to inflow of air into them. The erratic operation is caused by insufficient manifold exhaust (large exhaust resistance).

Countermeasure: To reduce the exhaust resistance, for the base monoblock manifold, vent the exhaust ports at both ends. For the split manifold, attach piping blocks to both ends to exhaust from both sides. If still affected even after exhausting from both ends, consider splitting the manifold, or if using a split manifold, either install a port isolator to separate the exhaust, or use a back pressure prevention valve.

2. Malfunctions due to insufficient pressure or flow rate Cause: When operating a large-bore cylinder, operating multiple cylinders at the same time, or using circuits to perform air blowing, etc., sudden consumption of air with the manifold type can result in insufficient flow rate to nearby cylinders, causing a reduction in speed or a shortage of thrust. In addition, in the pilot-type valve, this sudden consumption can lead to a pressure shortage for the pilot signals, and it causes erratic operations in the main stem.

Countermeasure: Because it causes insufficient air delivery to the manifold, supply air from both ends of the manifold, or from the piping block 1(P) port mounted on both sides. For air blowing, consider either dividing the air lines for independent use, or use of an external pilot valve.

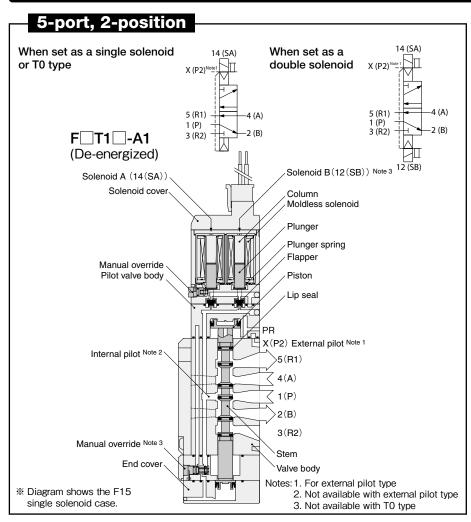



Remark: When using a 5-port valve as a 3-port valve, see p.25.

### **Major Parts and Materials**

Parts		S	Materials	
	Body		Aluminum die-casting	
	Ster	n	Aluminum alloy <sup>Note</sup>	
	Lip seal		0 11 11 1-1	
Valve	Flapper		Synthetic rubber	
vaive	Sub-base	-base	Aluminum alloy (anodized)	
	Plunger		Magnetic stainless steel	
	Column			
	End cover		Plastic	
	Body	Monoblock	Aluminum alloy (anodized)	
Manifold	B	Split type	Plastic	
	Block-off plate		Mild steel (nickel plated)	
	Seal		Synthetic rubber	

Note: Some F10 and F15 Series models use plastic for the stem material.

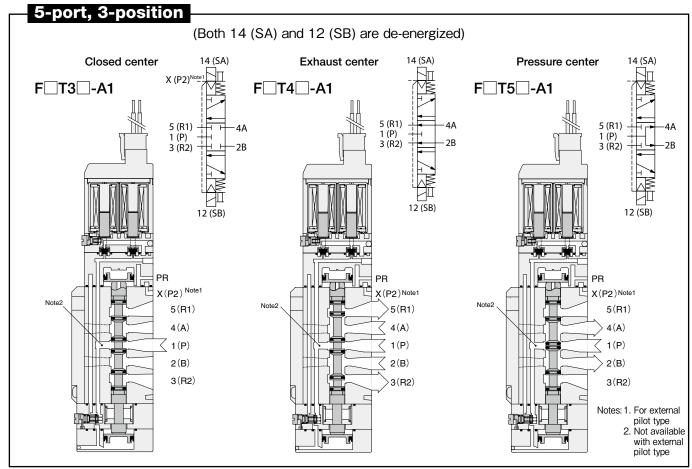

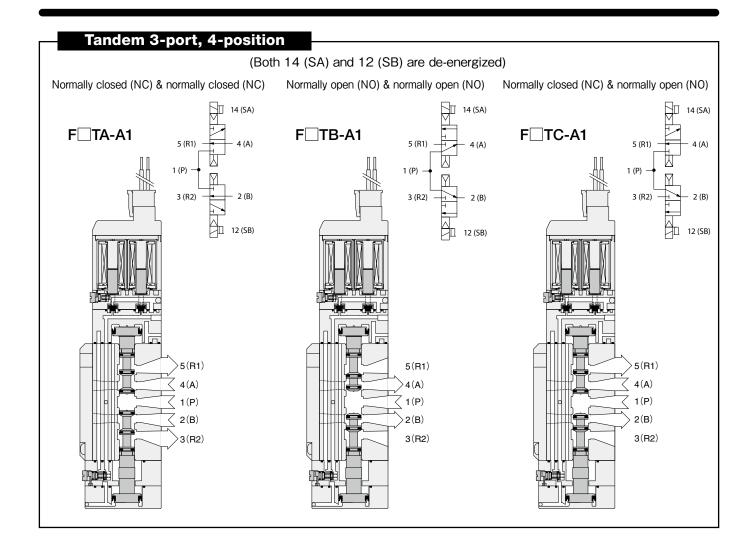



### Solenoid


### Single and double solenoid switching procedure

By switching the manual override, model FT1 (2-position valve) can be used as either a single solenoid valve or a double solenoid valve (switching not possible with a 3-position valve and a tandem 3-port valve). Note that the F□T1 is set to the single solenoid specification

### Switching from a single solenoid valve to a double solenoid valve

1.As shown in Fig.1, insert the flatblade edge of a small screwdriver into the gap between the valve and the cover, and then peel it off and remove the cover.

Caution: As shown in Fig.1, make sure to insert a small screwdriver from the side of the valve cover. The cover claw may be damaged when the cover is removed from the direction of the valve stem. Never remove the cover for any reason other than valve function switching.



Caution: When using it as a double solenoid valve, do not attach the cover that was removed in




Figure 1




Figure 2

solenoid

manual overrride button

Manual override button


clockwise to set as the single

### Switching from a double solenoid valve to a single solenoid valve Push lightly, then turn the

Double solenoid state

As shown in Fig.3, use a small screwdriver, etc. to push lightly against the manual override button, and then turn it by 90 degrees in the clockwise direction, so that the manual override button's slit is in the vertical direction, and then attach the cover.

Caution: The cover has directionality (F15 and F18 series only). When attaching, always align the detent on the back of the cover with the manual override button's slit, as shown in Fig.4.



The manual

Note about the wiring for the above switching

See the "Wiring instructions" to the right.


Single solenoid state

Wiring instructions (When used as a single unit, non-plug-in type manifold)

### 1. Attaching and removing plug connector

Use fingers to insert the connector into the pin, push it in until the lever claw latches onto the protruded section of the connector housing, and complete the connection.

To remove the connector, squeeze the lever along with the connector, lift the lever claw up from the protruded section of the housing, and pull it out.



Cautions: 1. When removing the connector, confirm that the lever claw is positively disengaged from the protruded section before pulling out. The housing may be damaged if it is pulled out while engaged with the protruded section.

2.The plug connector lead wires for model F 

T1 (2-position valve) are set to the single solenoid specification at shipping (for plug connector types).

When switching from a single solenoid to a double solenoid specification for use, disconnect the plug connector from the valve, check the hook directions on the lead wire (white) with the contacts, and then insert the lead wire into the plug connector's B side □ hole (see the illustration above). Use the same procedure to switch the manifold type single solenoid to a double solenoid specification.

3. When using the plug-in type manifold, caution should be exercised that even if the valve has been switched to a double solenoid, no power will be supplied to the B side solenoid unless the valve base wiring is set to the double wiring.


### 2. Attaching and removing plug connector and contact

### Attaching

Insert the contact with a lead wire into a plug connector  $\square$  hole until the contact hook latches on the connector and is secured to the plug connector. Confirm that the lead wire cannot be easily pulled out (see the diagram below).


### Removing

To remove it, insert a tool with a fine tip (such as a small screwdriver) into the rectangular hole on the side of the plug connector to push down on the hook, and then pull out the lead wire. When re-using the contacts, restore the hook back so that they spread outward.




### Common terminal and short bar

A short bar is attached to the plug connector to ensure that the solenoid A and B wiring are positive common. Do not remove the short bar.



### 4. Crimping of lead wire and contact

To crimp lead wires into contacts, strip off 4 mm [0.16 in.] of the insulation from the end of the lead wire, insert it into the contact, and crimp it. Be sure to avoid catching the insulation on the exposed wire crimping section.



Cautions: 1. Do not pull hard on the lead wire.

2. For crimping of lead wire and contact, always use a dedicated tool.


Contact: Model 706312-2MK Manufactured by Sumiko Tech, Inc. Crimping tool: Model F1 (for 706312-2MK) Manufactured by Sumiko Tech. Inc.

### 5. Common connector assembly

Using a common connector assembly for solenoid valves for a manifold provides common wiring for all the solenoid valves and greatly reduces wiring work.

The common connector assembly types are determined by looking at them from the lead wire side; the right end one is A type, the left end one is C type, and all the others are B type (see the illustration below).


### For positive common

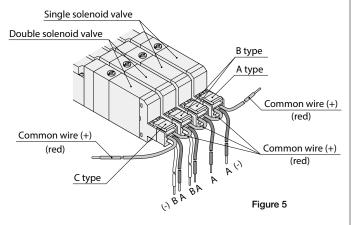

### For negative common


You can order the separately sold common connector assembly for use with negative common specification.


Note: Cannot be used with the conventional series (black coil).

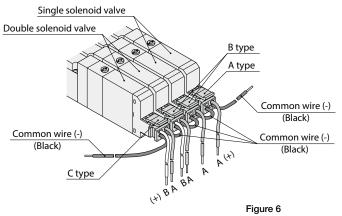

If ordering the common connector assembly, order from the common connector assemblies listed below.

### For positive common

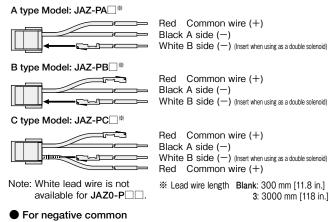

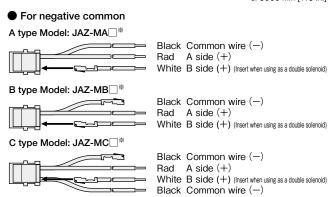

Single negative common plug connector unit

Model: JAZ-CM


 Lead wire length Blank: 300 mm [11.8 in.] 3: 3000 mm [118 in.]

### 6. Color identification for the positive common, negative common, single wiring, and double wiring on the easy assembly type manifold plug-in type

Color identification of specifications listed below is possible via a small window on the solenoid side of the valve base.


Blue: Positive common single wiring Green: Positive common double wiring Pink: Negative common single wiring Gray: Negative common double wiring

### 7. Cabtyre cable



Caution: Exercise caution that this is not dust-proof and drip-proof specification.

### Internal circuit

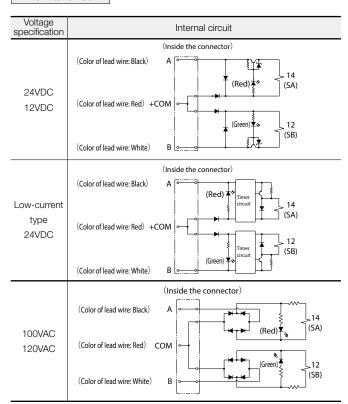


- Cautions: 1. Do not apply megger between the pins.
  - 2. Leakage current inside the circuit could result in failure of the solenoid valve to return, or in other erratic operation. Always use at less than the allowable leakage current shown in the solenoid specifications on p.56, 142, and 228, If circuit conditions etc. cause the leakage current to exceed the allowable leakage current, consult us.
  - 3. For the double solenoid specification, avoid energizing both solenoids at the same time (except for tandem 3-port valve).
  - 4. For the housing color, standard type is blue and low-current type is light blue.
  - 5. The low-current type will not operate if the power voltage is gradually increasing. Always apply a suitable voltage.
  - 6. For the T0 type, there is one solenoid.
  - The AC 100 V type has a full wave rectifier circuit. When SSR is used for solenoid valve control, pay adequate attention to SSR selection, as return problems may occur.

### Operating principles for the low-current type


The low-current type uses a timer circuit, as shown on the previous page, that achieves power consumption savings by switching to a holding operations mode after a certain period of time to operate at about 1/4 of the starting power consumption.

### Power waveform



### PC board manifold

When connecting a power line to the power supply terminal on the PC board manifold, care should be taken in regard to the following points when connecting.



Terminal screw tightening torque: 0.4 N·m [3.5 in·lbf]

Stripped wire length: 7 mm [0.28 in.]

Connecting wire size: 0.13~2.5 mm<sup>2</sup> [0.00020~0.00388 in.<sup>2</sup>]

AWG: No.26...14

When planning to use crimp-style terminals, use bar terminals. Recommended crimp-style terminals (bar terminals):

Manufactured by Nichifu, Inc.

Model BT1.25-9-1 (for 0.25~1.65 mm<sup>2</sup> [0.00039~0.00256 in.<sup>2</sup>])

### Wiring of the terminal block



Care should be taken with the terminal screw tightening torque. Overtightening beyond the tightening torque could result in breakage.

Terminal screw tightening torque: Max. 49.0 N·cm [4.3 in·lbf].

### Precautions for use of the double solenoid

When using models  $F \Box T1$  or  $F \Box T2$  (2-position valve) as double solenoid valves, caution should be exercised as energizing the A side solenoid or pushing the manual override button on the A side, while pushing the B side manual override button or in a locked state, or energizing the solenoid on the B side, will cause the valve to switch over the valve position. (At that time, the valve will operate in the same state as the single solenoid valve.)



### Manual override

### Manual override button (locking and non-locking dual use type)

To lock the manual override, use a small screwdriver to push down the manual override button all the way down and turn it clockwise 90 degrees. To release the manual override, turn the button 90 degrees counterclockwise, which will release the manual override lock by spring action and return it to its normal position. To operate the unit in the same way as the non-locking type, leave the manual override button unturned.

Cautions: 1. The F series valves are pilot type solenoid valves. As a result, the manual override cannot switch the main valve without air supplied from the 1(P) port (X(P2) port for external pilot type).


- 2. Always release the lock of the manual overrides before commencing normal operation. Caution should be exercised to release the lock of the manual override on the B side that also works as the switching button between the single solenoid and double solenoid (excluding the 3-position valve and tandem 3-port valve). For details, see "Switching from a double solenoid valve to a single solenoid valve" on p.22
- 3. Do not attempt to operate the manual override button with a pin or other object having an extremely fine tip. It could damage the manual override button.
- 4. Take care to avoid excessive turning of the manual override button, it could damage the override.
- 5. When operating the solenoid valve's manual override button for maintenance etc. always confirm that the solenoid valve's override button has been restored to its normal position, and that the main valve is in the required switching position before restarting operations.

### Manual override lever (locking and non-locking dual use type)

To lock the manual override lever, use fingers to push the lever all the way down and turn it clockwise 90 degrees. To release the manual override, turn the lever 90 degrees counterclockwise, which will release the manual override lock by spring action and return it to its normal position. To operate the unit in the same way as the non-locking type, leave the lever unturned.

Caution: Model F□T1 (2-position valve) has a manual override lever on the A side, and a manual override button with cover on the B side. Model F T2 has a manual override lever on the A side only, and a manual override button on the B side.


The 3-position valve has manual override lever on both the A and B sides.



※ Illustration shows the F10 series.

### Locking protruding type -83

Use a small screwdriver or the fingers to press down and rotate the manual override button by at least 45 degrees, to lock in place. Either rotation direction is acceptable. In the locked position, rotate further the manual override which will release the manual override lock by spring action and return it to its normal position. If the manual override is not rotated, the unit can be operated in the same way as the non-locking type.







**DIN** connector

### Wiring instructions

Remove the cover mounting screws, and lift the terminal cover off from the solenoid. Use a screwdriver, etc., to push strongly against the terminal body through the hole of the terminal cover's mounting screw, and remove the terminal body.

Slip a cable ground, washer, and cable gasket over a cable, insert the cable into the terminal cover's wiring port, and connect the lead wire to the terminal body (screwdriver blade width of about 3 mm [0.12 in]).

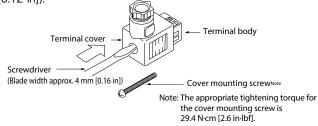

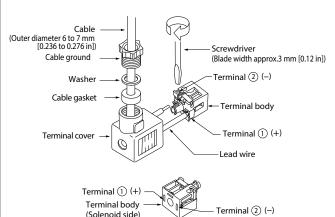

\*For the DC24V solenoid with surge suppression, connect (+) to terminal ①, and (-) to terminal ②.




### 3-port valves

While the F series is a 5-port valve (excluding tandem 3-port valve), it can be used as a normally closed (NC) or normally open (NO) 3-port valve by plugging one of either outlet port 4(A) or 2(B). In this case, leave the exhaust ports 3(R2) and 5(R1) open for use. It can also be used as a double solenoid type 3-port valve.

### When using a single use fitting block or female thread block for 3-port

In the F10 and F15 series, a single use fitting block and female thread block for 3-port with one plugged port can be selected at the time of order. (Note: Not available for F18 series.)

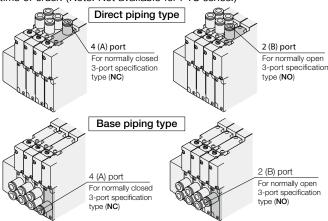

Fitting type	- ** A	- ** B
Switching type	Normally closed (NC)	Normally open (NO)
For single solenoid setting	14(SA) 5(R1) 1(P) 3(R2)	14(SA) 5(R1) 1(P) 3(R2) 2(B)
For double solenoid setting	14(SA) 14(SA) 11(P) 1(P) 12(SB)	14(SA) 5(R1) 1(P) 2(B) 12(SB)

### When using a plug

The F10, F15, and F18 series can be used as either a normally closed (NC) or normally open (NO) 3-port valve by plugging either outlet port of 4(A) or 2(B).


	01 +(//) 01 Z(B).	
Plug position	When the 2(B) port is plugged	When the 4(A) port is plugged
Switching type	Normally closed (NC)	Normally open (NO)
For single solenoid setting	14(SA)  5(R1) 1(P) 3(R2)  12(B) (Plug)	14(SA)  5(R1)  1(P)  3(R2)  2(B)
For double solenoid setting	14(SA)  5(R1)  1(P)  3(R2)  12(B) (Plug)	14(SA)  5(R1) 1(P) 3(R2) 12(SB)



### Manifold

### Attaching and removing valves

To remove the valve body from the sub-base or manifold, loosen the valve mounting screws (2 places), and lift it up in the direction of the arrow (see the illustration at right). To install it, reverse the above procedure. The recommended tightening torques for the valve mounting screws are as shown below.



※ Illustration shows the F10 series (split manifold).

N·cm [in·lbf]

Series	Recommended tightening torque
F10	17.6 [1.6]
F15	49.0 [4.3]
F18	49.0 [4.3]


### Precautions for using manifold

Observe the following precautions when using the split type, split type serial transmission type, easy assembly type and easy assembly type serial transmission type (except for the monoblock manifold and PC board manifold).

- When using the direct piping type manifold Avoid using valves at an operating frequency exceeding 2 Hz, as such use can result in heat-related breakdowns.
- When using the base piping type manifold When plugs have been attached on the 4(A) and/or 2(B) ports, avoid using valves at an operating frequency exceeding 2 Hz, as such use can result in heat-related breakdowns.

### Stop valve usage procedure (F10, F15 series)

Mount a stop valve on a manifold to stop the air supply to valves on the individual station. For the operation procedure, use a small screwdriver or the hand to press down and rotate the stop valve manual knob clockwise 90 degrees to lock in place, shutting off the air supply. In the locked position, rotate the stop valve manual knob counterclockwise 90 degrees, and air pressure returns the stop valve manual knob to its original position, releasing the lock. Note that use of the stop valve reduces the flow rate volume by about 30%.



Stop valve manual knob is locked, and air supply shut off.


Cautions: 1. Do not disassemble the stop valve

- When using a stop valve to remove the valve, be careful of residual pressure in the affected station.
- 3. When using a stop valve to remove the valve, be aware that exhaust from other stations can be exhausted through the stop valve's exhaust hole. If this will cause a problem during use, when ordering the manifold, select the back pressure prevention valve (-E1).
- 4. To use a stop valve in combination with a back pressure prevention valve, select the combination when ordering the manifold. The back pressure prevention valve (F1 


  Z-E1) in additional parts cannot be installed after purchase.
- Do not release the locked stop valve manual knob when valves have been removed by using the stop valve.

### Port isolator


In the split manifold and the easy assembly type, installing port isolators to the 1(P), 3(R2) and 5(R1) ports between each station isolates the air path between stations equipped with port isolators and stations with smaller station numbers. However, a piping block must be placed on both ends.

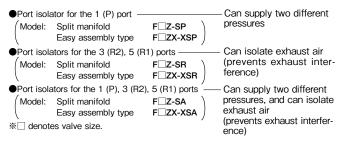


Split manifold (F10, F15 series)

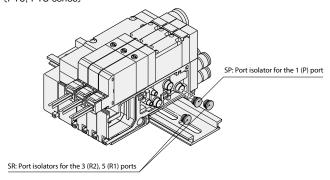

Split manifold (F18 series)

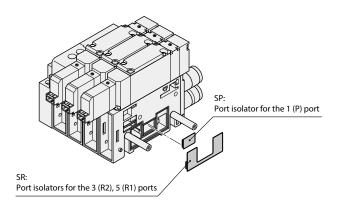

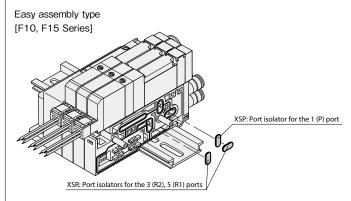

Caution: Installing port isolators requires the disassembly and re-assembly of manifolds. See the disassembly illustration, unit adding procedure, and cautions on p.30-37.

However, since the F18 series serial transmission compatible manifold cannot be disassembled, port isolators cannot be installed on it after purchase.

### Precautions for the use of individual air supply and exhaust spacers

By mounting an individual air supply or exhaust spacer on the manifold, the air supply or exhaust can be operated individually on the unit. It is also effective in preventing erratic operation due to back pressure. Caution should be exercised when spacers are used, as the effective area is reduced by about 30%. If mounting additional spacers to an existing unit, observe the following items:

### Spacer mounting procedure (F10 split manifold, F10 and F15 easy assembly type)

- Loosen the valve mounting screws where the individual air supply or exhaust spacer will be installed, and remove the valve.
- ② Install the gaskets and exhaust valve provided with the individual air supply or exhaust spacer, and use the mounting screws provided to secure the valve on the manifold (see Fig. 7).

Remark: When attaching fittings to the F10 spacer, use the recommended fittings shown below:

TSH4-M5M, TSH4-M5, TSH6-M5M, TS4-M50, TS4-M5M


### Spacer mounting procedure (F15 and F18 split manifold)

- ① Loosen the valve mounting screws where the individual air supply or exhaust spacer will be installed, and remove the valve.
- ② Open the cover of the manifold, and pull out the plug-in connector in the near side direction (for the plug-in type) (see Fig. 8).
- ③ Insert the plug-in connector firmly into the connector attaching section of the individual air supply or exhaust spacer, and then close the cover, while watching to ensure that the lead wires are not caught by the cover (for the plug-in type) (see Fig. 9).
- 4 Attach the gasket and exhaust valve provided with the individual air supply or exhaust spacer, and use the mounting screws provided to mount the valve on the manifold.

Cautions: Locations where the spacers are mounted make the valve height higher by the height of the spacer (see the dimensions below).

### Muffler for the individual exhaust spacer

A muffler for the individual exhaust spacer is available. For dimensions, see p.129, 225, and 263.



● Dimensions Unit: mm [in.]


F10Z-N (For F10 series) Mass 7 g [0.25 oz.]
F10ZX-XN (For F10 easy assembly type)

58.5[2.303]


Valve side


Manifold side

F15Z-N□□ (For F15 series) Mass 26 g [0.92 oz.] F15ZX-XN□□ (For F15 easy assembly type)




**F18Z-N**□□ (For F18 series) Mass 41 g [1.45 oz.]




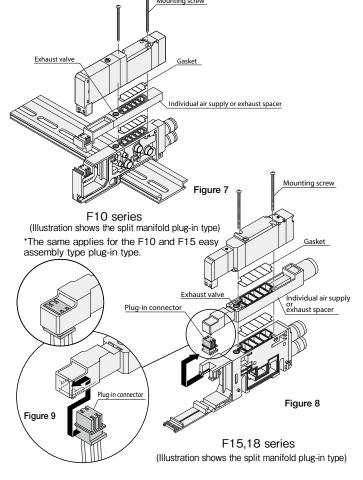


F10Z-P (For F10 series) Mass 9 g [0.32 oz.] F10ZX-XP (For F10 easy assembly type)




**F15Z-P**□□ (For F15 series) Mass 29 g [1.02 oz.]



F15ZX-XP (For F15 easy assembly type) Mass 32 g [1.129 oz.]



**F18Z-P** (For F18 series) Mass 44 g [1.55 oz.]




### Precautions for use of the back pressure prevention valve (F10, F15 series)


A back pressure prevention valve can be mounted on the manifold to prevent erratic operation of the cylinder due to exhaust from other valves. It is particularly effective when using a single acting cylinder or when using an exhaust center valve. Note that when a back pressure prevention valve is used, the OUT-EXH flow rate volume is reduced by as much as 30%. In addition, since the back pressure prevention valve allows back pressure leaks, be careful to avoid letting the manifold exhaust port throttle the exhaust air. When mounting the back pressure prevention valve on an existing system, observe the following points.

① Loosen the valve screws mounting the back pressure prevention valve, and remove the valve.

2) For a monoblock manifold, temporarily remove the gasket between

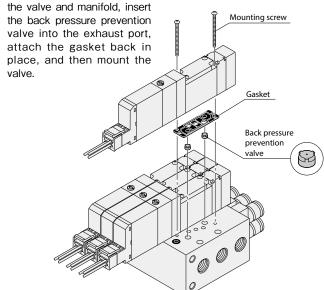

For a split type manifold, insert the back pressure prevention valve into the exhaust port, attach the dedicated gasket and plate provided, and then mount the valve.

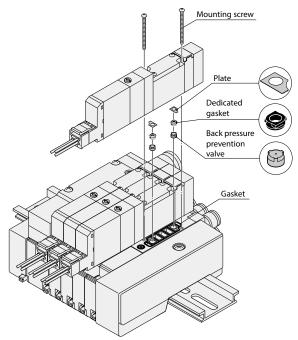


Mounting screw tightening torque: F10 series 17.6 N  $\cdot$  cm [1.6 in·lbf] F15 series 49.0 N  $\cdot$  cm [4.3 in·lbf]

### Changing the connector bracket direction (F10, F15 series)

### Split manifold

Remove the wiring block mounting screws, position the connector bracket as shown in the illustration, and rotate the connector 90 degrees so that it faces outward. The connector can be changed to either the top surface (vertical) wiring or side surface (horizontal) wiring positions.




Mounting screw tightening torque: 49 N·cm [4.3 in·lbf]

### Easy assembly type

The direction can be changed by grasping the knobs on both ends of the connector and unlocking it (Illustration shows the flat cable type. The same applies for the D-sub connector.).

<Procedure> ① Grasp the knobs. ② Turn the connector in the direction of the arrow. ③ Confirm that the knobs have returned to their original position.



### Securing the manifold in place

### Split manifold

When securing a DIN rail mounting type manifold to the installation surface, use the number of screws table below as a guide, depending on the installation direction and with or without vibration, to secure the DIN rail in place using screws. If not secured in place, be aware that there is a possibility of air leaks or other problems occurring.

Mounting condition	Number of screws			
Horizontal mounting		2 screv	ws or more	
Vertical mounting or	2 to 5 units	6 to 10 units	11 to 15 units	16 to 20 units
vibration area	2 screws or more	3 screws or more	4 screws or more	5 screws or more

### Easy assembly type

When securing a DIN rail mounting type manifold to the installation surface, use the number of screws table below as a guide, depending on the installation direction and with or without vibration, to secure the DIN rail in place using screws. If not secured in place, be aware that there is a possibility of air leaks or other problems occurring.

Take care when using the easy assembly type in a location subject to vibrations, as the load on the DIN fitting will be high. Or, use the direct mounting type.

Direct mounting screw tightening torque: 74 N·cm [6.5 in·lbf]



### Fittina

Piping

### <Valve base>

### 1. Procedure for switching between the base piping type and the direct piping type

Base piping and direct piping can be switched by replacing the plate with a fitting block or a female thread block (see Fig. 10).




Figure 10

\* Illustration shows the F10 series.

Cautions: 1. Firmly tighten the screws after completing a re-combination. Recommended tightening torques are shown below.


- 2. Perform piping carefully in regards to the locations of each connection port (see Figs. 11, 12).
- 3. Care should be taken not to lose the gaskets while changing

N·cm [in·lbf]

Series	Recommended tightening torque
F10	17.6 [1.6]
F15	49.0 [4.3]
F18	49.0 [4.3]

### <Piping block>

 Direct piping type For F10, F15 series



※ Diagram shows the F10 series.




Figure 11 Note: Caution should be exercised that the positions of the 1(P) and 3. 5(R) ports are reversed from their posi tions in the F10 and F15 series

### Base piping type Port locations for F10, F15, F18 series are as shown in Fig. 12.




Figure	1:
iagram shows the E10 series	

Diagram shows the F10 series

Series	Recommended tightening torque N · cm [in · lbf]		
Selles	Split manifold	Easy assembly type	
F10	58.8 [5.2]	49.0 [4.3]	
F15	58.8 [5.2]	58.8 [5.2]	
F18	58.8 [5.2]	-	

### 2. Attaching fittings to female thread blocks

When attaching fittings to female thread blocks, secure with the tightening torques shown below or less.

Screw size	Tightening torque N·cm [in·lbf]
Rc 1/8, NPT1/8	686 [60.7]
Rc 1/4, NPT1/4	882 [78.1]

<sup>\*</sup> For M5 and -10-32UNF, tighten at the recommended torques for the fittings used

### 3. Attaching fittings to piping blocks (F18Z(G)-PM(P))

To attach fittings to the female thread type piping block of the F18 series, remove the piping block portion (the triangular-shaped block portion), screw the fittings into the 1(P) and 3, 5(R) ports while holding the piping block by applying a wrench to its metal portion. The tightening torque for the mounting (two M3 screws) of the piping block after the fittings have been attached should be 58.8 N·cm [5.2 in·lbf].

### Dual use fittings (With dual use fitting blocks)

The F series dual use fitting blocks employ dual use fittings for different tube sizes, which can connect tubes of 2 different outer diameters.

### Attaching and removing tubes

When connecting tubes, insert an appropriate size tube until it contacts the tube stopper, and then lightly pull it to check the connection. For tube removal, push the tube against the tube stopper, then for large tube sizes, push on the release ring and at the same time pull the tube out. For small tube sizes, push on the outer ring by pressing the release ring and simultaneously pull the tube out (see Fig. 13).




Figure 13


### Usable tubes

Either a nylon or urethane tube can be used.

Use tubes with an outer diameter tolerance within  $\pm$  0.1 mm [0.004 in.] of the nominal diameter, and ensure the ovalness (difference between the large diameter and small diameter) is 0.2 mm [0.008 in.] or less. (Using a Koganei tube is recommended.)

- Cautions: 1. Do not use extra-soft tubes since their pull-out strength is significantly reduced.
  - 2. Only use tubes without scratches on their outer surfaces. If a scratch occurs during repeated use, cut off the scratched
  - 3. Do not bend the tube excessively near the fittings. The minimum bending radii for nylon tubes are shown in the table below.
  - 4. When attaching or removing tubes, always stop the air supply. In addition, always confirm that air has been completely exhausted from the manifold.

	[]
Tube size	Minimum bending radius
φ 4	20 [0.8]
φ6	30 [1.2]
φ8	50 [2.0]
φ 10	80 [3.1]

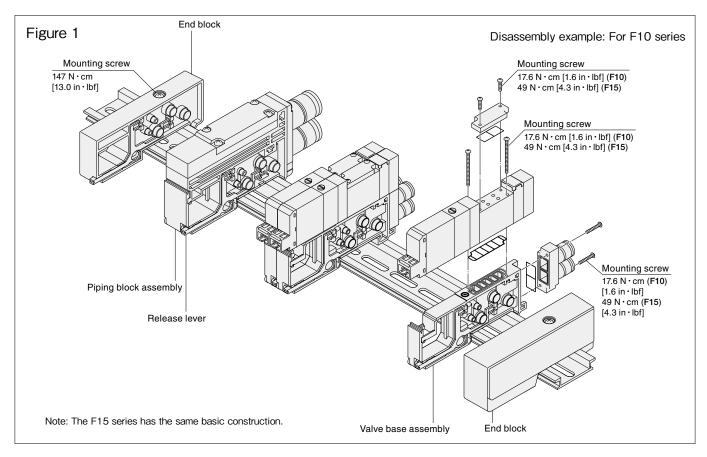

### Manifold Unit Adding Procedure (F10 and F15 Series Non-Plug-in Type)

### Adding a valve base unit


Use the valve base assembly for adding valve base units.


- ① Loosen the mounting screw on the end block until it can slide (see Fig. 1).
  - Note: For the F15 series, loosen the mounting screws on both the left and right end blocks (2 screws each).
- ② Press the release lever on the valve base assembly where the new unit is to be added, and disconnect the link between the bases.
- ③ Mount the valve base assembly to be added on the DIN rail as shown in Fig. 2.
- ④ Return the release lever of the valve base assembly disassembled in step ② to its normal position, as shown in Fig. 3. In addition, set the release lever for the valve assembly being added to the same position, then press the bases together until they connect and click into place.
- ⑤ Press the bases together from both sides to ensure that there is no gap between them, and then tighten the end block mounting screws, and install the units in place on the DIN rail (see Fig. 5). Tightening torque: 147 N·cm [13.0 in·lbf]
  - Notes:1. Always follow the steps shown in Fig.4 when tightening the end block mounting screws for the F15 series.
    - 2. Confirm that the DIN rail mounting hooks secure the DIN rail (see Fig. 5).

### (Caution)

- Always cut off the power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are connected, the end block mounting screws are tightened, etc. Supplying air when either of the end blocks is not secured to the DIN rail could result in air leaks or in separation of manifold bases.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).

Adding units to the piping block assembly should be performed in the same way as adding units of the valve base assembly.

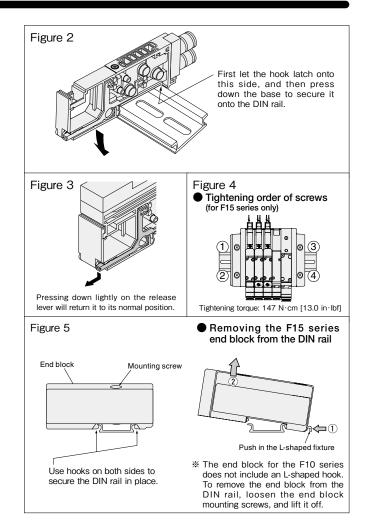

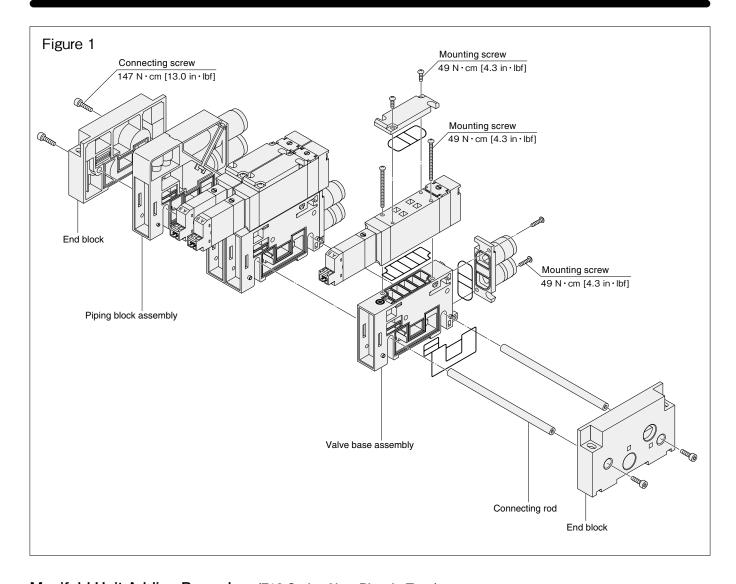

### Manifold Unit Adding Procedure (F18 Series Non-Plug-in Type)

### Adding a valve base unit


Use the valve base assembly and unit-adding connecting rod to add valve base units.

- ① Remove the connecting screws on the end block and separate the end block from the manifold (see Fig. 1).
- 2 Install the connecting rods to be added, open up the spaces where the units are being added, position the gaskets onto the valve base assemblies being added, and fit the units on the connecting rods from above. At this time, securely mount the units so that no gap is left between the added valve base assemblies and the upper surface of the connecting rods.
- 3 Install gaskets onto the end blocks removed in step 1, and retighten the connecting screws. At this time, use a hexagon bar wrench to hold the connecting screws on the opposite side in place so as to prevent the screws from slipping while securing them into place. Tightening torque: 147 N·cm [13.0 in·lbf]

### (Caution)

- Always cut off power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are securely connected, the end block connecting screws on both sides are tightened, etc. Supplying air when either of the end blocks is not secured to the DIN rail could result in air leaks or in separation of manifold bases.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).

Adding units to the piping block assembly should be performed in the same way as adding units to the valve base assembly.

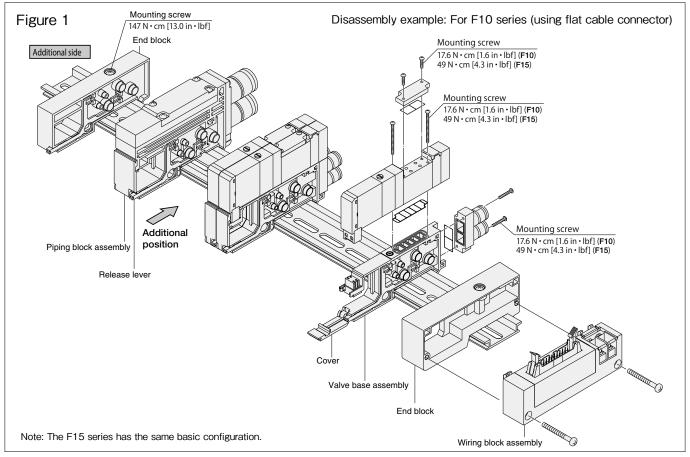

### Manifold Unit Adding Procedure (F10 and F15 Series Plug-in Type)


### Adding a valve base unit

Use the valve base assembly for adding valve base units.

1) Loosen the mounting screw on the end block until it can slide (see Fig. 1).

Note: For the F15 series, loosen the mounting screws on both the left and right end blocks (2 screws each).

- 2 Add units on the additional side (with the solenoid on top and its right) shown in Fig. 1. To split up at additional unit locations, push the piping base assembly's release lever, and release the connections between the bases.
- 3 Mount the valve base assembly to be added on the DIN rail as shown in Fig. 2.
- 4 Return the release lever of the piping block assembly disassembled in step ② to its normal position, as shown in Fig. 3. Set the release levers on the additional valve bases in the same position, and press all the bases together until they click into place, while watching to ensure that the lead wires are not caught by the cover.
- 5 Press the bases together from both sides to ensure that there is no gap between them, and then tighten the end block mounting screws, and install the units in place on the DIN rail (see Fig. 5). Tightening torque: 147 N·cm [13.0 in·lbf]
  - Notes: 1. Always follow the steps shown in Fig. 4 when tightening the end block mounting screws for the F15 series.
    - 2. Confirm that the DIN rail mounting hooks secure the DIN rail (see Fig. 5).

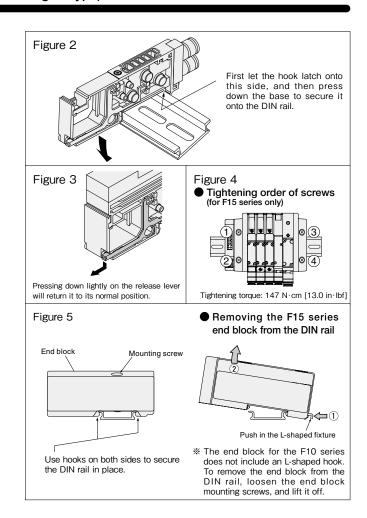

### Wiring Procedure

- ① Use a flatblade screwdriver to open all of the covers (see Fig. 1). Loosen the mounting screws of the valve next to the valve base to be added, remove the valve, and remove the plug-in connector (see Fig. 6).
- 2 The end terminal lead wire (short red wire) is inserted into the pin insert section (No.3) of the plug-in connector that was removed in step 1 (see Fig. 7).

(When shipping, end terminal lead wire is inserted into the plug-in connector of the end unit valve.) Remove this end terminal lead wire, and insert it into the insert section (No.3) of the plug-in connector for the valve base assembly to be added. Next, insert the common wire (red) of this plug-in connector into the insert section (No.3) of the removed plug-in connector.

Note: When inserting the lead wire, confirm that the short bar of the plugin connector's common wire insert section has been attached.

- 3 Install each of the wired plug-in connectors in step 2 to the valve base, and mount the valve.
- 4 Remove the wiring block mounting screws and place the connector bracket in the position shown in Fig. 8, then connect the lead wire (white) of the added valve base after confirming the pin locations. (For details, see the "Detailed diagram of wiring block internal connections" on p.34, 35)
- 5 Return the connector bracket to its original position, tighten the wiring block mounting screws in place, and then install the cover while exercising caution that the lead wires are not trapped by the

### (Caution)

- Always cut off the power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- When removing lead wires from the plug-in connector, use a tool with a fine tip (such as a small screwdriver) to press lightly on the contact hook from a hole on the side of the plug-in connector, and pull out the lead wire. When re-inserting the lead wire to the connector, spread the contact hooks so that they face outward, and then insert the lead wire into the plug-in connector. At this time, pull the lead wire lightly to confirm that it is securely inserted.
- Always connect the end terminal lead wires (see Fig. 7).
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are connected, the end block mounting screws are tightened, etc. Supplying air when either of the end blocks is not securing the DIN rail could result in air leaks or in separation of manifold bases.
- Caution should be exercised as the number of valve units that can be added is limited in the manifold, by the wiring specifications and wiring connection types, etc. For details, see the "Table for maximum number of valve units by wiring specification," on p.66.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).

Adding units to the piping block assembly should be performed in the same way as adding units to the valve base assembly. In addition, when the wiring block and piping block are mounted sideby-side, always mount the wiring block on the outside of the piping block, for structural reasons.

49.0 [4.3]

Valve tightening to	orque N·cm [in·lbf]
Series	Torque
F10	17.6 [1.6]

F15



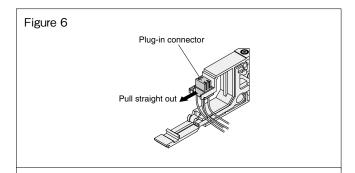


Figure 7 Newly added plug-in connector End terminal lead wire (Red) Plug-in connector Common wire (Red) Common vire (Red) Lead wire (White)\*\*2 End terminal lead wire (Red (Short, red wire) Change insert location of the end Lead wire (White) terminal lead wire

\* 1: Always insert end terminal lead wire. \* 2: Shows when both A and B are used.

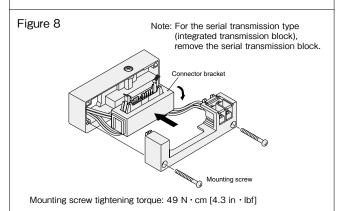

See "F10, F15 Series Detailed Diagram of Wiring Block Internal Connections" on p.38, 39.

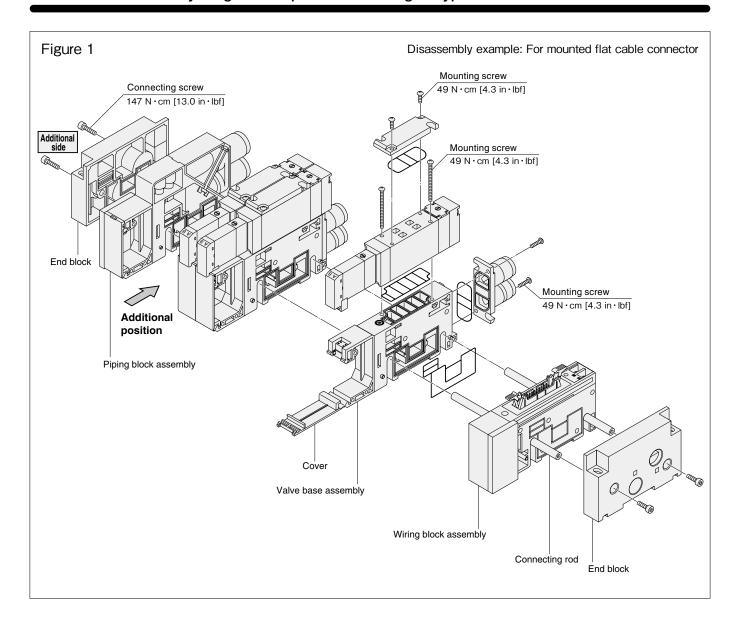

### Manifold Unit Adding Procedure (F18 Series Plug-in Type)

### Adding a valve base unit

Use the valve base assembly for adding valve base units.

- 1) Remove the connecting screws on the additional side end block and separate the end block from the manifold (see Fig. 1).
- 2 Install the connecting rods to be added, open up spaces where the units are being added, position the gaskets onto the valve base assemblies being added, and fit the units on the connecting rods from above. At this time, securely mount the units so that no gap is left between the added valve base assemblies and the upper surface of the connecting rods.
- $\ensuremath{\mathfrak{J}}$  Install gaskets onto the end blocks removed in step  $\ensuremath{\mathfrak{I}}$ , and retighten the connecting screws. At this time, use a hexagon bar wrench to hold the connecting screws on the opposite side in place so as to prevent the screws from slipping while securing them into place. Tightening torque: 147 N·cm [13.0 in·lbf]

### Wiring Procedure

- ① Use a flatblade screwdriver to open all of the covers (see Fig. 1). Loosen the mounting screws of the valve next to the valve base to be added, remove the valve, and remove the plug-in connector (see Fig. 2).
- 2) The end terminal lead wire (short red wire) is inserted into the pin insert section (No.3) of the removed plug-in connector that was removed in step ① (see Fig. 3).
  - (When shipping, end terminal lead wire is inserted into the plug-in connector of the end unit valve.) Remove this end terminal lead wire, and insert it into the insert section (No.3) of the plug-in connector for the valve base assembly to be added. Next, insert the common wire (red) of this plug-in connector into the insert section (No.3) of the removed plug-in connector.
  - Note: When inserting the lead wire, confirm that the short bar of the plugin connector's common wire insert section has been attached.
- 3 Install each of the wired plug-in connectors in step 2 to the valve base, and mount the valve.
- 4 Remove the wiring block mounting screws and place the connector bracket in the position shown in Fig. 4, then connect the lead wire (white) of the added valve base after confirming the pin locations (For details, see the "Detailed diagram of wiring block internal connections" on p.36, 37).
- 5 Return the connector bracket to its original position, tighten the wiring block mounting screws in place, and then install the cover while exercising caution that the lead wires are not trapped by the cover.

### [Caution]

- Always cut off the power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- When removing lead wires from the plug-in connector, use a tool with a fine tip (such as a small screwdriver) to press lightly on the contact hook from a hole on the side of the plug-in connector, and pull out the lead wire. When re-inserting the lead wire to the connector, spread the contact hooks so that they face outward, and then insert the lead wire into the plug-in connector. At this time, pull the lead wire lightly to confirm that it is securely inserted.
- Always connect the end terminal lead wire (see Fig. 3).
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are connected, the end block connecting screws on both sides are tightened, etc.
- Supplying air when either of the end blocks is not securing the DIN rail could result in air leaks or in separation of manifold bases.
- Caution should be exercised as the number of valve units that can be added is limited in the manifold, by the wiring specifications and wiring connection types, etc. For details, see the "Table for maximum number of valve units by wiring specification," on p.84.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).

Adding units to the piping block assembly should be performed in the same way as adding units to the valve base assembly. In addition, when the wiring block and piping block are mounted sideby-side, always mount the wiring block on the outside of the piping block, for structural reasons.

Valve tightening to	orque N·cm [in·lbf]
Series	torque
F18	49 0 [4 3]



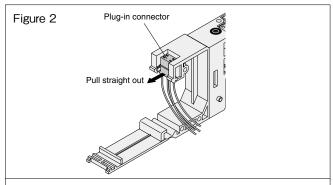


Figure 3

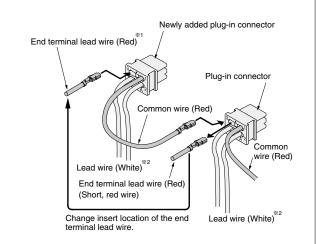


- \* 1: Always insert end terminal lead wire.
- \* 2: Shows when both A and B are used.

Figure 4



See "F18 Series Detailed Diagram of Wiring Block Internal Connections" on p.40.

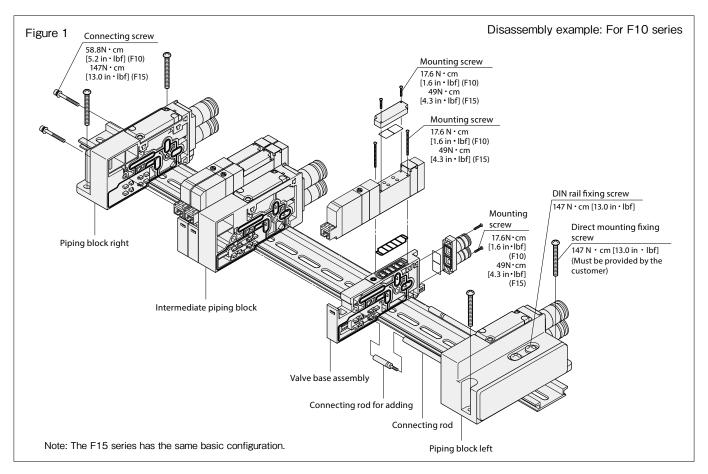

## Manifold Unit Adding Procedure (F10 and F15 Series Easy Assembly Type)

- Adding a valve base unit (use the same procedure for adding an intermediate piping block) <When using a DIN rail>
- ① Loosen the DIN rail fixing screws (4 locations) on both sides of the piping block in advance, to a degree which enables the manifold to slide on the DIN rail. (see Fig.1)
- 2 Loosen the connecting screws (two locations) on the right side of the piping block. (see Fig.2)
- 3 Divide the manifold in the location where the valve base unit will be added, and remove it from the connecting rod.
- ④ Install the connecting rod included with the valve base assembly to add to the connecting rod of the manifold.
- (5) Install the valve base assembly to add in the required location through the connecting rod, and enclose the valve base assembly on both sides.
- ⑥ Tighten the connecting screws (two locations) on the right side of the piping block. Tightening torque: F10 58.8 N·cm [5.2 in·lbf] F15 147 N·cm [13.0 in·lbf]
- ① Confirm that the hook of the DIN rail mounting bracket is securely caught, and tighten the DIN rail fixing screws (4 locations). (see Fig.4) Tightening torque: 147 N · cm [13.0 in · lbf]


Note: Always follow the steps shown in Fig.3 when tightening the DIN rail fixing screws.


#### <For direct mounting>


- ① Loosen the connecting screws (2 locations) on the right side of the piping block. (see Fig.2)
- $\ensuremath{ \textcircled{2}}$  Divide the manifold in the location where the valve base unit will be added, and remove it from the connecting rod.
- 3 Install the connecting rod included with the valve base assembly to add to the connecting rod of the manifold.
- ① Install the valve base assembly to add in the required location through the connecting rod, and enclose the valve base assembly on both sides.
- ⑤ Tighten the connecting screws (two locations) on the right side of the piping block. Tightening torque: F10 58.8 N⋅cm [5.2 in⋅lbf] F15 147 N⋅cm [13.0 in⋅lbf]
- 6 Tighten the fixing screws (provided by the customer). Tightening torque: 74.5 N·cm [6.6 in·lbf] (for both the F10 and F15)

### [Caution]


Before supplying air to the manifold, always confirm that the tightening of the connecting screws. Insufficient tightening is dangerous because it may cause air leaks or accidents.





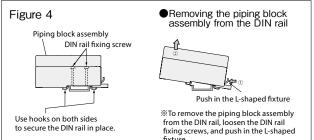

## F10 and F15 Series Disassembly Diagram of Easy Assembly Type Manifold Plug-in Type

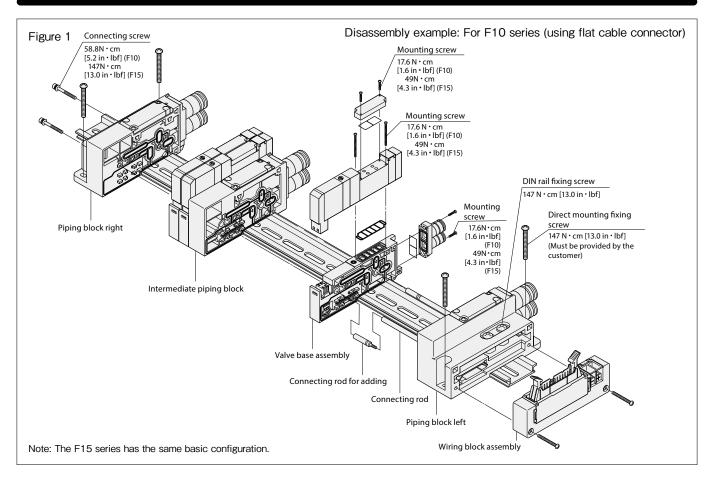

## Manifold Unit Adding Procedure (F10 and F15 Series Easy Assembly Type)

- ■Adding a valve base unit (use the same procedure for adding an intermediate piping block) <When using a DIN rail>
- ① Loosen the DIN rail fixing screws (4 locations) on both sides of the piping block in advance, to a degree which enables the manifold to slide on the DIN rail. (see Fig.1)
- 2 Loosen the connecting screws (two locations) on the right side of the piping block. (see Fig.2)
- 3 Divide the manifold in the location where the valve base unit will be added, and remove it from the connecting rod.
- ① Install the connecting rod included with the valve base assembly to add to the connecting rod of the manifold.
- (§) Install the valve base assembly to add in the required location through the connecting rod, and enclose the valve base assembly on both sides.
- ⑥ Tighten the connecting screws (two locations) on the right side of the piping block. Tightening torque: F10 58.8 N·cm [5.2 in·lbf] F15 147 N·cm [13.0 in·lbf]
- ② Confirm that the hook of the DIN rail mounting bracket is securely caught, and tighten the DIN rail fixing screws (4 locations). (see Fig.4) Tightening torque: 147 N · cm [13.0 in · lbf]

Note: Always follow the steps shown in Fig.3 when tightening the DIN rail fixing screws.


#### <For direct mounting>


- ① Loosen the connecting screws (2 locations) on the right side of the piping block. (see Fig.2)
- ② Divide the manifold in the location where the valve base unit will be added, and remove it from the connecting rod.
- 3 Install the connecting rod included with the valve base assembly to add to the connecting rod of the manifold.
- 4 Install the valve base assembly to add in the required location through the connecting rod, and enclose the valve base assembly on both sides.
- ⑤ Tighten the connecting screws (two locations) on the right side of the piping block. Tightening torque: F10 58.8 N⋅cm [5.2 in⋅lbf] F15 147 N⋅cm [13.0 in⋅lbf]
- ⑥ Always follow the steps shown in Fig.3 when tightening the fixing screws.


## [Caution]


- Before supplying air to the manifold, always confirm that the tightening of the connecting screws. Insufficient tightening is dangerous because it may cause air leaks or accidents.
- When adding a valve base unit, be aware that the pin locations will change if it is not inserted in the final station.


The pin locations are the same for an intermediate piping block, regardless of the station.






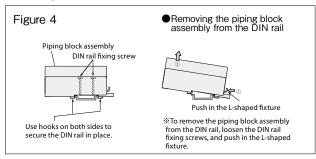


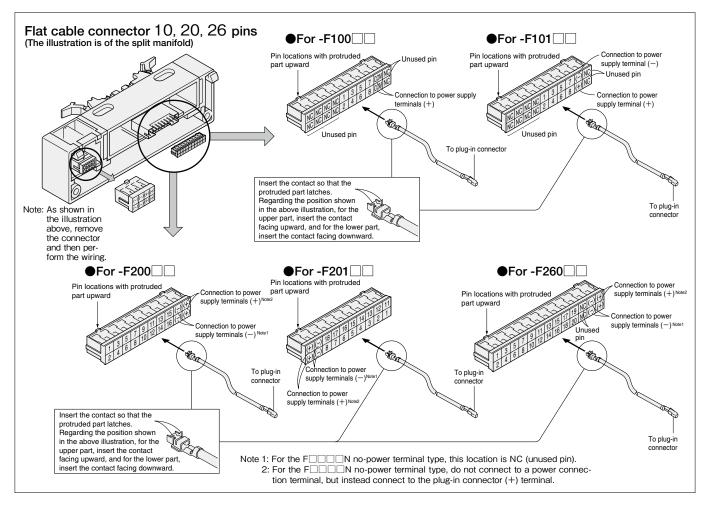

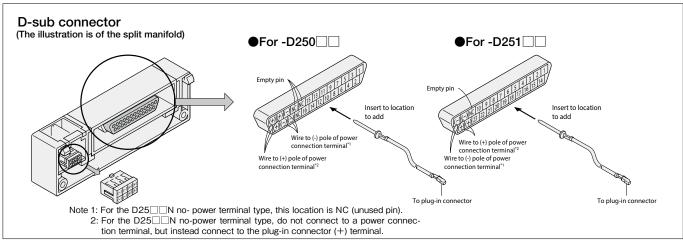


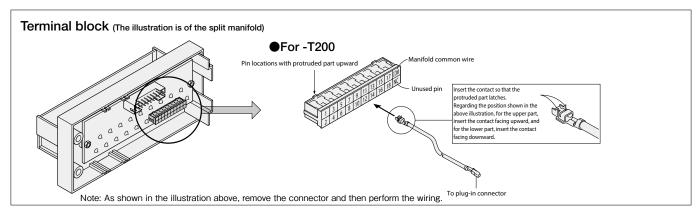



Remarks: The easy assembly type has internal wiring for each control point by default, so it is not necessary to add wiring.

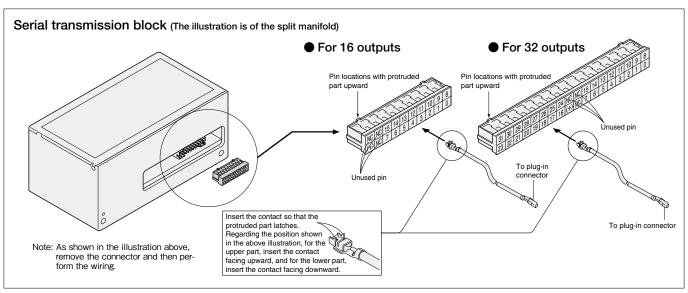

Remarks: The easy assembly type has internal wiring for each control point by default, so it is not necessary to add wiring.

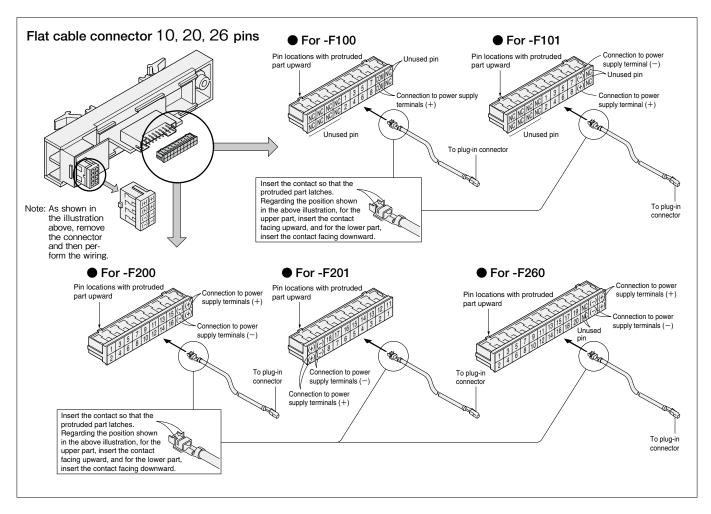

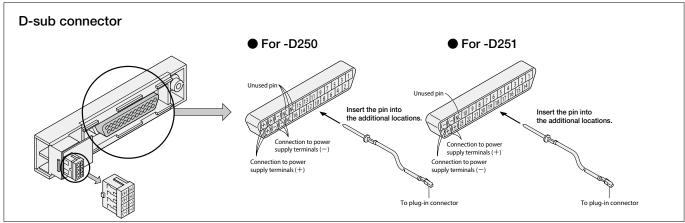


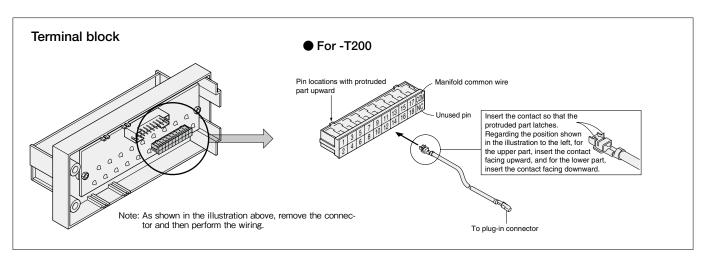


When ordering the serial transmission type, note that the product configurations vary between the F10 and F15 series, and the F18 series.

#### ■ For F10 and F15 series

- Models compatible with integrated transmission block
  - For CC-Link
  - For DeviceNet
  - For CompoNet
  - For EtherCAT (the shape differs to that below)
  - For EtherNet/IP (the shape differs to that below)
- Models for stand-alone transmission block The manifold body and serial transmission block are connected with a flat cable.
  - For Omron B7A Link Terminal

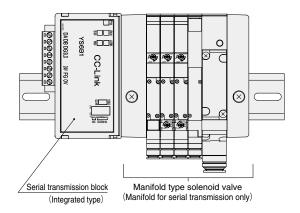

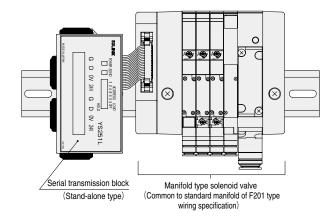


#### ■ For F18 series


- Models compatible with integrated transmission block
  - For Omron B7A Link Terminal
  - For CC-Link
  - For DeviceNet
  - For EtherCAT (the shape differs to that below)
  - For EtherNet/IP (the shape differs to that below)

#### • Models for stand-alone transmission block

The manifold body and serial transmission block are connected with a flat cable.

For CompoNet



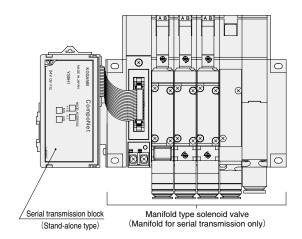

## **Specifications of Serial Transmission Type**

#### **General Specifications**

Voltage	24VDC ±10%
Operating temperature range	5~50° C [41~122° F]
Vibration resistance	49.0 m/s <sup>2</sup> [5G]
Shock resistance	98.1 m/s <sup>2</sup> [10G]


<sup>•</sup> For details about specifications, see each user's manual (see below).

## Serial Transmission Block, Terminal Block (LED) Part Names

#### For OMRON B7A Link Terminal

Transmission block specification: -31 (standard type), -32 (high-speed type)

(F10, F15 and F18 split manifold/Easy assembly type)



#### LED indicator

Indicator	Description
PWR	·Lights up when power is turned on
ERR	·Lights up during faulty transmission

#### Remarks

#### Connection method: 1 to 1

(Transmission block spec.)	Standard type (-31)	High-speed type (-32)
Transmission delay time	Max. 31 ms	Max. 5 ms
Transmission distance	Max. 500 m [1640 ft]	Max. 100 m [328 ft]


- \* For details of B7A Link Terminal, see the OMRON catalog, user's manual, etc.

  Number of outputs per block
- Maximum of 16 solenoids
- Error output specifications
   Output type: NPN open collector
   Rated load voltage: 24VDC
- Output current: Sink current MAX. 40 mA ■ Related materials: User's manual, document No. **BK-HV038**


## For CC-Link

CE

Transmission block specification: -B1 (16 outputs) (F10 and F15 split manifold/Easy assembly type)



#### (F18 split manifold)



HOLD/CLEAR switch

#### LED indicator

Indicator	Description
PW	•Lights up when power is turned on
L RUN	•Lights up when normal data is received from master station
SD	•Lights up during sending data
RD	•Lights up during receiving data
L ERR.	<ul> <li>Lights up during transmission errors, and shuts off when time is over</li> <li>Lights up due to station number setting error or transmission speed setting error</li> </ul>


#### Remarks

- \* Conforms to CC-Link.
- Number of outputs per block 16 solenoids (transmission block specification: -B1)
- \* Since the block occupies 1 station, if remote I/ O stations are entirely composed of the blocks, a maximum of 64 units can be connected to 1 master station.
- Related materials: User's manual, document No.BK-HV041

#### For CC-Link

## $\epsilon$

Transmission block specification: -B3 (32 outputs) (F10 and F15 split manifold/Easy assembly type)



#### LED indicator


LLD IIIGIC	atoi
Indicator	Description
PW	•Lights up when power is turned on
L RUN	*Lights up when normal data is received from master station
SD	•Lights up during sending data
RD	•Lights up during receiving data
L ERR.	<ul> <li>Lights up during transmission errors, and shuts off when time is over</li> <li>Lights up due to station number setting error or transmission speed setting error</li> </ul>

#### Remarks

- Conforms to CC-Link.Number of outputs per block 32 solenoids (transmission block specification: -B3)
- Since the block occupies 1 station, if remote I/ O stations are entirely composed of the blocks, a maximum of 64 units can be connected to 1
- Related materials: User's manual, document No.BK-HV041

#### For DeviceNet

Transmission block specification: -D1 (16 outputs). -D3 (32 outputs) (F10, F15 and F18 split manifold/Easy assembly type)



LED	inc	lica	to
		vu	


Indicator	State	Color	Description	
	Lights up	Green	Normal state	
MS	Flashing	Green	No setting state	
	Lights up	Red	Serious breakdown	
	Flashing	neu	Minor breakdown	
	Shuts off		No power supply	
NS	Lights up	Green	Communication connection completed	
	Flashing	Green	No communication connection	
	Lights up	Red	Serious communication fault	
	Flashing	Red	Minor communication fault	
	Shuts off	_	No power supply	

#### Remarks

- \*Conforms to DeviceNet.
- Number of outputs per block
- A maximum of 16 solenoids: -D1 A maximum of 32 solenoids: -D3
- Related materials: User's manual, document BK-HV042

## For CompoNet

Transmission block specification: -H1 (16 outputs) (F10, F15 and F18 split manifold/Easy assembly type)



#### LED indicator


Indicator	State	Color	Description
	Lights up	Green	Normal state
MS	Lights up	Red	Serious breakdown
IVIS	Flashing	Red	Minor breakdown
	Shuts off	_	Power OFF/In preparation
	Lights up	Green	Online/Access state
	Flashing	Green	Online/No-access state
NS	Lights up	Red	Serious communication fault
	Flashing	Red	Minor communication fault
	Shuts off	_	Power OFF/In preparation

#### Remarks

- \*Conforms to CompoNet.
- Number of outputs per block
- 16 solenoids (transmission block specification: -H1)
- ●Related materials: User's manual, document No.BK-HV043
- \*The communication connector is sold by Omron Corporation. Direct your inquiries to Omron.

## EtherCAT Compliant

Transmission block specifications: -K1 (16 outputs), -K3 (32 outputs) (F10, F15 and F18 split manifold/Easy assembly type)

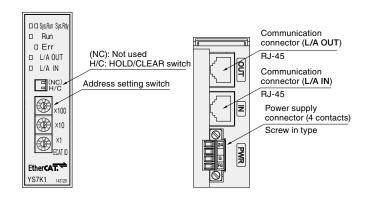

#### LED indicator

Indicator	State	Color	Description
	Lit/Not lit	Green/yellow	Transmission block operation normal
Sys.Run/ Sys.Rdy	Flashing/flashing	Green/yellow	Transmission block initialization
	Not lit/lit or flashing	Green/yellow	Transmission block error
	Not lit/Not lit	Green/yellow	Transmission block power OFF
	Off	Green	·INIT
Run	Flashing (blinking)	Green	PRE-OPERATIONAL
Hun	Flashing (single flash)	Green	SAFE-OPERATIONAL
	Lighted	Green	• OPERATIONAL
	Off	Red	No error
Frr	Flashing (blinking)	Red	Invalid setting
EII	Flashing (single flash)	Red	Unrequested change in status
	Flashing (double flash)	Red	Communication disconnect
	Lighted	Green	Normal communication
L/A OUT L/A IN	Flashing	Green	EtherCAT frame sending/receiving
	Off	Green	Not connected

EtherCAT® is a registered trademark for patented technology licensed from Beckhoff Automation GmbH of Germany.

#### Remarks

\*Comforms to EtherCAT.


Number of outputs per block

- A maximum of 16 solenoids: -K1 A maximum of 32 solenoids: -K3
- ■We recommend category 5 (100BASE-TX) or higher twisted paired cables (CAT 5e STP) for the communications cables.
- ●You can download the ESI (EtherCAT Slave Information) file from our web site.
- ●Related materials: User's manual, document No.BK-HV044
- For specifications and handling details, see the above-listed user's manuals (Document No. BK-HV038 BK-HV045).

## ● EtherNet/IP Compliant

 $\epsilon$ 

Transmission block specifications: -M1 (16 outputs), -M3 (32 outputs) (F10, F15 and F18 split manifold/Easy assembly type)

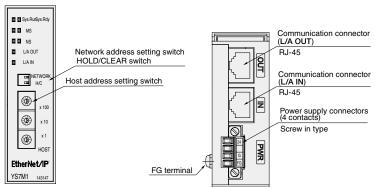

#### LED indicator

Indicator	LED state	Description				
Cua Dura/Cua Dalu	☐/ ☐ Not lit/Not lit	Transmission block power off				
Sys.Run/Sys.Rdy	Lit green/Not lit	Transmission block operation normal				
	☐ Not lit	Transmission block power off				
	Flashing green	Setting IP address				
MS	Lit green	During normal operation				
	Flashing red	Recoverable error				
	Lit red	Unrecoverable error				
	☐ Not lit	Transmission block power off				
	Flashing green	Normal communication being performed but connection not established				
NS	Lit green	Normal communication being performed and connection established				
	Flashing red	Connection timeout				
	Lit red	Duplicate IP address detected				
I/A	☐ Not lit	No connection				
L/A	Lit green	Normal communication				

#### EtherNet/IPTM is a trademark of ODVA.

#### Remarks

\*Complies with EtherNet/IP.

●Number of outputs per block

A maximum of 16 solenoids: -M1 A maximum of 32 solenoids: -M3

- ●We recommend category 5 (100BASE-TX) or higher twisted paired cables (CAT 5e STP) for the communications cables.
- ●You can download the EDS (Electronic Data Sheet) file from our web site.
- ●Related materials: User's manual, document No. BK-HV045.

For specifications and handling details, see the above-listed user's manuals (Document No. BK-HV038 - BK-HV045).

## PC Board Manifold Pin Locations by Wiring Specification (Top View)

#### Flat cable connector (20-pin)

● -F200 (Maximum number of control pins: 16) ● -F201 (Maximum number of control pins: 16)

19 17 15 13 11 9 20 18 16 14 12 10 8 6 4

 $1 \sim 16$ : Control pins

17, 18: ( — ) pins (Short-circuited inside) 19, 20: ( + ) pins (Short-circuited inside)

Triangle mark 11 12 13 14 15 16 17 18 19 20 1 2 3 4 5 6 7 8 9 10

 $1 \sim 8$ : Control pins

11 ~ 18: Control pins

9, 19 : ( - ) pins (Short-circuited inside) 10, 20 : ( + ) pins (Short-circuited inside)

Caution: Connector pin numbers are assigned for the sake of convenience.


Use the  $\nabla$  mark as the reference.

Remark: Socket and strain relief for flat cable are included at shipping.

\* For the relationship between the pin No. (terminal No.) and the corresponding solenoid, see p.46.


## **Detailed Diagram of Wiring System**

#### Positive common

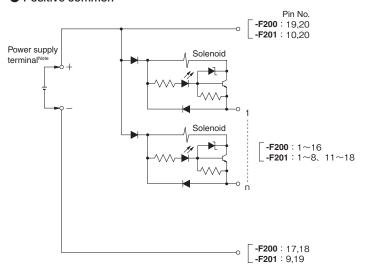

Note: For connecting a power line to the PC board manifold power terminal, see the "PC Board Manifold" precautions on p.23.

Remark: The internal circuit is of the standard type. For details of the low-current type, see p.23.




## Pin No. and Corresponding Solenoid (For PC Board Manifold A Type and F Type)

The examples below show the relationship between the PC board manifold pin No. and the corresponding solenoid. All the mounting examples show cases of the maximum number of control pins used.


#### Flat cable connector (20-pin)

● In the case of wiring specification **-F200** (Maximum number of control pins: 16)

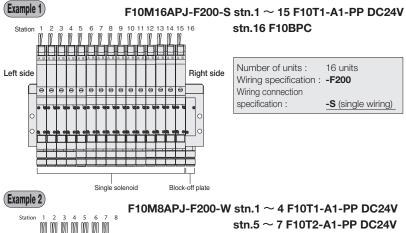

(Тор	Vie	w)						Trian	gle ma	ark
19	17	15	13	11	9	7	5	3	1	
20	18	16	14	12	9	8	6	4	2	

Pin No.	19	17	15	13	11	9	7	5	3	1
Valve No.	+	_	15A	13A	11A	9A	7A	5A	ЗА	1A
Pin No.	20	18	16	14	12	10	8	6	4	2
Valve No.	+	_	16A	14A	12A	10A	8A	6A	4A	2A

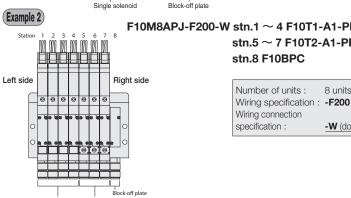




Pin No.	19	17	15	13	11	9	7	5	3	1
Valve No.	+	_	8A	7A	6A	5A	4A	ЗА	2A	1A
Pin No.	20	18	16	14	12	10	8	6	4	2
Valve No.	+	_	8B	7B	6B	5B	4B	3B	2B	1B

#### Flat cable connector (20-pin)


• In the case of wiring specification **-F201** (Maximum number of control pins: 16)

-W (double wiring)

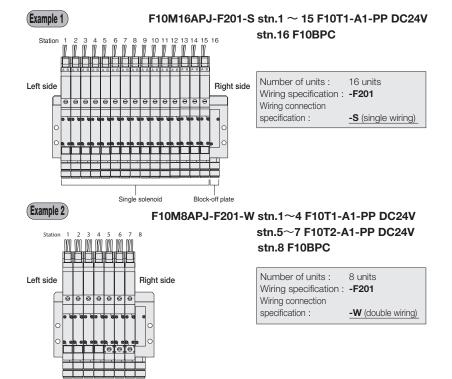

(Тор	Vie	w)				Trian	gle m	ark
11 1	12	13 3	14 4	16 6	18 8	19 9	20 10	

Pin No.	11	12	13	14	15	16	17	18	19	20
Valve No.	9A	10A	11A	12A	13A	14A	15A	16A	-	+
Pin No.	1	2	3	4	5	6	7	8	9	10
Valve No.	1A	2A	ЗА	4A	5A	6A	7A	8A	-	+



Pin No.	11	12	13	14	15	16	17	18	19	20
Valve No.	5A	5B	6A	6B	7A	7B	8A	8B	_	+
Pin No.	1	2	3	4	5	6	7	8	9	10

Caution: Connector pin numbers are assigned for the sake of convenience.

Use the  $\nabla$  mark as the reference.

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.

2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.

### Flat cable connector (10-pin)

●-F100 (Maximum number of control pins: 8)

				Iria	ngle n ▽	nark
Г				_		
	9	7	5	3	1	
	10	8	6	4	2	

1~8: Control pins


9, 10: Common pins (short-circuited within the wiring block)

Triangle mark

_					$\nabla$	
Г		一				$\neg$
	9	7	5	3	1	
	10	8	6	4	2	
L						

1~8: Control pins 9: (-) pin Note 10:(+)pin

Note: For no-power terminal type, set to NC (unused pin).



#### Flat cable connector (20-pin)

●-F200 (Maximum number of control pins: 16)

					Trian	gle ma ▽	ark
19 20	15 16		9		3 4	1 2	

1~16 : Control pins

17, 18: (-) pins (short-circuited within the wiring block) Note 19, 20: (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).

●-F101 ☐ (Maximum number of control pins: 8) ●-F201 ☐ (Maximum number of control pins: 16)

									man	yle III	air.
											٦
	11	12	13	14	15	16	17	18	19	20	
Ш	1	2	3	4	5	6	7	8	9	10	Ш
Ιl											_

1~8. Control pins

11~18: Control pins

9, 19: (-) pins (short-circuited within the wiring block) Note 10, 20: (+) pins (short-circuited within the wiring block)

Note: For no-power terminal type, set to NC (unused pin). Caution: Connector pin numbers are assigned for the

sake of convenience. Use the  $\nabla$  mark as the reference.

#### Flat cable connector (26-pin)

●-F260□□ (Maximum number of control pins: 20)



1~20 : Control pins

23, 24  $\,:\,(-)$  pins (short-circuited within the wiring block)  $^{\!Note}$ 25, 26 : (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).

\* For the relationship between the pin No.(terminal No.) and the corresponding solenoid, see p. 52-56.

#### D-sub connector (25-pin)

●-D250 ☐ (Maximum number of control pins: 16)



1~16: Control pins

20, 21, 22: (-) pins (short-circuited within the wiring block) Note 23, 24, 25: (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).

Caution: The above pin numbers are assigned based on the solenoid valve wiring sequence for the sake of

> They differ from the pin locations and pin numbers (marking) prescribed (JIS-X5101) for the Data Circuitterminating Equipment (DCE).

**D-D251** ☐ Pin locations based on JIS (Maximum number of control pins: 20)



1~10, 14~23 : Control pins

12, 13: (-) pins (short-circuited within the wiring block) Note 24, 25: (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).

#### Terminal block type (19 terminals, M3 screws)


●-T200 (Maximum number of control pins: 18)

	1	3	3	į	5	-	7	9	9	1	1	1	3	1	5	1	7	CC	M
	2	2	4	ļ	6	3	8	3	1	0	13	2	14	4	10	6	1	8	


1~18: Control terminals COM: Common terminal

Caution: Apply the tightening torque for the terminal screw (M3) to 49.0 N·cm [4.3 in·lbf] or less.

#### Flat cable connector and D-sub connector (12VDC and 24VDC)

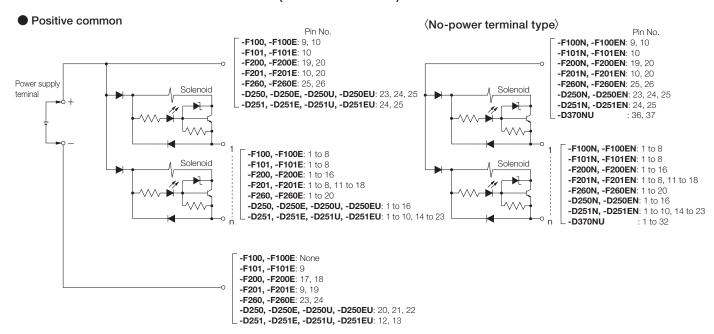


Remark: The internal circuit is of the standard type, For details of the low-current type, see p23.

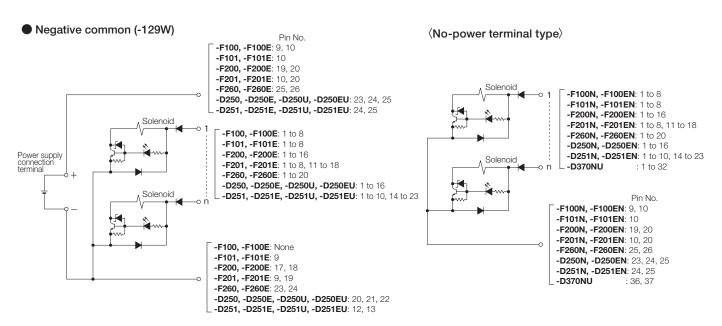


Remark: The internal circuit is of the standard type, For details of the low-current type, see p23.

## D-sub connector (For 100VAC and 120VAC specification)

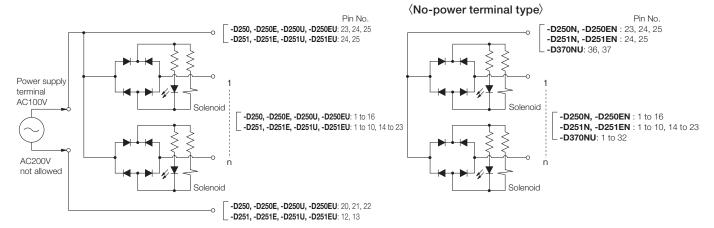


## Terminal block (For 12VDC and 24VDC specifications)


## Positive common



#### Negative common (-129W)



## Terminal block (For 100VAC and 120VAC specification)



Remark: The internal circuit is of the standard type. For details of the low-current type, see p.23.


#### Flat cable connector and D-sub connector (12VDC and 24VDC) Pin No. **-F100**: 9, 10 -F100:9, 10 -F101:10 Positive common Negative common (-129W) **-F101**∶10 **-F200**∶19, 20 **-F200**: 19, 20 **-F201**: 10, 20 -F201:10,20 -F260:25,26 -**F260**: 25, 26 -**D250, -D250U**: 23, 24, 25 -D250, -D250U: 23, 24, 25 -D251, -D251U: 24, 25 -D251, -D251U: 24, 25 LED for LED for Solenoid **-F100**:1 to 8 Power supply Power supply -F100:1 to 8 -F101:1 to 8 -F200:1 to 16 -F201:1 to 8, 11 to 18 -F260:1 to 20 terminal supply terminal supply -F101:1 to 8 -F200:1 to 16 **-F201**: 1 to 8, 11 to 18 **-F260**: 1 to 20 -D250, -D250U: 1 to 16 -D251, -D251U: 1 to 10, 14 to 23 Solenoid -D250, -D250U:1 to 16 -D251, -D251U:1 to 10, 11 -**F100**: None -**F100**: None -F101:9 -F101:9 **-F200**: 17, 18 **-F200**: 17, 18 -F200: 17, 16 -F201: 9, 19 -F260: 23, 24 -D250, -D250U: 20, 21, 22 -D251, -D251U: 12, 13 -F201: 9, 19 -F260: 23, 24 -D250, -D250U: 20, 21, 22 Reverse current prevention diode Reverse current prevention diode -D251, -D251U: 12, 13 -D370NU∶36, 37


Solenoid

o 32

Pin No.


**-₀-D370NU**: 34, 37

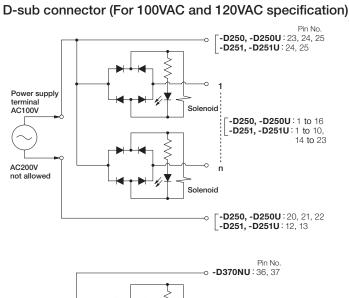




## Terminal block (For 12VDC and 24VDC specifications)


## Positive common



## Negative common (-129W)




## Terminal block (For 100VAC and 120VAC specification)



#### Flat cable connector (10-pin)

lacktriangle In the case of wiring specification -**F100**  $\Box$  (Maximum number of control pins: 8)

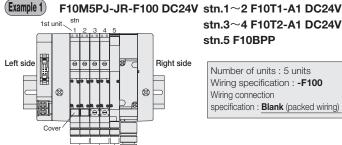


stn.3~4 F10T2-A1 DC24V stn.5 F10BPP

Number of units: 5 units Wiring specification: -F100 Wiring connection specification : Blank (packed wiring)

(Top	Vie	Tria	angle r	narl	
			$\vdash$		
g	7	5	3	1	
10	0 8	6	4	2	

Pin No.	9	7	5	3	1
Valve No.	+	5A	4A	ЗА	1A
Pin No.	10	8	6	4	2
Valve No.	+	5B	4B	3B	2A

#### Example 2 F10M4PJ-JR-F100-W DC24V stn.1~2 F10T1-A1 DC24V stn.3~4 F10T2-A1 DC24V 1st unit



Number of units: 4 units Wiring specification: -F100 Wiring connection specification: -W (double wiring)

(7	op \	/iew	1)	Tria	ngle n ▽	nark
	9	[ 7	5	3	1	
	10	8	6	4	2	
L						

Pin No.	9	7	5	3	1
Valve No.	+	4A	ЗА	2A	1A
Pin No.	10	8	6	4	2

## Flat cable connector (10-pin)

■ In the case of wiring specification -F101 □ (Maximum number of control pins: 8)

## **Example 1**) Left side Right side 03 (23)

Single solenoid

F10M5PJ-JR-F101 DC24V stn.1~2 F10T1-A1 DC24V stn.3~4 F10T2-A1 DC24V stn.5 F10BPP


> Number of units: 5 units Wiring specification: -F101 Wiring connection specification : Blank (packed wiring)

9 7 5 3	ngle mark ▽
10 8 6 4	1 2

Pin No.	9	7	5	3	1
Valve No.	_	5A	4A	ЗА	1A
Pin No.	10	8	6	4	2
Valve No.	+	5B	4B	3B	2A

Note: For the no-power terminal type, set pin No.9 to NC (unused pin).

#### F10M4PJ-JR-F101-W DC24V stn.1~2 F10T1-A1 DC24V Example 2 stn.3~4 F10T2-A1 DC24V



Number of units: 4 units Wiring specification: -F101 Wiring connection specification: -W (double wiring)

9 7 5 3	1 2

Pin No.	9	7	5	3	1
Valve No.	_	4A	ЗА	2A	1A
Pin No.	10	8	6	4	2
Valve No.	+	4B	3B	2B	1B


Note: For the no-power terminal type, set pin No.9 to NC (unused pin).

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.

- 2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.
- 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.
- 4. Caution should be exercised that the block-off plate is always dou ble wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection specifications.
- 5. Connector pin numbers are assigned for the sake of convenience. Use the  $\nabla$  mark as the reference.

#### Flat cable connector (20-pin)

■ In the case of wiring specification -F200□□ (Maximum number of control pins: 16)

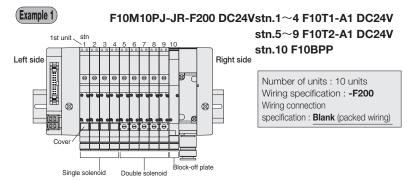



Pin No.	19	17	15	13	11	9	7	5	3	1
Valve No.	+	_	10A	9A	8A	7A	6A	5A	ЗА	1A
Pin No.	20	18	16	14	12	10	8	6	4	2
Valve No.	+	_	10B	9B	8B	7B	6B	5B	4A	2A

Note: For the no-power terminal type, set pins No.17 and 18 to NC (unused pins).

(Top	Vie	w)					Trian	gle m	ark
19 20		15 16		9	7	5 6	3 4	1 2	

Pin No.	19	17	15	13	11	9	7	5	3	1
Valve No.	+	_	8A	7A	6A	5A	4A	ЗА	2A	1A
Pin No.	20	18	16	14	12	10	8	6	4	2
Valve No.	+	_	8B	7B	6B	5B	4B	3B	2B	1B

Note: For the no-power terminal type, set pins No.17 and 18 to NC (unused pins).

#### Example 2 F10M8PJ-JR-F200-W DC24Vstn.1~4 F10T1-A1 DC24V stn.5~7 F10T2-A1 DC24V stn.8 F10BPP

Right side

Number of units: 8 units Wiring specification: -F200 Wiring connection specification: -W (double wiring)

#### Flat cable connector (20-pin)

Left side


Example 2

Single solenoid

Double :

03

lacktriangle In the case of wiring specification -**F201**  $\Box$  (Maximum number of control pins: 16)

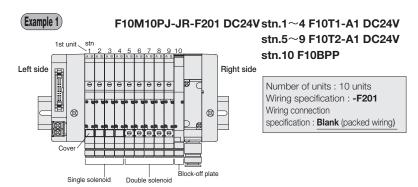



Pin No.	11	12	13	14	15	16	17	18	19	20
Valve No.	7A	7B	8A	8B	9A	9B	10A	10B	_	+
Pin No.	1	2	3	4	5	6	7	8	9	10
Valve No.	1A	2A	ЗА	4A	5A	5B	6A	6B	_	+

Note: For the no-power terminal type, set pins No.9 and 19 to NC (unused pins).


	(Тор	Vie	w)						Trian	gle m	ark
						$\bot$					$\neg$
	11	12	13	14	15	16	17	18	19	20	
	1	2	3	4	5	6	7	8	9	10	
_											

Pin No.	11	12	13	14	15	16	17	18	19	20
Valve No.	5A	5B	6A	6B	7A	7B	8A	8B	-	+
Pin No.	1	2	3	4	5	6	7	8	9	10
							,			. 0

Note: For the no-power terminal type, set pins No.9 and 19 to NC (unused pins).

Caution: Connector pin numbers are assigned for the sake of convenience.

Use the  $\nabla$  mark as the reference.



Block-off plate

Number of units: 8 units Wiring specification: -F201 Wiring connection specification: -W (double wiring)

- Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.
  - The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.

F10M8PJ-JR-F201-W DC24Vstn.1~4 F10T1-A1 DC24V


- 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.
- 4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection
- 5. Connector pin numbers are assigned for the sake of convenience. Use the  $\nabla$  mark as the reference.

#### Flat cable connector (26-pin)


Single solenoid

Double solenoid

■ In the case of wiring specification -F260□□ (Maximum number of control pins: 20)

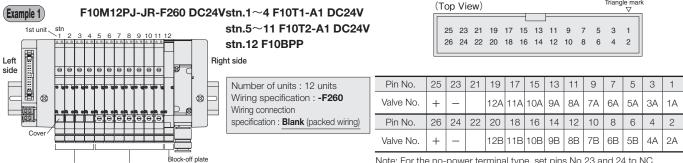


Note: For the no-power terminal type, set pins No.23 and 24 to NC (unused pins).

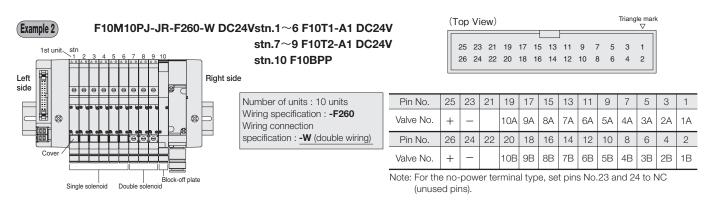


- Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.
  - 2. The stn. numbers are counted from the left, 1,  $2\cdots$ , with the solenoid on top and the valve in front.
  - 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.
  - 4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection
  - 5. Connector pin numbers are assigned for the sake of convenience. Use the  $\nabla$  mark as the reference.

#### D-sub connector (25-pin)


lacktriangle In the case of wiring specification **-D250** $\Box$  $\Box$ (Maximum number of control pins: 16)

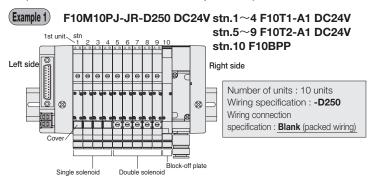

Caution: The connector pin numbers are assigned based on the solenoid valve wiring sequence for the sake of convenience. They differ from the pin locations and pin numbers (marking) prescribed (JIS-X5101) for the Data Circuit-terminating Equipment (DCE).

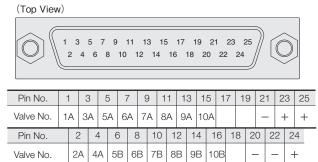

Note: For the no-power terminal type, set pins No.20, 21, and 22 to NC (unused pins).

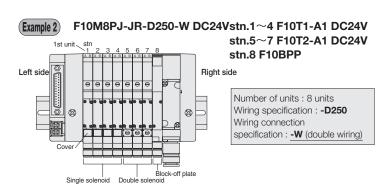






Pin No.	1	(	3	5	7	7	9	1	1	13	3	15	5	17	1	9	2	1	2	3	25
Valve No.	1/	2	Α	34	4	Α	5 <i>A</i>	4 6	iΑ	7,	A	8/	4				-	-	+	-	+
Pin No.		2	4	ŀ	6	8	3	10	1:	2	14	1	16	1	8	2	0	2	2	2	4
Valve No.		1B	21	В	3B	4	3	5B	6	в	7E	3	8E	3		-	-	-	-	+	-


Note: For the no-power terminal type, set pins No.20, 21, and 22 to NC (unused pins).

#### D-sub connector (25-pin)

In the case of wiring specification **-D251** Pin locations based on JIS (Maximum number of control pins: 20)

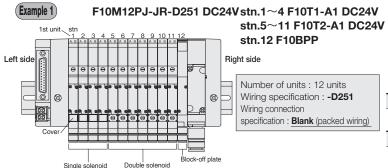


#### (Top View)




Pin No.	1		2	3	4	1	5	(	3	7		8	Ĝ	) 1	0	1	1	12	2	13
Valve No.	1/	Α	2A	34	4	Α	5 <i>A</i>	5	В	6/	A 6	В	7,	A 7	В			-		-
Pin No.		14	1 1	5	16	1	7	18	19	9	20	2	1	22	2	3	2	4	25	
Valve No.		84	8	В	9A	91	В	10A	10	В	11A	1	1B	12A	12	2B	+	- [	+	

Note: For the no-power terminal type, set pins No.12 and 13 to NC (unused pins).

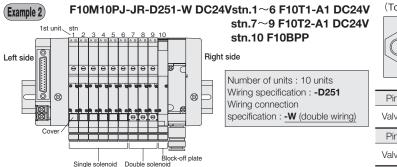

(Top View)



Pin No.	1		2	3	}	4	5		6	7	7	8		9	10	0	11	1	12	13	3
Valve No.	1/	Δ 1	ΙB	2	4 2	В	34	A 3	ВВ	4.	Α	4E	3 5	БА	51	В			-	-	-
Pin No.		14	1:	5	16	1	7	18	1	9	20	)	21	22	2	23	3	24	1 2	25	_
Valve No.		6A	61	В	7A	7	В	8A	8	В	9/	4	9B	10	Α	10	В	+		+	

Note: For the no-power terminal type, set pins No.12 and 13 to NC (unused pins).

- Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.
  - 2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.
  - 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.
  - 4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection specifications.

### Pin No. (Terminal No.) and Corresponding Solenoid (For Split Manifold, Easy Assembly Type Manifold Plug-in Type)


The examples below show the relationship between the split manifold terminal No., the easy assembly type manifold terminal No. and the corresponding solenoid.

All the mounting examples show cases of the maximum number of control pins used.

#### Terminal block type (19 terminals, M3 screws)

Single solenoid Double solenoid

In the case of wiring specification -T200 (Maximum number of control pins: 18)

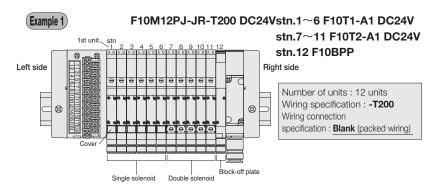

#### (Top View)

1	3	3	Ę	5	7	7	ę	9	1	1	1	3	1	5	1	7	CC	MC
2	2	4	ļ	6	6	8	3	1	0	13	2	14	4	10	6	1	8	

Terminal No.	1		3	3	Ę	5	7	7	Ś	)	1	1	1	3	1	5	1	7	COM
Valve No.	1,	Д	3,	Α	5	Α	7.	Α	8	Α	9.	Α	10	λ	11	Α	12	2A	+
Terminal No.		2	2		1	6	3	8	3	1	0	1	2	1	4	1	6	1	8
Valve No.		2	Д	4.	Α	6	Α	7	В	8	В	9	В	10	В	11	ΙB	12	2B

### Example 2

Left side

## F10M9PJ-JR-T200-W DC24V stn.1~6 F10T1-A1 DC24V

Right side

stn.7~8 F10T2-A1 DC24V stn.9 F10BPP

Number of units: 9 units Wiring specification: -T200 Wiring connection

specification: -W (double wiring)

#### (Top View)

1	1	3	3	Ę	5	- 1	7	9	9	1	1	1	3	1	5	1	7	CC	MC
	2	2	4	ļ	6	6	8	3	1	0	13	2	1.	4	1	6	18	8	


Terminal No.	-	1	3	3	5	5	7	7	Ć	)	1	1	1	3	1	5	1	7	COM
Valve No.	1.	А	2	4	3,	Α	4.	Α	5.	Α	6	Α	7.	Α	8.	Α	9	Α	+
Terminal No.		2	2	4	ļ.	6	3	8	3	1	0	1	2	1	4	1	6	1	8
Valve No.		11	в	21	В	3	В	4	В	5	В	6	В	7	В	8	В	9	В


Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.

- The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.
   When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.
- 4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control terminals to 1 unit), regardless of the wiring connection specifications


A dedicated cable assembly is provided for each wiring specification.



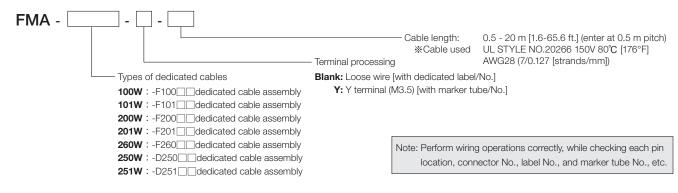


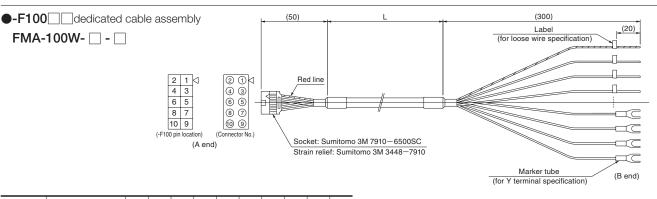


A end	-F100 pin location	1	2	3	4	5	6	7	8	9	10
A enu	Connector No.	1	2	3	4	(5)	6	7	8	9	10
B end	Label, marker tube No.	1	2	3	4	5	6	7	8	COM	COM

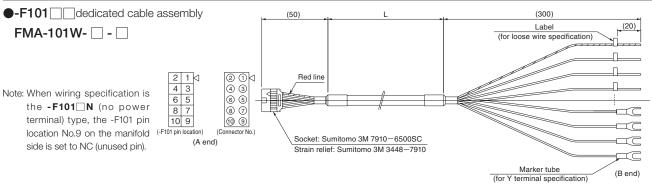

A and	-F101 pin location	1	2	3	4	5	6	7	8	9	10
A end	Connector No.	1	2	3	4	(5)	6	7	8	9	10
B end	Label, marker tube No.	1	2	3	4	5	6	7	8	_	+

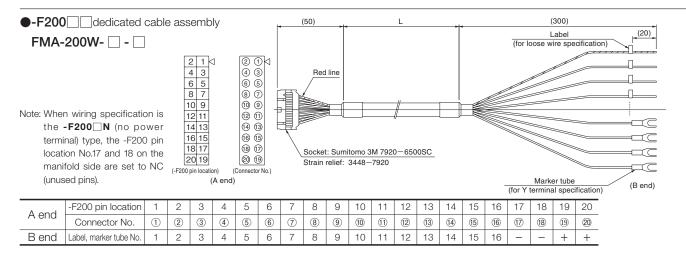

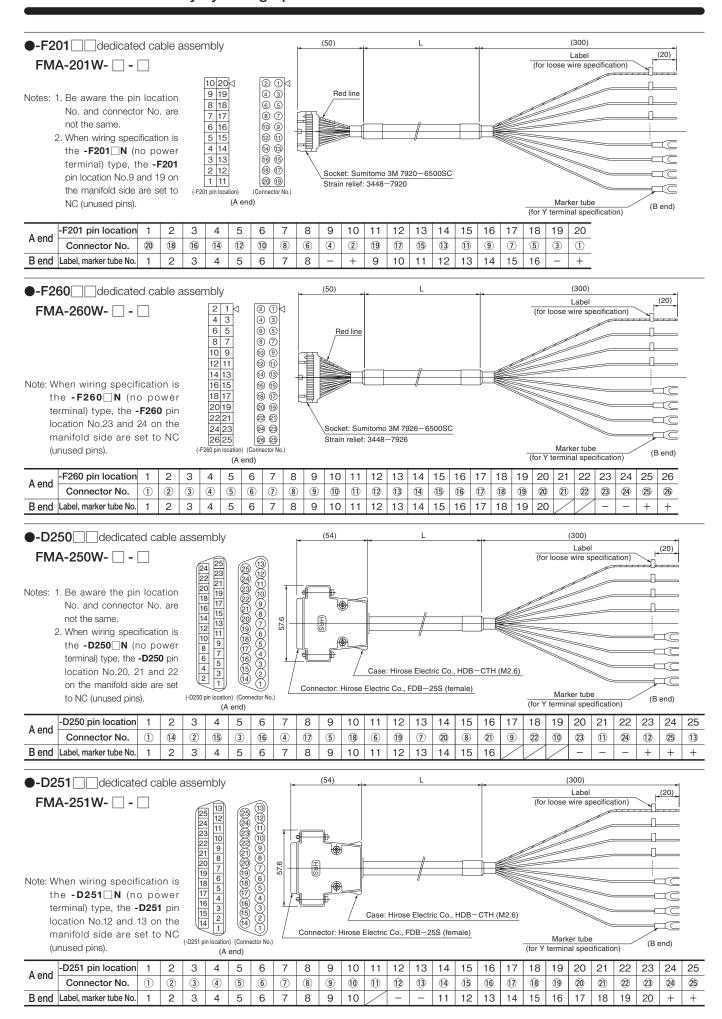


# **SOLENOID VALVES**

# F10 SERIES

## Contents

Spe	ecifications —	— 60
	Single Valve Unit	— <b>6</b> 6
	Monoblock Manifold A Type (Base Piping Type) —	<b>—</b> 69
	Monoblock Manifold F Type (Direct Piping Type)	
	Monoblock Manifold A Type, Wire-saving Type (Base Piping Type)—	
유	Monoblock Manifold F Type, Wire-saving Type (Direct Piping Type) -	<b>—</b> 78
ORDER	PC Board Manifold A Type (Base Piping Type)	<b>80</b>
R	PC Board Manifold F Type (Direct Piping Type)	
COD	Split Manifold Non-plug-in Type	
ES	Split Manifold Plug-in Type	<b>—</b> 92
	Split Manifold Serial Transmission Type —	
	Easy Assembly Type Manifold Non-plug-in Type	—100
	Easy Assembly Type Manifold Plug-in Type	
	Easy Assembly Type Manifold Serial Transmission Type	—112
	Single Valve Unit —	—118
	Monoblock Manifold —	<b>—12</b> 1
	Monoblock Manifold, Wire-saving Type	—1 <b>2</b> 3
₽	PC Board Manifold —	—12 <u>5</u>
	Split Manifold Non-plug-in Type	—1 <b>2</b> 6
DIMENSIONS	Split Manifold Plug-in Type	<b>—12</b> 8
SNC	Split Manifold Serial Transmission Type	—137
	Easy Assembly Type Manifold Non-plug-in Type	
	Easy Assembly Type Manifold Plug-in Type	
	Easy Assembly Type Manifold Serial Transmission Type ———	

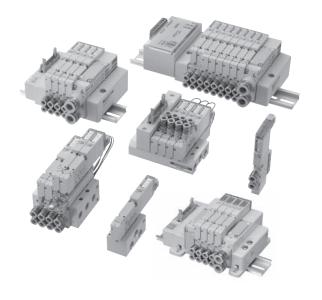

# F10 SERIES Specifications

## **Specifications**

#### **Basic Models and Valve Functions**

Basic model Item	F10□T0	F10□T1 F10□T2	F10□T3 F10□T4 F10□T5	F10⊟TA F10⊟TB F10⊟TC
Number of positions	2 pos	sitions	3 positions	4 positions
Number of ports		5		Tandem 3-port
Valve function	Single solenoid only	Both single and double solenoid use	Closed center, Exhaust center, Pressure center	NC/NC, NO/NO, NC/NO

Remark: For the optional specifications and order codes, see p.66.

#### **Specifications**

_									
	_	Dania madal	F10□T0	F10□T3	F10⊡TA	F10□T0G	F10⊡T3G	F10□T0V	
		Basic model	F10□T1	F10□T4	F10□TB	F10□T1G	F10□T4G	F10□T1V	F10⊡T3V
Item			F10□T2	F10□T5	F10⊡TC	F10□T2G	F10⊡T5G	F10□T2V	
Media						Air			
Operation	on type		ı	nternal pilot type	;	External pilot type (fo	or positive pressure)	External pilot ty	pe (for vacuum)
Flow rate	Sonic conduct	ance C dm <sup>3</sup> /(s·bar) Note1	0.97	0.93	0.75	0.97	0.93	0.97	0.93
characteristics	Effective area	Note2 mm <sup>2</sup> (Cv)	4.8 (0.27)	4.6 (0.25)	3.7 (0.21)	4.8 (0.27)	4.6 (0.25)	4.8 (0.27)	4.6 (0.25)
Port size	e <sup>Note3</sup>			M5×0.8,	10-32UNF, dual	use fitting for $\phi$	4 and $\phi$ 6, Rc1/8	B, NPT1/8	
Lubricat	tion					Not required			
Operatir	ng pressure	Main valve	0.2~0	.7 MPa [29~10	2 psi.]	0~0.7 MPa [0	~102 psi.] Note4	-100 kPa~0.15 MPa [	-29.53 in.Hg~22 psi.]
range		External pilot				0.2~0.7 MPa [2	9~102 psi.] Note4	0.2~0.7 MPa	[29~102 psi.]
Proof pr	essure	MPa [psi.]				1.05 [152]			
Respons	se time Note5	12VDC, 24VDC	15/15(20) or below	15/20 (25) or below	15/20 (25) or below	15/15 (20) or below	15/20 (25) or below	15/15 (20) or below	15/20 (25) or below
ON/OFF	F <sup>ms</sup>	100VAC	15/15 or below	15/20 or below		15/15 or below	15/20 or below	15/15 or below	15/20 or below
Maximu	m operating	frequency Hz				5			
Minimum t	time to energize t	or self holding Note6 ms	50	_	_	50		50	
Operating to	emperature range (a	atmosphere and media) °C [°F]			ţ	5~50 [41~122]			
Shock re	esistance	m/s <sup>2</sup> [G]				294.2 [30]			
Mountin	g direction					Any			

- Notes: 1. For details, see the flow rate characteristics on p.61.
  - 2. The effective area is a calculated value, and not a measured value.
  - 3. For details, see the port size on p.61.
  - 4. When the main valve pressure is 0.2 $\sim$ 0.7 MPa [29 $\sim$ 102 psi.], set the external pilot pressure to the main valve pressure or higher, and 0.7 MPa [102 psi.] or less.

Remark: Specification values are based on Koganei test standards.

Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center. Values in parentheses ( ) are for low-current type. 6. When used as a double solenoid valve. Excludes T0.

## **Solenoid Specifications**


Rated voltage Item	12VDC	24VDC (Standard type)	24VDC (Low-current type)	100	VAC	120\	VAC
Voltage range V	10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	21.6~26.4 (24±10%)	90~ (100±		108~ (120±	
Rated frequency Hz	_	_	_	50	60	50	60
Current (when rated voltage is applied) mA (r.m.s)  Power consumption W	33	17	_	3	3	8.	3
Power consumption W	0.4	0.4	_	0.8	VA	1 \	/A
8 Current Starting mA			17				
(when rated voltage is applied) Holding mA	_	_	4.2	_	_	_	_
Current (when rated voltage is applied) Holding mA  Power consumption Starting W  Holding W			0.4				
Holding W	_	_	0.1		_		
Starting time (standard) ms	_	_	70	-	_	_	-
Allowable leakage current mA	2.0	1.0	1.0	1.	.0	1.	0
Type of insulation			Type B				
Insulation resistance Note1 MΩ			Over 100				
Color of LED indicator Note2		14(	SA): Red, 12(SB): Gre	een			
Surge suppression (as standard)	Surge absorp	tion transistor	Flywheel diode		Bridge	diode	•

Notes: 1. Value at 500VDC megger.

Remark: Specification values are based on Koganei test standards.

<sup>2.</sup> The color of the  ${\bf T0}$  indicator is red only.

#### How to obtain cylinder speed




#### Measuring conditions


- •Air pressure : 0.5 MPa [73 psi.]
- ●Piping (outer diameter × inner diameter × length) :  $\phi 6 \times \phi 4 \times 1000$  mm [39 in.]
- ●Fitting: Quick fitting TS6-01
- Load ●Load ratio=

  Cylinder theoretical thrust

  Cylinder stroke: 150 mm [5.91 in.]




#### Maximum operating speed




1 mm/s = 0.0394 in./sec.

#### Delay time



Note: Delay time may vary according to the cylinder stroke.

### Flow Rate



1 MPa = 145 psi., 1  $\ell$  /min = 0.0353 ft.3/min.

#### How to read the graph

When the supply pressure is 0.5 MPa [73 psi.] and flow rate is 240R/min [8.47 ft.3/min.] (ANR), the valve outlet pressure becomes 0.4 MPa [58 psi.].

## Port Size

	Description/Piping specification	PR	X (P2)	4(A), 2(B)	1(P), 3(R2), 5(R1), 3, 5(R)
	With sub-base	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/8, NPT1/8
Φ	With female thread block	_	_	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF
Single	With dual use fitting block	_	-	Dual use fitting for $\phi 4$ and $\phi 6$	M5×0.8, 10-32UNF
· σ	With single use fitting block	_	-	φ4 or φ6	M5×0.8, 10-32UNF
	Monoblock type with female thread block, and PC board type with female thread block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/8, NPT1/8
	Monoblock type with fitting block, and PC board type with fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Dual use fitting for $\phi 4$ and $\phi 6$	Rc1/8, NPT1/8
	Monoblock type with single use fitting block, and PC board type with single use fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	φ4 or φ6	Rc1/8, NPT1/8
plo	Split type with female thread block, and serial transmission type with female thread block	_	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/4, NPT1/4
Manifold	Split type with fitting block, and serial transmission type with fitting block	_	M5×0.8, 10-32UNF	Dual use fitting for $\phi 4$ and $\phi 6$	Dual use fitting for $\phi$ 8 and $\phi$ 10
Š	Split type with single use fitting block, and serial transmission type with single use fitting block	_	M5×0.8, 10-32UNF	φ4 or φ6	Single use fitting for $\phi$ 8 or $\phi$ 10
	Easy assembly type with female thread block, and serial transmission type with female thread block	_	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/8, NPT1/8
	Easy assembly type with fitting block, and serial transmission type with fitting block	_	M5×0.8, 10-32UNF	Dual use fitting for $\phi 4$ and $\phi 6$	Dual use fitting for $\phi$ 6 and $\phi$ 8
	Easy assembly type with single use fitting block, and serial transmission type with single use fitting block	_	M5×0.8, 10-32UNF	φ4 or φ6	Single use fitting for $\phi$ 6 or $\phi$ 8

## When used as a single unit

	1(P)→2(B)	/1(P)→4(A)	2(B)→3(R2)	/4(A)→5(R1)	
Basic model	Sonic conductance C dm <sup>3</sup> /(s•bar)	Critical pressure ratio b	Sonic conductance C dm <sup>3</sup> /(s·bar)	Critical pressure ratio	
F10_T0-A2					
F10_T1-A2	0.85	0.14	0.85	0.26	
F10_T2-A2					
F10_T3-A2					
F10_T4-A2	0.82	0.13	0.82	0.29	
F10_T5-A2					
F10_TA-A2					
F10 TB-A2	0.68	0.30	0.69	0.30	
F10 TC-A2					
F10_T0-F3			0.50	_	
F10 T1-F3	0.73	0.29	0.58	0.47	
F10 T2-F3					
F10 T4-F3	0.00	0.00	0.57	0.46	
F10□T5-F3	0.69	0.26	0.57		
F10 TA-F3					
F10 TB-F3	0.61	0.28	0.54	0.44	
F10 TC-F3	0.01	0.20	0.01	0.11	
F10_T0-F4					
F10□T1-F4	0.54	0.39	0.53	0.37	
F10_T2-F4					
F10□T3-F4					
F10 T4-F4	0.53	0.43	0.51	0.34	
F10_T5-F4					
F10 TA-F4					
F10 TB-F4	0.50	0.32	0.50	0.30	
F10 TC-F4					

	1(P)→2(B)	/1 (P)→4 (A)	2(B)→3(R2)	/4(A)→5(R1)			
Basic model	Sonic conductance C	Critical pressure ratio	Sonic conductance C	Critical pressure ratio			
	dm <sup>3</sup> /(s•bar)	b	dm <sup>3</sup> /(s•bar)	b			
F10□T0-F5							
F10_T1-F5	0.57	0.39	0.54	0.38			
F10 T2-F5							
F10_T3-F5							
F10 T4-F5	0.57	0.41	0.54 0.40				
F10_T5-F5							
F10 TA-F5							
F10 TB-F5	0.53	0.33	0.51	0.31			
F10 TC-F5							
F10□T0-F6							
F10□T1-F6	0.64	0.47	0.56	0.42			
F10_T2-F6							
F10□T3-F6							
F10□T4-F6	0.61	0.42	0.56	0.40			
F10_T5-F6							
F10_TA-F6							
F10□TB-F6	0.57	0.34	0.52	0.40			
F10□TC-F6							

Note: For **-F4**, value assumes **TS6-M5M** is mounted on the piping port.

## When mounted on a manifold

Manifold model		Monoblock ma	∃F (FP)	F10M	anifold A type <b>A (AP)</b>	Split m <b>F10M</b> □	N (P) (S)	Easy assembly F10M	(N (P) (S)
		1 (P) → 2 (B)/1 (P) → 4 (A)	$2~(B) \rightarrow 3~(R2)/4~(A) \rightarrow 5~(R1)$	1 (P) → 2 (B)/1 (P) → 4 (A)		1 (P) → 2 (B)/1 (P) → 4 (A)		1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)
Valve type		Sonic conductance	C dm <sup>3</sup> /(s/bar)	Sonic conductance	e C dm <sup>3</sup> /(s/bar)	Sonic conductance	C dm <sup>3</sup> /(s/bar)	Sonic conductance	C dm <sup>3</sup> /(s/bar)
F10□T0□									
F10□T1□	Outlet port	0.84	0.82	0.75	0.76	0.97	0.93	1.06	1.00
F10_T2_									
F10□T3□	dual use fitting for $\phi$								
F10_T4_	4 and φ6 *These are	0.83	0.78	0.73	0.72	0.93	0.89	0.99	0.95
F10_T5_	the cases								
F10 TA	of φ6.		0.70				0.70		
F10 TB		0.70	0.70	0.64	0.66	0.75	0.73	0.82	0.84
F10 T0									
F10_T0_		0.66	0.72	0.63	0.69	0.72	0.79	0.84	0.79
F10_T2_		0.00	0.72	0.03	0.09	0.72	0.79	0.04	0.79
F10_T3_	_								
F10□T4□	Output port	0.65	0.70	0.62	0.67	0.70	0.77	0.82	0.80
F10□T5□	φ4 fitting								
F10 TA									
F10□TB□		0.60	0.64	0.56	0.62	0.63	0.67	0.73	0.74
F10 TC									
F10 T0									
F10 T1		0.72	0.81	0.67	0.73	0.80	0.83	0.88	0.86
F10 T2									
F10 T3	Output port	0.71	0.70	0.00	0.00	0.70	0.00	0.04	0.05
F10□T4□ F10□T5□	φ6 fitting	0.71	0.73	0.66	0.69	0.78	0.80	0.84	0.85
F10_T3_									
F10 TB		0.64	0.66	0.58	0.63	0.68	0.69	0.72	0.75
F10□TC□		3.01	2.00	2.30	1.00	2.00	2.00	3.7.2	

Notes: 1. When the individual air supply spacer or the individual air exhaust spacer, the back pressure prevention valve, or the stop valve is used, sonic conductance decreases by about 30%.

Remark: Specification values are based on Koganei test standards.

<sup>2.</sup> For the flow rate characteristics of other outlet ports, consult us.

## Single Valve Unit Mass

g [oz.]

F10□T□□	F10□T□□-A1	F10□T□□-A2	F10□T□□-FJ	F10□T□□-FJ5	F10□T□□-FJ6
Outlet portion	Outlet portion	Outlet portion	Outlet portion With dual use	Outlet portion	Outlet portion
None	With plate	With plate	fitting block	With	With φ6 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	None	With A type sub-base	None	None	None
44 [1.55]	47 [1.66]	116 [4.09]	55 [1.94]	57 [2.01]	60 [2.12]

a [oz.]

				9 [02.]
F10□T□□-FM	F10□T□□-F3	F10□T□□-F4	F10□T□□-F5	F10□T□□-F6
Outlet portion	Outlet portion With dual use	Outlet portion	Outlet portion	Outlet portion
With female thread block	fitting block	With female thread block	With $\phi 4$ fitting block	With $\phi$ 6 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	With female thread block	With female thread block	With female thread block	With female thread block
51 [1.80]	62 [2.19]	58 [2.05]	64 [2.26]	67 [2.36]

Basic Type F10□T0 is 10 g [0.35 oz.] less than the mass shown above.

#### Monoblock Manifold Mass (single valve unit included)

g [oz.]

				Mass calculation	on of each un	it		
Monoblock manifold		4(A), 2(B) ports outlet specifications						
	Female	thread block	Dual use	e fitting block	φ4 fitting block		φ6 fitting block	
A type	(97×n)+79	[(3.42×n)+2.79]	(101×n)+79	[(3.56×n)+2.79]	(103×n)+79	[(3.63×n)+2.79]	(106×n)+79	[(3.74×n)+2.79]
F type	(71×n)+57	[(2.50×n)+2.01]	(75×n)+57	[(2.65×n)+2.01]	(77×n)+57	[(2.72×n)+2.01]	(80×n)+57	[(2.82×n)+2.01]

g [oz.]

		Additional mass (wire-saving type)						
Monoblock manifold		Wiring specification						
	-F100N, -F101N	-F200N, -F201N, -F260N	-D250N, -D251N					
A type	164+4n [5.78+0.14n]	166+4n [5.86+0.14n]	170+4n [6.00+0.14n]					
F type	112+4n [3.95+0.14n]	114+4n [4.02+0.14n]	118+4n [4.16+0.14n]					

Calculation example : F10M8AM

stn.1 $\sim$ stn.8 F10T1-A1-PS DC24V

 $(97 \times 8) + 79 = 855 \text{ g } [30.16 \text{ oz.}]$ 

When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the  $F10\Box T0$  specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

## PC Board Manifold Mass (single valve unit included)

g [oz.]

	, ,	,			9 [02:1		
		M	ass calculation of each un	it			
PC board manifold		4(A), 2(B) ports outlet specifications					
	Female thread block	Dual use fitting block	φ4 fitting block	φ6 fitting block	connector portion		
A type	(97×n)+79 [(3.42×n)+2.79]	(101×n)+79 [(3.56×n)+2.79]	(103×n)+79 [(3.63×n)+2.79]	(106×n)+79 [(3.74×n)+2.79]	$(2\times n)+29$ [(0.07×n)+1.02]		
F type	(76×n)+83 [(2.68×n)+2.93]	(80×n)+83 [(2.82×n)+2.93]	(82×n)+83 [(2.89×n)+2.93]	(85×n)+83 [(3.00×n)+2.93]	[(2×n)+29 [(0.07×n)+1.02]		

Calculation example: F10M8APM-F201-W

stn.1 $\sim$ stn.8 F10T1-A1-PP DC24V

 $(97\times8)+79+(2\times8)+29=900 \text{ g } [31.75 \text{ oz.}]$ 

When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the F10 To specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

## Optional Parts Mass

Stop valve (-STP): 29 g [023 oz.]

#### Mass of Split Manifold and Serial Transmission Type

Because the valve and manifold have the same output specifications, their mass is the same. The mass can only be changed by choosing a different type of inlet/outlet block.

### Mass of Split Manifold Non-Plug-in Type (single valve unit included)

g [oz.]

	Mass calculation of each unit								
Manual on to have		4(A), 2(B) ports outlet specifications							
Non-plug-in type	Female	thread block	Dual use fitting block		φ4 fit	$\phi$ 4 fitting block		$\phi$ 6 fitting block	
	(75×n)+120	$[(2.65 \times n) + 4.23]$	(79×n)+120	[(2.79×n)+4.23]	(81×n)+120	$[(2.86 \times n) + 4.23]$	$(84 \times n) + 120$	[(2.96×n)+4.23]	

g [oz.]

Additional mass								
	Piping block specification							
Female thread block	Female thread block Dual use fitting block $\phi$ 8 fitting block $\phi$ 10 fitting block							
111 [3.92]	111 [3.92] 125 [4.41] 149 [5.26] 159 [5.61]							

Calculation example: F10M8N-MR

stn.1~stn.8 F10T1-A1-PS DC24V

(75×8)+120+111=831 g [29.31 oz.]

When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the  $F10\Box T0$  specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

## Mass of Split Manifold Plug-in Type/Serial Transmission Type (single valve unit included)

g [oz.]

Dhumin tuna				Mass calculation	on of each uni	t		
Plug-in type	4(A), 2(B) ports outlet specifications							
Serial transmission	Female	thread block	Dual use	fitting block	φ4 fit	ting block	φ6 fi	tting block
compatible manifold	(79×n)+120	[(2.79×n)+4.23]	(83×n)+120	[(2.93×n)+4.23]	(85×n)+120	[(3.00×n)+4.23]	(88×n)+120	[(3.10×n)+4.23]

g [oz.]

	Additional mass				
	Piping block specification				
Female thread block Dual use fitting block $\phi$ 8 fitting block $\phi$ 10 fitting					
111 [3.92]	125 [4.41]	149 [5.26]	159 [5.61]		

g [oz.]

Additional mass				
	Wiring block specification			
-F100, -F101F200, -F201, -F260		-D250□□, -D251□□	-T200	
32 [1.13]	34 [1.20]	39 [1.38]	110 [3.88]	

g [oz.]

	Additional mass				
	Serial transmission block specification				
Stand-alone type Integrated type Integrated type (For EtherCAT) Integrated type (For					
231 [8.15] 138 [4.87]		100 [3.53]	110 [3.88]		

Calculation example: F10M8PM-MR-F201 DC24V

stn.1 $\sim$ stn.8 F10T1-A1 DC24V

(79×8)+120+111+34=897 g [31.64 oz.]

When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the F10 To specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

## Mass of Easy Assembly Type Manifold and Serial Transmission Type Manifold

## Mass of Easy Assembly Type Manifold Non-Plug-in Type (single valve unit included)

g [oz.]

	Mass calculation of each unit			
Mounting type	Outlet port specifications			
	Female thread block	Dual use fitting block	φ4 fitting block	φ6 fitting block
No code	(83 x n) + 229 [(2.93 × n) + 8.078]	(87 x n) + 229 [(3.069 × n) + 8.078]	(89 x n) + 229 [(3.139 × n) + 8.078]	(92 x n) + 229 [(3.245 × n) + 8.078]
-DN	(83 x n) + 290 [(2.93 × n) + 10.229]	(87 x n) + 290 [(3.069 × n) + 10.229]	(89 x n) + 290 [(3.139 × n) + 10.229]	(92 x n) + 290 [(3.245 × n) + 10.229]
-DR	(85 x n) + 308 [(3.00 × n) + 10.864]	(89 x n) + 308 [(3.139 × n) + 10.864]	(91 x n) + 308 [(3.210 × n) + 10.864]	(94 x n) + 308 [(3.316 × n) + 10.864]

g [oz.]

	Additional mass  Intake/exhaust outlet			
Fitting specifications				
	Female thread block	Dual use fitting block	φ6 fitting block	φ8 fitting block
J M	22 [0.776]	32 [1.129]	43 [1.517]	48 [1.693]
J D MD	26 [0.917]	46 [1.623]	68 [2.399]	78 [2.751]
J□T MT□	33 [1.164]	63 [2.222]	96 [3.386]	111 [3.92]

Calculation example: F10M8XNJ-JR-DR DC24V

stn.1  $\sim$  8 F10T1-A1-PS DC24V

 $(89 \times 8) + 308 + 32 = 1052 g [37.11 oz.]$ 

When mounting the block-off plate, subtract 50 g [1.76 oz.] per unit from the above calculation result.

When mounting the  $\textbf{F10} \square \textbf{T0}$  specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

### Mass of Easy Assembly Type Manifold Plug-in Type/Serial Transmission Type Manifold (single valve unit included)

g [oz.]

	Mass calculation of each unit			
Mounting type	Outlet port specifications			
	Female thread block	Dual use fitting block	φ4 fitting block	φ6 fitting block
No code	(86 x n) + 227 [(3.034 × n) + 8.007]	(90 x n) + 227 [(3.175 × n) + 8.007]	(92 x n) + 227 [(3.245 × n) + 8.007]	(95 x n) + 227 [(3.351 × n) + 8.007]
-DN	(86 x n) + 288 [(3.034×n) + 10.159]]	(90 x n) + 288 [(3.175 × n) + 10.159]	(92 x n) + 288 [(3.245 × n) + 10.159]	(95 x n) + 288 [(3.351 × n) + 10.159]
-DR	(88 x n) + 310 [(3.104 × n) + 10.935]	(92 x n) + 310 [(3.245 × n) + 10.935]	(94 x n) + 310 [(3.316 × n) + 10.935]	(97 x n) + 310 [(3.422 × n) + 10.935]

g [oz.]

	Additional mass  Intake/exhaust outlet			
Fitting specifications				
	Female thread block	Dual use fitting block	φ6 fitting block	φ8 fitting block
J M	22 [0.776]	32 [1.129]	43 [1.517]	48 [1.693]
J_D MD_	26 [0.917]	46 [1.623]	68 [2.399]	78 [2.751]
J□T MT□	31 [1.093]	61 [2.152]	94 [3.316]	109 [3.845]

g [oz.]

Additional mass				
Wiring block specifications				
-F100 , -F101 -F200 , -F201 , -F260 -D250 , -D251 -T200 -T200				
36 [1.270]	38 [1.340]	43 [1.517]	116 [4.092]	

g [oz.]

Additional mass					
Serial tran	Serial transmission block specifications (Monoblock)				
For CC-Link, DeviceNet, and CompoNet	For EtherCAT For EtherNet/IP				
138 [4.87]	100 [3.53]	110 [3.88]			


Calculation example: F10M8XPJ-JR-F201-DR DC24V

stn.1  $\sim$  8 F10T1-A1 DC24V

 $(98 \times 8) + 310 + 32 + 38 = 1116 \text{ g} [39.37 \text{ oz.}]$ 

When mounting the block-off plate, subtract 50 g [1.76 oz.] per unit from the above calculation result.

When mounting the F10 T0 specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

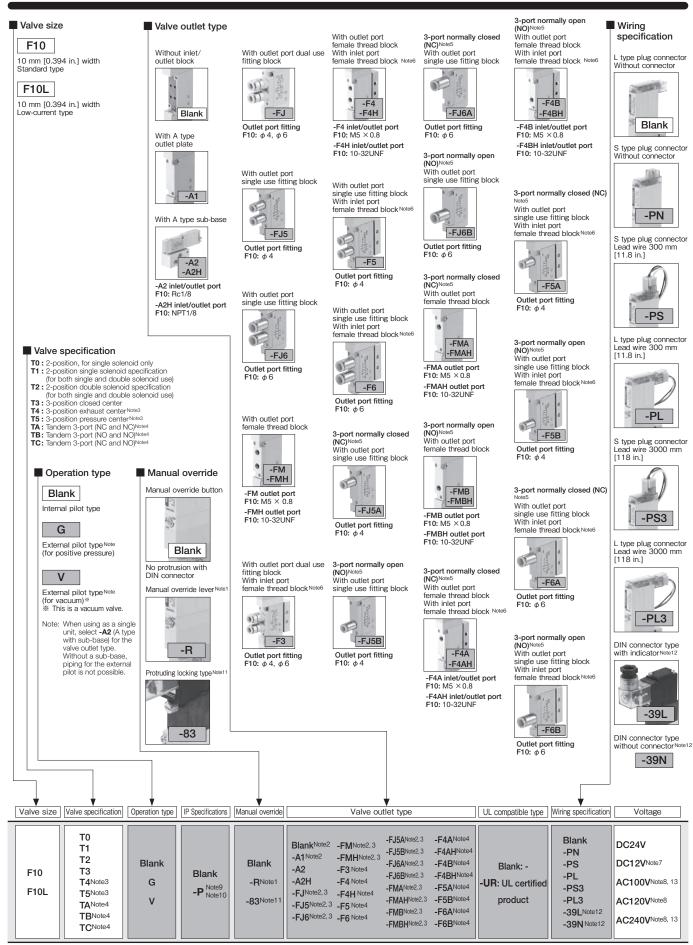

- Notes: 1. When the valve specification is T1 or T2, the manual override lever is placed only on
  - Two manifold mounting screws are included
  - Not available in the vacuum valves.
  - Not available in external pilot type and vacuum valves. Only for valve specification T0, T1, and T2.

  - Thread size for the inlet port female thread block is F10:  $M5 \times 0.8$ .
  - Not available in low-current type.
  - 8. Not available in low-current type and tandem 3-port valves.
- 9. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- 11 Only for wiring specification -39
- 12 Only for F15 series and not available for valve specification T1. TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2.
- 13 Not available with DIN connectors

Remark: Negative common specifications are also available as made to order products (add -129W to the end of order code). For details, consult us

## For internal pilot

F10Z -

Valve size Parts content

10: 10 mm Mounting bracket (mounting bracket, 2 mounting screws) 21 [0.394 in.] width

Sub-base Rc1/8 (sub-base body, gasket, exhaust valve)Note1

Plate (plate, gasket, 2 mounting screws)
Dual use fitting block (fitting block, gasket, 2 mounting screws)
Single use fitting block **F10**:  $\phi$  4

Single use fitting block **F10:**  $\phi$  6 Single use fitting block for 3-port **F10:**  $\phi$  4 Note3 Single use fitting block for 3-port F10:  $\phi$  6 Note3 J5A

Female thread block **F10**: M5 × 0.8 (female thread block, gasket, 2 mounting screws)
Female thread block **F10**: 10-32UNF (female thread block, gasket, 2 mounting screws)
Female thread block for 3-port **F10**: M5 × 8 (female thread block, gasket, 2 mounting screws)
Note3 МН

MAH: Female thread block for 3-port F10: 10-32UNF (female thread block, gasket, 2 mounting screws)Note3

MP: P port female thread block F10: M5 × 0.8 (P port female thread block, gasket)Note1

MPH: P port female thread block F10: 10-32UNF (P port female thread block, gasket)Note1

MPP: IP dedicated P port female thread block (P port female thread block, gasket)
GS1: Gasket (gasket, exhaust valve)Note2

Notes: 1. Valve mounting screws are not included.

Caution should be exercised as this gasket is different from the GS2 gasket for the split-type manifolds.
 Common to both normally closed (NC) and normally open (NO) types. Select the mounting direction by application requirements.

## For external pilot F10Z -

Parts content

**10:** 10 mm [0.394 in.] width

Plate (plate, gasket, 2 mounting screws)
 Dual use fitting block (fitting block, gasket, 2 mounting screws)

Single use fitting block F10:  $\phi$ 4

.16

J5A

Single use fitting block **F10:**  $\phi$  6 Single use fitting block for 3-port **F10:**  $\phi$  4 Note1 Single use fitting block for 3-port **F10:**  $\phi$  6 Note1

: Female thread block F10: M5 × 0.8 (female thread block, gasket, 2 mounting screws) : Female thread block F10: 10-32UNF (female thread block, gasket, 2 mounting screws)

Female thread block for 3-port F10: M5 × 0.8 (female thread block, gasket, 2 mounting screws)Note1

MAH: Female thread block for 3-port F10: 10-32UNF (female thread block, gasket, 2 mounting screws)Note1

GS1: Gasket (gasket, exhaust valve)Not

Notes: 1. Common to both normally closed (NC) and normally open (NO) types. Select the mounting direction by application requirements

2. Caution should be exercised as this gasket is different from the GS2 gasket for the split type manifolds.

## Sub-base for external pilot

F10ZG - 25

10: 10 mm [0.394 in.] width

F10ZG - 25H

Valve size

10: 10 mm [0.394 in.] width Sub-base NPT1/8

#### Connector-related order codes



Valve specification
For T1, T2, T3,

TA, TB, TC

Connector specification : Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

CPN: Connector without lead wire

(1 short bar and 3 contacts included)

Remarks: A connector for negative common is also available. See p. 22 for details. 1. The lead wire thickness is 24AWG when Blank or 22AWG when UR is specified.



Connector specification specification

: Connector, lead wire length 300 mm [11.8 in.]

(black, red, for total of 2 lead wires) CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)


CPN: Connector without lead wire (1 short bar, 2 contacts included)

specification For T1, T2, T3, T4, T5, TA, TB, TC

Connector specification CC1.5: Cabtyre cable length 1500 mm [59 in.] \*

Cabtyre cable length 3000 mm [118 in.]

\* For details, see p. 22.

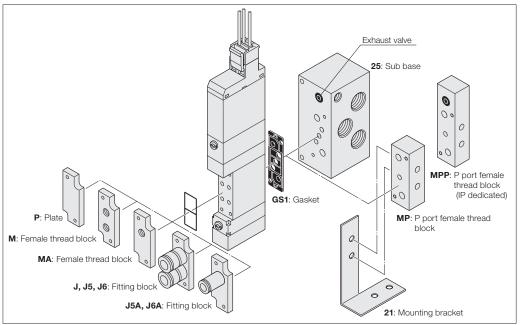

#### Connector-related order codes

TC

**JAZ - P -** (for double use only) Valve Connector specification specification CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, For **T2**, **T3**, **T4**, white, for total of 3 lead wires) **T5, TA, TB,** or

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB : Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*\* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\* \*A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P- single dedicated type.

2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type).

3. There is no white lead wire for the **JAZ0-P-** .

4. It is necessary to disassemble the connector to add a common

connector assembly. Contact your nearest KOGANEI sales office.

5. For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.

6. For information on replacing the waterproof seal, contact your

nearest KOGANEI sales office.

**JAZ0 - P -** (for single use only)

Valve specification For T0/T1


Connector specification

CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB~: Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.] \* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

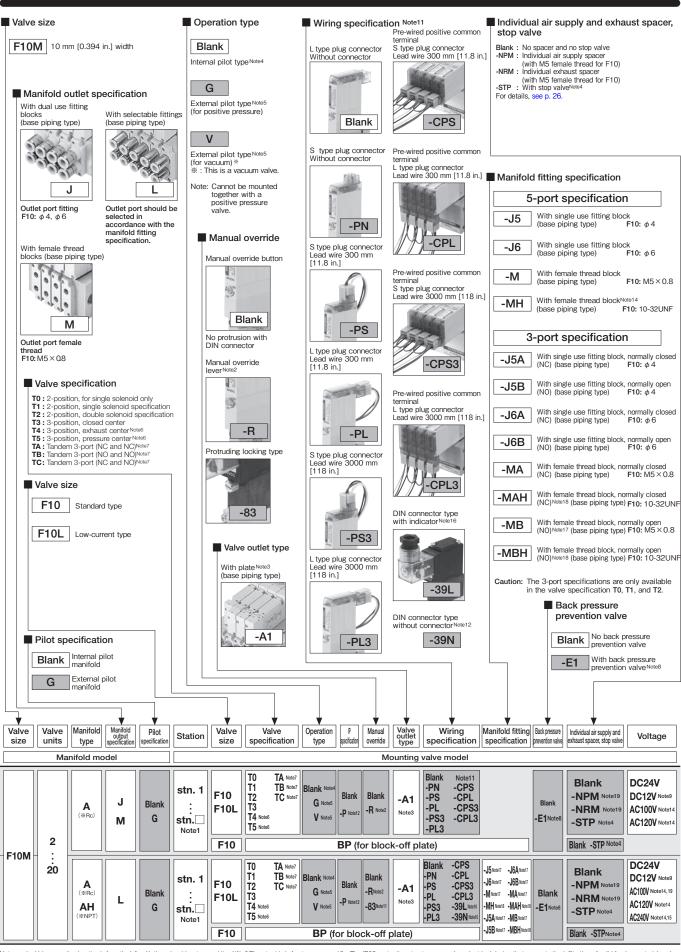

- Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front

  - Valve mounting location is from the left, with the sciencial on top, and the 4(4) When the valve specification is **T1** or **T2**, the manual override lever is pla Always enter -**A1**. Cannot be mounted on the external pilot manifold. Cannot be mounted on the internal pilot manifold. Not available in the vacuum valves.

  - Not available in external pilot type and vacuum valves
  - Not available with the individual exhaust spacer and vacuum valve.

  - Not available in low-current type.

    10.Not available in the low current type and tandem 3-port valves.

    11. The -P ☐ (including when Blank) and -CP ☐ wiring specifications cannot be mixed.
- The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and

- The IPGs protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
   3 port type is only supported by the T0, T1, and T2 valve type.
   Not available in low-current type and tandem 3-port valves.
   Only for wiring specification -39[].
   Not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2.
   Can be elected only when the magnified time in A.
- Can be selected only when the manifold type is A.
   Can be selected only when the manifold type is AH. Not available with DIN connectors (-39 )
- Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

## Gasket (gasket and exhaust valve)


F10Z - GS1


Valve size 10: 10 mm [0.394 in.] width

## Block-off plate (block-off plate and 2 mounting screws)



#### Connector-related order codes

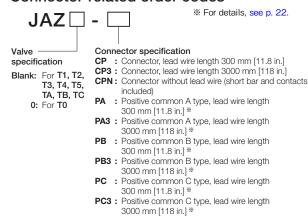

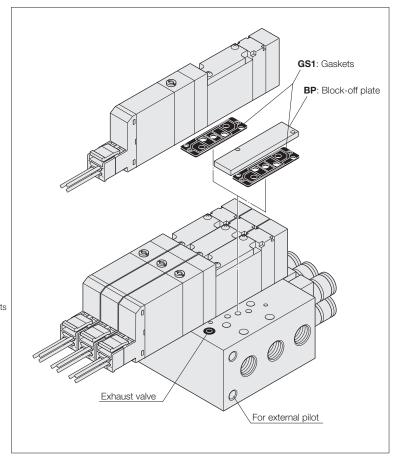

# FZ -

Valve specification For **T1**, **T2**, **T3**, T4, T5, TA, TB, TC

Connector specification

CC1.5 : Cabtyre cable length 1500 mm [59 in.] \* cc3 : Cabtyre cable length 3000 mm [118 in.] \*

## Back pressure prevention valve


(for monoblock type, 2 pieces)

F10Z - E1

Valve size

10: 10 mm [0.394 in.] width

#### Common connector assembly

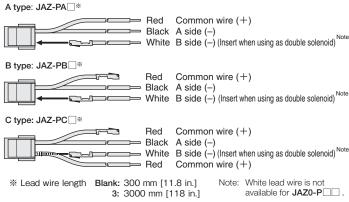

Remark: Connector for negative common type also available. For details,

#### Individual air supply and / Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws exhaust spacer



Specification 10: 10 mm [0.394 in.] NPM: Individual air supply spacer

(with M5 female thread for F10)

NRM: Individual exhaust spacer (with M5 female thread for F10)

For details, see p. 27.

※ Not available with DIN connectors (-39□).

Manifold Order Code Example (6 units of F10 Series)

#### F10M6AL

stn.1  $\sim$  2 F10T0-A1-PS-J5 DC24V F10T2-A1-PS-J6 DC24V

stn.6 F10BP-J6

Note: This order code example has no relationship to the illustration at upper right

### Muffler

**KM** - **J**[

Fitting size

**6:** Outer diameter  $\phi$  6 (for individual exhaust spacer)

8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

#### Precautions for Order Codes

- Manifold outlet specification
- Select from among "dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, F  $\square$  **Z-J** (dual use fitting block), F  $\square$  **Z-J**  $\square$  (single use fitting block), or F  $\square$  **Z-M**  $\square$  (female thread block), on p. 67.
- Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66. Note, however, that the only available valve outlet type is A1. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

#### Connector-related order codes

**JAZ0 - P -** (for single use only) **JAZ - P -** (for double use only) Valve Connector specification Valve Connector specification

specification For **T2**, **T3**, **T4**, **T5, TA, TB,** or TC

CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB : Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*\* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

Notes: 1. When the valve specification is **T1**, select the **JAZ0-P-** ☐ single dedicated type

- 2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and
- double type).

  3. There is no white lead wire for the JAZ0-P- .
- 4. It is necessary to disassemble the connector to add a common
- connector assembly. Contact your nearest KOGANEI sales office.

  5. For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.

  6. For information on replacing the waterproof seal, contact your
- nearest KOGANEI sales office.


specification CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead For T0/T1

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* **PC**: Positive common C type, lead wire length 300 mm [11.8 in.]  $\times$ PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

# F10 Series Monoblock Manifold F Type (Direct Piping Type) Order Codes

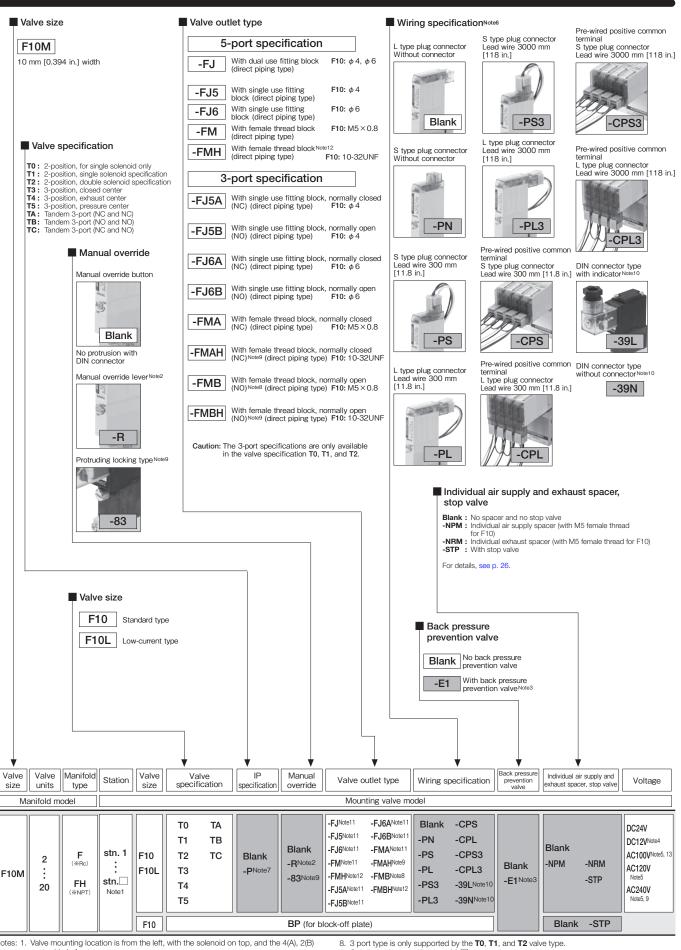

- - ports side in front.
  - 2. When the valve specification is  ${\bf T1}$  or  ${\bf T2}$ , the manual override lever is placed only on the A side. This is not available with **-39**
  - 3. Not available with the individual exhaust spacer.4. Not available in low-current type.

  - 5. Not available in low-current type and tandem 3-port valves.
    6. The -P ☐ (including when Blank) and -CP ☐ wiring specifications cannot be mixed.
  - 7. The IP65 protective structure around an electrical device that prevents the
  - infiltration of solid foreign material and water from outside.
- 9. Only for wiring specification -39
- 10.Not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2.
- 11. Can be selected only when the manifold type is F.
  12. Can be selected only when the manifold type is FH.
- Not available with DIN connectors (-39 □).
- Remarks: 1. The external pilot type valve cannot be mounted on the F type manifold.
  - Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.


# Gasket (gasket and exhaust valve)


# F10Z - GS1 Valve size 10: 10 mm [0.394 in.] width

# Block-off plate (block-off plate and 2 mounting screws)




#### Connector-related order codes



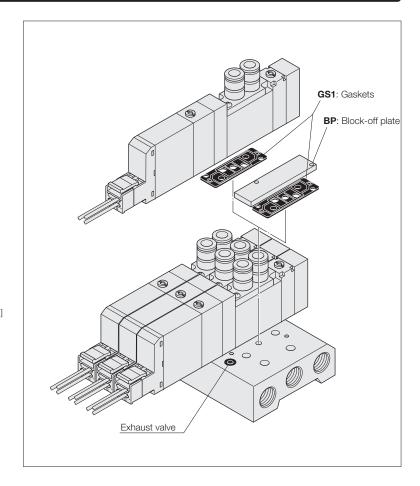



#### Common connector assembly

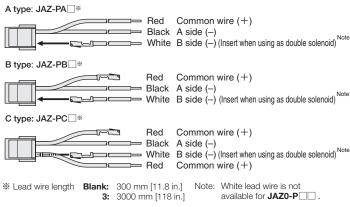

Remark: Connector for negative common type also available. For details, see p. 22.


# Back pressure prevention valve (for monoblock type, 2 pieces)

F10Z - E1

Valve size **10:** 10 mm [0.394 in.] width

#### Individual air supply and exhaust spacer

Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws



※ For details, see p. 27

※ Not available with DIN connectors (-39□).

# Manifold Order Code Example

(4 units of F10 Series)

#### F10M4F

stn.1  $\sim$  2 F10T0-FJ5-PS DC24V stn.3 F10T2-FJ6-PS DC24V

F10BP


stn.4

Note: This order code example has no relationship to the illustration at upper right.

#### **Precautions for Order Codes**

#### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66.
Select from valve outlet types -FJ, -FJ5, -FJ6, -FM5, -FJ5B, -FJ6A, -FJ6B, -FMA, or -FMB. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.



#### Connector-related order codes

**JAZ - P -** (for double use only) Valve Connector specification specification CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, For **T2**, **T3**, **T4**, white, for total of 3 lead wires) **T5, TA, TB,** or CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, TC white, for total of 3 lead wires) PA : Positive common A type, lead wire length 300 mm [11.8 in.]\*\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB : Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*\* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\* \*A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P- single dedicated type.

- 2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type).

  3. There is no white lead wire for the **JAZ0-P-** .
- 4. It is necessary to disassemble the connector to add a common
- connector assembly. Contact your nearest KOGANEI sales office.

  5. For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.

  6. For information on replacing the waterproof seal, contact your
- nearest KOGANEI sales office.


**JAZ0 - P -** (for single use only)

Valve specification For T0/T1

#### Connector specification

- CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead
- CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead
- PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
- PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* **PC**: Positive common C type, lead wire length 300 mm [11.8 in.]  $\times$
- PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

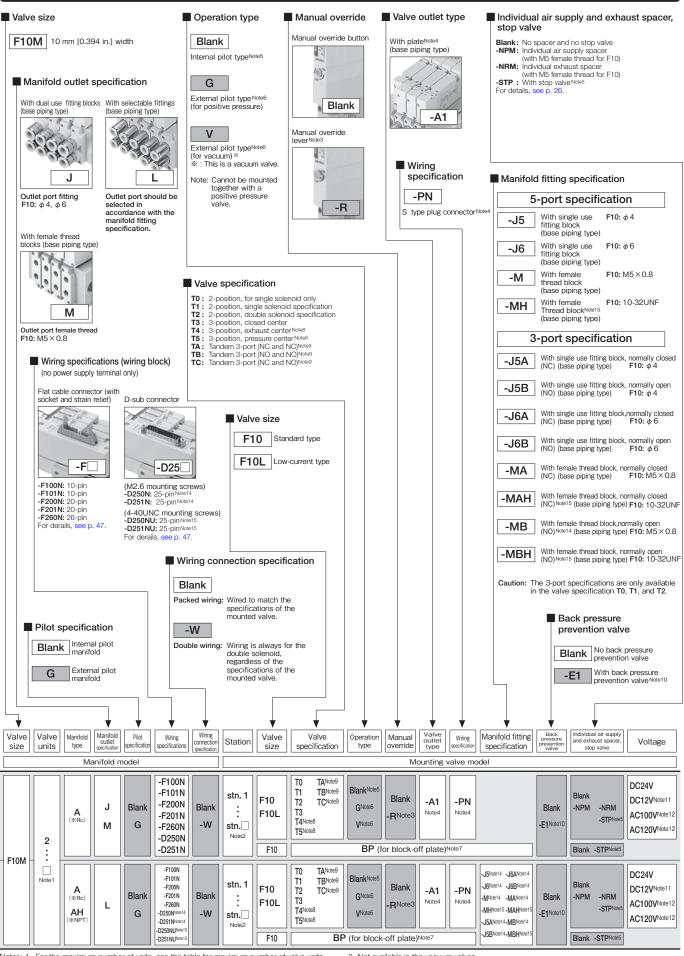

- Notes: 1. For the maximum number of units, see the table for maximum number of valve units by wiring specification, on p. 77.
  - Nalve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
     When the valve specification is **T1** or **T2**, the manual override lever is placed only on the A side.

  - Always enter -A1 and -PN.
  - Cannot be mounted on the external pilot manifold.

  - Cannot be mounted on the internal pilot manifold.

    Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For single wiring, see p. 77.
- 8. Not available in the vacuum valves.
- Not available in external pilot type and vacuum valves.
- Not available with the individual exhaust spacer and vacuum valve.
   Not available in low-current type.
- Not available in low-current type and tandem 3-port valves. In addition, only available when the wiring specification is a D-sub connector.
- 13. 3 port type is only supported by the T0, T1, and T2 valve type.
- 14. Can be selected only when the manifold type is A
- 15. Can be selected only when the manifold type is **AH**.

# Gasket (gasket and exhaust valve)

F10Z - GS1

Valve size

10: 10 mm [0.394 in.] width

# Block-off plate (block-off plate and 2 mounting screws)



Valve size

10: 10 mm [0.394 in.] width


# Back pressure prevention valve

(for monoblock type, 2 pieces)

F10Z - E1

10: 10 mm [0.394 in.] width

## Individual air supply and exhaust spacer





Specification

NPM: Individual air supply spacer (with M5 female thread for F10) [0.394 in.] width NRM: Individual exhaust spacer (with M5 female thread for F10)

\* For details, see p. 27.

# Muffler



Fitting size

**6:** Outer diameter  $\phi$  6 (for individual exhaust spacer) 8: Outer diameter  $\phi$  8 (for individual exhaust spacer) (Sales unit: Set of 10 mufflers)

# Manifold Order Code Example

(6 units of F10 Series)

#### F10M6AL-F201N

stn.1 ~ 2 F10T0-A1-PN-J5 DC24V stn.3  $\sim$  5 F10T2-A1-PN-J6 DC24V

F10BP-J6

Note: This order code example has no relationship to the illustration at upper right.

# Table for maximum number of valve units by wiring specification

		Maximum number of units		
		Wiring connection specification		
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)	
F100N Flat cable (10P)	8	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less.	4 units	
F101N Flat cable (10P)	8		4 units	
F200N Flat cable (20P)	16		8 units	
F201N Flat cable (20P)	16		8 units	
F260N Flat cable (26P)	20		10 units	
D250ND-sub connector (25P)	16		8 units	
D251ND-sub connector (25P)	20		10 units	

GS1: Gaskets

RP: Block-off plate

#### **Precautions for Order Codes**

Manifold outlet specification

Select from among "dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, F 🗆 Z-J (dual use fitting block), **F**  $\square$  **Z-J**  $\square$  (single use fitting block), or **F**  $\square$  **Z-M**  $\square$  (female thread block), on p. 67

Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66. Note, however, that the only available valve outlet type is A1.


Wiring connection specification
 Blank (packed wiring): Wired to match the specifications of the mounted valve.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

#### Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case.

# F10 Series Monoblock Manifold F Type, Wire-Saving Type (Direct Piping Type) Order Codes

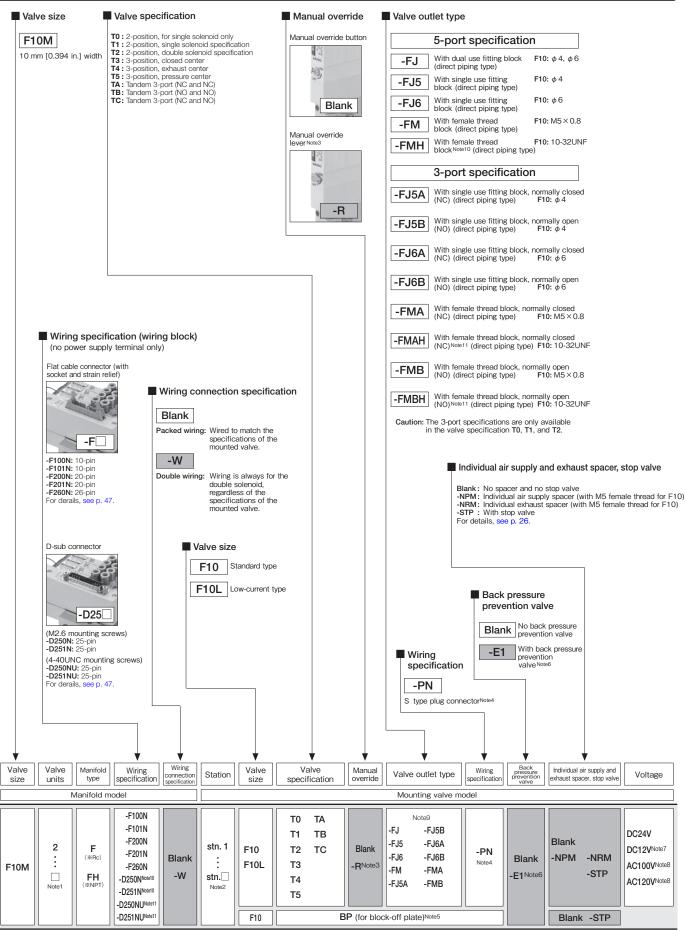

- Notes: 1. For the maximum number of units, see the table for maximum number of valve units
  - by wiring specification, on p. 79. 2. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B)
  - ports side in front.

    3. When the valve specification is **T1** or **T2**, the manual override lever is placed only on
  - Always enter -PN
  - Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For single wiring, see p. 79.
- 6. Not available with the individual exhaust spacer.
- 7. Not available in low-current type.
  8. Not available in low-current type and tandem 3-port valves. In addition, only available when
- the wiring specification is a D-sub connector.

  9. 3 port type is only supported by the T0, T1, and T2 valve type.
- Can be selected only when the manifold type is F.
   Can be selected only when the manifold type is FH.

Remark: The external pilot type valve cannot be mounted on the F type manifold.

# Gasket (gasket and exhaust valve)

F10Z - GS1

Valve size

10: 10 mm [0.394 in.] width

# Block-off plate (block-off plate and 2 mounting screws)



Valve size

10: 10 mm [0.394 in.] width

#### Back pressure prevention valve

(for monoblock type, 2 pieces)

10: 10 mm [0.394 in.] width

# Individual air supply and /Spacer for non-plug-in type, gasket, exhaust spacer

exhaust valve, and 2 mounting screws



Specification

NPM: Individual air supply spacer (with M5 female thread for F10) NRM: Individual exhaust spacer (with M5 female thread for F10)

※ For details, see p. 27.

#### Muffler



**6:** Outer diameter  $\phi$  6 (for individual exhaust spacer)

8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

# Manifold Order Code Example

(4 units of F10 Series)

#### F10M4F-F201

stn.1~2 F10T0-FJ5-PN DC24V

F10T2-FJ6-PN DC24V stn.3

F10BP stn.4

Note: This order code example has no relationship to the illustration at upper right

# Table for maximum number of valve units by wiring specification

		Maximum number of units		
		Wiring connection specification		
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)	
F100N Flat cable (10P)	8	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less.	4 units	
F101N Flat cable (10P)	8		4 units	
F200N Flat cable (20P)	16		8 units	
F201N Flat cable (20P)	16		8 units	
F260N Flat cable (26P)	20		10 units	
D250N D-sub connector (25P)	16		8 units	
D251N D-sub connector (25P)	20		10 units	

GS1: Gaskets

BP: Block-off plate

#### **Precautions for Order Codes**

Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66.
Select from valve outlet types -FJ, -FJ5, -FJ6, -FM□, -FJ5A, -FJ5B, -FJ6A, -FJ6B, -FMA□, or -FMB□.


Wiring connection specification

Blank (packed wiring): Wired to match the specifications of the mounted valve.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add **-1W** to the end of the block-off plate order code in the case.


# F10 Series PC Board Manifold A Type (Base Piping Type) Order Codes

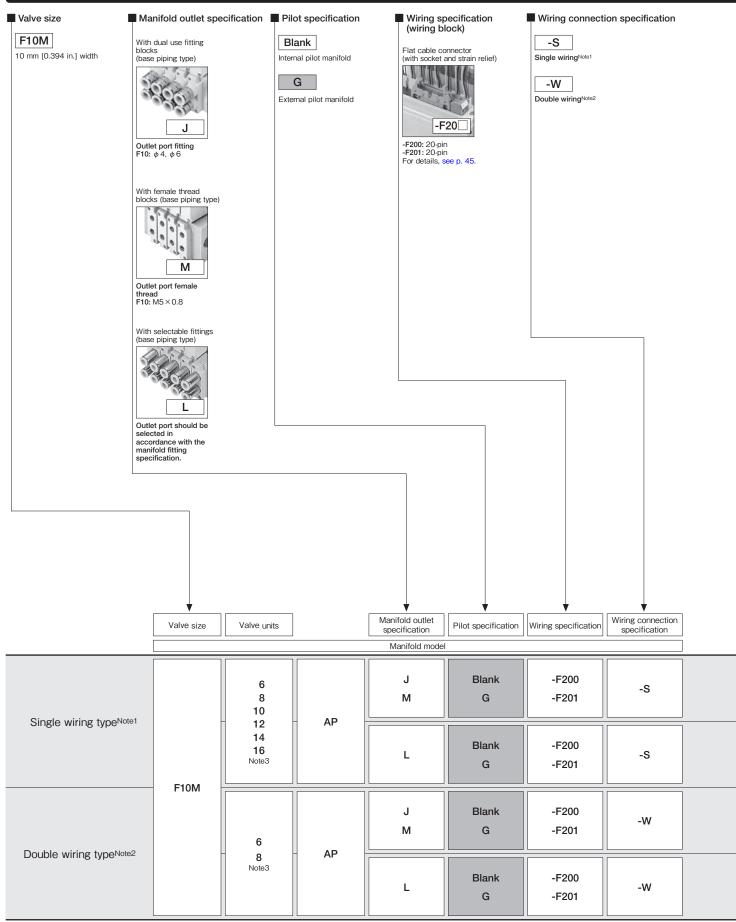

Notes: 1. Wiring is for the single solenoid only. Note that this is not the same as packed wiring. The mounting valves are limited to single solenoid only (T0, T1 specifications). Therefore, even if the T1 specification valve is switched over to a double solenoid, no power will be applied to the B side solenoid.

<sup>2.</sup> Wiring is always for the double solenoid, regardless of the specifications of the mounted valves.

3. In terms of wiring connection specifications, the number of units for single wiring is 6-16 (even numbers only) and for double wiring is 6 or 8.

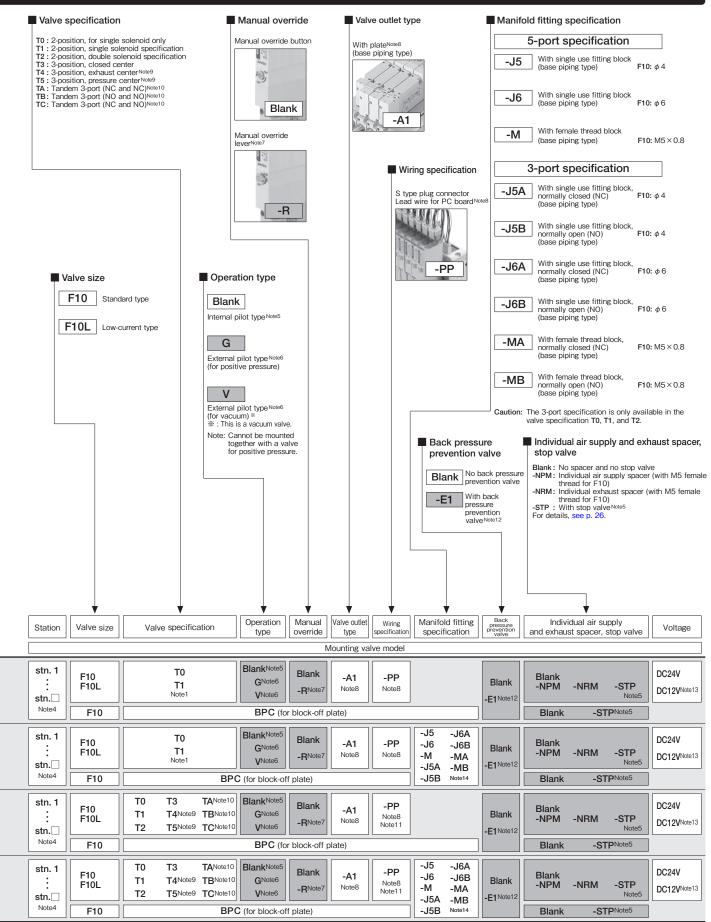

4. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front 5. Cannot be mounted on the external pilot manifold.

- Cannot be mounted on the internal pilot manifold.

  Cannot be mounted on the internal pilot manifold.

  When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
- 8. Always enter -A1 and -PP.
- 9. Not available in the vacuum valves.
- 10. Not available in external pilot type and vacuum valves.11. The lead wire on the solenoid B side (white) is not available in valve specification T0.
- Not available with the individual exhaust spacer and vacuum valve.
   Not available in low-current type.
- 14. The 3-port specification is only available in the valve specification T0, T1, and T2.

# Gasket (gasket and exhaust valve)





#### Block-off plate

(block-off plate, 2 mounting screws, and housing)



#### Connector-related order codes







Note: White lead wire is not available for JAZ0-P

# Back pressure prevention valve

(for monoblock type, 2 pieces)



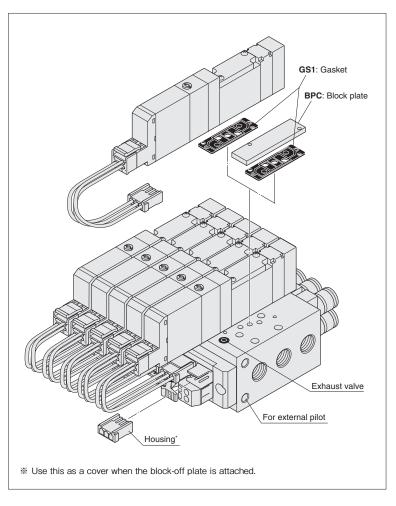

#### Individual air supply and / Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws exhaust spacer



\* For details, see p. 27.

# Manifold Order Code Example

(8 units of F10 Series)

#### F10M8APL-F201-W

stn.1~4 F10T0-A1-PP-J5 DC24V stn.5~7 F10T2-A1-PP-J6 DC24V stn.8 F10BPC-J6

Note: This order code example has no relationship to the illustration at upper right

#### Muffler

6: Outer diameter  $\phi$  6 (for individual exhaust spacer) 8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

#### **Precautions for Order Codes**

Orders for valves only


Enter the code Valve size Valve specification Pilot specification Manual override - Valve outlet type - PP Voltage to order.

Wiring connection specification

When the lead wire for the PC board is not required, enter -PN.

-S (single wiring): Wiring for single solenoid only -W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

# F10 Series PC Board Manifold F Type (Direct Piping Type) Order Codes

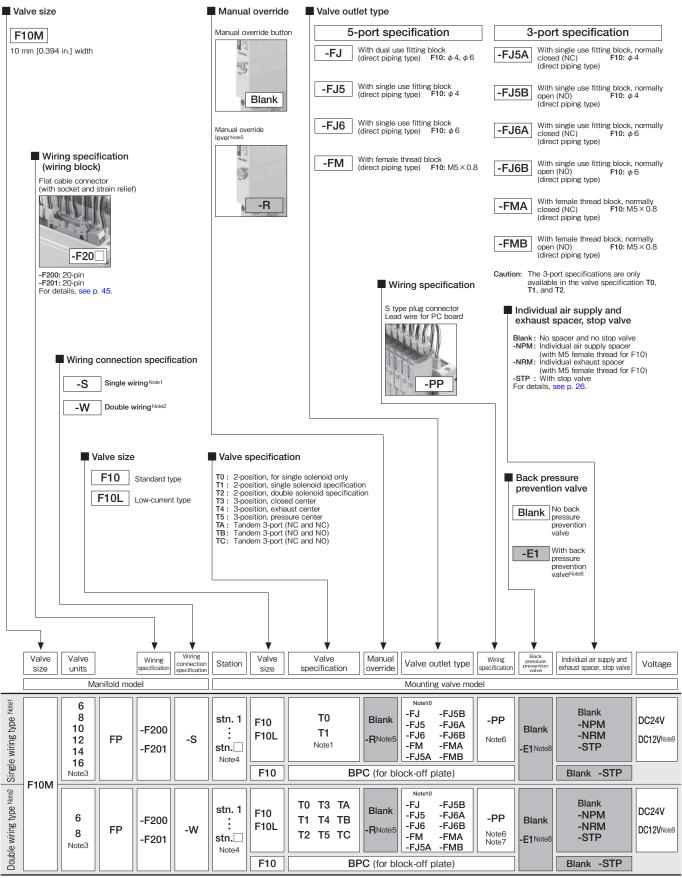

Notes: 1. Wiring is for the single solenoid only. Note that this is not the same as packed wiring. The mounting valves are limited to single solenoid only (T0, T1 specifications). Therefore, even if the T1 specification valve is switched over to a double solenoid, no power will be applied to the B side solenoid.

- Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

  In terms of wiring connection specifications, the number of units for single wiring is 6-16 (even numbers only) and for double wiring is 6 or 8. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

  When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

- Always enter -PP.
   The lead wire on the solenoid B side (white) is not available in valve specification T0.
- 8. Not available with the individual exhaust spacer
- 9. Not available in low-current type.
- 10. The 3-port specifications are only available in the valve specification T0, T1, and T2.

GS1: Gaskets

BPC: Block-off plate

# Gasket (gasket and exhaust valve)

F10Z - GS1

Valve size 10: 10 mm [0.394 in.] width


### Block-off plate


(block-off plate, 2 mounting screws, and housing)



10: 10 mm [0.394 in.] width

# Connector-related order code







Note: White lead wire is not available for JAZ0-P□.

# Back pressure prevention valve

(for monoblock type, 2 pieces)



10: 10 mm [0.394 in.] width

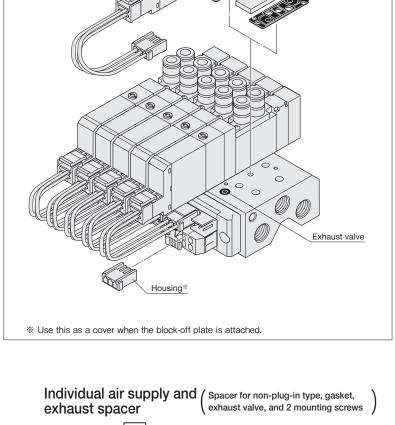

F10Z -

Valve size Specification

10: 10 mm [0.394 in.] NPM: Individual air supply spacer (with M5 female thread for F10) width NRM: Individual exhaust spacer (with M5 female thread for F10)

For details, see p. 27.

# Manifold Order Code Example

(8 units of F10 Series)

#### F10M8FP-F201-W

stn.1~4 F10T0-FJ5-PP DC24V stn.5~7 F10T2-FJ6-PP DC24V

F10BPC stn.8

Note: This order code example has no relationship to the illustration at upper right.

# Muffler

**KM** - **J**[

6: Outer diameter  $\phi$  6 (for individual exhaust spacer) 8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

#### **Precautions for Order Codes**


Orders for valves only

Enter the code Valve size Valve specification Manual override - Valve outlet type - PP Voltage to order.


Wiring connection specification

When the lead wire for the PC board is not required, enter -PN.

-S (single wiring): Wiring for single solenoid only.
-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

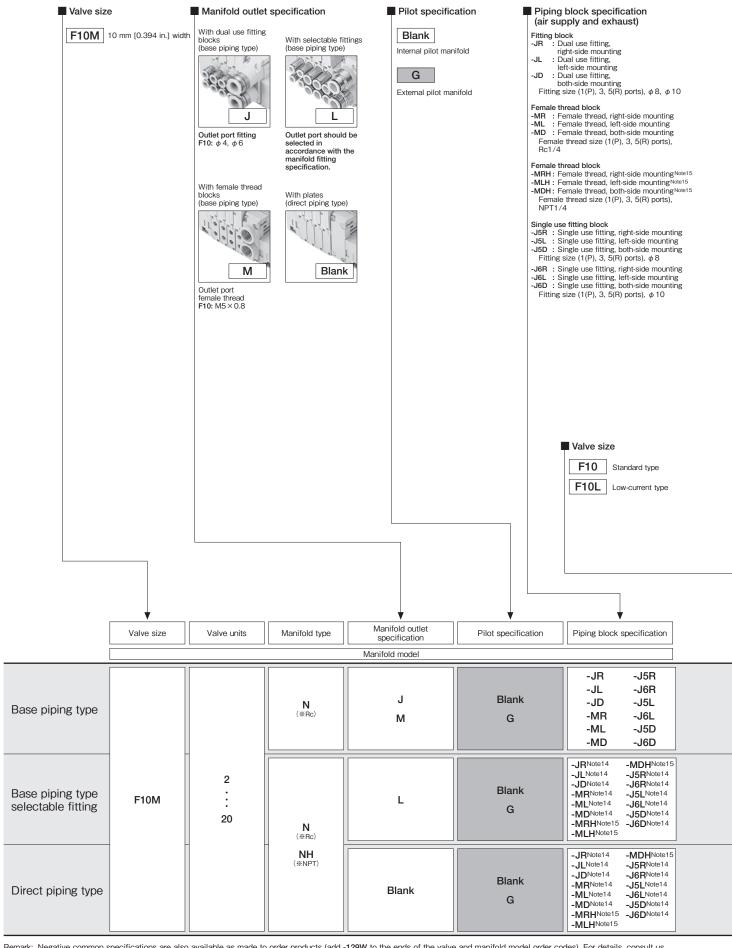

Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

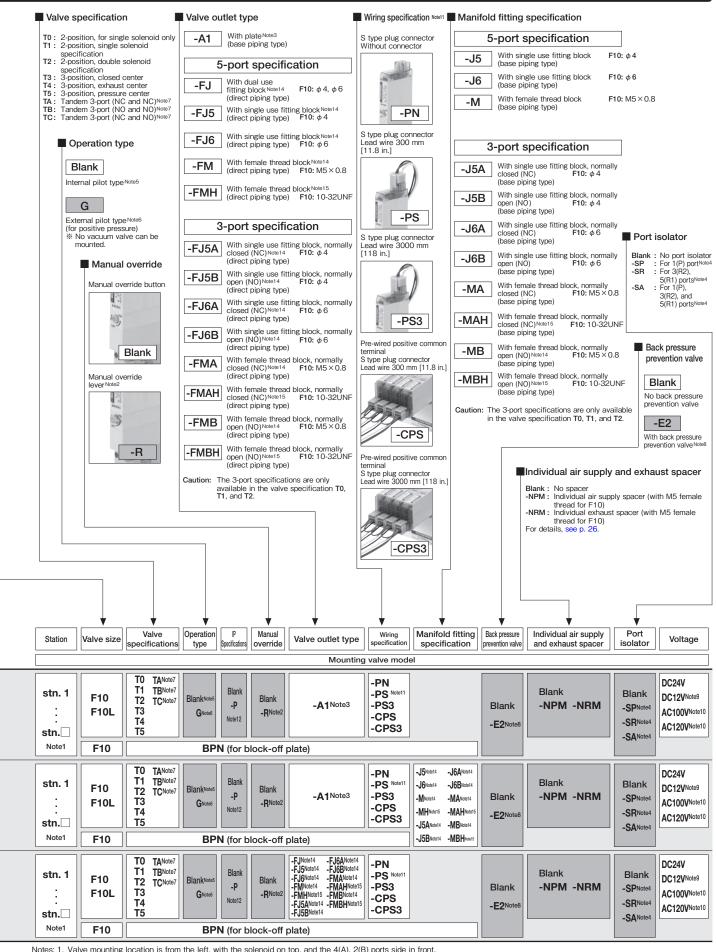

- 1. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
  2. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  3. When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.
  4. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.). 10.Not available in low-current type and tandem 3-port valves.
  - 5. Cannot be mounted on the external pilot manifold.
    6. Cannot be mounted on the internal pilot manifold.
    7. Not available in external pilot type.

  - Not available with the individual exhaust spacer
     Not available in low-current type.

- 11. Wiring specifications of -P ☐ and -CP ☐ cannot be mounted together.

  12. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- 13.The 3-port specifications are only available in the valve specification T0, T1, and T2.
  14.Can be selected only when the manifold type is N.
  15.Can be selected only when the manifold type is NH.

## Parts for manifold


#### F10Z -Parts content Valve size 10: 10 mm [0.394 in.] GS2: Gasket (gasket and exhaust valve) : Port isolator (for 1(P) port) width : Port isolator (for 3(R2), 5(R1) ports) : Port isolator (for 1(P), 3(R2), 5(R1) ports)

# Block-off plate (block-off plate, 2 mounting screws, and plug)




#### Connector-related order codes


\* For details, see p. 19.

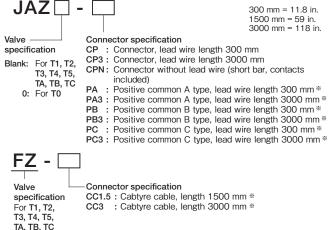


#### Common connector assembly

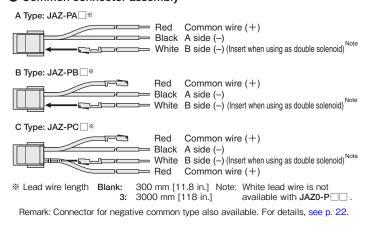

# Piping block assembly




#### End blocks (one set of left and right)




# Back pressure prevention valve

(2 pieces for split type, with dedicated gasket)



# Individual air supply and ( Spacer for non-plug-in type, gasket, exhaust spacer

exhaust valve, and 2 mounting screws

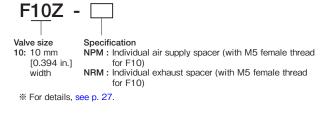

### Muffler





6: Outer diameter  $\phi$ 6 (for individual exhaust spacer) 8: Outer diameter  $\phi$ 8 (for individual exhaust spacer) 10: Outer diameter φ10

(Sales unit: Set of 10 mufflers)

# DIN rail

# Valve base assembly (valve base and gasket)

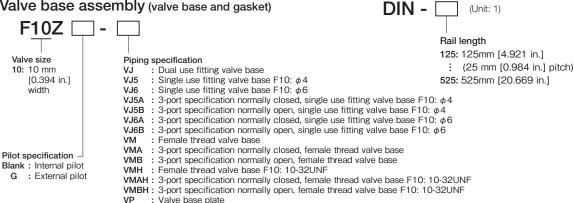

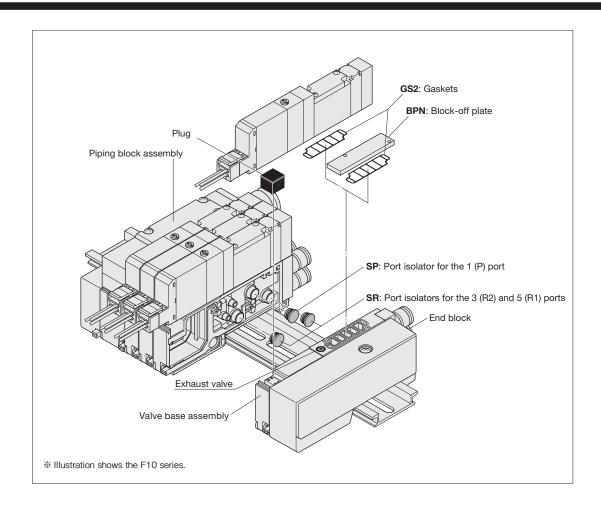

# Manifold Order Code Example

(4 units of F10 Series)

#### F10M4NL-J5R

stn.1~2 F10T0-A1-PS-J5 DC24V stn.3 F10T2-A1-PS-J6 DC24V

stn.4 F10BPN-J6

Note: This order code example has no relationship to the illustration above.

# **Precautions for Order Codes**

Orders for valves only
Place orders from "Single Valve Unit Order Codes" on p. 66.
However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. And for the wiring specification, Blank, PL, and PL3 cannot be selected. In addition, for common terminal wiring connections, separately order the common connector assemblies listed on the previous page.

#### Connector-related order codes

#### **JAZ - P -** (for double use only) Valve Connector specification CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, specification For **T2**, **T3**, **T4**, white, for total of 3 lead wires) T5, TA, TB, or CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, TC white, for total of 3 lead wires) PA : Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB: Positive common B type, lead wire length 300 mm [11.8 in.]\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*

Notes: 1. When the valve specification is T1, select the JAZ0-P- single dedicated type.


\*A common connector assembly.

2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and

PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*

PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

- 3. There is no white lead wire for the **JAZ0-P-** .
- 4. It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office. 5. For information on use in locations/atmospheres subject to
- substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.
- 6. For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.




#### Valve specification For T0/T1

#### Connector specification

- CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead
- CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead
- PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB : Positive common B type, lead wire length 300 mm [11.8 in.]\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.] \* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

**X**A common connector assembly.

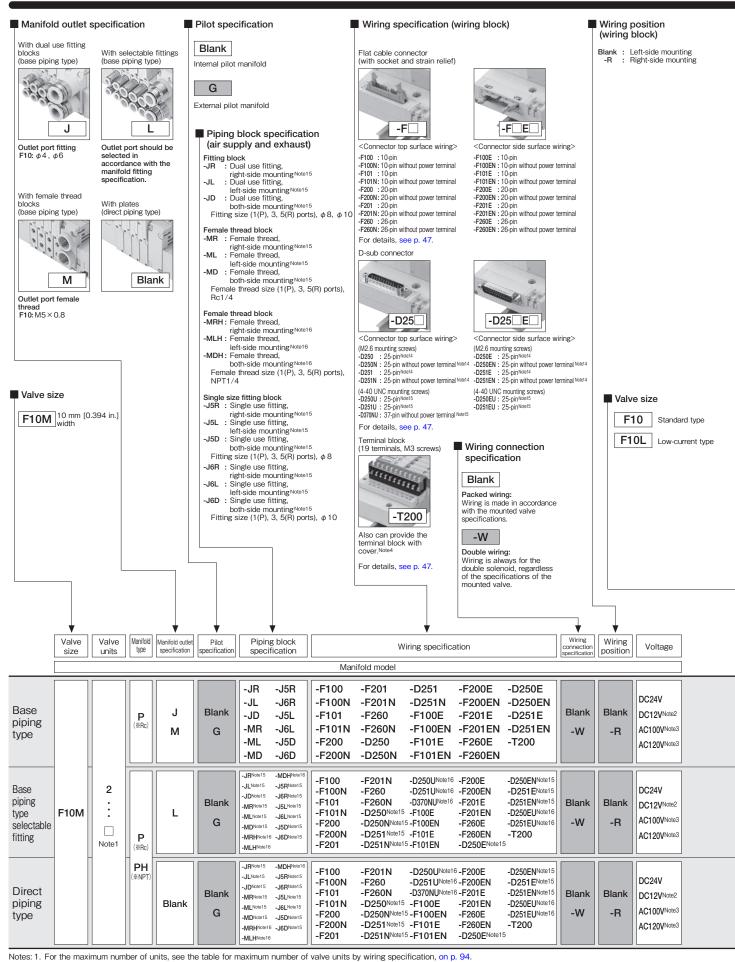

Por the maximum humber of drifts
 Not available in low-current type.


4. The terminal block with cover is also available as a made to order product (add -139W to the end of the manifold model order code). For details, consult us.

5 Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

- 6 When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type
- 7 Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For wiring for a single solenoid, see p. 71.

  Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

<sup>3.</sup> AC100V, AC120V is available only for the -D250 , -D251 , -D370NU (D-sub connector) and -T200 (terminal block) wiring specifications. In addition, not available in low-current type and tandem 3-port valves.

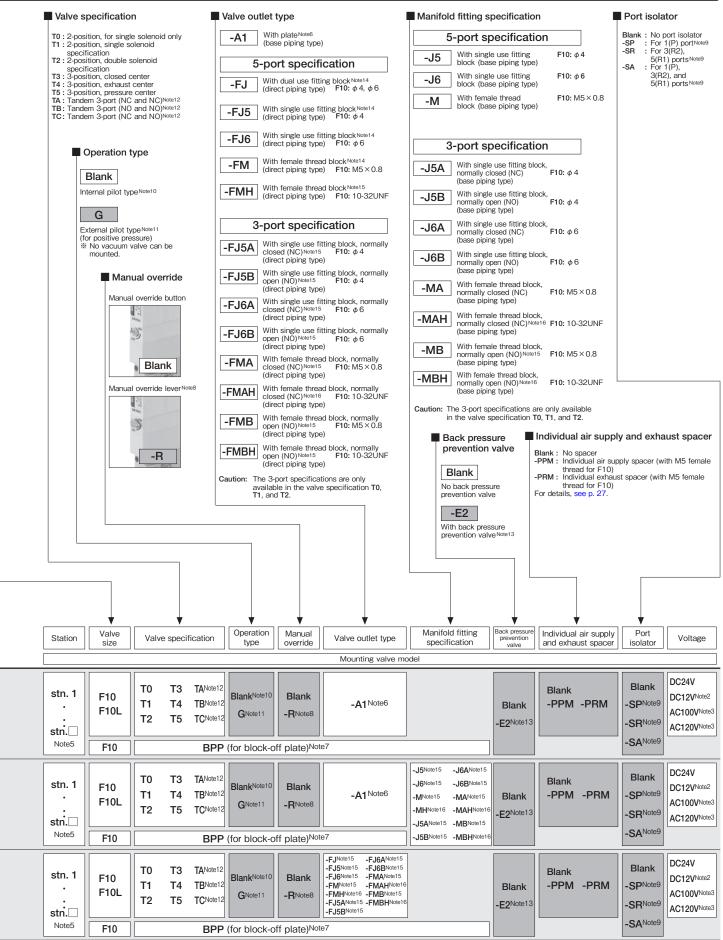


- 8. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  - 9. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
  - Cannot be mounted on the external pilot manifold.
     Cannot be mounted on the internal pilot manifold.


  - 12. Not available in external pilot type.13. Not available with the individual exhaust spacer.

  - 14. The 3-port specifications are only available in the valve specification T0, T1, and T2.
- 15. Can be selected only when the manifold type is P
- 16. Can be selected only when the manifold type is PH.


#### Parts for manifold



# Block-off plate (block-off plate, 2 mounting screws, and plug)




#### Valve base assembly (valve base, gasket, lead wire, and plug-in connector)

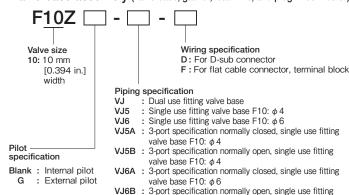

valve base F10: φ6 : Female thread valve base

: Valve base plate

Wiring block assembly (one set)

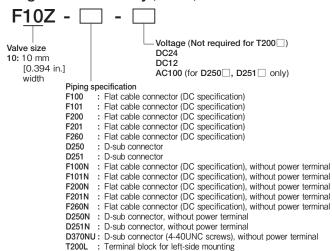

: Terminal block for right-side mounting


# Back pressure prevention valve

T200R

(2 pieces for split type, with dedicated gasket)




#### Individual air supply and /Spacer for plug-in type, gasket, exhaust spacer exhaust valve, and 2 mounting screws




# Piping block assembly

VMA

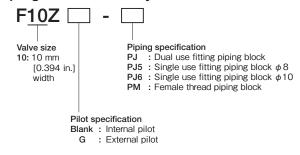


#### End blocks (one set of left and right)




#### Table for maximum number of valve units by wiring specification

		Maximum number of units	
		Wiring connection specification	
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
F100 ☐ Flat cable (10P)	8	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less. D370NU is a maximum of 20 units.	4 units
F101 ☐ Flat cable (10P)	8		4 units
F200 ☐ Flat cable (20P)	16		8 units
F201 ☐ Flat cable (20P)	16		8 units
F260 ☐ Flat cable (26P)	20		10 units
D250 D-sub connector (25P)	16		8 units
D251 ☐ D-sub connector (25P)	20		10 units
D370NU D-sub connector(37P)	32		16 units
T200 Terminal block (19 terminals)	18		9 units

#### Muffler **DIN** rail KM - J□ **DIN** - [ (Unit:1) Fitting size Rail length **6:** Outer diameter $\phi$ 6 (for individual exhaust spacer) **125:** 125mm [4.921 in.] 8: Outer diameter $\phi$ 8 (for individual exhaust spacer) 10: Outer diameter $\phi$ 10 : (25 mm [0.984 in.] pitch) **525:** 525mm [20.669 in.] (Sales unit: Set of 10 mufflers)

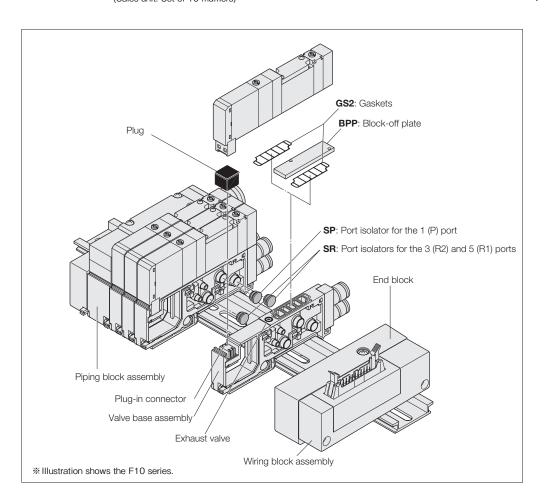



# **Precautions for Order Codes**

Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66.

However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.


Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.

# F10 Series Split Manifold Serial Transmission Type Order Codes

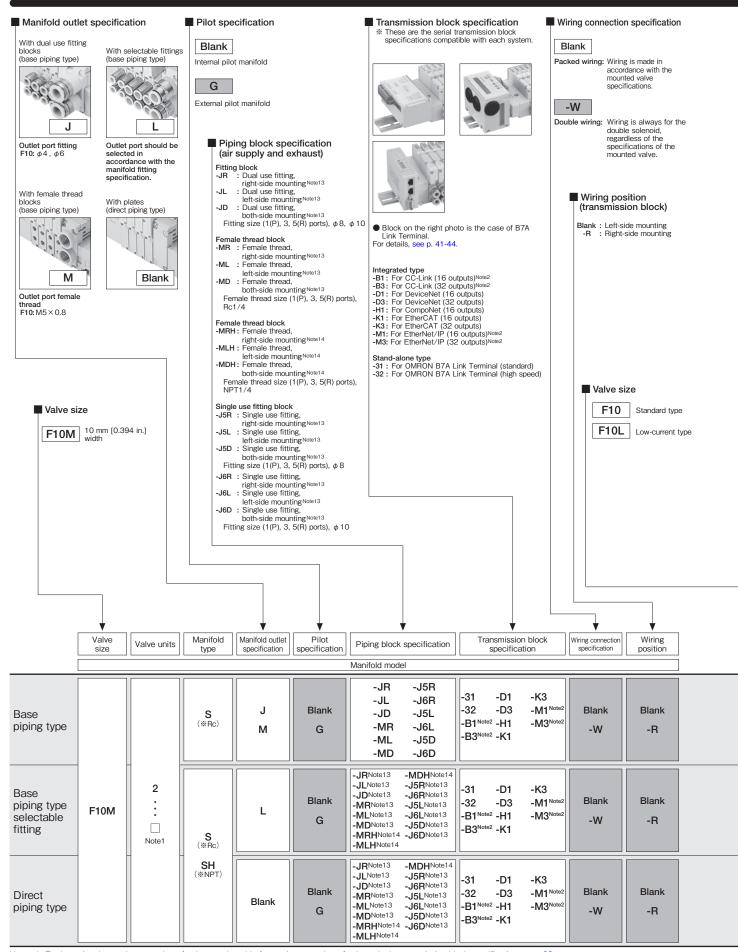

To determine the maximum number of units, see the table for maximum number of valve units by transmission block specification, on p. 98.


Complies with the CE marking regulation.

Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

When selecting J, M, or L (base piping type) for the manifold outlet specifications, always enter -A1 (with plate) for the valve outlet type.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case.

6. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

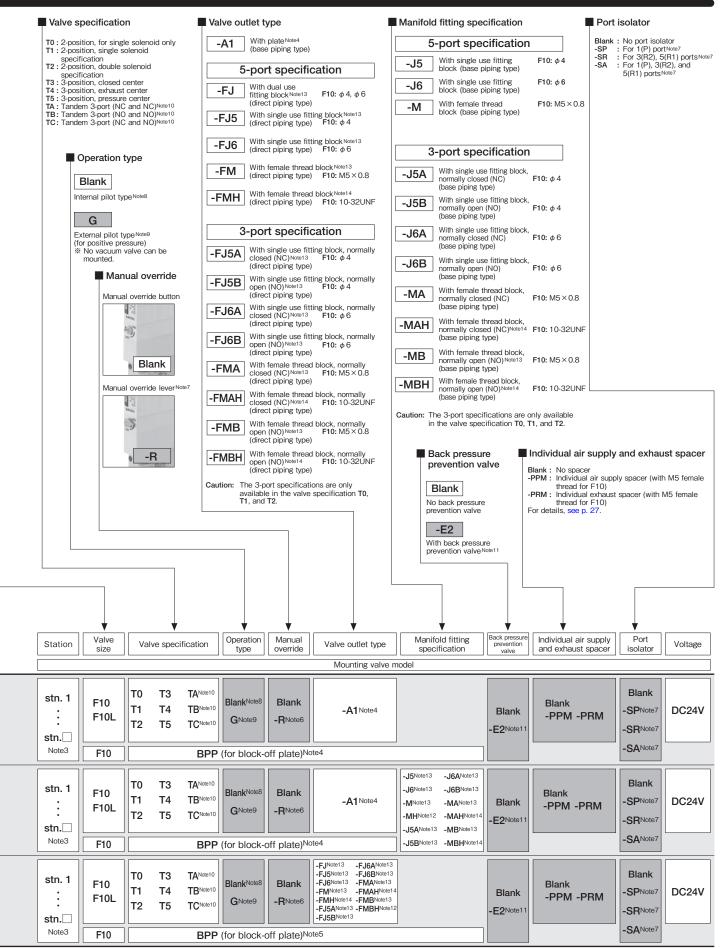

- Notes: 7. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
  - 8. Cannot be mounted on the external pilot manifold
  - Cannot be mounted on the internal pilot manifold.
     Not available in external pilot type.

  - 11.Not available with the individual exhaust spacer
  - 12. The 3-port specifications are only available in the valve specification T0, T1, and T2.
  - 13.Can be selected only when the manifold type is S
  - 14.Can be selected only when the manifold type is SH.

## Parts for manifold


F10Z -Parts content 10: 10 mm [0.394 in.] GS2: Gasket (gasket and exhaust valve) : Port isolator (for 1(P) port) width : Port isolator (for 3(R2), 5(R1) ports) : Port isolator (for 1(P), 3(R2), 5(R1) ports)

# Block-off plate (block-off plate, 2 mounting screws, and plug)




#### Valve base assembly

(valve base, gasket, lead wire, and plug-in connector)

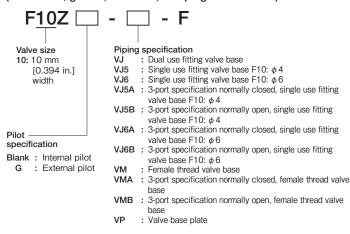

#### Piping block assembly

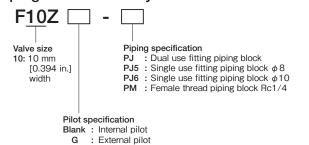


#### Back pressure prevention valve

(2 units for split type, with dedicated gasket)

#### Individual air supply and (Spacer for plug-in type, gasket, exhaust valve, and 2 mounting screws exhaust spacer




# Serial transmission block (single unit)





B1 : For CC-Link (16 outputs) B3 : For CC-Link (32 outputs) D1: For DeviceNet (16 outputs) D3: For DeviceNet (32 outputs) H1: For CompoNet (16 outputs)


M3: For EtherNet/IP (32 outputs)



## Table for maximum number of valve units by transmission block specification

	Maximum number of units		
	Wiring connection specification		
Transmission block specifications	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
-31: For Omron B7A Link Terminal (standard)	16		8 units
-32: For Omron B7A Link Terminal (high speed)	16	Varies depending on the number of mounted	8 units
-B1: For CC-Link (16 outputs)	16	single solenoids, double solenoids, and block-off plates.  The number of controlled solenoids should be designated as the maximum number of outputs or lessB3, -D3,	8 units
-B3: For CC-Link (32 outputs)	32		16 units
-D1: For DeviceNet (16 outputs)	16		8 units
-D3: For DeviceNet (32 outputs)	32		16 units
-H1: For CompoNet (16 outputs)	16		8 units
-K1: For EtherCAT (16 outputs)	16		8 units
-K3: For EtherCAT (32 outputs)	32		16 units
-M1: For EtherNet/IP (16 outputs)	16	-K3, and -M3 are a maximum of 20 units.	8 units
-M3: For EtherNet/IP (32 outputs)	32	maximum or 20 units.	16 units

# End blocks (one set of left and right)



# Wiring block assembly \*

F10Z -	F201N	-	DC24
Valve size			

10: 10 mm [0.394 in.] width


<sup>\*</sup> Use this when the transmission block specification is -31, or -32.

#### Muffler


KM - J

- Fitting size

  6: Outer diameter φ6 (for individual exhaust spacer)
- 8: Outer diameter  $\phi$ 8 (for individual exhaust spacer)
- 10: Outer diameter  $\phi$ 10 (Sales unit: Set of 10 mufflers)



**125:** 125mm [4.921 in.] : (25 mm [0.984 in.] pitch) 525: 525mm [20.669 in.]

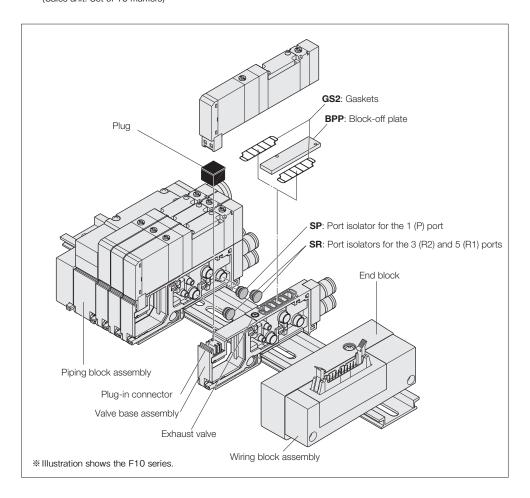

# Manifold Order Code Example

(8 units of F10 Series)

# F10M8SL-J5R-B1-W

stn.1~5 F10T0-A1-J5 DC24V stn.6~7 F10T2-A1-J6 DC24V stn.8 F10BPP-J6

Note: This order code example has no relationship to the illustration above.

#### **Precautions for Order Codes**

 Orders for valves only Place orders from "Single Valve Unit Order Codes" on p. 66. However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.


#### Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.


# F10 Series Easy Assembly Type Manifold Non-Plug-in Type Order Codes

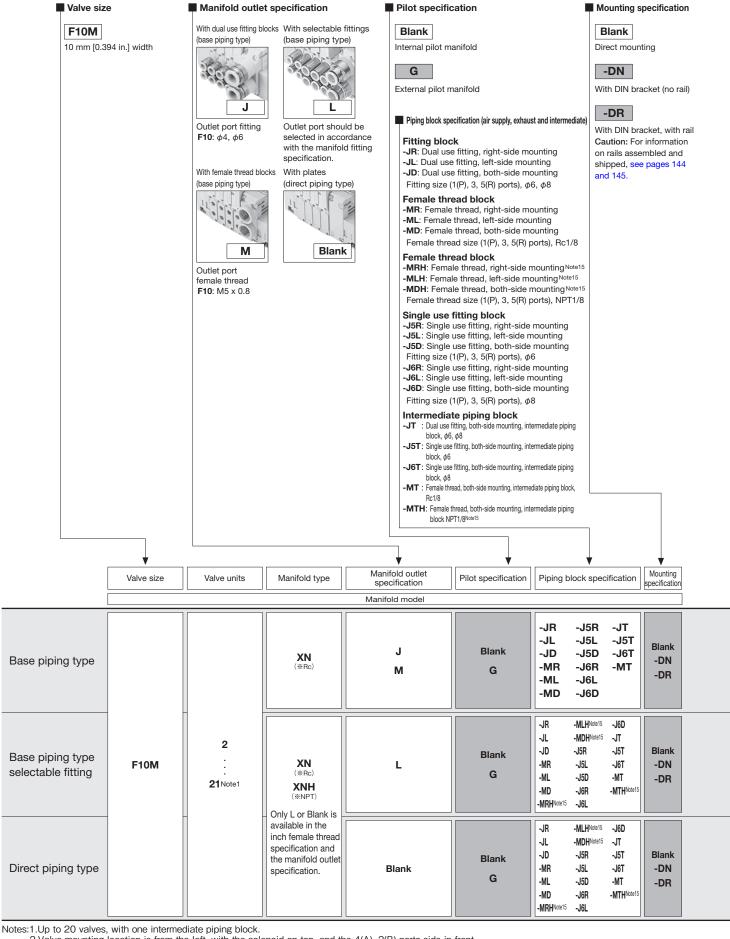

- 2. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
- 3. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

<sup>4.</sup> When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.


5. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -XSA, or 1 each port isolator for -XSP and -XSR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).

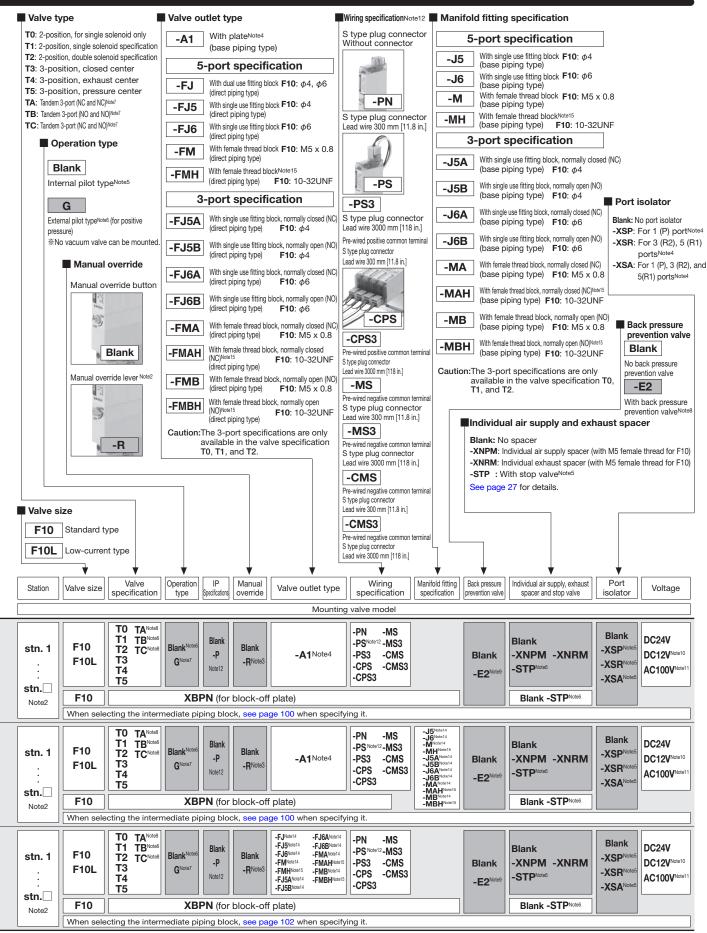

- Notes:6.Cannot be mounted on the external pilot manifold. Only direct mounting is available.
  - 7. Cannot be mounted on the internal pilot manifold.
  - 8.Not available in external pilot type.
  - 9.Not available with the individual exhaust spacer.
  - 10.Not available in low-current type.
  - 11. Not available in low-current type and tandem 3-port valves.
- 12. Wiring specifications of -P\(\sigma\) and -CP\(\sigma\), the -M\(\sigma\) and -CM\(\sigma\), positive common and negative common cannot be mounted together.
- 13. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- The 3-port specifications are only available in the valve specification T0, T1, and T2.
- 15. Can be selected only when the manifold type is **XNH**.

# Intermediate piping block

(When mounting an intermediate piping block to the manifold, complete the following type and specify the station specified on page 101.)

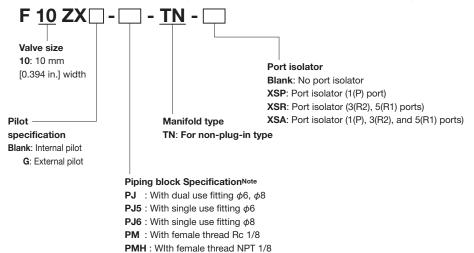

Note:See the following table for combinations of intermediate piping block port specifications and manifold piping block specifications.

Manifold piping specifications	Intermediate piping block
JT	PJ
J5T	PJ5
J6T	PJ6
MT	PM
MTH	PMH

# Parts for manifold F 10 ZX - Parts content 10: 10 mm [0.394 in.] width GS2: Gasket (gasket and exhaust valve) GS3: Gasket (valve base side) XSP: Port isolator (for 1(P) port) XSR: Port isolator (for 3(R2), 5(R1) ports)

Valve size 10: 10 mm [0.394 in.] width

F 10 Z - E2

GS3: Gasket (valve base side)

XSP: Port isolator (for 1(P) port)

XSR: Port isolator (for 3(R2), 5(R1) ports)


XSA: Port isolator (for 1(P), 3(R2), 5(R1) ports)

DN: DIN mounting bracket (one set of two)

Individual air supply and exhaust spacer (Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws)

Back pressure prevention valve (2 pieces for split type, with dedicated gasket)

Block-off plate (block-off plate, 2 mounting screws, and plug)




Valve size Specification


10: 10 mm [0.394 in.] XNPM: Individual air supply spacer (with M5 female width thread for F10)

XNRM: Individual exhaust spacer (with M5 female \*\*For details, see p.27. thread for F10)

Valve base assembly (valve base, gasket, and two connecting rods for adding)

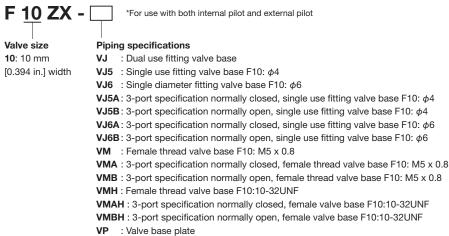

# Piping block assembly (non-plug-in)

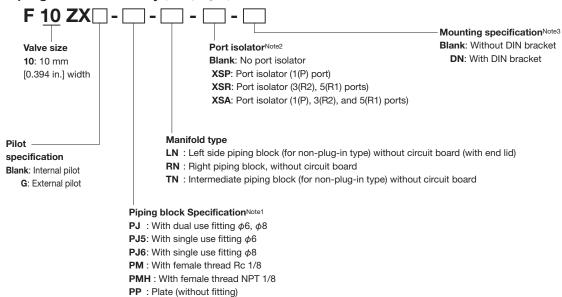

Notes:1. The fitting of the piping block is included. One set of two connecting rods is also included for a LN and TN type manifold.

- 2.Port isolator selection only available when the piping block name is TN.
- 3. Only when the manifold type is LN or RN.


# Muffler **KM** - J [ **6**: Outer diameter $\phi$ 6 (for piping block) 8: Outer diameter $\phi$ 8 (for piping block) (Sales unit: Set of 10 mufflers) Connecting rod (1 set of 2) F 10 ZX - - -

Number of units  $\mathbf{01} \sim \mathbf{20}$  : When type for valve base (RV) is selected Valve size 01: When type for left side piping block (RH) is selected 10: 10 mm 01: When type for intermediate piping block (RC) is selected [0.394 in.] width Specification RV: For valve base


RC: For intermediate piping block


RH: For left piping block

#### DIN rail




#### Connector-related order codes

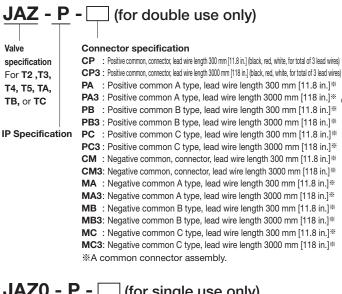


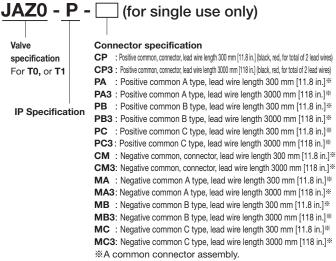



#### Connector-related order codes

\*For details, see p. 22.

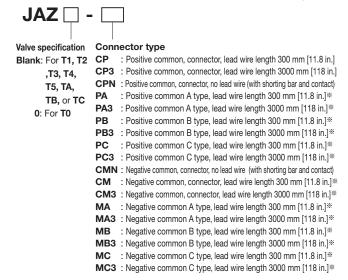

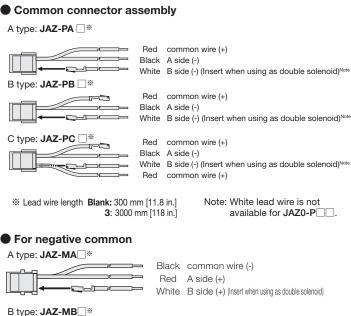

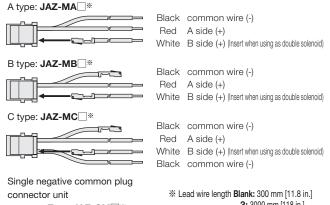



3: 3000 mm [118 in.]




For **T1, T2** ,T3, T4, T5,

CC1.5: Cabtyre cable, length 1500 mm [59 in.]\* CC3 : Cabtyre cable, length 3000 mm [118 in.]\*

TA, TB, or TC

- Notes: 1. When the valve specification is T1, select the JAZ0-P- single dedicated type.
  - When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use the number of seal holes in the lead wire differs for the single and double type).
  - 3. There is no white lead wire for the **JAZ0-P-** .
  - 4. It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.
  - For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.

    6. For information on replacing the waterproof seal, contact your
  - nearest KOGANEI sales office.

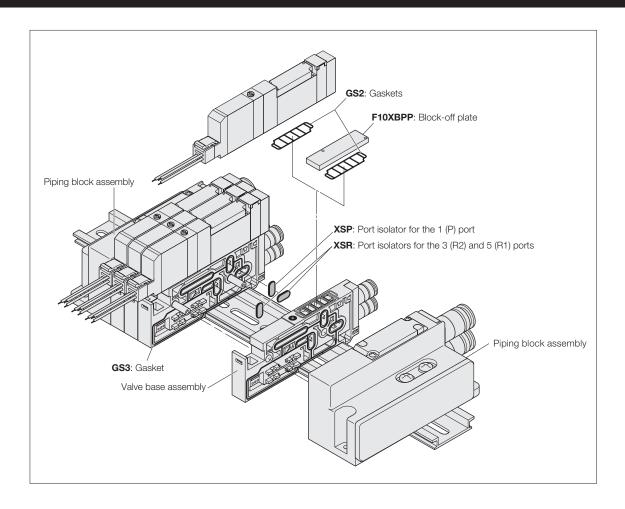

# Manifold Order Code Example

(4 units of F10 Series)

# F10M4XNJ-J6T-DR

stn.1 ~ 2 F10T0-A1-PS DC24V stn.3 F10ZX-PJ6-TN stn.4 F10T0-A1-PS DC24V

Note: This order code example has no relationship to the illustration above.


# **Precautions for Order Codes**

#### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66.


However, Blank, A2, F3, F4, F5, F6, F4A, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. And for the wiring specification, Blank, PL, and PL3 cannot be selected. In addition, for common terminal wiring connections, separately order the common connector assemblies listed on the left.

# F10 Series Easy Assembly Type Manifold Plug-in Type Order Codes

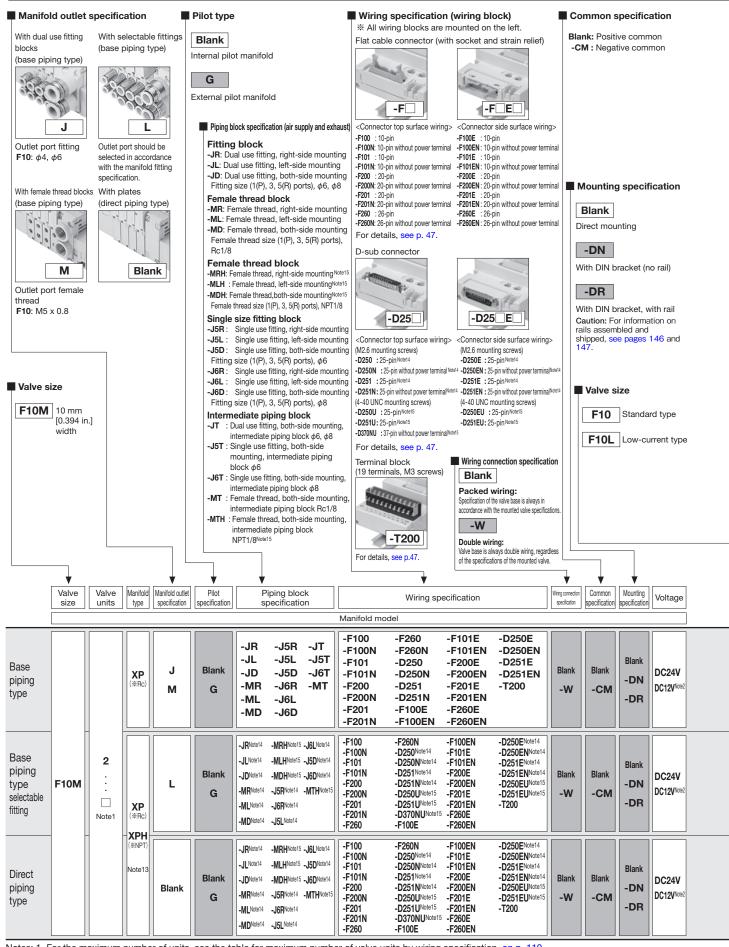

Notes: 1. For the maximum number of units, see the table for maximum number of valve units by wiring specification, on p. 110.

- 2. Not available in low-current type.
- 3. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
- 4. When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.

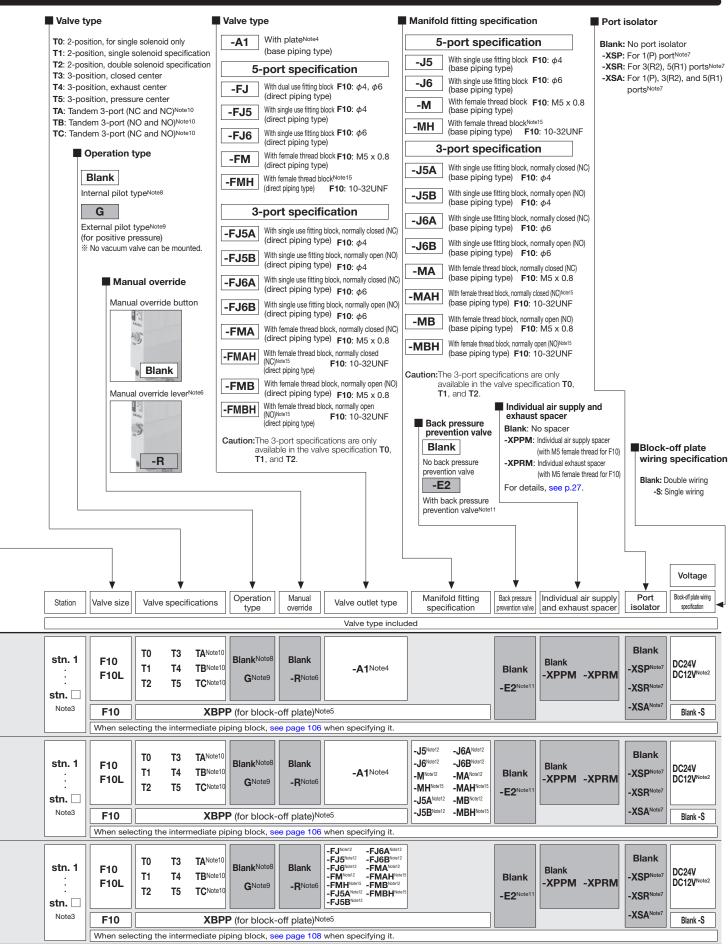


- Notes: 5. Select the block-off plate wiring in the block-off plate wiring connection specification.
  - When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  - 7. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -XSA, or 1 each port isolator for -XSP and -XSR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller str. No.).
  - Cannot be mounted on the external pilot manifold.

- 9. Cannot be mounted on the internal pilot manifold.
- 10. Not available in external pilot type.
- 11. Not available with the individual exhaust spacer.
- 12. The 3-port specifications are only available in the valve specification T0, T1, and T2.
- Only L or Blank is available in the inch female thread specification and the manifold outlet specification.
- 14. Can be selected only when the manifold type is XP.
- 15. Can be selected only when the manifold type is XPH.

### Intermediate piping block

(When mounting an intermediate piping block to the manifold, complete the following type and specify the station specified on page 107.)

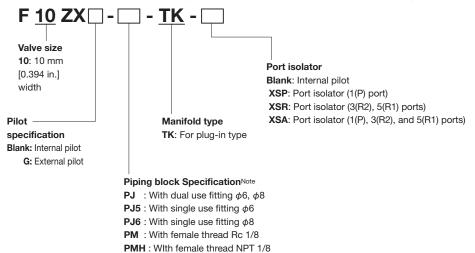

Note:See the following table for combinations of intermediate piping block port specifications and manifold piping block specifications.

Manifold piping specifications	Intermediate piping block
JT	PJ
J5T	PJ5
J6T	PJ6
MT	PM
MTH	PMH

### Parts for manifold

F 10 ZX - [ Valve size


Parts content

GS2: Gasket (gasket and exhaust valve) 10: 10 mm [0.394 in.] GS3: Gasket (valve base side) XSP: Port isolator (for 1(P) port) width


XSR: Port isolator (for 3(R2), 5(R1) ports) XSA: Port isolator (for 1(P), 3(R2), 5(R1) ports) DN: DIN mounting bracket (1 set of 2)

F10 Series Easy Assembly Type Manifold Plug-in Type Additional Parts Order Codes

Block-off plate (block-off plate, 2 mounting screws, and plug)



Valve base assembly (valve base, gasket, and 2 connecting rods for adding)



#### Piping specifications

: Dual use fitting valve base

VJ5 : Single use fitting valve base F10: φ4

**VJ6**: Single diameter fitting valve base F10:  $\phi$ 6

**VJ5A**: 3-port specification normally closed, single use fitting valve base F10: φ4 **VJ5B**: 3-port specification normally open, single use fitting valve base F10:  $\phi$ 4

**VJ6A**: 3-port specification normally closed, single use fitting valve base F10: φ6 **VJ6B**: 3-port specification normally open, single use fitting valve base F10: φ6

VM : Female thread valve base F10: M5 x 0.8

VMA: 3-port specification normally closed, female thread valve base F10: M5 x 0.8 VMB: 3-port specification normally open, female thread valve base F10: M5 x 0.8

VMH: Female thread valve base F10:10-32UNF

VMAH: 3-port specification normally closed, female valve base F10:10-32UNF VMBH: 3-port specification normally open, female valve base F10:10-32UNF

: Valve base plate

/ Spacer for plug-in type, gasket, exhaust Individual air supply and exhaust spacer valve, and 2 mounting screws

F 10 ZX -

10: 10 mm [0.394 in.] width

Valve size

10: 10 mm [0.394 in.] XPPM: Individual air supply spacer (with M5 female

width thread for F10)

XPRM: Individual exhaust spacer (with M5 female \*For details, see p.27.

thread for F10)

#### Muffler

KM - J Fitting size

> **6**: Outer diameter  $\phi$ 6 (for piping block) 8: Outer diameter  $\phi$ 8 (for piping block)


(Sales unit: Set of 10 mufflers)

DIN rail

**DIN** - [ (Unit:1) Rail length

> 125: 125mm [4.921 in.] : (25 mm [0.984 in.] pitch) 525: 525mm [20.669 in.]


### Piping block assembly (plug-in)

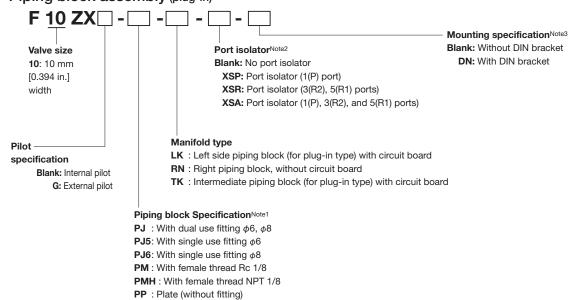


Notes: 1. The fitting of the piping block is included. One set of two connecting rods is also included for a LN and TN type manifold.

- 2. Port isolator selection only available when the piping block name is TK.
- 3. Only when the manifold type is LK or RN.

### Connecting rod (1 set of 2)

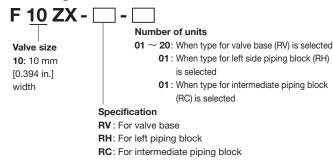



#### Wiring specification

F100 : Flat cable connector (DC specification)
F101 : Flat cable connector (DC specification)
F200 : Flat cable connector (DC specification)
F201 : Flat cable connector (DC specification)
F260 : Flat cable connector (DC specification)
D250 : D-sub connector (M2.6 screws)

**D251** : D-sub connector (M2.6 screws)

F100N: Flat cable connector (DC specification), without power terminal F101N: Flat cable connector (DC specification), without power terminal F200N: Flat cable connector (DC specification), without power terminal F201N: Flat cable connector (DC specification), without power terminal F260N: Flat cable connector (DC specification), without power terminal D250N: D-sub connector, without power terminal (M2.6 screws)

D251N: D-sub connector, without power terminal (M2.6 screws)

D250U: D-sub connector, (4-40UNC screws)

**D250NU**: D-sub connector, without power terminal (4-40UNC screws)

D251U: D-sub connector, (4-40UNC screws)

D251NU: D-sub connector, without power terminal (4-40UNC screws)
D370NU: D-sub connector, without power terminal (4-40UNC screws)


T200 : Terminal block, for left-side mounting

\*\* The above flat cable connectors and D-sub connectors can be switched between the top and side type.

#### ■ Table for maximum number of valve units by wiring specification

		Maximum number of units *	
		Wiring connection	n specification
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
<b>F100</b> Flat cable (10P)	8		4 units
<b>F101</b> Flat cable (10P)	8	16 of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less. D370NU is a	4 units
<b>F200</b> Flat cable (20P)	16		8 units
<b>F201</b> Flat cable (20P)	16		8 units
<b>F260</b> ☐ Flat cable (26P)	20		10 units
<b>D250</b> D-sub connector (25P)	16		8 units
<b>D251</b> D-sub connector (25P)	20		10 units
<b>D370NU</b> D-sub connector (37P)	32		16 units
T200 Terminal block (19 terminals)	18		9 units

\*\*Note: When the intermediate piping block is selected, the maximum number of units will be added +1.

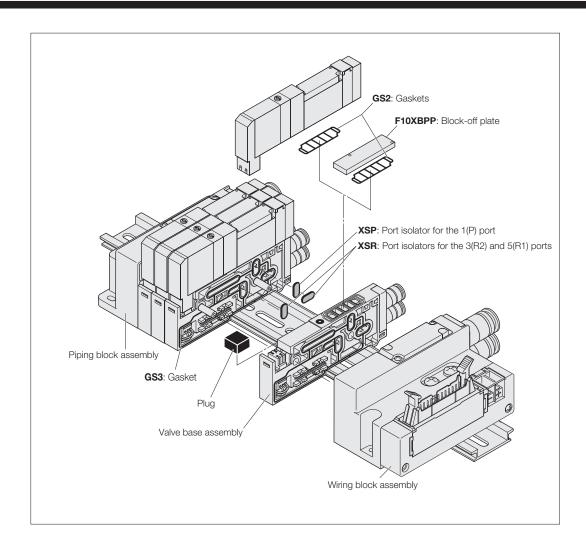

### Manifold Order Code Example

(12 units of F10 Series)

### F10M12XPL-J6T-F201-DR DC24V

 $\begin{array}{lll} \text{stn.1} \sim 8 & \text{F10T1-A1-J5 DC24V} \\ \text{stn.9} & \text{F10ZX-PJ6-TK} \\ \text{stn.10} \sim 12 \text{ F10T1-A1-J5 DC24V} \end{array}$ 

Note: This order code example has no relationship to the illustration above.

### **Precautions for Order Codes**

#### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66.

However, Blank, A2, F3, F4, F5, F6, F4A, F5B, F6A, F5B, F6A, or F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection

### Wiring connection specification


Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution


Single or double can also be selected as the block-off plate wiring specification separately from the manifold (valve) wiring specification.

### F10 Series Easy Assembly Type Manifold Serial Transmission Type Order Codes

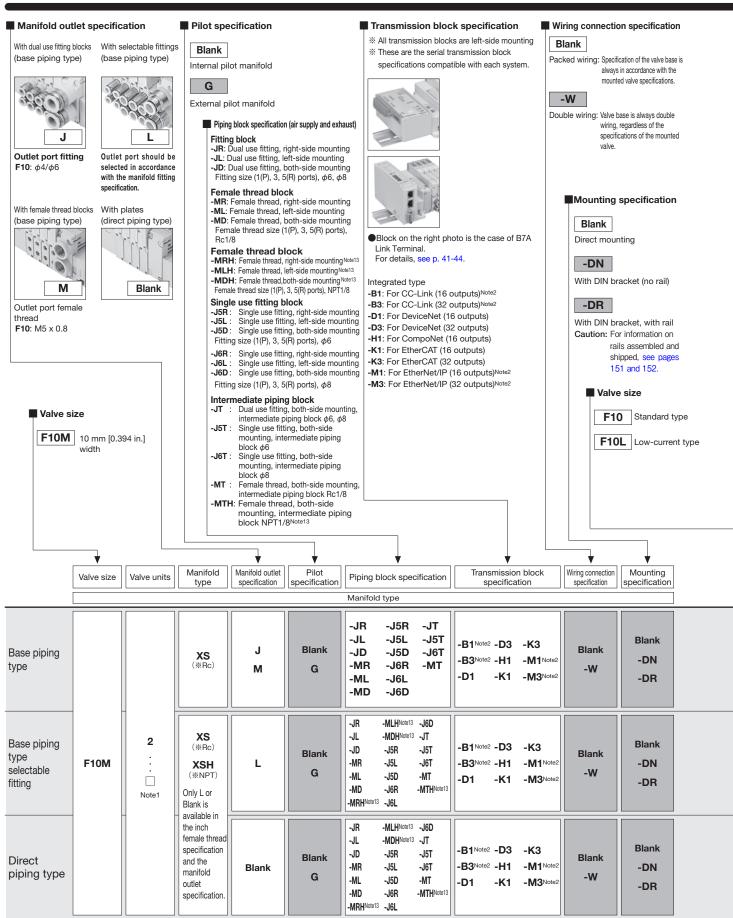

Notes 1. To determine the maximum number of units, see the table for maximum number of valve units by transmission block specification, on p. 116.


2. Complies with the CE marking regulation.

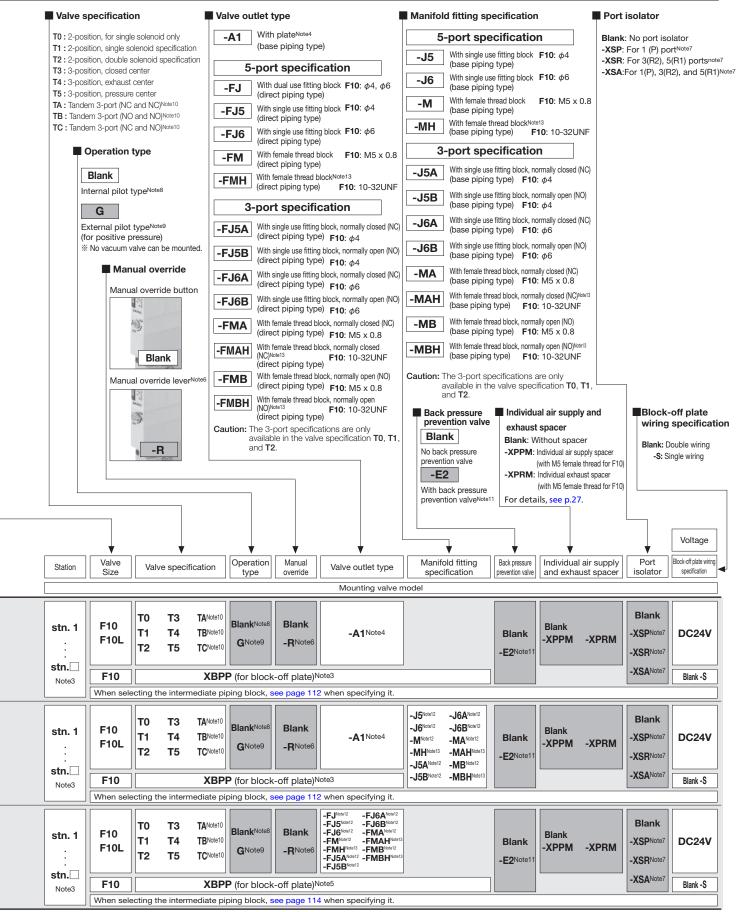

- Notes: 3. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
  - When selecting J, M, or L (base piping type) for the manifold outlet specifications, always enter -A1 (with plate) for the valve outlet type.
  - Sipecifications, aways enter An (with place) of the valve outer type.
     Single or double can also be selected as the block-off plate wiring specification separately from the manifold (valve) wiring specification.
  - 6. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  - 7. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -XSA, or 1 each port isolator for -XSP and -XSR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
- 8. Cannot be mounted on the external pilot manifold.
- 9. Cannot be mounted on the internal pilot manifold.
- 10. Not available in external pilot type.
- 11. Not available with the individual exhaust spacer.
- 12. The 3-port specifications are only available in the valve specification T0, T1, and T2.
- 13. Can be selected only when the manifold type is XSH.

### Intermediate piping block

(When mounting an intermediate piping block to the manifold, complete the following type and specify the station specified on page 113.)

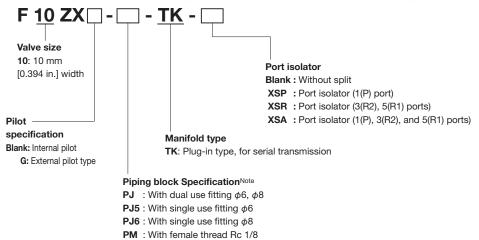

PMH: With female thread NPT 1/8

Note:See the following table for combinations of intermediate piping block port specifications and manifold piping block specifications.

Manifold piping specifications	Intermediate piping block
JT	PJ
J5T	PJ5
J6T	PJ6
MT	PM
MTH	PMH

### Parts for manifold

F 10 ZX - [ Valve size Parts content

in.] width

10: 10 mm [0.394

GS2: Gasket (gasket and exhaust valve)

GS3: Gasket (valve base side) XSP: Port isolator (for 1(P) port)

XSR: Port isolator (for 3(R2), 5(R1) ports) XSA: Port isolator (for 1(P), 3(R2), 5(R1) ports) **DN**: DIN mounting bracket (one set of two)

Block-off plate (block-off plate, 2 mounting screws, and plug)

# **F 10 XBPP**

Valve size

10: 10 mm [0.394 in.] width

Back pressure prevention valve (2 units for split type, with dedicated gasket)

F 10 Z - E2

Valve size

10: 10 mm [0.394 in.] width

/ Spacer for plug-in type, gasket, exhaust \ Individual air supply and exhaust spacer valve, and 2 mounting screws

F 10 ZX -Specifications


width

10: 10 mm [0.394 in.] XPPM: Individual air supply spacer (with M5 female thread for F10)

XPRM: Individual exhaust spacer (with M5 female thread for F10)

\*For details, see p.27.

### Valve base assembly (valve base, gasket, and 2 connecting rods for adding)



### Piping specification

: Dual use fitting valve base

VJ5 : Single use fitting valve base F10: φ4 **VJ6** : Single diameter fitting valve base F10:  $\phi$ 6

**VJ5A**: 3-port specification normally closed, single use fitting valve base F10:  $\phi$ 4 **VJ5B**: 3-port specification normally open, single use fitting valve base F10:  $\phi$ 4

**VJ6A**: 3-port specification normally closed, single use fitting valve base F10:  $\phi$ 6 VJ6B: 3-port specification normally open, single use fitting valve base F10:  $\phi6$ 

VM : Female thread valve base F10: M5 x 0.8

VMA: 3-port specification normally closed, female thread valve base F10: M5 x 0.8  $\textbf{VMB}\,:$  3-port specification normally open, female thread valve base F10: M5 x 0.8

VMH: Female thread valve base F10:10-32UNF

VMAH: 3-port specification normally closed, female valve base F10:10-32UNF VMBH: 3-port specification normally open, female valve base F10:10-32UNF

VP : Valve base plate

### Muffler



**6:** Outer diameter  $\phi$ 6 (for piping block)

8: Outer diameter  $\phi$ 8 (for piping block)


#### DIN rail



Rail length

125: 125mm [4.921 in.] : (25 mm [0.984 in.] pitch) 525: 525mm [20.669 in.]


### Connecting rod (1 set of 2)



RV: For valve base RH: For left piping block

RC: For intermediate piping block

### Piping block assembly (plug-in)

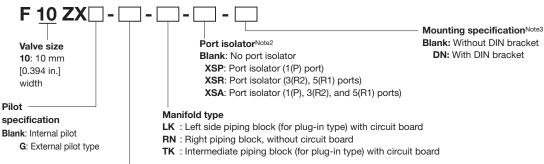

#### Piping block specification<sup>Note1</sup>

**PJ**: With dual use fitting  $\phi$ 6,  $\phi$ **PJ5**: With single use fitting  $\phi$ **PJ6**: With single use fitting  $\phi$ PM: With female thread Rc 1/8

PMH: With female thread NPT 1/8

PP: Plate (without fitting)

- Notes: 1. The fitting of the piping block is included. One set of two connecting rods is also included for a LN and TN type manifold.
  - 2. Port isolator selection only available when the piping block name is TK.
  - 3. Only when the manifold type is LK or RN.

### Serial transmission block (single unit)

YS6 (dedicated for manifold mounting)

#### Transmission block specification


B1: For CC-Link (16 outputs)

B3: For CC-Link (32 outputs)

D1: For DeviceNet (16 outputs)

D3: For DeviceNet (32 outputs)

H1: For CompoNet (16 outputs)



### Transmission block specification

K1: For EtherCAT (16 outputs)


K3: For EtherCAT (32 outputs)

M1: For EtherNet/IP (16 outputs)
M3: For EtherNet/IP (32 outputs)

■ Table for maximum number of valve units by transmission block specification

		Maximum numbe	r of units *
		Wiring connection specification	
Transmission block specifications	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
-B1: For CC-Link (16 outputs)	16	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates.  The number of controlled solenoids should be designated as the maximum number of outputs or less.  -B3, -D3, -K3, and -M3 are	8 units
-B3: For CC-Link (32 outputs)	32		16 units
-D1: For DeviceNet (16 outputs)	16		8 units
-D3: For DeviceNet (32 outputs)	32		16 units
-H1: For CompoNet (16 outputs)	16		8 units
-K1: For EtherCAT (16 outputs)	16		8 units
-K3: For EtherCAT (32 outputs)	32		16 units
-M1: For EtherNet/IP (16 outputs)	16		8 units
-M3: For EtherNet/IP (32 outputs)	32	a maximum of 20 units.	16 units

<sup>\*</sup>Note: When the intermediate piping block is selected, the maximum number of units will be added +1.

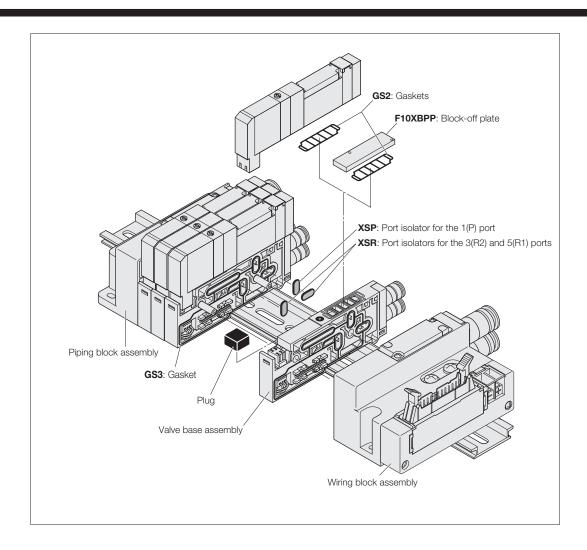

### Manifold Order Code Example

(8 units of F10 Series)

#### F10M8XSL-J5R-B1-W

 $\begin{array}{lll} \mathrm{stn.1} \sim 5 & \mathrm{F10T0\text{-}A1\text{-}J5} \ \mathrm{DC24V} \\ \mathrm{stn.6} \sim 7 & \mathrm{F10T2\text{-}A1\text{-}J6} \ \mathrm{DC24V} \\ \mathrm{stn.8} & \mathrm{F10XBPP\text{-}J6} \end{array}$ 

Note: This order code example has no relationship to the illustration above.

### **Precautions for Order Codes**

### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66.

However, **Blank**, **A2**, **F3**, **F4**, **F5**, **F6**, **F4A**, **F5B**, **F5A**, **F5B**, **F6A**, **or F6B** cannot be selected for the valve outlet type. For the wiring specification, **Blank** is the only selection.

#### Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.


Caution

Single or double can also be selected as the block-off plate wiring specification separately from the manifold (valve) wiring specification.

### F10T Valve specifications -F3-PS

With outlet port dual use fitting block With inlet port female thread block S type plug connector


\* For T0 Type dimensions, see page 119.

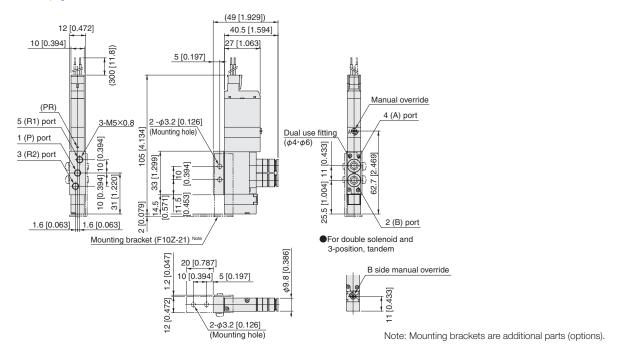

## F10T Valve specifications -F4-PS F10T Valve specifications -F4H-PS

With outlet port female thread block With inlet port female thread block S type plug connector


\* For T0 Type dimensions, see page 119.

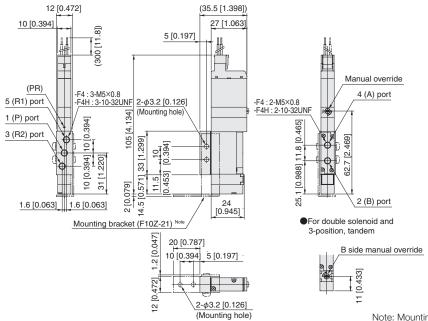

Note: Mounting brackets are additional parts (options).

### F10T0-F□-PS


With outlet port single use fitting block With inlet port female thread block S type plug connector

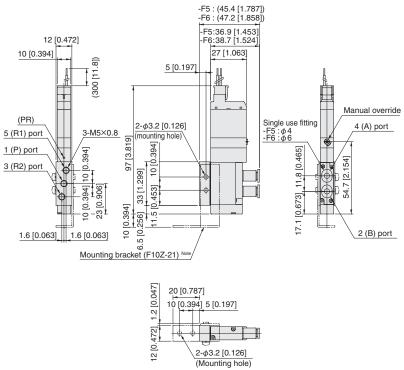

Note: Mounting brackets are additional parts (options).

### IP type

F10T Valve specifications -P-A2-PS Operation system

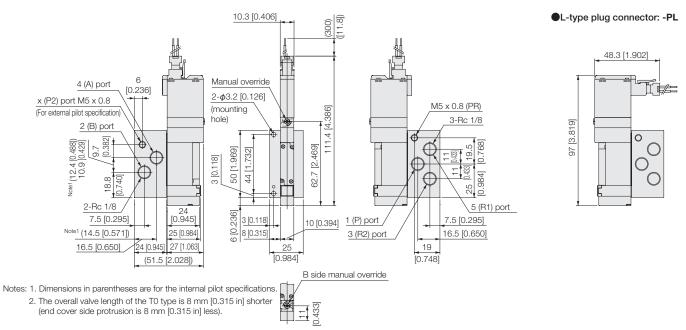


For double solenoid and 3-position, tandem

F10T Valve specifications Operation system -A2-PS F10T Valve specifications Operation system -A2H-PS


With A-type sub-base S type plug connector

#### Internal pilot specifications

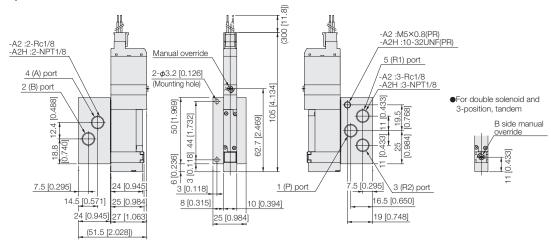

Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).


### External pilot specifications

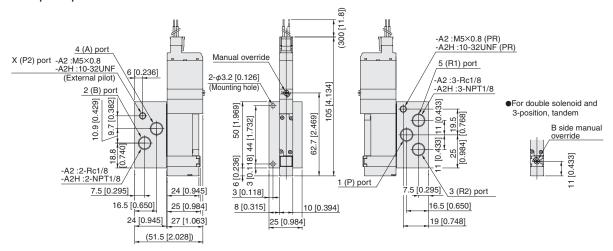


Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).


### **Options**












Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).


## F10M Number of valves


ΑM

Pilot specifications (Base piping type)


Monoblock manifold A type With manifold outlet port dual use fitting block S type plug connector

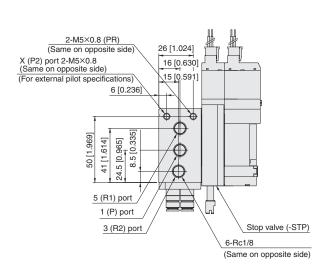





Unit c	ımer	ision
Number of units	L	Р
2	38.5 [1.516]	30.5 [1.201]
3	49.0 [1.929]	41.0 [1.614]
4	59.5 [2.343]	51.5 [2.028]
5	70.0 [2.756]	62.0 [2.441]
6	80.5 [3.169]	72.5 [2.854]
7	91.0 [3.583]	83.0 [3.268]
8	101.5 [3.996]	93.5 [3.681]
9	112.0 [4.409]	104.0 [4.094]
10	122.5 [4.823]	114.5 [4.508]
11	133.0 [5.236]	125.0 [4.921]
12	143.5 [5.650]	135.5 [5.335]
13	154.0 [6.063]	146.0 [5.748]
14	164.5 [6.476]	156.5 [6.161]
15	175.0 [6.890]	167.0 [6.575]
16	185.5 [7.303]	177.5 [6.988]
17	196.0 [7.717]	188.0 [7.402]
18	206.5 [8.130]	198.5 [7.815]
19	217.0 [8.543]	209.0 [8.228]
20	227.5 [8.957]	219.5 [8.642]

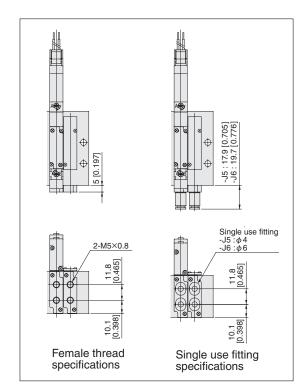

### **F10M** Number of valves **F** (Direct piping type)

Monoblock manifold F type With valve outlet port dual use fitting block 10.5 [0.413] (pitch) S type plug connector Manual override 4-φ4.5 [0.177] 6-Rc1/8 (Same on opposite side) 4 (A) port (Mounting hole) 2 (B) port 5 (R1) port 105 [4.134] 5.5 [1.004] 11 [0.433] 16 [0.630 62.7 [2.469] 11 [0.433] 23 [0.906] [0.630] 49 630 29 [1.142] Stop valve (-STP) 1 (P) port 12 [0.472] 9 [0.354] (9 [0.354]) Ρ 3 (R2) port 9 [0.354] stn.1 stn.2 stn.3 stn.4 10 [0.394] Dual use fitting ( $\phi$ 4 and  $\phi$ 6) (M5×0.8 female thread can also be selected.) (Single use fitting can also be selected.) 57.7 [2.272 6.5 [0.256] (78.2[3.079])40.5 [1.594] (61 [2.402]) Block off plate

Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).


[0.787]


### **Unit dimensions**


Number of units	L	Р
2	48.5 [1.909]	30.5 [1.201]
3	59.0 [2.323]	41.0 [1.614]
4	69.5 [2.736]	51.5 [2.028]
5	80.0 [3.150]	62.0 [2.441]
6	90.5 [3.563]	72.5 [2.854]
7	101.0 [3.976]	83.0 [3.268]
8	111.5 [4.390]	93.5 [3.681]
9	122.0 [4.803]	104.0 [4.094]
10	132.5 [5.217]	114.5 [4.508]
11	143.0 [5.630]	125.0 [4.921]
12	153.5 [6.043]	135.5 [5.335]
13	164.0 [6.457]	146.0 [5.748]
14	174.5 [6.870]	156.5 [6.161]
15	185.0 [7.283]	167.0 [6.575]
16	195.5 [7.697]	177.5 [6.988]
17	206.0 [8.110]	188.0 [7.402]
18	216.5 [8.524]	198.5 [7.815]
19	227.0 [8.937]	209.0 [8.228]
20	237.5 [9.350]	219.5 [8.642]

### F10M Number of valves FH (Direct piping type)

Monoblock manifold F type With valve outlet port female thread block S type plug connector








Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

Number of units	L	Р
2	48.5 [1.909]	30.5 [1.201]
3	59.0 [2.323]	41.0 [1.614]
4	69.5 [2.736]	51.5 [2.028]
5	80.0 [3.150]	62.0 [2.441]
6	90.5 [3.563]	72.5 [2.854]
7	101.0 [3.976]	83.0 [3.268]
8	111.5 [4.390]	93.5 [3.681]
9	122.0 [4.803]	104.0 [4.094]
10	132.5 [5.217]	114.5 [4.508]
11	143.0 [5.630]	125.0 [4.921]
12	153.5 [6.043]	135.5 [5.335]
13	164.0 [6.457]	146.0 [5.748]
14	174.5 [6.870]	156.5 [6.161]
15	185.0 [7.283]	167.0 [6.575]
16	195.5 [7.697]	177.5 [6.988]
17	206.0 [8.110]	188.0 [7.402]
18	216.5 [8.524]	198.5 [7.815]
19	227.0 [8.937]	209.0 [8.228]
20	237.5 [9.350]	219.5 [8.642]

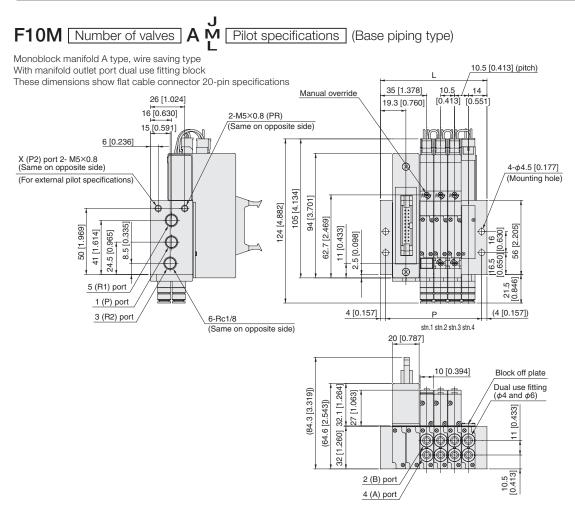


#### Unit dimensions


Unit c	ımer	nsions
Number of units	L	Р
2	59.5 [2.343]	51.5 [2.028]
3	70.0 [2.756]	62.0 [2.441]
4	80.5 [3.169]	72.5 [2.854]
5	91.0 [3.583]	83.0 [3.268]
6	101.5 [3.996]	93.5 [3.681]
7	112.0 [4.409]	104.0 [4.094]
8	122.5 [4.823]	114.5 [4.508]
9	133.0 [5.236]	125.0 [4.921]
10	143.5 [5.650]	135.5 [5.335]
11	154.0 [6.063]	146.0 [5.748]
12	164.5 [6.476]	156.5 [6.161]
13	175.0 [6.890]	167.0 [6.575]
14	185.5 [7.303]	177.5 [6.988]
15	196.0 [7.717]	188.0 [7.402]
16	206.5 [8.130]	198.5 [7.815]
17	217.0 [8.543]	209.0 [8.228]
18	227.5 [8.957]	219.5 [8.642]
19	238.0 [9.370]	230.0 [9.055]
20	248.5 [9.783]	240.5 [9.469]


# F10M Number of valves F (Direct piping type) F10M Number of valves FH (Direct piping type)

Monoblock manifold F type, wire saving type With manifold outlet port dual use fitting block

These dimensions show flat cable connector 20-pin specifications








Office	ılılıeı	121011
Number of units	L	Р
2	69.5 [2.736]	51.5 [2.028]
3	80.0 [3.150]	62.0 [2.441]
4	90.5 [3.563]	72.5 [2.854]
5	101.0 [3.976]	83.0 [3.268]
6	111.5 [4.390]	93.5 [3.681]
7	122.0 [4.803]	104.0 [4.094]
8	132.5 [5.217]	114.5 [4.508]
9	143.0 [5.630]	125.0 [4.921]
10	153.5 [6.043]	135.5 [5.335]
11	164.0 [6.457]	146.0 [5.748]
12	174.5 [6.870]	156.5 [6.161]
13	185.0 [7.283]	167.0 [6.575]
14	195.5 [7.697]	177.5 [6.988]
15	206.0 [8.110]	188.0 [7.402]
16	216.5 [8.524]	198.5 [7.815]
17	227.0 [8.937]	209.0 [8.228]
18	237.5 [9.350]	219.5 [8.642]
19	248.0 [9.764]	230.0 [9.055]
20	258.5 [10.177]	240.5 [9.469]

### **F10M** Number of valves **F** (Direct piping type)

Monoblock manifold F type, wire saving type With valve outlet port dual use fitting block


These dimensions show flat cable connector 20-pin specifications

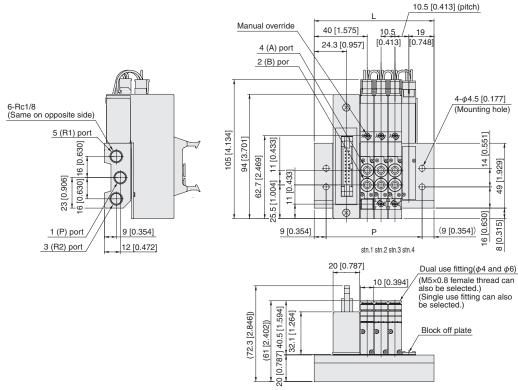

## F10M Number of valves FH (Direct piping type)

Monoblock manifold F type, wire saving type With valve outlet port female thread block

These dimensions show flat cable connector 20-pin specifications

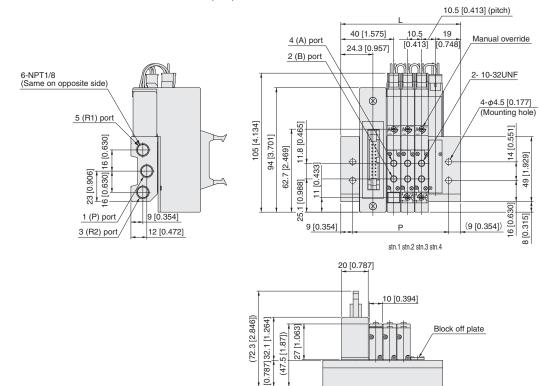

### **Unit dimensions**


Number of units	L	Р
2	69.5 [2.736]	51.5 [2.028]
3	80.0 [3.150]	62.0 [2.441]
4	90.5 [3.563]	72.5 [2.854]
5	101.0 [3.976]	83.0 [3.268]
6	111.5 [4.390]	93.5 [3.681]
7	122.0 [4.803]	104.0 [4.094]
8	132.5 [5.217]	114.5 [4.508]
9	143.0 [5.630]	125.0 [4.921]
10	153.5 [6.043]	135.5 [5.335]
11	164.0 [6.457]	146.0 [5.748]
12	174.5 [6.870]	156.5 [6.161]
13	185.0 [7.283]	167.0 [6.575]
14	195.5 [7.697]	177.5 [6.988]
15	206.0 [8.110]	188.0 [7.402]
16	216.5 [8.524]	198.5 [7.815]
17	227.0 [8.937]	209.0 [8.228]
18	237.5 [9.350]	219.5 [8.642]
19	248.0 [9.764]	230.0 [9.055]
20	258.5 [10.177]	240.5 [9.469]


Unit c	dimer	nsions
Number of units	L	Р
2	69.5 [2.736]	51.5 [2.028]
3	80.0 [3.150]	62.0 [2.441]
4	90.5 [3.563]	72.5 [2.854]
5	101.0 [3.976]	83.0 [3.268]
6	111.5 [4.390]	93.5 [3.681]
7	122.0 [4.803]	104.0 [4.094]
8	132.5 [5.217]	114.5 [4.508]
9	143.0 [5.630]	125.0 [4.921]
10	153.5 [6.043]	135.5 [5.335]
11	164.0 [6.457]	146.0 [5.748]
12	174.5 [6.870]	156.5 [6.161]
13	185.0 [7.283]	167.0 [6.575]
14	195.5 [7.697]	177.5 [6.988]
15	206.0 [8.110]	188.0 [7.402]
16	216.5 [8.524]	198.5 [7.815]
17	227.0 [8.937]	209.0 [8.228]
18	237.5 [9.350]	219.5 [8.642]
19	248.0 [9.764]	230.0 [9.055]
20	258.5 [10.177]	240.5 [9.469]


PC board manifold A type With manifold outlet port dual use fitting block

Note: Mounted valve example shows -W wiring specifications.

In the case of -S wiring specifications, the mounted valve becomes T0 or T1 type.

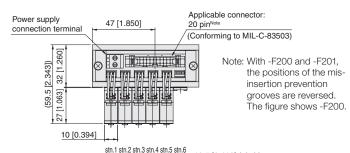

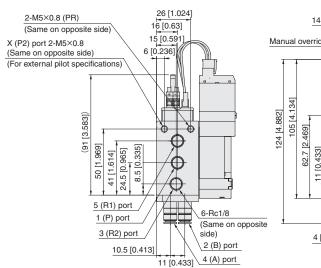



### **Unit dimensions**

Number of units	L	Р
6	80.5 [3.169]	72.5 [2.854]
8	101.5 [3.996]	93.5 [3.681]
10	122.5 [4.823]	114.5 [4.508]
12	143.5 [5.650]	135.5 [5.335]
14	164.5 [6.476]	156.5 [6.161]
16	185.5 [7.303]	177.5 [6.988]

Note: Wiring specifications For -S 6, 8, 10, 12, 14, 16 units


> For -W Only 6 and 8 units selectable


## **F10M** Number of valves **FP** (Direct piping type)


PC board manifold F type With valve outlet port dual use fitting block

Note: Mounted valve example shows -W wiring specifications.

In the case of -S wiring specifications, the mounted valve becomes T0 or T1 type.

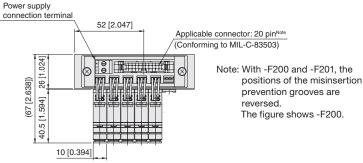



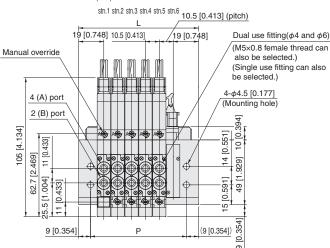

Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8  $\,$ mm [0.315 in] less).

### **Unit dimensions**


Number of units	L	Р
6	90.5 [3.563]	72.5 [2.854]
8	111.5 [4.390]	93.5 [3.681]
10	132.5 [5.217]	114.5 [4.508]
12	153.5 [6.043]	135.5 [5.335]
14	174.5 [6.870]	156.5 [6.161]
16	195.5 [7.697]	177.5 [6.988]

Note: Wiring specifications For -S 6, 8, 10, 12, 14, 16 units

> For -W Only 6 and 8 units selectable



With manifold outlet port dual use fitting block

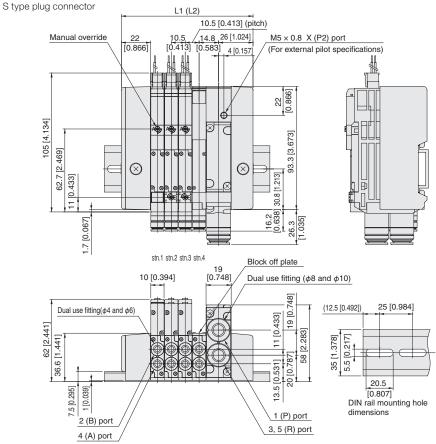


#### Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]

Note: When two piping blocks are used.

## $\textbf{F10M} \ \ \, \underline{ \ \ \ \, } \ \, \underline{ \ \ \ \, \, } \ \, \underline{ \ \ \ \, \underline{ \ \ } \ \, \underline{ \ \ \ } \ \, \underline{ \ \ } \ \, \underline{ \ \$


With valve outlet port dual use fitting block S type plug connector

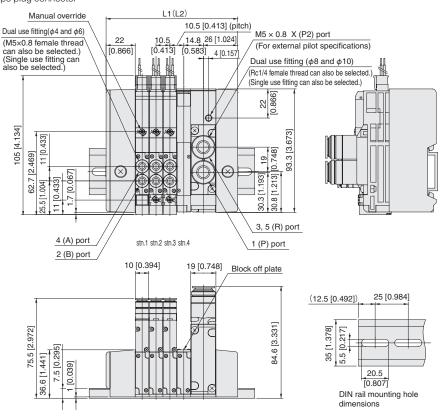

### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]	
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]	
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]	
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]	
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]	
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]	
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]	
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]	
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]	
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]	
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]	
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]	
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]	
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]	
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]	
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]	
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]	
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]	
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]	
Noto: M/b	Note: When two piping blocks are used				

With manifold outlet port female thread block

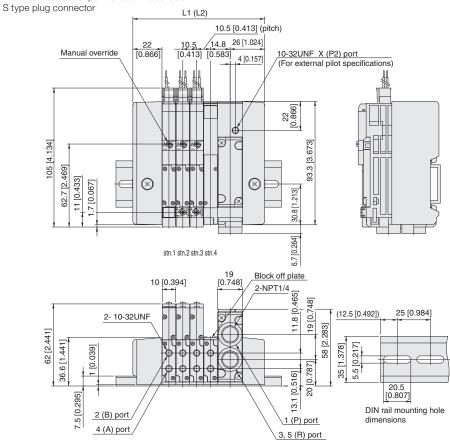


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]

Note: When two piping blocks are used.

## F10M Number of valves NH Pilot specifications (Direct piping type)


With valve outlet port female thread block

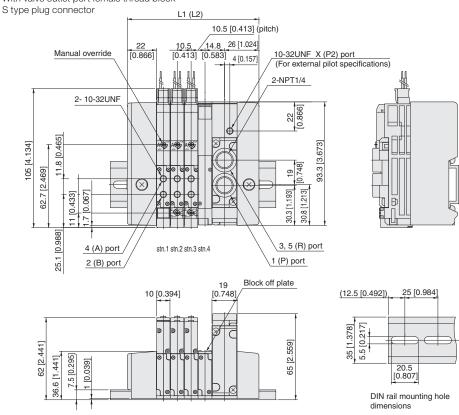


Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

### Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]

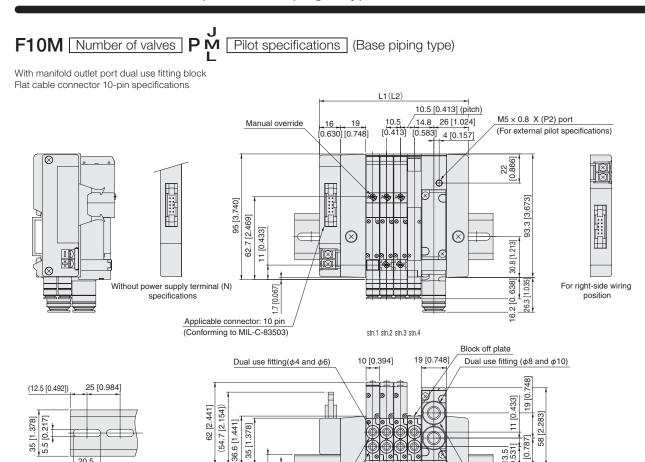

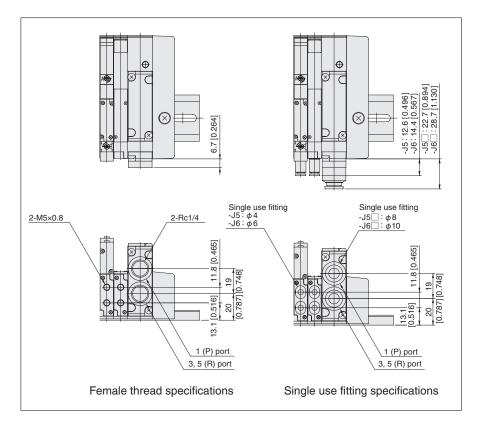

7.5 [0.295]

2 (B) port

4 (A) port

### **Unit dimensions**

1 (P) port

3, 5 (R) port

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]

Note: When two piping blocks are used.

20.5 [0.807]


DIN rail mounting hole

dimensions

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port dual use fitting block

Flat cable connector 20-pin specifications (side surface wiring)

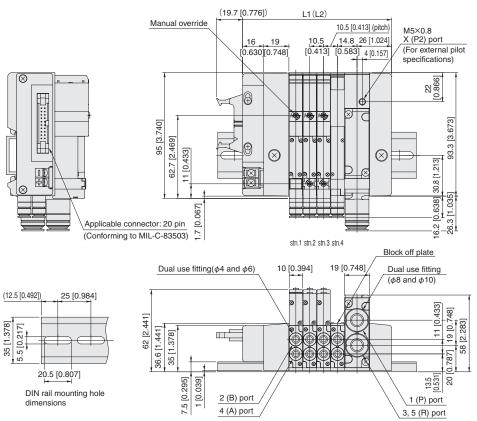


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]

Note: When two piping blocks are used.

### F10M Number of valves Pilot specifications (Base piping type)

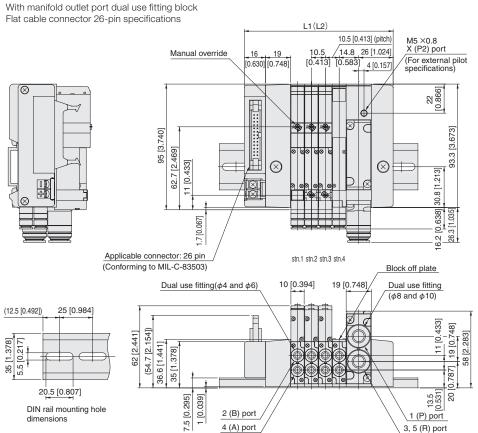

### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. \* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.



With manifold outlet port dual use fitting block D-sub connector 25-pin specifications

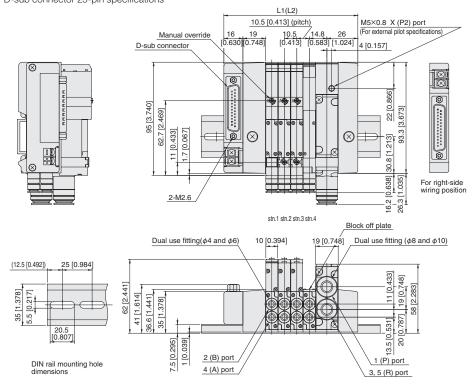

### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]	
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]	
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]	
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]	
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]	
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]	
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]	
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]	
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]	
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]	
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]	
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]	
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]	
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]	
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]	
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]	
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]	
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]	
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]	

Note: When two piping blocks are used.

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.





With manifold outlet port dual use fitting block Terminal block type

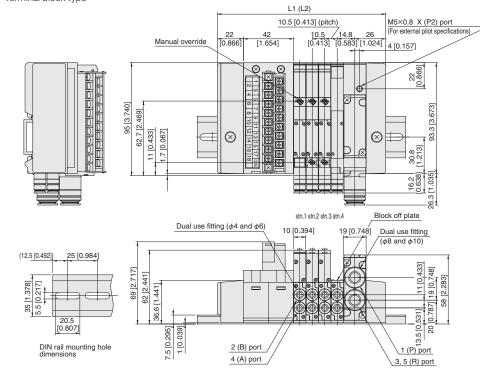



### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
3	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
4	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
5	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
6	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
7	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
8	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
9	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
10	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
11	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
12	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
13	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
14	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
15	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
16	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]
17	278.0 [10.945]	325 [12.795]	297.0 [11.693]	325 [12.795]
18	288.5 [11.358]	325 [12.795]	307.5 [12.106]	350 [13.780]

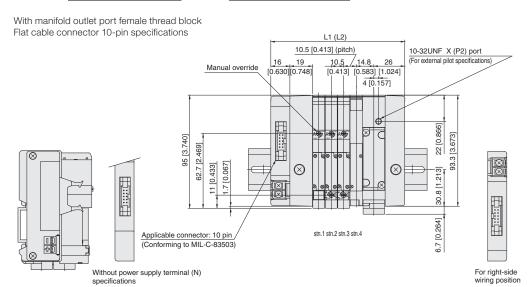





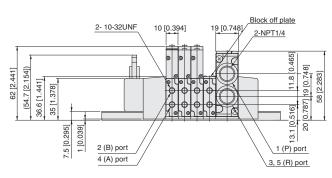


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]


Note: When two piping blocks are used.

#### F10M Number of valves Pilot specifications (Direct piping type)

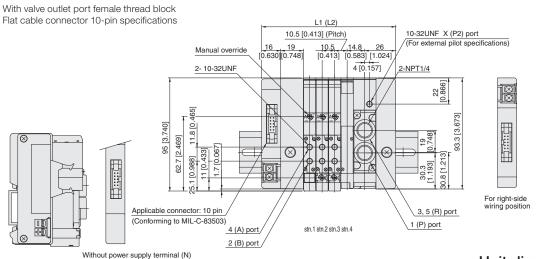

(12.5 [0.492]) 25 [0.984] DIN rail mounting hole dimensions

specifications

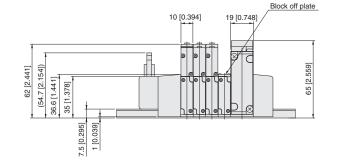

### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]


Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port female thread block

Flat cable connector 20-pin specifications (side surface wiring)

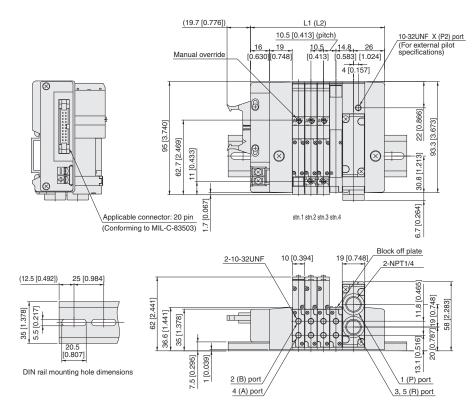

#### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

## F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 20-pin specifications

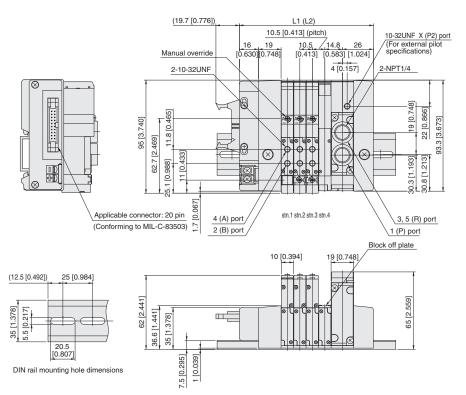


#### Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Flat cable connector 26-pin specifications

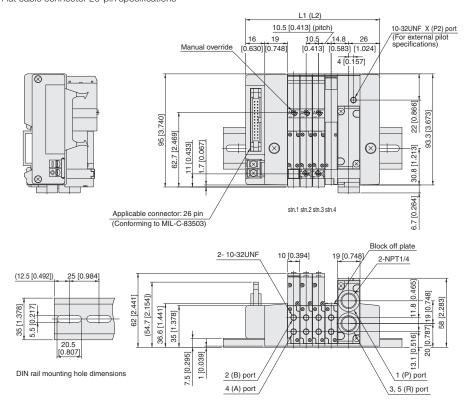


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. \* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

## F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 26-pin specifications

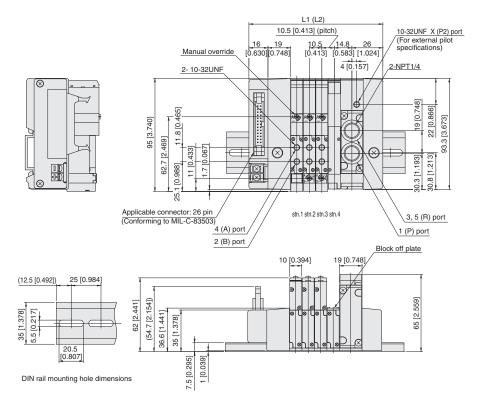


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]
Moto: M/h	on two ni	aina block	e are usee	

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port female thread block D-sub connector 25-pin specifications

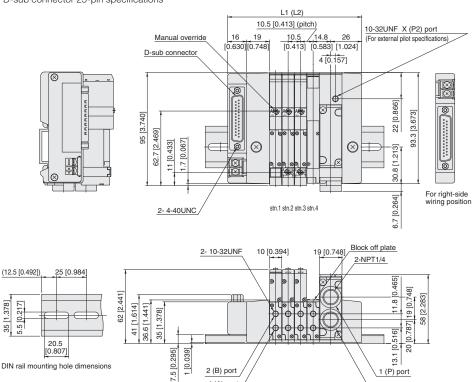

### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. \* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

### F10M Number of valves PH Pilot specifications (Direct piping type)

4 (A) port

With valve outlet port female thread block D-sub connector 25-pin specifications

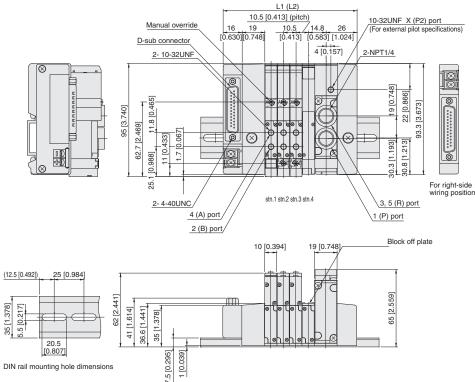

### **Unit dimensions**


1 (P) port

3, 5 (R) port

Number	L1	Length of	L2	Length of	
of units	LI	DIN rail	Note	DIN rail Note	
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]	
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]	
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]	
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]	
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]	
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]	
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]	
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]	
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]	
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]	
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]	
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]	
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]	
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]	
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]	
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]	
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]	
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]	
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]	
Note: Wh	Note: When two pining blocks are used				

Note: When two piping blocks are used.

For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

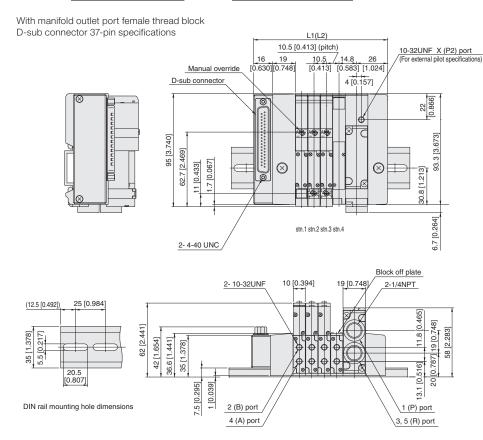


### **Unit dimensions**

Number		Longth of		Longth of
of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. \* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

### F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block D-sub connector 37-pin specifications

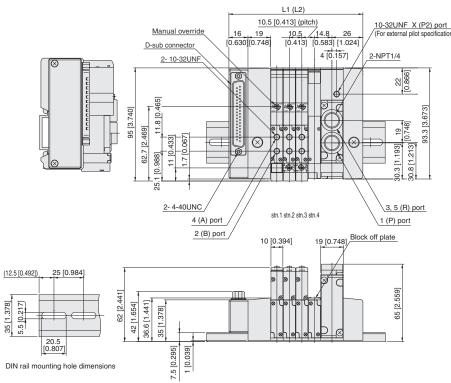


### **Unit dimensions**

2 91.5 [3.602] 125 [4.921] 110.5 [4.350] 3 102.0 [4.016] 150 [5.906] 121.0 [4.764] 4 112.5 [4.429] 150 [5.906] 131.5 [5.177] 5 123.0 [4.843] 175 [6.890] 142.0 [5.591] 6 133.5 [5.256] 175 [6.890] 152.5 [6.043]	150 [5.906] 175 [6.890] 175 [6.890] 175 [6.890] 200 [7.874]
4     112.5 [4.429]     150 [5.906]     131.5 [5.177]       5     123.0 [4.843]     175 [6.890]     142.0 [5.591]       6     133.5 [5.256]     175 [6.890]     152.5 [6.004]	175 [6.890] 175 [6.890] 200 [7.874]
5 123.0 [4.843] 175 [6.890] 142.0 [5.591] 6 133.5 [5.256] 175 [6.890] 152.5 [6.004]	175 [6.890] 200 [7.874]
6 133.5 [5.256] 175 [6.890] 152.5 [6.004]	200 [7.874]
7 1440 [5 000] 000 [7 074] 100 0 [0 417]	
7   144.0 [5.669]   200 [7.874]   163.0 [6.417]	200 [7.874]
8   154.5 [6.083]   200 [7.874]   173.5 [6.831]	225 [8.858]
9   165.0 [6.496]   200 [7.874]   184.0 [7.244]	225 [8.858]
1O 175.5 [6.909] 225 [8.858] 194.5 [7.657]	250 [9.843]
<b>1 1</b> 186.0 [7.323] 225 [8.858] 205.0 [8.071]	250 [9.843]
12   196.5 [7.736]   250 [9.843]   215.5 [8.484]	250 [9.843]
13 207.0 [8.150] 250 [9.843] 226.0 [8.898]	275 [10.827]
14 217.5 [8.563] 275 [10.827] 236.5 [9.311]	275 [10.827]
15 228.0 [8.976] 275 [10.827] 247.0 [9.724]	300 [11.811]
16 238.5 [9.390] 275 [10.827] 257.5 [10.138]	300 [11.811]
17 249.0 [9.803] 300 [11.811] 268.0 [10.551]	325 [12.795]
18   259.5 [10.217]   300 [11.811]   278.5 [10.965]	325 [12.795]
19 270.0 [10.630] 325 [12.795] 289.0 [11.378]	325 [12.795]
2O 280.5 [11.043] 325 [12.795] 299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Terminal block type

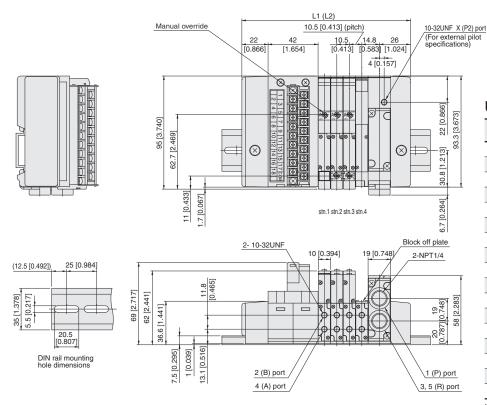


### **Unit dimensions**

<u> </u>				
Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
3	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
4	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
5	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
6	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
7	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
8	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
9	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
10	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
11	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
12	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
13	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
14	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
15	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
16	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]
17	278.0 [10.945]	325 [12.795]	297.0 [11.693]	325 [12.795]
18	288.5 [11.358]	325 [12.795]	307.5 [12.106]	350 [13.780]

Note: When two piping blocks are used.

F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Terminal block type

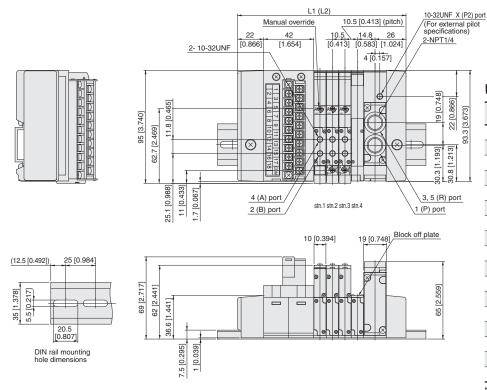


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
3	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
4	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
5	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
6	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
7	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
8	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
9	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
10	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
11	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
12	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
13	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
14	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
15	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
16	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]
17	278.0 [10.945]	325 [12.795]	297.0 [11.693]	325 [12.795]
18	288.5 [11.358]	325 [12.795]	307.5 [12.106]	350 [13.780]
N				

With manifold outlet port dual use fitting block

(Integrated serial transmission block compatible model)

\*For dimensions of EtherCAT, see p. 139.

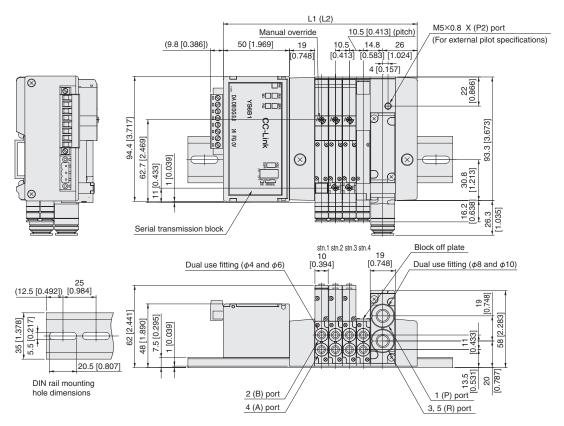


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	125.5 [4.941]	175 [6.890]	144.5 [5.689]	200 [7.874]
3	136.0 [5.354]	200 [7.874]	155.0 [6.102]	200 [7.874]
4	146.5 [5.768]	200 [7.874]	165.5 [6.516]	225 [8.858]
5	157.0 [6.181]	200 [7.874]	176.0 [6.929]	225 [8.858]
6	167.5 [6.594]	225 [8.858]	186.5 [7.343]	250 [9.843]
7	178.0 [7.008]	225 [8.858]	197.0 [7.756]	250 [9.843]
8	188.5 [7.421]	250 [9.843]	207.5 [8.169]	250 [9.843]
9	199.0 [7.835]	250 [9.843]	218.0 [8.583]	275 [10.827]
10	209.5 [8.248]	250 [9.843]	228.5 [8.996]	275 [10.827]
11	220.0 [8.661]	275 [10.827]	239.0 [9.409]	300 [11.811]
12	230.5 [9.075]	275 [10.827]	249.5 [9.823]	300 [11.811]
13	241.0 [9.488]	300 [11.811]	260.0 [10.236]	300 [11.811]
14	251.5 [9.902]	300 [11.811]	270.5 [10.650]	325 [12.795]
15	262.0 [10.315]	325 [12.795]	281.0 [11.063]	325 [12.795]
16	272.5 [10.728]	325 [12.795]	291.5 [11.476]	350 [13.780]
17	283.0 [11.142]	350 [13.780]	302.0 [11.890]	375 [14.764]
18	293.5 [11.555]	350 [13.780]	312.5 [12.303]	375 [14.764]
19	304.0 [11.969]	350 [13.780]	323.0 [12.717]	375 [14.764]
20	314.5 [12.382]	375 [14.764]	333.5 [13.130]	400 [15.748]

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port female thread block

(Integrated serial transmission block compatible manifold)

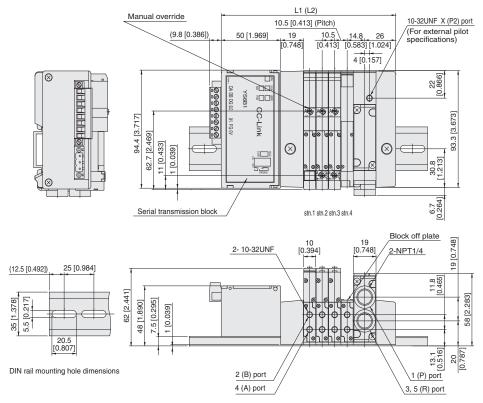

### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	125.5 [4.941]	175 [6.890]	144.5 [5.689]	200 [7.874]
3	136.0 [5.354]	200 [7.874]	155.0 [6.102]	200 [7.874]
4	146.5 [5.768]	200 [7.874]	165.5 [6.516]	225 [8.858]
5	157.0 [6.181]	200 [7.874]	176.0 [6.929]	225 [8.858]
6	167.5 [6.594]	225 [8.858]	186.5 [7.343]	250 [9.843]
7	178.0 [7.008]	225 [8.858]	197.0 [7.756]	250 [9.843]
8	188.5 [7.421]	250 [9.843]	207.5 [8.169]	250 [9.843]
9	199.0 [7.835]	250 [9.843]	218.0 [8.583]	275 [10.827]
10	209.5 [8.248]	250 [9.843]	228.5 [8.996]	275 [10.827]
11	220.0 [8.661]	275 [10.827]	239.0 [9.409]	300 [11.811]
12	230.5 [9.075]	275 [10.827]	249.5 [9.823]	300 [11.811]
13	241.0 [9.488]	300 [11.811]	260.0 [10.236]	300 [11.811]
14	251.5 [9.902]	300 [11.811]	270.5 [10.650]	325 [12.795]
15	262.0 [10.315]	325 [12.795]	281.0 [11.063]	325 [12.795]
16	272.5 [10.728]	325 [12.795]	291.5 [11.476]	350 [13.780]
17	283.0 [11.142]	350 [13.780]	302.0 [11.890]	375 [14.764]
18	293.5 [11.555]	350 [13.780]	312.5 [12.303]	375 [14.764]
19	304.0 [11.969]	350 [13.780]	323.0 [12.717]	375 [14.764]
20	314.5 [12.382]	375 [14.764]	333.5 [13.130]	400 [15.748]

Note: When two piping blocks are used.

F10M Number of valves SH Pilot specifications (Direct piping type)

With valve outlet port female thread block

(Integrated serial transmission block compatible manifold)

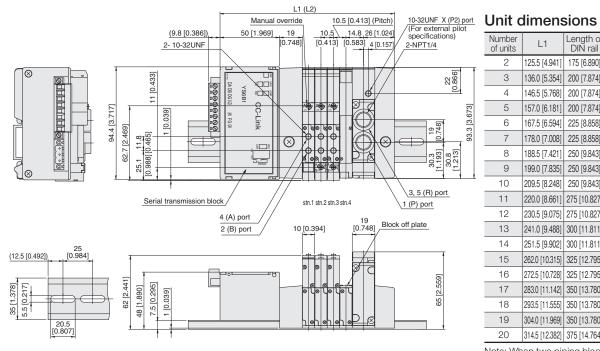

DIN rail mounting hole dimensions

18 293.5 [11.555] 350 [13.780] 312.5 [12.303] 375 [14.764]	Offic difficusions				
3         1360 [5.354]         200 [7.874]         1550 [6.102]         200 [7.874]           4         146.5 [5.768]         200 [7.874]         165.5 [6.516]         225 [8.858]           5         157.0 [6.181]         200 [7.874]         176.0 [6.929]         225 [8.858]           6         167.5 [6.594]         225 [8.858]         186.5 [7.343]         250 [9.843]           7         178.0 [7.008]         225 [8.858]         197.0 [7.756]         250 [9.843]           8         188.5 [7.421]         250 [9.843]         207.5 [8.169]         250 [9.843]           9         199.0 [7.835]         250 [9.843]         218.0 [8.583]         275 [10.827]           10         209.5 [8.248]         250 [9.843]         228.5 [8.996]         275 [10.827]           11         220.0 [8.661]         275 [10.827]         239.0 [9.409]         300 [11.811]           12         230.5 [9.075]         275 [10.827]         249.5 [9.823]         300 [11.811]           13         241.0 [9.488]         300 [11.811]         205 [10.236]         300 [11.811]           14         251.5 [9.902]         300 [11.811]         270.5 [10.650]         325 [12.795]           15         262.0 [10.315]         325 [12.795]         281.0 [11.063]		L1			Length of DIN rail Note
4 146.5 [5.768] 200 [7.874] 165.5 [6.516] 225 [8.858] 5 157.0 [6.181] 200 [7.874] 176.0 [6.929] 225 [8.858] 6 167.5 [6.594] 225 [8.858] 186.5 [7.343] 250 [9.843] 7 178.0 [7.008] 225 [8.858] 197.0 [7.756] 250 [9.843] 8 188.5 [7.421] 250 [9.843] 207.5 [8.169] 250 [9.843] 9 199.0 [7.835] 250 [9.843] 218.0 [8.583] 275 [10.827] 10 209.5 [8.248] 250 [9.843] 228.5 [8.996] 275 [10.827] 11 220.0 [8.661] 275 [10.827] 239.0 [9.409] 300 [11.811] 12 230.5 [9.075] 275 [10.827] 249.5 [9.823] 300 [11.811] 13 241.0 [9.488] 300 [11.811] 260.0 [10.236] 300 [11.811] 14 251.5 [9.902] 300 [11.811] 270.5 [10.650] 325 [12.795] 15 262.0 [10.315] 325 [12.795] 281.0 [11.063] 325 [12.795] 16 272.5 [10.728] 325 [12.795] 291.5 [11.476] 350 [13.780] 17 283.0 [11.142] 350 [13.780] 302.0 [11.890] 375 [14.764] 18 293.5 [11.555] 350 [13.780] 323.0 [21.717] 375 [14.764] 19 304.0 [11.969] 350 [13.780] 323.0 [21.717] 375 [14.764] 19	2	125.5 [4.941]	175 [6.890]	144.5 [5.689]	200 [7.874]
5         157.0 [6.181]         200 [7.874]         176.0 [6.929]         225 [8.858]           6         167.5 [6.594]         225 [8.858]         186.5 [7.343]         250 [9.843]           7         178.0 [7.008]         225 [8.858]         197.0 [7.756]         250 [9.843]           8         188.5 [7.421]         250 [9.843]         207.5 [8.169]         250 [9.843]           9         199.0 [7.835]         250 [9.843]         218.0 [8.583]         275 [10.827]           10         209.5 [8.248]         250 [9.843]         228.5 [8.996]         275 [10.827]           11         220.0 [8.661]         275 [10.827]         239.0 [9.409]         300 [11.811]           12         230.5 [9.075]         275 [10.827]         249.5 [9.823]         300 [11.811]           13         241.0 [9.488]         300 [11.811]         260.0 [10.236]         300 [11.811]           14         251.5 [9.902]         300 [11.811]         270.5 [10.650]         325 [12.795]           15         262.0 [10.315]         325 [12.795]         281.0 [11.063]         325 [12.795]           16         272.5 [10.728]         325 [12.795]         291.5 [11.476]         350 [13.780]           17         283.0 [11.142]         350 [13.780]         312.5 [12.303] <td>3</td> <td>136.0 [5.354]</td> <td>200 [7.874]</td> <td>155.0 [6.102]</td> <td>200 [7.874]</td>	3	136.0 [5.354]	200 [7.874]	155.0 [6.102]	200 [7.874]
6 167.5 [6.594] 225 [8.858] 186.5 [7.343] 250 [9.843] 7 178.0 [7.008] 225 [8.858] 197.0 [7.756] 250 [9.843] 8 188.5 [7.421] 250 [9.843] 207.5 [8.169] 250 [9.843] 9 199.0 [7.835] 250 [9.843] 218.0 [8.583] 275 [10.827] 10 209.5 [8.248] 250 [9.843] 228.5 [8.996] 275 [10.827] 11 220.0 [8.661] 275 [10.827] 239.0 [9.409] 300 [11.811] 12 230.5 [9.075] 275 [10.827] 249.5 [9.823] 300 [11.811] 13 241.0 [9.488] 300 [11.811] 260.0 [10.236] 300 [11.811] 14 251.5 [9.902] 300 [11.811] 270.5 [10.650] 325 [12.795] 15 2620 [10.315] 325 [12.795] 281.0 [11.063] 325 [12.795] 16 272.5 [10.728] 325 [12.795] 291.5 [11.476] 350 [13.780] 17 283.0 [11.142] 350 [13.780] 302.0 [11.890] 375 [14.764] 18 293.5 [11.555] 350 [13.780] 323.0 [12.717] 375 [14.764]	4	146.5 [5.768]	200 [7.874]	165.5 [6.516]	225 [8.858]
7 178.0 [7.008] 225 [8.858] 197.0 [7.756] 250 [9.843] 8 188.5 [7.421] 250 [9.843] 207.5 [8.169] 250 [9.843] 9 199.0 [7.835] 250 [9.843] 218.0 [8.583] 275 [10.827] 10 209.5 [8.248] 250 [9.843] 228.5 [8.996] 275 [10.827] 11 220.0 [8.661] 275 [10.827] 239.0 [9.409] 300 [11.811] 12 230.5 [9.075] 275 [10.827] 249.5 [9.823] 300 [11.811] 13 241.0 [9.488] 300 [11.811] 260.0 [10.236] 300 [11.811] 14 251.5 [9.902] 300 [11.811] 270.5 [10.650] 325 [12.795] 15 2620 [10.315] 325 [12.795] 281.0 [11.063] 325 [12.795] 16 272.5 [10.728] 325 [12.795] 291.5 [11.476] 350 [13.780] 17 283.0 [11.142] 350 [13.780] 302.0 [11.890] 375 [14.764] 18 293.5 [11.555] 350 [13.780] 323.0 [12.717] 375 [14.764] 19 304.0 [11.969] 350 [13.780] 323.0 [12.717] 375 [14.764]	5	157.0 [6.181]	200 [7.874]	176.0 [6.929]	225 [8.858]
8 188.5 [7.421] 250 [9.843] 207.5 [8.169] 250 [9.843] 9 199.0 [7.835] 250 [9.843] 218.0 [8.583] 275 [10.827] 10 209.5 [8.248] 250 [9.843] 228.5 [8.996] 275 [10.827] 11 220.0 [8.661] 275 [10.827] 239.0 [9.409] 300 [11.811] 12 230.5 [9.075] 275 [10.827] 249.5 [9.823] 300 [11.811] 13 241.0 [9.488] 300 [11.811] 260.0 [10.236] 300 [11.811] 14 251.5 [9.902] 300 [11.811] 270.5 [10.650] 325 [12.795] 15 2620 [10.315] 325 [12.795] 281.0 [11.063] 325 [12.795] 16 272.5 [10.728] 325 [12.795] 291.5 [11.476] 350 [13.780] 17 283.0 [11.142] 350 [13.780] 302.0 [11.890] 375 [14.764] 18 293.5 [11.555] 350 [13.780] 323.0 [12.717] 375 [14.764] 19 304.0 [11.969] 350 [13.780] 323.0 [12.717] 375 [14.764]	6	167.5 [6.594]	225 [8.858]	186.5 [7.343]	250 [9.843]
9 199.0 [7.835] 250 [9.843] 218.0 [8.583] 275 [10.827] 10 209.5 [8.248] 250 [9.843] 228.5 [8.996] 275 [10.827] 11 220.0 [8.661] 275 [10.827] 239.0 [9.409] 300 [11.811] 12 230.5 [9.075] 275 [10.827] 249.5 [9.823] 300 [11.811] 13 241.0 [9.488] 300 [11.811] 260.0 [10.236] 300 [11.811] 14 251.5 [9.902] 300 [11.811] 270.5 [10.650] 325 [12.795] 15 2620 [10.315] 325 [12.795] 281.0 [11.063] 325 [12.795] 16 272.5 [10.728] 325 [12.795] 291.5 [11.476] 350 [13.780] 17 283.0 [11.142] 350 [13.780] 302.0 [11.890] 375 [14.764] 18 293.5 [11.555] 350 [13.780] 323.0 [12.717] 375 [14.764]	7	178.0 [7.008]	225 [8.858]	197.0 [7.756]	250 [9.843]
10         209.5 [8.248]         250 [9.843]         228.5 [8.996]         275 [10.827]           11         220.0 [8.661]         275 [10.827]         239.0 [9.409]         300 [11.811]           12         230.5 [9.075]         275 [10.827]         249.5 [9.823]         300 [11.811]           13         241.0 [9.488]         300 [11.811]         260.0 [10.236]         300 [11.811]           14         251.5 [9.902]         300 [11.811]         270.5 [10.650]         325 [12.795]           15         262.0 [10.315]         325 [12.795]         281.0 [11.063]         325 [12.795]           16         272.5 [10.728]         325 [12.795]         291.5 [11.476]         350 [13.780]           17         283.0 [11.142]         350 [13.780]         302.0 [11.890]         375 [14.764]           18         293.5 [11.555]         350 [13.780]         323.0 [12.717]         375 [14.764]           19         304.0 [11.969]         350 [13.780]         323.0 [12.717]         375 [14.764]	8	188.5 [7.421]	250 [9.843]	207.5 [8.169]	250 [9.843]
11         220.0 [8.661]         275 [10.827]         239.0 [9.409]         300 [11.811]           12         230.5 [9.075]         275 [10.827]         249.5 [9.823]         300 [11.811]           13         241.0 [9.488]         300 [11.811]         260.0 [10.236]         300 [11.811]           14         251.5 [9.902]         300 [11.811]         270.5 [10.650]         325 [12.795]           15         262.0 [10.315]         325 [12.795]         281.0 [11.063]         325 [12.795]           16         272.5 [10.728]         325 [12.795]         291.5 [11.476]         350 [13.780]           17         283.0 [11.142]         350 [13.780]         302.0 [11.890]         375 [14.764]           18         293.5 [11.555]         350 [13.780]         323.0 [12.717]         375 [14.764]           19         304.0 [11.969]         350 [13.780]         323.0 [12.717]         375 [14.764]	9	199.0 [7.835]	250 [9.843]	218.0 [8.583]	275 [10.827]
12     230.5 [9.075]     275 [10.827]     249.5 [9.823]     300 [11.811]       13     241.0 [9.488]     300 [11.811]     260.0 [10.236]     300 [11.811]       14     251.5 [9.902]     300 [11.811]     270.5 [10.650]     325 [12.795]       15     262.0 [10.315]     325 [12.795]     281.0 [11.063]     325 [12.795]       16     272.5 [10.728]     325 [12.795]     291.5 [11.476]     350 [13.780]       17     283.0 [11.142]     350 [13.780]     302.0 [11.890]     375 [14.764]       18     293.5 [11.555]     350 [13.780]     312.5 [12.303]     375 [14.764]       19     304.0 [11.969]     350 [13.780]     323.0 [12.717]     375 [14.764]	10	209.5 [8.248]	250 [9.843]	228.5 [8.996]	275 [10.827]
13     241.0 [9.488]     300 [11.811]     260.0 [10.236]     300 [11.811]       14     251.5 [9.902]     300 [11.811]     270.5 [10.650]     325 [12.795]       15     262.0 [10.315]     325 [12.795]     281.0 [11.063]     325 [12.795]       16     272.5 [10.728]     325 [12.795]     291.5 [11.476]     350 [13.780]       17     283.0 [11.142]     350 [13.780]     302.0 [11.890]     375 [14.764]       18     293.5 [11.555]     350 [13.780]     312.5 [12.303]     375 [14.764]       19     304.0 [11.969]     350 [13.780]     323.0 [12.717]     375 [14.764]	11	220.0 [8.661]	275 [10.827]	239.0 [9.409]	300 [11.811]
14     251.5 [9.902]     300 [11.811]     270.5 [10.650]     325 [12.795]       15     262.0 [10.315]     325 [12.795]     281.0 [11.063]     325 [12.795]       16     272.5 [10.728]     325 [12.795]     291.5 [11.476]     350 [13.780]       17     283.0 [11.142]     350 [13.780]     302.0 [11.890]     375 [14.764]       18     293.5 [11.555]     350 [13.780]     312.5 [12.303]     375 [14.764]       19     304.0 [11.969]     350 [13.780]     323.0 [12.717]     375 [14.764]	12	230.5 [9.075]	275 [10.827]	249.5 [9.823]	300 [11.811]
15         262.0 [10.315]         325 [12.795]         281.0 [11.063]         325 [12.795]           16         272.5 [10.728]         325 [12.795]         291.5 [11.476]         350 [13.780]           17         283.0 [11.142]         350 [13.780]         302.0 [11.890]         375 [14.764]           18         293.5 [11.555]         350 [13.780]         312.5 [12.303]         375 [14.764]           19         304.0 [11.969]         350 [13.780]         323.0 [12.717]         375 [14.764]	13	241.0 [9.488]	300 [11.811]	260.0 [10.236]	300 [11.811]
16     272.5 [10.728]     325 [12.795]     291.5 [11.476]     350 [13.780]       17     283.0 [11.142]     350 [13.780]     302.0 [11.890]     375 [14.764]       18     293.5 [11.555]     350 [13.780]     312.5 [12.303]     375 [14.764]       19     304.0 [11.969]     350 [13.780]     323.0 [12.717]     375 [14.764]	14	251.5 [9.902]	300 [11.811]	270.5 [10.650]	325 [12.795]
17     283.0 [11.142]     350 [13.780]     302.0 [11.890]     375 [14.764]       18     293.5 [11.555]     350 [13.780]     312.5 [12.303]     375 [14.764]       19     304.0 [11.969]     350 [13.780]     323.0 [12.717]     375 [14.764]	15	262.0 [10.315]	325 [12.795]	281.0 [11.063]	325 [12.795]
18 293.5 [11.555] 350 [13.780] 312.5 [12.303] 375 [14.764] 19 304.0 [11.969] 350 [13.780] 323.0 [12.717] 375 [14.764]	16	272.5 [10.728]	325 [12.795]	291.5 [11.476]	350 [13.780]
19 304.0 [11.969] 350 [13.780] 323.0 [12.717] 375 [14.764]	17	283.0 [11.142]	350 [13.780]	302.0 [11.890]	375 [14.764]
	18	293.5 [11.555]	350 [13.780]	312.5 [12.303]	375 [14.764]
20 314.5 [12.382] 375 [14.764] 333.5 [13.130] 400 [15.748]	19	304.0 [11.969]	350 [13.780]	323.0 [12.717]	375 [14.764]
1 2 2 2 2 2 2 2 2	20	314.5 [12.382]	375 [14.764]	333.5 [13.130]	400 [15.748]


Note: When two piping blocks are used.


\* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port dual use fitting block

(EtherCAT/EtherNet/IP) \*The figure shows EtherCAT.

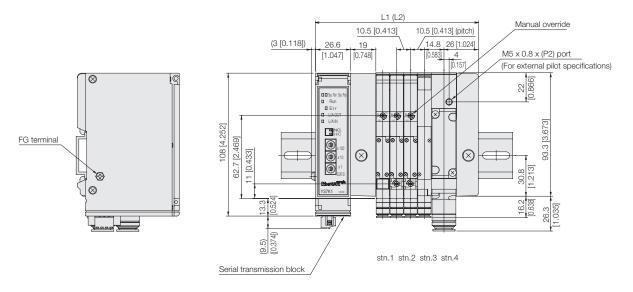

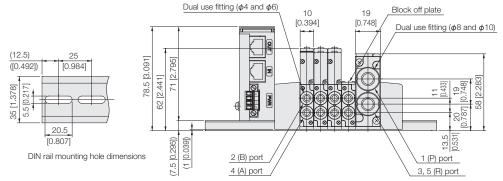

### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	102.1 [4.020]	150 [5.906]	121.1 [4.768]	175 [6.890]
3	112.6 [4.433]	175 [6.890]	131.6 [5.181]	175 [6.890]
4	123.1 [4.846]	175 [6.890]	142.1 [5.594]	200 [7.874]
5	133.6 [5.260]	175 [6.890]	152.6 [6.008]	200 [7.874]
6	144.1 [5.673]	200 [7.874]	163.1 [6.421]	225 [8.858]
7	154.6 [6.087]	200 [7.874]	173.6 [6.835]	225 [8.858]
8	165.1 [6.500]	225 [8.858]	184.1 [7.248]	225 [8.858]
9	175.6 [6.913]	225 [8.858]	194.6 [7.661]	250 [9.843]
10	186.1 [7.327]	225 [8.858]	205.1 [8.075]	250 [9.843]
11	196.6 [7.740]	250 [9.843]	215.6 [8.488]	275 [10.827]
12	207.1 [8.154]	250 [9.843]	226.1 [8.902]	275 [10.827]
13	217.6 [8.567]	275 [10.827]	236.6 [9.315]	275 [10.827]
14	228.1 [8.980]	275 [10.827]	247.1 [9.728]	300 [11.811]
15	238.6 [9.394]	300 [11.811]	257.6 [10.142]	300 [11.811]
16	249.1 [9.807]	300 [11.811]	268.1 [10.555]	325 [12.795]
17	259.6 [10.220]	325 [12.795]	278.6 [10.969]	350 [13.780]
18	270.1 [10.633]	325 [12.795]	289.1 [11.382]	350 [13.780]
19	280.6 [11.047]	325 [12.795]	299.6 [11.795]	350 [13.780]
20	291.1 [11.461]	350 [13.780]	310.1 [12.209]	375 [14.764]


<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.



With manifold outlet port dual use fitting block

(Stand alone serial transmission block compatible manifold)




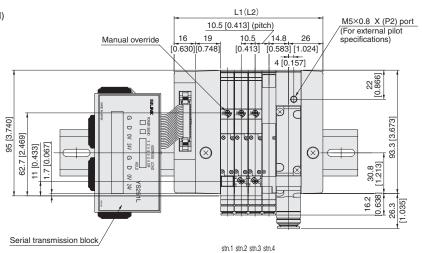


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	200 [7.874]	110.5 [4.350]	200 [7.874]
3	102.0 [4.016]	200 [7.874]	121.0 [4.764]	225 [8.858]
4	112.5 [4.429]	225 [8.858]	131.5 [5.177]	225 [8.858]
5	123.0 [4.843]	225 [8.858]	142.0 [5.591]	250 [9.843]
6	133.5 [5.256]	225 [8.858]	152.5 [6.004]	250 [9.843]
7	144.0 [5.669]	250 [9.843]	163.0 [6.417]	275 [10.827]
8	154.5 [6.083]	250 [9.843]	173.5 [6.831]	275 [10.827]
9	165.0 [6.496]	275 [10.827]	184.0 [7.244]	275 [10.827]
10	175.5 [6.909]	275 [10.827]	194.5 [7.657]	300 [11.811]
11	186.0 [7.323]	300 [11.811]	205.0 [8.071]	300 [11.811]
12	196.5 [7.736]	300 [11.811]	215.5 [8.484]	325 [12.795]
13	207.0 [8.150]	300 [11.811]	226.0 [8.898]	325 [12.795]
14	217.5 [8.563]	325 [12.795]	236.5 [9.311]	350 [13.780]
15	228.0 [8.976]	325 [12.795]	247.0 [9.724]	350 [13.780]
16	238.5 [9.390]	350 [13.780]	257.5 [10.138]	350 [13.780]

Note: When two piping blocks are used.

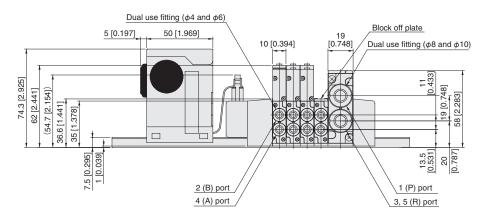





DIN rail mounting hole dimensions


### Additional Parts (available separately)


● Muffler: KM-J10 for both plug-in and non-plug-in





<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

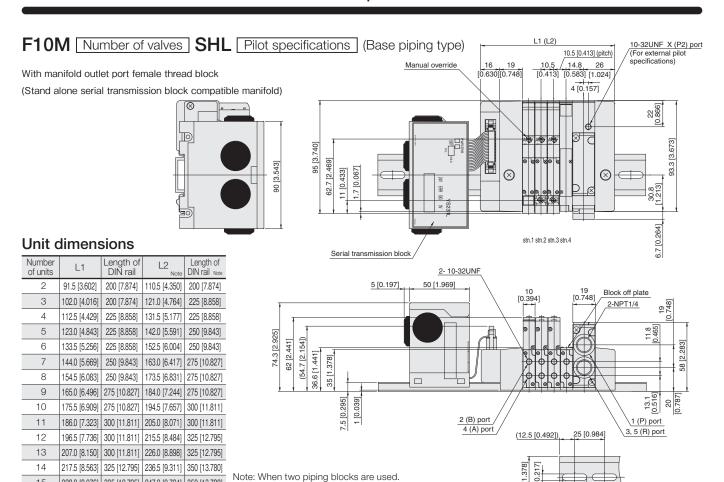

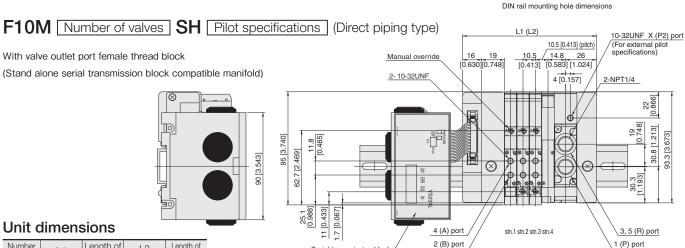

For right-side mounting wiring (-R), add

5.5 mm [0.217 in] to the L1 (L2) dimension.

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	200 [7.874]	110.5 [4.350]	200 [7.874]
3	102.0 [4.016]	200 [7.874]	121.0 [4.764]	225 [8.858]
4	112.5 [4.429]	225 [8.858]	131.5 [5.177]	225 [8.858]
5	123.0 [4.843]	225 [8.858]	142.0 [5.591]	250 [9.843]
6	133.5 [5.256]	225 [8.858]	152.5 [6.004]	250 [9.843]
7	144.0 [5.669]	250 [9.843]	163.0 [6.417]	275 [10.827]
8	154.5 [6.083]	250 [9.843]	173.5 [6.831]	275 [10.827]
9	165.0 [6.496]	275 [10.827]	184.0 [7.244]	275 [10.827]
10	175.5 [6.909]	275 [10.827]	194.5 [7.657]	300 [11.811]
11	186.0 [7.323]	300 [11.811]	205.0 [8.071]	300 [11.811]
12	196.5 [7.736]	300 [11.811]	215.5 [8.484]	325 [12.795]
13	207.0 [8.150]	300 [11.811]	226.0 [8.898]	325 [12.795]
14	217.5 [8.563]	325 [12.795]	236.5 [9.311]	350 [13.780]
15	228.0 [8.976]	325 [12.795]	247.0 [9.724]	350 [13.780]
16	238.5 [9.390]	350 [13.780]	257.5 [10.138]	350 [13.780]


15

16

228.0 [8.976] | 325 [12.795]

247.0 [9.724] 350 [13.780]


238.5 [9.390] 350 [13.780] 257.5 [10.138] 350 [13.780]

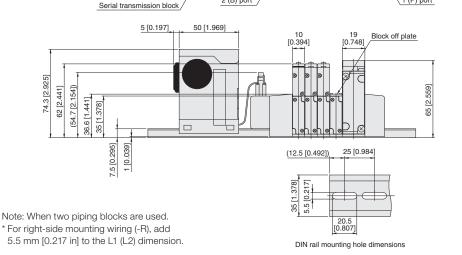

20.5 [0.807]



With manifold outlet port female thread block (Ether CAT)

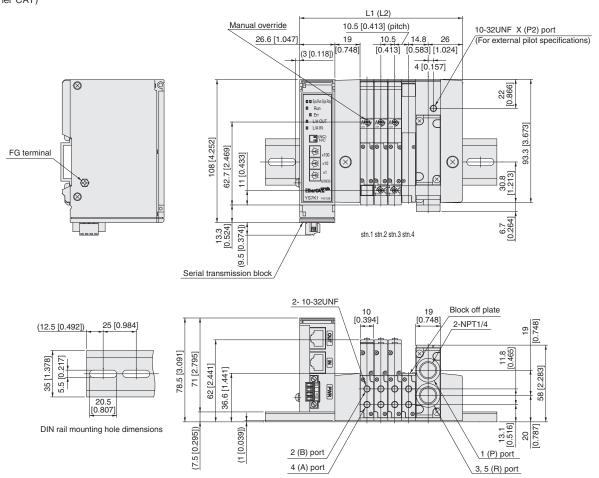


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	120.1 [4.728]	150 [5.906]	121.1 [4.768]	175 [6.890]
3	112.6 [4.433]	175 [6.890]	131.6 [5.181]	175 [6.890]
4	123.1 [4.846]	175 [6.890]	142.1 [5.594]	200 [7.874]
5	133.6 [5.260]	175 [6.890]	152.6 [6.008]	200 [7.874]
6	144.1 [5.673]	200 [7.874]	163.1 [6.421]	225 [8.858]
7	154.6 [6.087]	200 [7.874]	173.6 [6.835]	225 [8.858]
8	165.1 [6.500]	225 [8.858]	184.1 [7.248]	225 [8.858]
9	175.6 [6.913]	225 [8.858]	194.6 [7.661]	250 [9.843]
10	186.1 [7.327]	225 [8.858]	205.1 [8.075]	250 [9.843]
11	196.6 [7.740]	250 [9.843]	215.6 [8.488]	275 [10.827]
12	207.1 [8.154]	250 [9.843]	226.1 [8.902]	275 [10.827]
13	217.6 [8.567]	275 [10.827]	236.6 [9.315]	275 [10.827]
14	228.1 [8.980]	275 [10.827]	247.1 [9.728]	300 [11.811]
15	238.6 [9.394]	300 [11.811]	257.6 [10.142]	300 [11.811]
16	249.1 [9.807]	300 [11.811]	268.1 [10.555]	325 [12.795]
17	259.6 [10.220]	325 [12.795]	278.6 [10.969]	350 [13.780]
18	270.1 [10.634]	325 [12.795]	289.1 [11.382]	350 [13.780]
19	280.6 [11.047]	325 [12.795]	299.6 [11.795]	350 [13.780]
20	291.1 [11.461]	350 [13.780]	310.1 [12.209]	375 [14.764]

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With valve outlet port female thread block (Ether CAT)

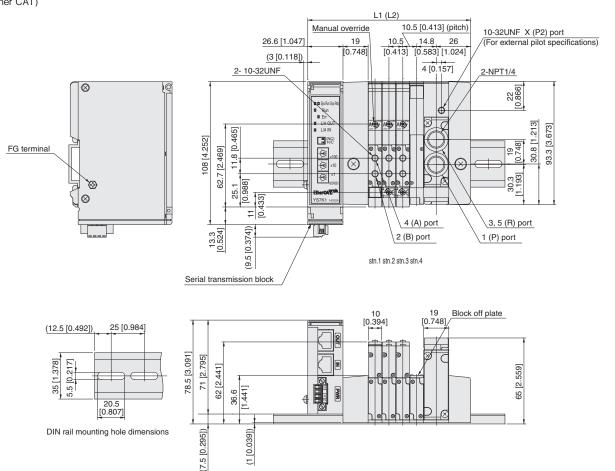


### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	120.1 [4.728]	150 [5.906]	121.1 [4.768]	175 [6.890]
3	112.6 [4.433]	175 [6.890]	131.6 [5.181]	175 [6.890]
4	123.1 [4.846]	175 [6.890]	142.1 [5.594]	200 [7.874]
5	133.6 [5.260]	175 [6.890]	152.6 [6.008]	200 [7.874]
6	144.1 [5.673]	200 [7.874]	163.1 [6.421]	225 [8.858]
7	154.6 [6.087]	200 [7.874]	173.6 [6.835]	225 [8.858]
8	165.1 [6.500]	225 [8.858]	184.1 [7.248]	225 [8.858]
9	175.6 [6.913]	225 [8.858]	194.6 [7.661]	250 [9.843]
10	186.1 [7.327]	225 [8.858]	205.1 [8.075]	250 [9.843]
11	196.6 [7.740]	250 [9.843]	215.6 [8.488]	275 [10.827]
12	207.1 [8.154]	250 [9.843]	226.1 [8.902]	275 [10.827]
13	217.6 [8.567]	275 [10.827]	236.6 [9.315]	275 [10.827]
14	228.1 [8.980]	275 [10.827]	247.1 [9.728]	300 [11.811]
15	238.6 [9.394]	300 [11.811]	257.6 [10.142]	300 [11.811]
16	249.1 [9.807]	300 [11.811]	268.1 [10.555]	325 [12.795]
17	259.6 [10.220]	325 [12.795]	278.6 [10.969]	350 [13.780]
18	270.1 [10.634]	325 [12.795]	289.1 [11.382]	350 [13.780]
19	280.6 [11.047]	325 [12.795]	299.6 [11.795]	350 [13.780]
20	291.1 [11.461]	350 [13.780]	310.1 [12.209]	375 [14.764]

<sup>\*</sup> For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

## F10M Number of units XN M Pilot specifications - Piping block specification (Base piping type)

With manifold outlet port dual use fitting block S type plug connector

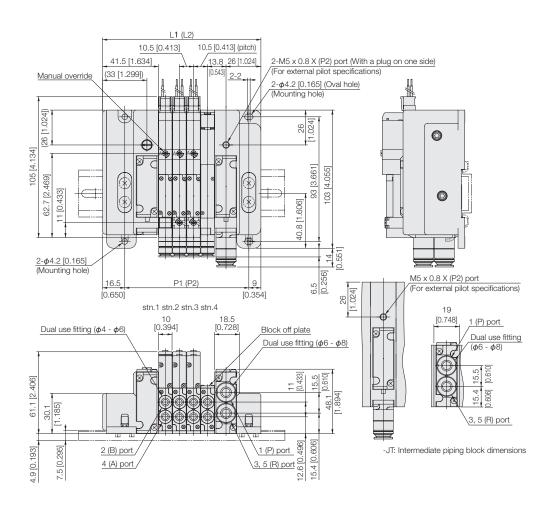


### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2 Note	P2 Note	Length of DIN rail Note	
2	97.0 [3.819]	71.5 [2.815]	150 [5.906]	-	-	-	
3	107.5 [4.232]	82.0 [3.228]	150 [5.906]	126.5 [4.980]	101.0 [3.976]	175 [6.890]	
4	118.0 [4.646]	92.5 [3.642]	175 [6.890]	137.0 [5.394]	111.5 [4.390]	175 [6.890]	
5	128.5 [5.059]	103.0 [4.055]	175 [6.890]	147.5 [5.807]	122.0 [4.803]	175 [6.890]	
6	139.0 [5.472]	113.5 [4.469]	175 [6.890]	158.0 [6.220]	132.5 [5.217]	200 [7.874]	
7	149.5 [5.886]	124.0 [4.882]	[4.882] 200 [7.874] 168.5 [6.634] 143.0 [5.630]		200 [7.874]		
8	160.0 [6.299]	134.5 [5.295]	134.5 [5.295] 200 [7.874] 179.0 [7.047] 15		153.5 [6.043]	225 [8.858]	
9	170.5 [6.713]	145.0 [5.709]	[5.709] 225 [8.858] 189.5 [7.461] 164.0 [6.4		164.0 [6.457]	225 [8.858]	
10	181.0 [7.126]	6] 155.5 [6.122] 225 [8.85		200.0 [7.874]	174.5 [6.870]	225 [8.858]	
11	1 191.5 [7.539] 10		250 [9.843]	210.5 [8.287]	185.0 [7.283]	250 [9.843]	
12	202.0 [7.953]	176.5 [6.949]	250 [9.843]	221.0 [8.701]	195.5 [7.697]	250 [9.843]	
13	212.5 [8.366]	187.0 [7.362]	250 [9.843]	231.5 [9.114]	206.0 [8.110]	275 [10.827]	
14	223.0 [8.780]	197.5 [7.776]	275 [10.827]	242.0 [9.528]	216.5 [8.524]	275 [10.827]	
15	233.5 [9.193]	208.0 [8.189]	275 [10.827]	252.5 [9.941]	227.0 [8.937]	300 [11.811]	
16	244.0 [9.606]	218.5 [8.602]	300 [11.811]	263.0 [10.354]	237.5 [9.350]	300 [11.811]	
17	254.5 [10.020]	229.0 [9.016]	300 [11.811]	273.5 [10.768]	248.0 [9.764]	300 [11.811]	
18	265.0 [10.433]	239.5 [9.429]	325 [12.795]	284.0 [11.181]	258.5 [10.177]	325 [12.795]	
19	275.5 [10.846]	250.0 [9.843]	325 [12.795]	294.5 [11.594]	269.0 [10.591]	325 [12.795]	
20	286.0 [11.260]	260.5 [10.256]	325 [12.795]	305.0 [12.008] 279.5 [11.004]		350 [13.780]	
21	-	-	-	315.5 [12.421]	290.0 [11.417]	350 [13.780]	

Note:When the  $J \square T$  or MT piping block specification is selected.

### F10M Number of units XN Pilot specifications - Piping block specification (Direct piping type)

With manifold outlet port dual use fitting block S type plug connector

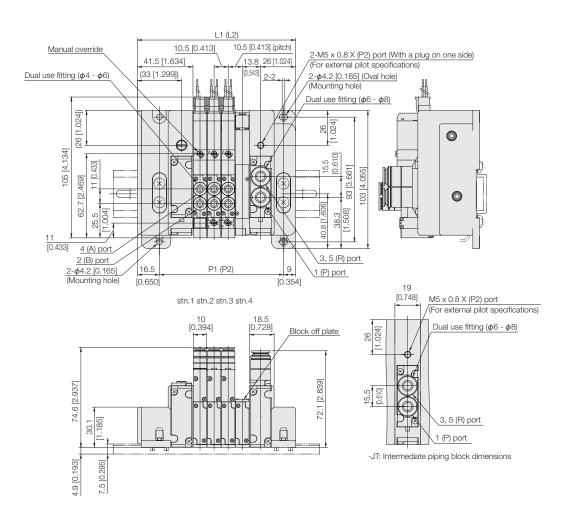


### **Unit dimensions**


Number of units	L1	P1	Length of DIN rail	L2 Note	P2 Note	Length of DIN rail Note	
2	97.0 [3.819]	71.5 [2.815]	150 [5.906]	-	-	-	
3	107.5 [4.232]	82.0 [3.228]	150 [5.906]	126.5 [4.980]	101.0 [3.976]	175 [6.890]	
4	118.0 [4.646]	92.5 [3.642]	175 [6.890]	137.0 [5.394]	111.5 [4.390]	175 [6.890]	
5	128.5 [5.059]	103.0 [4.055]	175 [6.890]	147.5 [5.807]	122.0 [4.803]	175 [6.890]	
6	139.0 [5.472]	113.5 [4.469]	175 [6.890]	158.0 [6.220]	132.5 [5.217]	200 [7.874]	
7	149.5 [5.886]	124.0 [4.882]	200 [7.874]	168.5 [6.634]	143.0 [5.630]	200 [7.874]	
8	160.0 [6.299]	134.5 [5.295]	200 [7.874]	179.0 [7.047]	153.5 [6.043]	225 [8.858]	
9	170.5 [6.713]	145.0 [5.709]	225 [8.858]	189.5 [7.461]	164.0 [6.457]	225 [8.858]	
10	181.0 [7.126]	155.5 [6.122]	225 [8.858]	200.0 [7.874]	174.5 [6.870]	225 [8.858]	
11	191.5 [7.539]	166.0 [6.535]	250 [9.843]	210.5 [8.287]	185.0 [7.283]	250 [9.843]	
12	202.0 [7.953]	176.5 [6.949]	250 [9.843]	221.0 [8.701]	195.5 [7.697]	250 [9.843]	
13	212.5 [8.366]	187.0 [7.362]	250 [9.843]	231.5 [9.114]	206.0 [8.110]	275 [10.827]	
14	223.0 [8.780]	197.5 [7.776]	275 [10.827]	242.0 [9.528]	216.5 [8.524]	275 [10.827]	
15	233.5 [9.193]	208.0 [8.189]	275 [10.827]	252.5 [9.941]	227.0 [8.937]	300 [11.811]	
16	244.0 [9.606]	218.5 [8.602]	300 [11.811]	263.0 [10.354]	237.5 [9.350]	300 [11.811]	
17	254.5 [10.020]	229.0 [9.016]	300 [11.811]	273.5 [10.768]	248.0 [9.764]	300 [11.811]	
18	265.0 [10.433]	239.5 [9.429]	325 [12.795]	284.0 [11.181]	258.5 [10.177]	325 [12.795]	
19	275.5 [10.846]	250.0 [9.843]	325 [12.795]	294.5 [11.594]	269.0 [10.591]	325 [12.795]	
20	286.0 [11.260]	260.5 [10.256]	325 [12.795]	305.0 [12.008] 279.5 [11.004		350 [13.780]	
21	-	-	-	315.5 [12.421]	290.0 [11.417]	350 [13.780]	

Note:When the J $\square$ T or MT piping block specification is selected.


With manifold outlet port dual use fitting block Flat cable connector 10-pin specifications

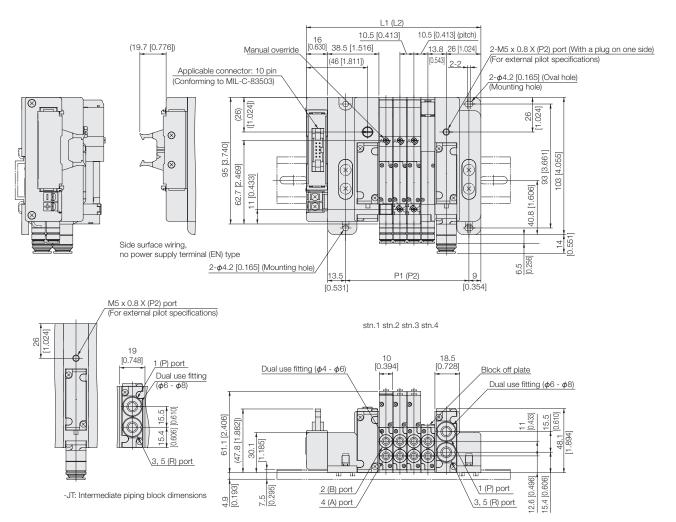



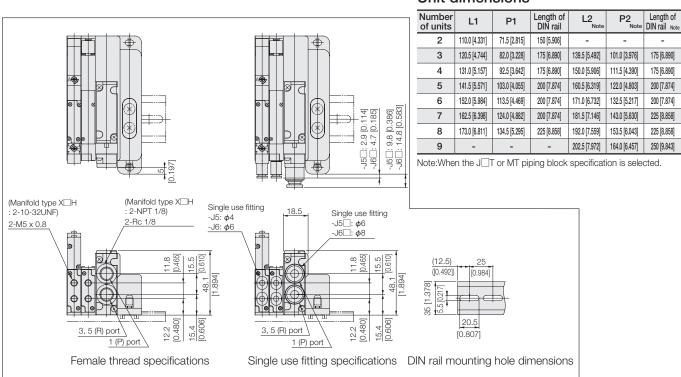

With manifold outlet port dual use fitting block Flat cable connector 20-pin specifications

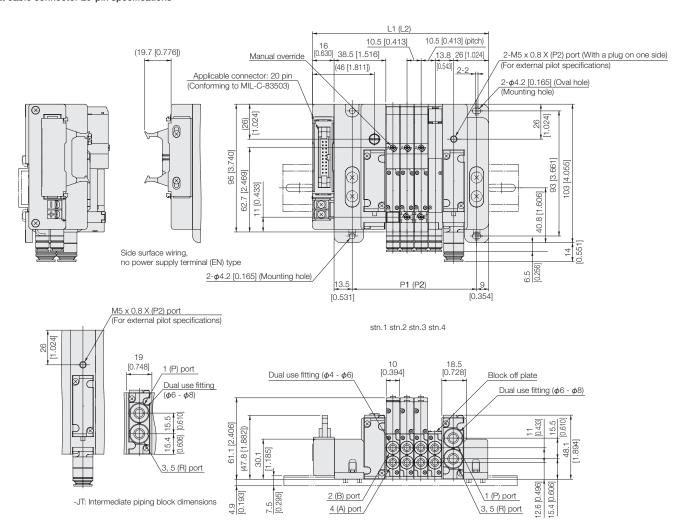


### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2 Note	P2 Note	Length of DIN rail Note	
2	110.0 [4.331]	71.5 [2.815]	150 [5.906]	-	-	-	
3	120.5 [4.744]	82.0 [3.228]	175 [6.890]	139.5 [5.492]	101.0 [3.976]	175 [6.890]	
4	131.0 [5.157]	92.5 [3.642]	175 [6.890]	150.0 [5.906]	111.5 [4.390]	175 [6.890]	
5	141.5 [5.571]	103.0 [4.055]	200 [7.874]	160.5 [6.319]	122.0 [4.803]	200 [7.874]	
6	152.0 [5.984]	113.5 [4.469]	200 [7.874]	171.0 [6.732]	132.5 [5.217]	200 [7.874]	
7	162.5 [6.398]	124.0 [4.882]	200 [7.874]	181.5 [7.146]	143.0 [5.630]	225 [8.858]	
8	173.0 [6.811]	134.5 [5.295]	225 [8.858]	192.0 [7.559]	153.5 [6.043]	225 [8.858]	
9	183.5 [7.224]	145.0 [5.709]	225 [8.858]	202.5 [7.972]	164.0 [6.457]	250 [9.843]	
10	194.0 [7.638]	155.5 [6.122]	250 [9.843]	213.0 [8.386]	174.5 [6.870]	250 [9.843]	
11	204.5 [8.051]	166.0 [6.535]	250 [9.843]	223.5 [8.799]	185.0 [7.283]	250 [9.843]	
12	215.0 [8.465]	176.5 [6.949]	275 [10.827]	234.0 [9.213]	195.5 [7.697]	275 [10.827]	
13	225.5 [8.878]	187.0 [7.362]	275 [10.827]	244.5 [9.626]	206.0 [8.110]	275 [10.827]	
14	236.0 [9.291]	197.5 [7.776]	275 [10.827]	255.0 [10.039]	216.5 [8.524]	300 [11.811]	
15	246.5 [9.705]	208.0 [8.189]	300 [11.811]	265.5 [10.453]	227.0 [8.937]	300 [11.811]	
16	257.0 [10.118]	218.5 [8.602]	300 [11.811]	276.0 [10.866]	237.5 [9.350]	325 [12.795]	
17	-	-	-	286.5 [11.280]	248.0 [9.764]	325 [12.795]	

Note:When the  $J \square T$  or MT piping block specification is selected.

With manifold outlet port dual use fitting block Flat cable connector 26-pin specifications

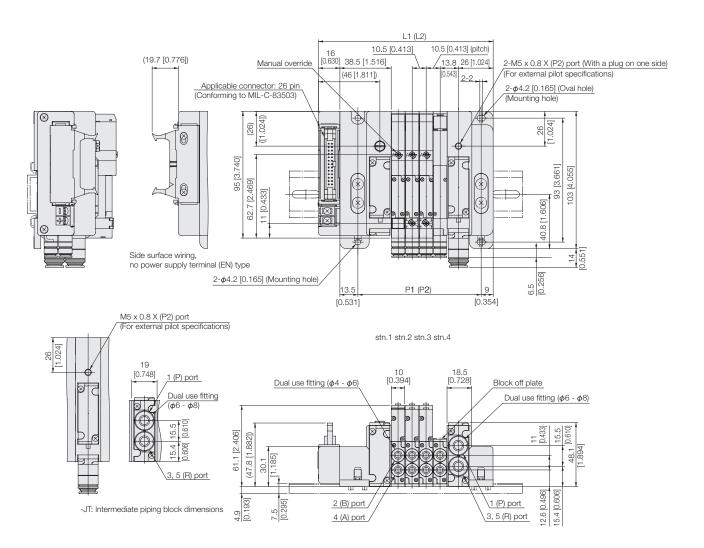



### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2 Note	P2 Note	Length of DIN rail Note	
2	110.0 [4.331]	71.5 [2.815]	150 [5.906]	-	-	-	
3	120.5 [4.744]	82.0 [3.228]	175 [6.890]	139.5 [5.492]	101.0 [3.976]	175 [6.890]	
4	131.0 [5.157]	92.5 [3.642]	175 [6.890]	150.0 [5.906]	111.5 [4.390]	175 [6.890]	
5	141.5 [5.571]	103.0 [4.055]	200 [7.874]	160.5 [6.319]	122.0 [4.803]	200 [7.874]	
6	152.0 [5.984]	113.5 [4.469]	200 [7.874]	171.0 [6.732]	132.5 [5.217]	200 [7.874]	
7	162.5 [6.398]	124.0 [4.882]	200 [7.874]	181.5 [7.146]	143.0 [5.630]	225 [8.858]	
8	173.0 [6.811]	134.5 [5.295]	225 [8.858]	192.0 [7.559]	153.5 [6.043]	225 [8.858]	
9	183.5 [7.224]	145.0 [5.709]	225 [8.858]	202.5 [7.972]	164.0 [6.457]	250 [9.843]	
10	194.0 [7.638]	155.5 [6.122]	250 [9.843]	213.0 [8.386]	174.5 [6.870]	250 [9.843]	
11	204.5 [8.051]	166.0 [6.535]	250 [9.843]	223.5 [8.799]	185.0 [7.283]	250 [9.843]	
12	215.0 [8.465]	176.5 [6.949]	275 [10.827]	234.0 [9.213]	195.5 [7.697]	275 [10.827]	
13	225.5 [8.878]	187.0 [7.362]	275 [10.827]	244.5 [9.626]	206.0 [8.110]	275 [10.827]	
14	236.0 [9.291]	197.5 [7.776]	275 [10.827]	255.0 [10.039]	216.5 [8.524]	300 [11.811]	
15	246.5 [9.705]	208.0 [8.189]	300 [11.811]	265.5 [10.453]	227.0 [8.937]	300 [11.811]	
16	257.0 [10.118]	218.5 [8.602]	300 [11.811]	276.0 [10.866]	237.5 [9.350]	325 [12.795]	
17	267.5 [10.531]	229.0 [9.016]	325 [12.795]	286.5 [11.280]	248.0 [9.764]	325 [12.795]	
18	278.0 [10.945]	239.5 [9.429]	325 [12.795]	297.0 [11.693]	258.5 [10.177]	325 [12.795]	
19	288.5 [11.358]	250.0 [9.843]	325 [12.795]	307.5 [12.106]	269.0 [10.591]	350 [13.780]	
20	299.0 [11.772]	260.5 [10.256]	350 [13.780]	318.0 [12.520]	279.5 [11.004]	350 [13.780]	
21	-	-	-	328.5 [12.933]	290.0 [11.417]	375 [14.764]	

Note:When the  $J \square T$  or MT piping block specification is selected.

With manifold outlet port dual use fitting block D-sub connector 25-pin specifications

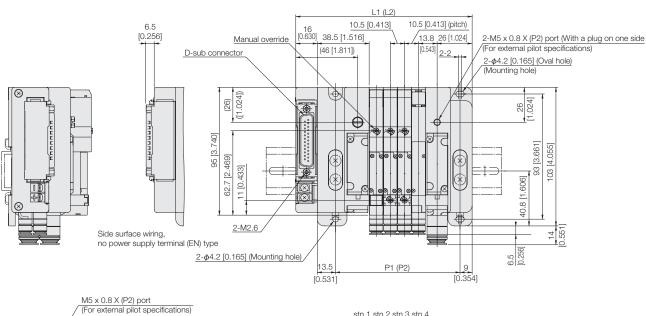

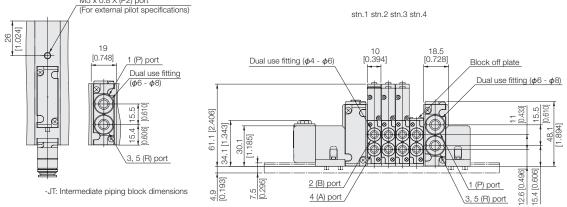


### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2 Note	P2 Note	Length of DIN rail Note	
2	110.0 [4.331]	71.5 [2.815]	150 [5.906]	-	-	-	
3	120.5 [4.744]	82.0 [3.228]	175 [6.890]	139.5 [5.492]	101.0 [3.976]	175 [6.890]	
4	131.0 [5.157]	92.5 [3.642]	175 [6.890]	150.0 [5.906]	111.5 [4.390]	175 [6.890]	
5	141.5 [5.571]	103.0 [4.055]	200 [7.874]	160.5 [6.319]	122.0 [4.803]	200 [7.874]	
6	152.0 [5.984]	113.5 [4.469]	200 [7.874]	171.0 [6.732]	132.5 [5.217]	200 [7.874]	
7	162.5 [6.398]	124.0 [4.882]	200 [7.874]	181.5 [7.146]	143.0 [5.630]	225 [8.858]	
8	173.0 [6.811]	134.5 [5.295]	225 [8.858]	192.0 [7.559]	153.5 [6.043]	225 [8.858]	
9	183.5 [7.224]	145.0 [5.709]	225 [8.858]	202.5 [7.972]	164.0 [6.457]	250 [9.843]	
10	194.0 [7.638]	155.5 [6.122]	250 [9.843]	213.0 [8.386]	174.5 [6.870]	250 [9.843]	
11	204.5 [8.051]	166.0 [6.535]	250 [9.843]	223.5 [8.799]	185.0 [7.283]	250 [9.843]	
12	215.0 [8.465]	176.5 [6.949]	275 [10.827]	234.0 [9.213]	195.5 [7.697]	275 [10.827]	
13	225.5 [8.878]	187.0 [7.362]	275 [10.827]	244.5 [9.626]	206.0 [8.110]	275 [10.827]	
14	236.0 [9.291]	197.5 [7.776]	275 [10.827]	255.0 [10.039]	216.5 [8.524]	300 [11.811]	
15	246.5 [9.705]	208.0 [8.189]	300 [11.811]	265.5 [10.453]	227.0 [8.937]	300 [11.811]	
16	257.0 [10.118]	218.5 [8.602]	300 [11.811]	276.0 [10.866]	237.5 [9.350]	325 [12.795]	
17	267.5 [10.531]	229.0 [9.016]	325 [12.795]	286.5 [11.280]	248.0 [9.764]	325 [12.795]	
18	278.0 [10.945]	239.5 [9.429]	325 [12.795]	297.0 [11.693]	258.5 [10.177]	325 [12.795]	
19	288.5 [11.358]	250.0 [9.843]	325 [12.795]	307.5 [12.106]	269.0 [10.591]	350 [13.780]	
20	299.0 [11.772]	260.5 [10.256]	350 [13.780]	318.0 [12.520]	279.5 [11.004]	350 [13.780]	
21	-	-	-	328.5 [12.933]	290.0 [11.417]	375 [14.764]	

Note:When the J $\square$ T or MT piping block specification is selected.

With manifold outlet port dual use fitting block Terminal block type

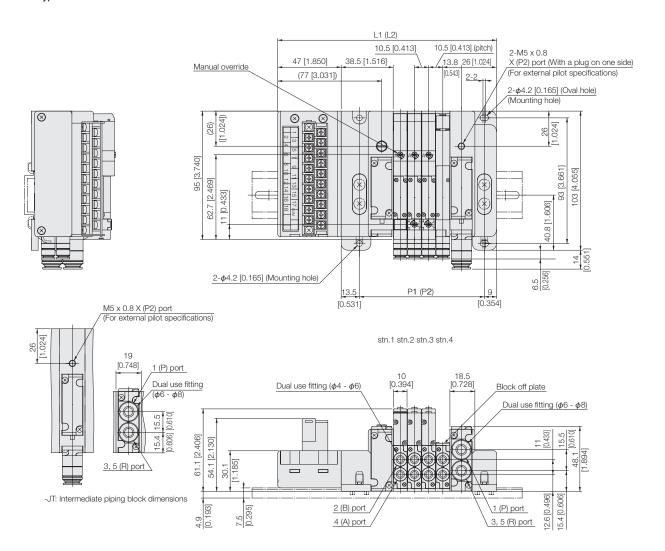


### **Unit dimensions**

2			DIÑ rail	Note	P2 Note	Length of DIN rail Note	
_	141.0 [5.551]	71.5 [2.815]	200 [7.874]	-	-	-	
3	151.5 [5.965]	82.0 [3.228]	200 [7.874]	170.5 [6.713]	101.0 [3.976]	200 [7.874]	
4	162.0 [6.378]	92.5 [3.642]	200 [7.874]	181.0 [7.126]	111.5 [4.390]	225 [8.858]	
5	172.5 [6.791]	103.0 [4.055]	225 [8.858]	191.5 [7.539]	122.0 [4.803]	225 [8.858]	
6	183.0 [7.205]	113.5 [4.469]	225 [8.858]	202.0 [7.953]	132.5 [5.217]	250 [9.843]	
7	193.5 [7.618]	124.0 [4.882]	250 [9.843]	212.5 [8.366]	143.0 [5.630]	250 [9.843]	
8	204.0 [8.032]	134.5 [5.295]	250 [9.843]	223.0 [8.780]	153.5 [6.043]	250 [9.843]	
9	214.5 [8.445]	145.0 [5.709]	250 [9.843]	233.5 [9.193]	164.0 [6.457]	275 [10.827]	
10	225.0 [8.858]	155.5 [6.122]	275 [10.827]	244.0 [9.606]	174.5 [6.870]	275 [10.827]	
11	235.5 [9.272]	166.0 [6.535]	275 [10.827]	254.5 [10.020]	185.0 [7.283]	300 [11.811]	
12	246.0 [9.685]	176.5 [6.949]	300 [11.811]	265.5 [10.453]	195.5 [7.697]	300 [11.811]	
13	256.5 [10.098]	187.0 [7.362]	300 [11.811]	275.5 [10.846]	206.0 [8.110]	325 [12.795]	
14	267.0 [10.512]	197.5 [7.776]	325 [12.795]	286.0 [11.260]	216.5 [8.524]	325 [12.795]	
15	277.5 [10.925]	208.0 [8.189]	325 [12.795]	296.5 [11.673]	227.0 [8.937]	325 [12.795]	
16	288.0 [11.339]	218.5 [8.602]	325 [12.795]	307.0 [12.087]	237.5 [9.350]	350 [13.780]	
17	298.5 [11.752]	229.0 [9.016]	350 [13.780]	317.5 [12.500]	248.0 [9.764]	350 [13.780]	
18	309.0 [12.165]	239.5 [9.429]	350 [13.780]	328.0 [12.913]	258.5 [10.177]	375 [14.764]	
19	-	-	-	338.5 [13.327]	269.0 [10.591]	375 [14.764]	

Note:When the  $J \square T$  or MT piping block specification is selected.

With manifold outlet port dual use fitting block

(Stand alone serial transmission block compatible manifold) \*The figure shows CC-Link.

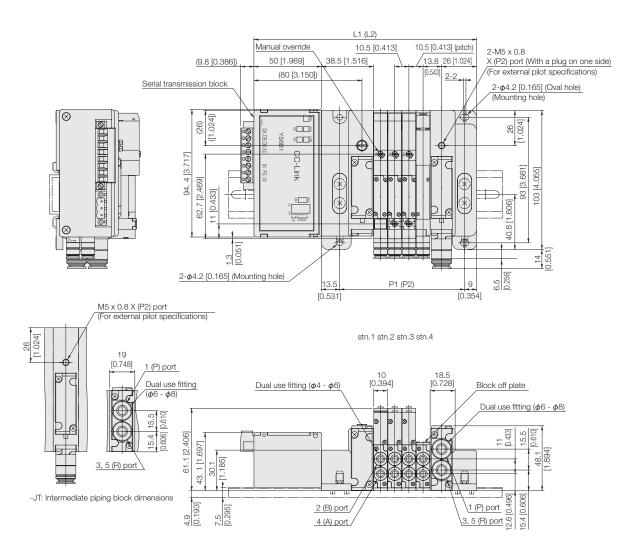


### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2 Note	P2 Note	Length of DIN rail Note	
2	144.0 [5.669]	71.5 [2.815]	200 [7.874]	-	-	-	
3	154.5 [6.083]	82.0 [3.228]	200 [7.874]	173.5 [6.831]	101.0 [3.976]	200 [7.874]	
4	165.0 [6.496]	92.5 [3.642]	225 [8.858]	184.0 [7.244]	111.5 [4.390]	225 [8.858]	
5	175.5 [6.909]	103.5 [4.075]	225 [8.858]	194.5 [7.657]	122.0 [4.803]	225 [8.858]	
6	186.0 [7.323]	113.5 [4.469]	225 [8.858]	205.0 [8.071]	132.5 [5.217]	250 [9.843]	
7	196.5 [7.736]	124.0 [4.882]	250 [9.843]	215.5 [8.484]	143.0 [5.630]	250 [9.843]	
8	207.0 [8.150]	134.5 [5.295]	250 [9.843]	226.0 [8.898]	153.5 [6.043]	275 [10.827]	
9	217.5 [8.563]	145.0 [5.709]	275 [10.827]	236.5 [9.311]	164.0 [6.457]	275 [10.827]	
10	228.0 [8.976]	155.5 [6.122]	275 [10.827]	247.0 [9.724]	174.5 [6.870]	275 [10.827]	
11	238.5 [9.390]	166.0 [6.535]	275 [10.827]	257.5 [10.138]	185.0 [7.283]	300 [11.811]	
12	249.0 [9.803]	176.5 [6.949]	300 [11.811]	268.0 [10.551]	195.5 [7.697]	300 [11.811]	
13	259.5 [10.217]	187.0 [7.362]	300 [11.811]	278.5 [10.965]	206.0 [8.110]	325 [12.795]	
14	270.0 [10.630]	197.5 [7.776]	325 [12.795]	289.0 [11.378]	216.5 [8.524]	325 [12.795]	
15	280.5 [11.043]	208.0 [8.189]	325 [12.795]	299.5 [11.791]	227.0 [8.937]	325 [12.795]	
16	291.0 [11.457]	218.5 [8.602]	350 [13.780]	310.0 [12.205]	237.5 [9.350]	350 [13.780]	
17	301.5 [11.870]	229.0 [9.016]	350 [13.780]	320.5 [12.618]	248.0 [9.764]	350 [13.780]	
18	312.0 [12.283]	239.5 [9.429]	350 [13.780]	331.0 [13.031]	258.5 [10.177]	375 [14.764]	
19	322.5 [12.697]	250.0 [9.843]	375 [14.764]	341.5 [13.445]	269.0 [10.591]	375 [14.764]	
20	333.0 [13.110]	260.5 [10.256]	375 [14.764]	352.0 [13.858] 279.5 [11.		400 [15.748]	
21	-	-	-	362.5 [14.272]	290.0 [11.417]	400 [15.748]	

Note:When the J $\square$ T or MT piping block specification is selected.

With manifold outlet port dual use fitting block (EtherCAT/EtherNet/IP) \*The figure shows EtherCAT.

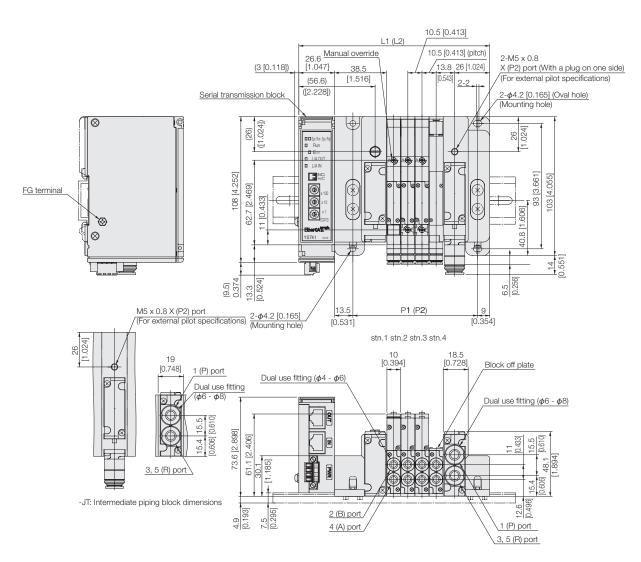


### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2 Note	P2 Note	Length of DIN rail Note	
2	120.6 [4.748]	71.5 [2.815]	175 [6.890]	-	-	-	
3	131.1 [5.161]	82.0 [3.228]	175 [6.890]	175 [6.890] 150.1 [5.909] 101.0 [3.976]		200 [7.874]	
4	141.6 [5.575]	92.5 [3.642]	200 [7.874]	160.6 [6.323]	111.5 [4.390]	200 [7.874]	
5	152.1 [5.988]	103.0 [4.055]	200 [7.874]	171.1 [6.736]	122.0 [4.803]	200 [7.874]	
6	162.6 [6.402]	113.5 [4.469]	200 [7.874]	181.6 [7.150]	132.5 [5.217]	225 [8.858]	
7	173.1 [6.815]	124.0 [4.882]	225 [8.858]	192.1 [7.563]	143.0 [5.630]	225 [8.858]	
8	183.6 [7.228]	134.5 [5.295]	225 [8.858]	202.6 [7.976]	153.5 [6.043]	250 [9.843]	
9	194.1 [7.642]	145.0 [5.709]	250 [9.843]	213.1 [8.390]	164.0 [6.457]	250 [9.843]	
10	204.6 [8.055]	155.5 [6.122]	250 [9.843]	223.6 [8.803]	174.5 [6.870]	250 [9.843]	
11	215.1 [8.469]	166.0 [6.535]	275 [10.827]	234.1 [9.217]	185.0 [7.283]	275 [10.827]	
12	225.6 [8.882]	176.5 [6.949]	275 [10.827]	244.6 [9.630]	195.5 [7.697]	275 [10.827]	
13	236.1 [9.295]	187.0 [7.362]	275 [10.827]	255.1 [10.043]	206.0 [8.110]	300 [11.811]	
14	246.6 [9.709]	197.5 [7.776]	300 [11.811]	265.6 [10.457]	216.5 [8.524]	300 [11.811]	
15	257.1 [10.122]	208.0 [8.189]	300 [11.811]	276.1 [10.870]	227.0 [8.937]	325 [12.795]	
16	267.6 [10.535]	218.5 [8.602]	325 [12.795]	286.6 [11.283]	237.5 [9.350]	325 [12.795]	
17	278.1 [10.949]	229.0 [9.016]	325 [12.795]	297.1 [11.697]	248.0 [9.764]	325 [12.795]	
18	288.6 [11.362]	239.5 [9.429]	325 [12.795]	307.6 [12.110]	258.5 [10.177]	350 [13.780]	
19	299.1 [11.776]	250.0 [9.843]	350 [13.780]	318.1 [12.524]	269.0 [10.591]	350 [13.780]	
20	309.6 [12.189]	260.5 [10.256]	350 [13.780]	328.6 [12.937]	279.5 [11.004]	375 [14.764]	
21	-	-	-	339.1 [13.350]	290.0 [11.417]	375 [14.764]	


Note:When the  $J \square T$  or MT piping block specification is selected.


### Additional Parts (available separately)

### ●Muffler: KM-J8 [for both plug-in and non-plug-in]



### ●Muffler: KM-J6






# **SOLENOID VALVES**

# F15 SERIES

### Contents

Spe	ecifications —	—1 <b>5</b> 6
	Single Valve Unit—	<b>—162</b>
	Monoblock Manifold A Type (Base Piping Type)	<b>-166</b>
	Monoblock Manifold F Type (Direct Piping Type)	<b>-170</b>
	Monoblock Manifold A Type, Wire-saving Type (Base Piping Type)—	
ORD	Monoblock Manifold F Type, Wire-saving Type (Direct Piping Type) -	<b>-176</b>
	PC Board Manifold A Type (Base Piping Type)	<b>-178</b>
RC	PC Board Manifold F Type (Direct Piping Type)	
OD(	Split Manifold Non-plug-in Type	<del>-184</del>
ES	Split Manifold Plug-in Type	<b>-190</b>
	Split Manifold Serial Transmission Type —	<b>-194</b>
	Easy Assembly Type Manifold Non-plug-in Type	<b>—198</b>
	Easy Assembly Type Manifold Plug-in Type	
	Easy Assembly Type Manifold Serial Transmission Type ———	
	Single Valve Unit —	— <b>2</b> 16
	Monoblock Manifold —	<del>-2</del> 19
	Monoblock Manifold, Wire-saving Type	<b>-222</b>
	PC Board Manifold —	<b>-224</b>
	Split Manifold Non-plug-in Type	<b>-225</b>
DIMENSIONS	Split Manifold Plug-in Type	<b>-227</b>
SNC	Split Manifold Serial Transmission Type	<b>-236</b>
	Easy Assembly Type Manifold Non-plug-in Type	
	Easy Assembly Type Manifold Plug-in Type	
	Easy Assembly Type Manifold Serial Transmission Type	

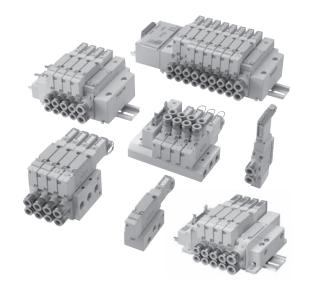

# F15 SERIES Specifications

### **Specifications**

### **Basic Models and Valve Functions**

Basic model	F15⊡T0	F15□T1 F15□T2	F15□T3 F15□T4 F15□T5	F15⊟TA F15⊟TB F15⊟TC	
Number of positions	2 pos	sitions	3 positions	4 positions	
Number of ports		Tandem 3-port			
Valve function	Single solenoid only	Both single and double solenoid use	Closed center, Exhaust center, Pressure center	NC/NC, NO/NO, NC/NO	

Remark: For the optional specifications and order codes, see p.162.

### **Specifications**

Item		Basic model	F15□T0 F15□T1 F15□T2	F15□T3 F15□T4 F15□T5	F15□TA F15□TB F15□TC	F15□T0G F15□T1G F15□T2G	F15□T3G F15□T4G F15□T5G	F15□T0V F15□T1V F15□T2V	F15□T3V	
Media						Air				
Operation	n type		ı	nternal pilot type	;	External pilot type (f	for positive pressure)	External pilot ty	pe (for vacuum)	
Flow rate	Sonic conductar	nce C dm <sup>3</sup> /(s · bar) Note1	2.05	2.05	1.60	2.05	2.05	2.05	2.05	
characteristics	Effective area	Note2 mm <sup>2</sup> (Cv)	10.3 (0.57)	10.3 (0.57)	8 (0.44)	10.3 (0.57)	10.3 (0.57)	10.3 (0.57)	10.3 (0.57)	
Port size	Note3		Dual use fitting	for $\phi$ 6 and $\phi$ 8,	Rc1/8, NPT1/8	M5×0.8,10-32U	NF, dual use fittir	ig for $\phi$ 6 and $\phi$ 8,	Rc1/8, NPT1/8	
Lubrication				Not required						
Operatir	ng pressure	Main valve	0.15~0	0.15~0.7 MPa [22~102 psi.] 0~0.7			~102 psi.] Note4	- 100 kPa~0.15 MPa [	- 29.53 in.Hg~22 psi.]	
range		External pilot				0.2~0.7 MPa [29~102 psi.] Note4 0.2~0.7 MPa [29~102 psi			[29~102 psi.]	
Proof pro	essure	MPa [psi.]	1.05 [152]							
Respons	se time Note5	12VDC, 24VDC	20/25 (30) or below	15/45 (50) or below	20/30 (35) or below	20/25 (30) or below	15/45 (50) or below	20/25 (30) or below	15/45 (50) or below	
ON/OFF	= ms	100VAC	20/25 or below	15/45 or below		20/25 or below	15/45 or below	20/25 or below	15/45 or below	
Maximur	m operating fr	equency Hz				5				
Minimum ti	me to energize for	self holding Note6 ms	50	_	_	50		50		
Operating ter	Operating temperature range (atmosphere and media) ° C [° F]		5~50 [41~122]							
Shock re	esistance	m/s² [G]	294.2 [30] (245 [25]) Figure in parentheses is for when mounted on the split manifold.							
Mountin	g direction					Any				

- Notes: 1. For details, see the flow rate characteristics on p.157.
  - 2. The effective area is a calculated value, and not a measured value.

  - 3. For details, see the port size on p.157. 4. When the main valve pressure is 0.2 $\sim$ 0.7 MPa [29 $\sim$ 102 psi.], set the external pilot pressure to the main valve pressure or higher, and to 0.7 MPa [102 psi.] or less.

Remark: Specification values are based on Koganei test standards.

- Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center. Values in parentheses ( ) are for low-current type.
  - 6. When used as a double solenoid valve. Excludes T0.

### **Solenoid Specifications**

Ra Item	Rated voltage tem		24VDC (Standard type)	24VDC (Low-current type)	100VAC		120VAC		
Voltage range	٧	10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	21.6~26.4 (24±10%)		90~110 (100±10%)		108~132 (120±10%)	
Rated frequency	Hz	_	_	_	50	60	50	60	
Current (when rated voltage is appl Power consumption	ied)mA (r.m.s)	33	17	_	8	3	8.	3	
Power consumption	W	0.4	0.4	_	0.8	VA	1 VA		
Current (when rated voltage is applied) Power consumption	Starting mA			17			_		
	Holding mA	_	_	4.2					
Power consumption	Starting W			0.4					
> Power consumption	Holding W	_	_	0.1					
Starting time (standard)	ms	_	_	70	-	-	_	-	
Allowable leakage current	mA	2.0	1.0	1.0	1.	0	1.	0	
Type of insulation				Type B					
Insulation resistance Note 1	ΜΩ			Over 100					
Color of LED indicator Notes	2	14(SA): Red, 12(SB): Green							
Surge suppression (as standar	rd)	Surge absorp	tion transistor	Flywheel diode		Bridge	diode		


Notes: 1. Value at 500VDC megger.

2. The color of the **T0** indicator is red only.

Remark: Specification values are based on Koganei test standards.


### Cylinder operating speed

### How to obtain cylinder speed




### Measuring conditions


- •Air pressure: 0.5 MPa [73 psi.]
- ●Fitting: Quick fitting TS8-01
- ●Load ratio = Load Cylinder theoretical thrust (%)
- ●Cylinder stroke: 150 mm [5.91 in.]



### Maximum operating speed




#### **Delay time**



Note: Delay time may vary according to the cylinder stroke.

### Flow rate



#### How to read the graph

When the supply pressure is 0.5 MPa [73 psi.] and flow rate is 500R/min [17.7 ft.3/min.] (ANR), the valve outlet pressure becomes 0.4 MPa [58 psi.].

- 1 mm/s = 0.0394 in./sec.
- 1 MPa = 145 psi.
- 1  $\ell$ /min = 0.0353 ft.<sup>3</sup>/min.

### **Port Size**

	D 1 11 (D) 1 17 17	55	V (D0)	1/1) 0/5)	+(D) 0(D0) 5(D+) 0 5(D)
	Description/Piping specification	PR	X (P2)	4(A), 2(B)	1 (P), 3 (R2), 5 (R1), 3, 5 (R)
	With sub-base	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/8, NPT1/8
Φ	With female thread block	_	-	Rc1/8, NPT1/8	Rc1/8, NPT1/8
Single	With dual use fitting block	_	-	Dual use fitting for $\phi 6$ and $\phi 8$	Rc1/8, NPT1/8
S	With single use fitting block	_	ı	φ6 or φ8	Rc1/8, NPT1/8
	Monoblock type with female thread block, and PC board type with female thread block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/4, NPT1/4
	Monoblock type with fitting block, and PC board type with fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Dual use fitting for $\phi$ 6 and $\phi$ 8	Rc1/4, NPT1/4
	Monoblock type with single use fitting block, and PC board type with single use fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	φ6 or φ8	Rc1/4, NPT1/4
p	Split type with female thread block, and serial transmission type with female thread block	_	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/4, NPT1/4
Manifold	Split type with fitting block, and serial transmission type with fitting block	_	M5×0.8, 10-32UNF	Dual use fitting for $\phi$ 6 and $\phi$ 8	Dual use fitting for φ8 and φ10
Š	Split type with single use fitting block, and serial transmission type with single use fitting block	_	M5×0.8, 10-32UNF	φ6 or φ8	Single use fitting for $\phi 8$ or $\phi 10$
	Easy assembly type with female thread block, and serial transmission type with female thread block	_	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/4, NPT1/4
	Easy assembly type with fitting block, and serial transmission type with fitting block	_	M5×0.8, 10-32UNF	Dual use fitting for $\phi$ 6 and $\phi$ 8	Dual use fitting for φ8 and φ10
	Easy assembly type with single use fitting block, and serial transmission type with single use fitting block	_	M5×0.8, 10-32UNF	φ6 or φ8	Single use fitting for φ8 or φ10

### Specifications for DIN Connector (-39□) Type

### **Specifications** Remark: Specification values are the same as the Standard type, excluding the response time. See page 156.

Basic model Item	F15T0 F15T2	F15T3 F15T4 F15T5	F15T0G F15T2G	F15T3G F15T4G F15T5G	F15T0V F15T2V	F15T3V
Response time Note ON/OFF ms	20/30 or below	15/50 or below	20/30 or below	15/50 or below	20/30 or below	15/50 or below

Note: Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center.

### Solenoid Specifications for DIN Connector (-39 ) Type

Rated voltage Item			12VDC 24VDC 120VAC		VAC	240VAC				
Voltage ra	ange	V 10.8~13.2 21.6~26.4 (12±10%) (24±10%)		90~	132	180~264				
	Frequency	Hz	_	_	50	60	50	60		
Current	Starting	mA (r.m.s)	_	_	43	38	22	19		
	Holding	mA (r.m.s)	140 (1.7W)	75 (1.8W)	29	24	14	12		
Allowable	e leakage current	mA	8	4	4	ļ	2	2		
Insulation resistance Note ΜΩ			Over 100							
Surge suppression (as standard)			Surge absorp	tion transistor	Vari	stor	Varistor			

Note: Value at 500VDC megger.

### When used as a single unit

	1 (P)→2(B)	/1(P)→4(A)	2(B)→3(R2)	/4(A)→5(R1)	
Basic model	Sonic conductance C	Critical pressure ratio	Sonic conductance C	Critical pressure ratio	
	dm <sup>3</sup> /(s•bar)	b	dm <sup>3</sup> /(s·bar)	b	
F15_T0-A2					
F15_T1-A2	1.76	0.25	1.72	0.26	
F15_T2-A2					
F15_T3-A2					
F15□T4-A2	1.78	0.25	1.72	0.24	
F15_T5-A2					
F15 TA-A2					
F15 TB-A2	1.53	0.26	1.61	0.23	
F15 TC-A2					
F15_T0-F3					
F15_T1-F3	1.80	0.25	1.71	0.29	
F15_T2-F3					
F15_T3-F3					
F15_T4-F3	1.81	0.23	1.61	0.27	
F15_T5-F3					
F15_TA-F3					
F15_TB-F3	1.57	0.28	1.57	0.24	
F15 TC-F3					
F15_T0-F4					
F15_T1-F4	1.83	0.30	1.62	0.33	
F15 T2-F4					
F15 T3-F4					
F15 T4-F4	1.57	0.36	1.51	0.25	
F15_T5-F4					
F15 TA-F4					
F15 TB-F4	1.54	0.31	1.55	0.27	
F15 TC-F4					

	1 (P) →2(B)	/1(P)→4(A)	2(B)→3(R2)	/4(A)→5(R1)
Basic model	Sonic conductance C	Critical pressure ratio	Sonic conductance C	Critical pressure ratio
	dm <sup>3</sup> /(s•bar)	b	dm <sup>3</sup> /(s•bar)	b
F15_T0-F5				
F15□T1-F5	1.62	0.38	1.56	0.28
F15_T2-F5				
F15 T3-F5				
F15 T4-F5	1.57	0.36	1.51	0.25
F15_T5-F5				
F15⊡TA-F5				
F15□TB-F5	1.44	0.34	1.46	0.24
F15□TC-F5				
F15□T0-F6				
F15□T1-F6	1.86	0.30	1.70	0.30
F15_T2-F6				
F15□T3-F6				
F15□T4-F6	1.84	0.29	1.64	0.29
F15□T5-F6				
F15□TA-F6				
F15□TB-F6	1.58	0.31	1.57	0.31
F15 TC-F6				

### When mounted on a manifold

Ma	nifold model	Monoblock m F15M	anifold F type ∃F (FP)	Monoblock m F15M	anifold A type ☑A (AP)	Split manifold F15M□N (P) (S)		Easy assembly type manifold F15M XN (P) (S)	
		1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)	1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)	1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)	1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)
Valve mode		Sonic conductance	C dm <sup>3</sup> /(s/bar)	Sonic conductance	C dm <sup>3</sup> /(s/bar)	Sonic conductance	C dm <sup>3</sup> /(s/bar)	Sonic conductance	C dm <sup>3</sup> /(s/bar)
F15T0									
F15T1	Outlet port	1.72	1.56	1.56	1.46	2.01	1.84	2.00	1.90
F15□T2□	dual use								
F15_T3_	fitting for $\phi$ 6 and $\phi$ 8								
F15_T4_	*These	1.72	1.53	1.57	1.43	2.02	1.78	2.14	1.79
F15_T5_	are the								
F15 TA	cases of								
F15 TB	φ8.	1.48	1.47	1.38	1.34	1.57	1.61	1.46	1.56
F15 TC									
F15_T1_		1.50	1.46	1.38	1.39	1.67	1.70	1.77	1.71
F15_T1_		1.50	1.40	1.56	1.59	1.07	1.70	1.77	1.71
F15_T3_									
F15 T4	Outlet port	1.52	1.46	1.39	1.37	1.67	1.66	1.77	1.69
F15_T5_	φ6 fitting								
F15 TA									
F15□TB□		1.37	1.39	1.28	1.30	1.41	1.50	1.39	1.44
F15 TC									
F15T0									
F15_T1_		1.73	1.56	1.60	1.47	2.05	1.83	1.98	1.92
F15 T2									
F15 T3	Outlet port					2.25			
F15 T4	φ8 fitting	1.72	1.54	1.60	1.45	2.05	1.78	2.11	1.68
F15 T5 F15 TA									
F15 TB		1.49	1.48	1.39	1.36	1.58	1.60	1.47	1.55
F15 TC		15	1.40	1.00	1.00	1.55	1.00	1.77	1.00

Notes: 1. When the individual air supply spacer or the individual air exhaust spacer, the back pressure prevention valve, or the stop valve is used, sonic conductance decreases by about 30%.2: For the flow rate characteristics of other outlet ports, consult us.

Remark: Specification values are based on Koganei test standards.

### Single Valve Unit Mass

g [oz.]

F15T	F15□T□□-A1	F15□T□□-A2	F15□T□□-FJ	F15□T□□-FJ5	F15□T□□-FJ6
Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion
None	With plate	With plate	With dual use fitting block	With $\phi$ 6 fitting block	With <i>ϕ</i> 8 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	None	With A type sub-base	None	None	None
82 [2.89]	101 [3.56]	210 [7.41]	114 [4.02]	125 [4.41]	130 [4.59]

g [oz.]

F15□T□□-FM	F15□T□□-F3	F15□T□□-F4	F15□T□□-F5	F15□T□□-F6
Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion
With female thread block	With dual use fitting block	With female thread block	With φ6 fitting block	With φ8 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	With female thread block	With female thread block	With female thread block	With female thread block
104 [3.67]	127 [4.48]	117 [4.13]	138 [4.87]	143 [5.04]

Basic Type F15T0 is 13 g [0.46 oz.] less than the mass shown above.

### Monoblock Manifold Mass (single valve unit included)

g [oz.]

		Mass calculation of each unit									
Monoblock manifold		4(A), 2(B) ports outlet specifications									
	Female t	hread block	Dual use	Dual use fitting block		φ6 fitting block		φ8 fitting block			
A type	(230×n)+128	[(8.11×n)+4.51]	(240×n)+128	[(8.47×n)+4.51]	(251×n)+128	[(8.85×n)+4.51]	(256×n)+128	[(9.03×n)+4.51]			
F type	(156×n)+116	[(5.50×n)+4.09]	(166×n)+116	[(5.86×n)+4.09]	(177×n)+116	[(6.24×n)+4.09]	(182×n)+116	[(6.42×n)+4.09]			

g [oz.]

		Additional mass (wire-saving type)							
Monoblock manifold		Wiring specification							
	-F100N, -F101N	-D250N, -D251N							
A type	340+4n [11.99+0.14n]	342+4n [12.06+0.14n]	346+4n [12.20+0.14n]						
F type	192+4n [6.77+0.14n]	194+4n [6.84+0.14n]	198+4n [6.98+0.14n]						

Calculation example: F15M8AM

stn.1 $\sim$ stn.8 F15T1-A1-PS DC24V

(230×8)+128=1968 g [69.42 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the F15 T0 specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

### PC Board Manifold Mass (single valve unit included)

g [oz.]

		Mass calculation of each unit									
PC board manifold		4(A), 2(B) ports outlet specifications									
	Female threa	emale thread block Dual use fi		fitting block	k φ6 fitting block		φ8 fitting block		connector portion		
A type	(230×n)+128 [(8.1	11×n)+4.51]	(240×n)+128	[(8.47×n)+4.51]	(251×n)+128	[(8.85×n)+4.51]	(256×n)+128	[(9.03×n)+4.51]	(2×n)+29		
F type	(162×n)+121 [(5.7	71×n)+4.27]	(172×n)+121	[(6.07×n)+4.27]	(183×n)+121	[(6.46×n)+4.27]	(188×n)+121	[(6.63×n)+4.27]	$[(0.07 \times n) + 1.02]$		

Calculation example :F15M8APM-F201-W

stn.1~stn.8 F15T1-A1-PP DC24V

 $(230\times8)+128+(2\times8)+29=2013$  g [71.01 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the F15 T0 specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

### **Optional Parts Mass**

Stop valve (-STP): 50 g [1.76 oz.]

### Mass of Split Manifold and Serial Transmission Compatible Manifold

Because the valve and manifold have the same output specifications, their mass is the same. The mass can only be changed by choosing a different type of inlet/outlet block.

### Mass of Split Manifold Non-Plug-in Type (single valve unit included)

g [oz.]

	Non-plug-in type		Mass calculation of each unit									
N.		4(A), 2(B) ports outlet specifications										
I.		Female thread block		Dual use fitting block		φ6 fitting block		φ8 fitting block				
		(173×n)+249	[(6.10×n)+8.78]	(183×n)+249	[(6.46×n)+8.78]	(194×n)+249	[(6.84×n)+8.78]	(199×n)+249	[(7.02×n)+8.78]			

g [oz.]

Additional mass					
Piping block specification					
Female thread block	Female thread block Dual use fitting block $\phi 8$ fitting block $\phi 10$ fitting block				
153 [5.40]	167 [5.89]	191 [6.74]	201 [7.09]		

Calculation example : F15M8N-MR

stn.1~stn.8 F15T1-A1-PS DC24V

(173×8)+249+153=1786 g [63.00 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the  $F15 \square T0$  specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

### Mass of Split Manifold Plug-in Type/ Serial Transmission Type (single valve unit included)

g [oz.]

DI	Mass calculation of each unit							
Plug-in type	4(A), 2(B) ports outlet specifications							
Serial transmission compatible manifold	Female thread block Dual use fitting block φ6 fitting block φ8 fitting block					ting block		
сотраные тапнои	(177×n)+249	[(6.24×n)+8.78]	(187×n)+249	$[(6.60 \times n) + 8.78]$	(198×n)+249	$[(6.98 \times n) + 8.78]$	(203×n)+249	$[(7.16 \times n) + 8.78]$

g [oz.]

Additional mass					
	Piping block specification				
Female thread block	Female thread block Dual use fitting block φ8 fitting block φ10 fitting block				
153 [5.40] 167 [5.89] 191 [6.74] 201 [7.09]					

g [oz.]

Additional mass				
Wiring block specification				
-F100 , -F101 - F200 , -F201 - F206 - D250 - D251 - D370NU -T200				
32 [1.13]	34 [1.20]	39 [1.38]	72 [2.54]	158 [5.57]

g [oz.]

Additional mass				
Serial transmission block specification				
Stand-alone type	Stand-alone type   Integrated type   Integrated type (For EtherCAT) Integrated type (For EtherNet			
231 [8.15] 138 [4.87] 100 [3.53] 110 [3.88]				

Calculation example :F15M8PM-MR-F201 DC24V

stn.1~stn.8 F15T1-A1 DC24V

(177×8)+249+153+34=1852 g [65.33 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the  $F15\Box T0$  specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

### Mass of Easy Assembly Type Manifold and Serial Transmission Type Manifold

### Mass of Easy Assembly Type Manifold Non-Plug-in Type (single valve unit included)

g [oz.]

				3 []	
Mounting type	Outlet port specifications				
	Female thread block	Dual use fitting block	φ6 fitting block	φ8 fitting block	
No code	(186 x n) + 309 [(6.56×n) + 10.90]	(196 x n) + 309 [(6.91×n) + 10.90]	(207 x n) + 309 [(7.30×n) + 10.90]	(212 x n) + 309 [(7.48×n) + 10.90]	
-DN	(186 x n) + 371 [(6.56×n) + 13.09]	(196 x n) + 371 [(6.91×n) + 13.09]	(207 x n) + 371 [(7.30×n) + 13.09]	(212 x n) + 371 [(7.48×n) + 13.09]	
-DR	(189 x n) + 387 [(6.67×n) + 13.65]	(199 x n) + 387 [(7.02×n) + 13.65]	(210 x n) + 387 [(7.41×n) + 13.65]	(215 x n) + 387 [(7.58×n) + 13.65]	

g [oz.]

	Additional mass				
Fitting specifications	Intake/exhaust outlet				
	Female thread block Dual use fitting block φ8 fitting block φ10 fitting block				
J M	34 [1.20]	48 [1.70]	72 [2.54]	82 [2.90]	
J_D MD_	44 [1.55]	72 [2.54]	120 [4.23]	140 [4.94]	
J□T MT□	-25 [-0.88]	17 [0.60]	89 [3.14]	119 [4.20]	

#### Calculation example: F15M8XNJ-JR-DR DC24V

stn.1  $\sim$  8 F15T1-A1-PS DC24V

(199 x 8) + 387 + 48 = 2027 g [71.50 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz.] per unit from the above calculation result.

When mounting the F15 $\square$ T0 specification valve, subtract 13g [0.46 oz.] per unit from the above calculation result.

### Mass of Easy Assembly Type Manifold Plug-in Type/Serial Transmission Type (single valve unit included)

g [oz.]

	Mass calculation of each unit				
Mounting type	Outlet port specifications				
	Female thread block Dual use fitting block \$\phi6\$ fitting block \$\phi6\$ fitting block \$\phi8\$ fitting block				
No code	(189 x n) + 306 [(6.67×n) + 10.80]	(199 x n) + 306 [(7.02×n) + 10.80]	(210 x n) + 306 [(7.41×n) + 10.80]	(215 x n) + 306 [(7.58×n) + 10.80]	
-DN	(189 x n) + 369 [(6.67×n) + 13.01]	(199 x n) + 369 [(7.02×n) + 13.01]	(210 x n) + 369 [(7.41×n) + 13.01]	(215 x n) + 369 [(7.58×n) + 13.01]	
-DR	(192 x n) + 391 [(6.77×n) + 13.79]	(201 x n) + 391 [(7.09×n) + 13.79]	(213 x n) + 391 [(7.51×n) + 13.79]	(218 x n) + 391 [(7.69×n) + 13.79]	

g [oz.]

		Addition	nal mass		
Fitting specifications	Intake/exhaust outlet				
	Female thread block	Dual use fitting block	φ8 fitting block	φ10 fitting block	
J M	34 [1.20]	48 [1.70]	72 [2.54]	82 [2.90]	
J_D MD_	44 [1.55]	72 [2.54]	120 [4.23]	140 [4.94]	
J□T MT□	-27 [-0.95]	15 [0.53]	87 [3.07]	117 [4.13]	

g [oz.]

Additional mass					
Wiring block specifications					
-F100□□, -F101□□	-F100 , -F101 -F200 , -F201 , -F260 -D250 , -D251 -T200 -T200				
36 [1.27]	38 [1.34]	43 [1.52]	116 [4.09]		

g [oz.]

	Additional mass			
Serial transmission block specifications (Monoblock)				
For CC-Link, DeviceNet, and For EtherCAT For EtherNet/IP				
CompoNet				
138 [4.87] 100 [3.53] 110 [3.88]				


#### Calculation example: F15M8XPJ-JR-F201-DR DC24V

stn.1  $\sim$  8 F15T1-A1 DC24V

 $(201 \times 8) + 391 + 48 + 38 = 2085 \text{ g} [73.55 \text{ oz.}]$ 

When mounting the block-off plate, subtract 100g [3.53 oz.] per unit from the above calculation result.

When mounting the F10 $\square$ T0 specification valve, subtract 13g [0.46 oz.] per unit from the above calculation result.

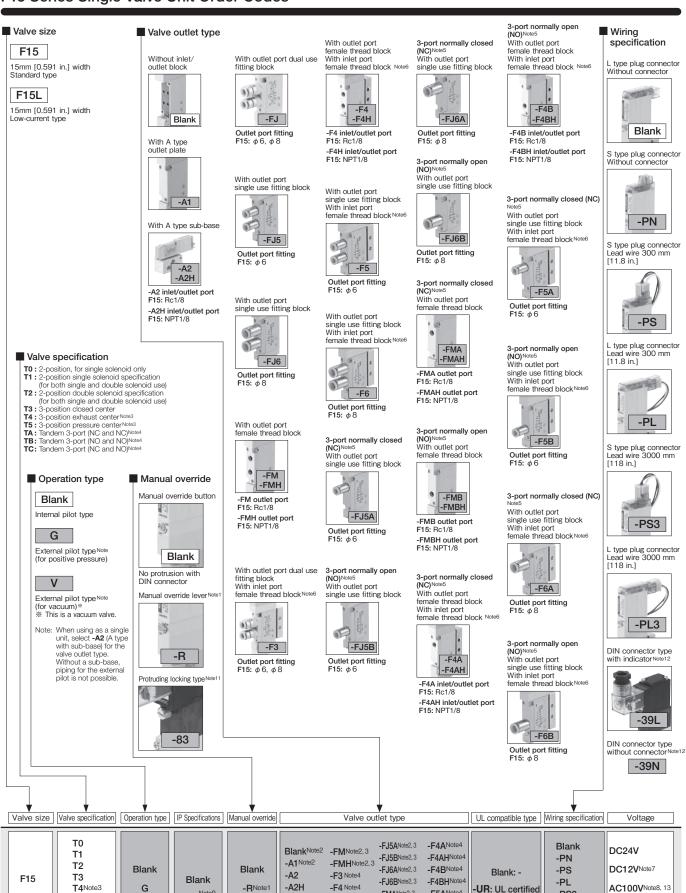

Notes: 1. When the valve specification is T1 or T2, the manual override lever is placed only on

-P Note9 Note10

- Two manifold mounting screws are included
- Not available in the vacuum valves.

T5Note3

TANote4

TBNote4

TCNote4

- Not available in external pilot type and vacuum valves. Only for valve specification T0, T1, and T2.
- Thread size for the inlet port female thread block is F15: Rc 1/8.
- Not available in low-current type.
- 8. Not available in low-current type and tandem 3-port valves.

9. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.

product

-PS3

-PI 3

-39LNote12

-39N Note12

AC120VNote8

AC240VNote8, 11

**-F.** [Note2, 3

-FJ5Note2,3 -F5 Note4

-FJ6Note2,3 -F6 Note4

-83Note1

-F4H Note4

11 Only for wiring specification -39

-FMANote2, 3

-FMBNote2,3

-FMAHNote2,3 -F5BNote4

-FMBHNote2,3 -F6BNote4

-F5ANote4


-F6ANote4

- 12 Only for F15 series and not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2.
- 13 Not available with DIN connectors

Remark: Negative common specifications are also available as made to order products (add -129W to the end of order code). For details, consult us

F15L





Valve size 15: 15 mm [0.591 in.] width

#### Parts content

: Mounting bracket (mounting bracket, 2 mounting screws) 21 Sub-base Rc1/8 (sub-base body, gasket, exhaust valve)Note1 25H

Sub-base NPT1/8 (sub-base body, gasket, exhaust valve)Note1 Plate (plate, gasket, 2 mounting screws) Dual use fitting block (fitting block, gasket, 2 mounting screws)

J5 J6

Dual use fitting block (itting block, gasket, 2 mounting screws) Single use fitting block **F15**:  $\phi$  8 (fitting block, gasket, 2 mounting screws) Single use fitting block for 3-port **F15**:  $\phi$  8 (fitting block, gasket, 2 mounting screws) Note3 Single use fitting block for 3-port **F15**:  $\phi$  8 (fitting block, gasket, 2 mounting screws) Note3 Single use fitting block for 3-port **F15**:  $\phi$  8 (fitting block, gasket, 2 mounting screws) Note3 Female thread block (female thread block, gasket, 2 mounting screws) Female thread block **F15**: NPT1/8 (female thread block, gasket, 2 mounting screws) -I6A

MA: Female thread block for 3-port (female thread block, gasket, 2 mounting screws)Note3

MAH: Female thread block for 3-port F15: NPT1/8 (female thread block, gasket, 2 mounting screws)Note3

MP: P port female thread block (P port female thread block, gasket)Note1

MPH: P port female thread block F15: NPT1/8 (P port female thread block, gasket)
MPP: IP dedicated P port female thread block (P port female thread block, gasket)
GS1: Gasket (gasket, exhaust valve)
Mote2

Notes: 1. Valve mounting screws are not included.

2. Caution should be exercised as this gasket is different from the GS2 gasket for the split-type manifolds.

Common to both normally closed (NC) and normally open (NO) types. Select the mounting direction by application requirements.

### For external pilot

[0.591 in.] width



Parts content

Plate (plate, gasket, 2 mounting screws)

Dual use fitting block (fitting block, gasket, 2 mounting screws) Single use fitting block **F15:**  $\phi$  6 (fitting block, gasket, 2 mounting screws) Single use fitting block **F15:**  $\phi$  8 (fitting block, gasket, 2 mounting screws) J5

Single use fitting block for 3-port **F15**:  $\phi$  6 (fitting block, gasket, 2 mounting screws) Note1

Single use fitting block for 3-port F15: \$\phi\$ 8 (fitting block, gasket, 2 mounting screws) \(^{\text{Note1}}\)
Female thread block (female thread block, gasket, 2 mounting screws)
Female thread block F15: \(^{\text{NPT1/8}}\) (female thread block, gasket, 2 mounting screws) J<sub>6</sub>A

MA: Female thread block for 3-port (female thread block, gasket, 2 mounting screws)<sup>Note1</sup>

MAH: Female thread block for 3-port F15: NPT1/8 (female thread block, gasket, 2 mounting screws)<sup>Note1</sup>

GS1: Gasket (gasket, exhaust valve)Note2

Notes: 1. Common to both normally closed (NC) and normally open (NO) types. Select the mounting direction by

2. Caution should be exercised as this gasket is different from the GS2 gasket for the split type manifolds.

specification

## Sub-base for external



Valve size

15: 15 mm [0.591 in.] width Sub-base Rc1/8

### F15ZG - 25H

Valve size

**15:** 15 mm [0.591 in.] width Sub-base NPT1/8

### Connector-related order codes



specification
For T1, T2, T3, T4, T5, TA, TB, TC

: Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires) CP3: Connector, lead wire length 3000 mm [118 in.]

(black, red, white, for total of 3 lead wires)

CPN: Connector without lead wire

(1 short bar and 3 contacts included)

Remarks: A connector for negative common is also available. See p. 22 for details. (UR is unsupported) 1. The lead wire thickness is 24AWG when Blank or 22AWG when UR is specified



Connector specification

: Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)

CPN: Connector without lead wire (1 short bar, 2 contacts included)




FZ - |

Connector specification

CC1.5: Cabtyre cable length 1500 mm [59 in.] \* Cabtyre cable length 3000 mm [118 in.]

For details, see p. 22.

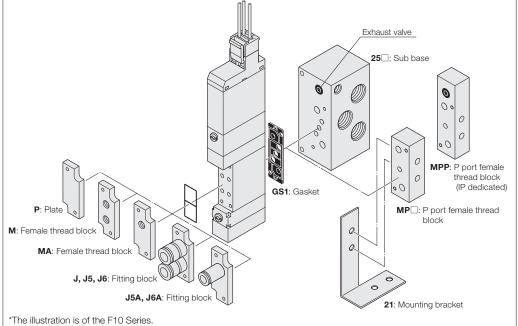

### Connector-related order codes

**T5, TA, TB,** or

TC

### **JAZ - P -** (for double use only) Valve Connector specification specification For **T2**, **T3**, **T4**,

CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB : Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*\* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P- single dedicated type

- 2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type).

  3. There is no white lead wire for the **JAZ0-P-** .
- 4. It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.

  5. For information on use in locations/atmospheres subject to
- substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.

  6. For information on replacing the waterproof seal, contact your
- nearest KOGANEI sales office.

### **JAZ0 - P -** (for single use only)

Valve specification For T0/T1

#### Connector specification


CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* **PC**: Positive common C type, lead wire length 300 mm [11.8 in.]  $\times$ PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

### F15 Series Monoblock Manifold A Type (Base Piping Type) Order Codes

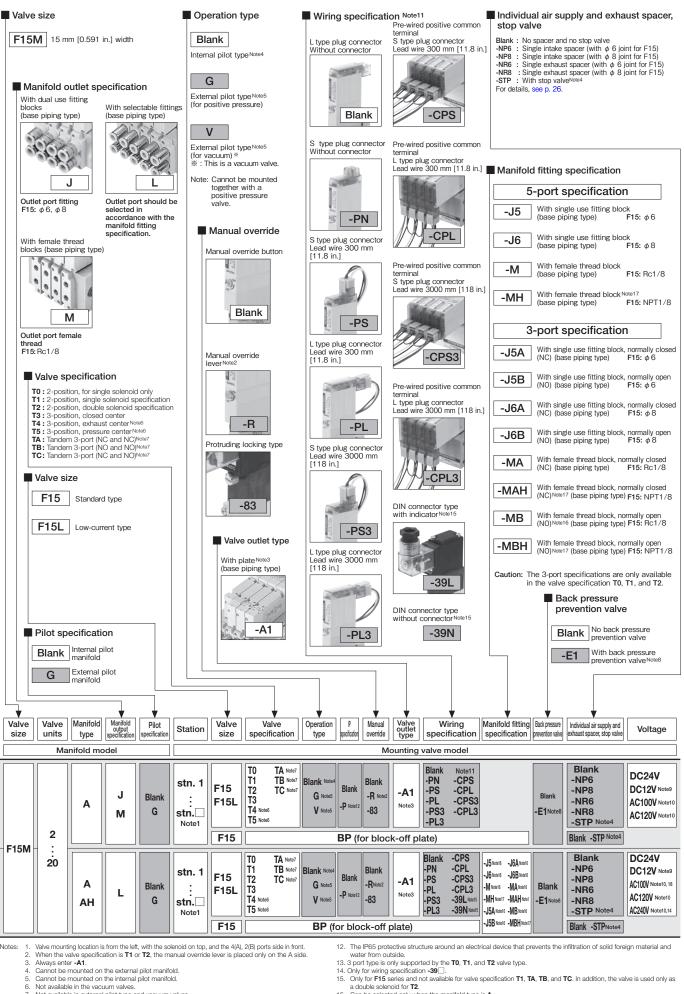

- - Not available in external pilot type and vacuum valves
  - Not available with the individual exhaust spacer and vacuum valve.

  - Not available in low-current type.

    10.Not available in the low current type and tandem 3-port valves.

    11.The -P ☐ (including when Blank) and -CP ☐ wiring specifications cannot be mixed.

- Can be selected only when the manifold type is A.
   Can be selected only when the manifold type is AH.
   Not available with DIN connectors (-39\_).


### Gasket (gasket and exhaust valve)

F15Z - GS1 Valve size 15: 15 mm [0.591 in.] width

### Block-off plate (block-off plate and 2 mounting screws)




### Connector-related order codes

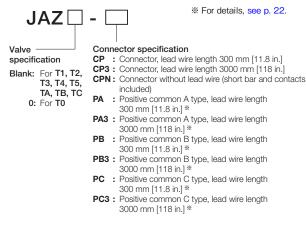

Connector specification

CC1.5 : Cabtyre cable length 1500 mm [59 in.] \*

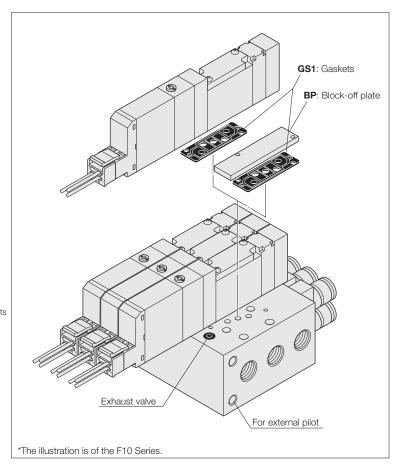

### Back pressure prevention valve

(for monoblock type, 2 pieces)




#### For **T1**, **T2**, **T3**, cc3 : Cabtyre cable length 3000 mm [118 in.] \* T4, T5, TA, TB, TC

FZ -

Valve

specification


#### Common connector assembly

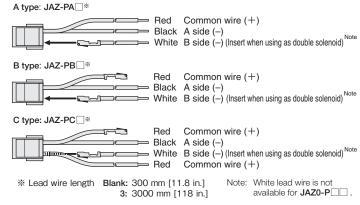

Remark: Connector for negative common type also available. For details,

### Individual air supply and / Spacer for non-plug-in type, gasket, exhaust spacer

exhaust valve, and 2 mounting screws



**NP6:**Single intake spacer (with  $\phi$ 6 joint for F15) **NP8:** Single intake spacer (with  $\phi$ 8 joint for F15) **NR6:** Single exhaust spacer (with  $\phi$ 6 joint for F15) **NR8:** Single exhaust spacer (with  $\phi$ 8 joint for F15)

\* For details, see p. 27.

### Manifold Order Code Example

(6 units of F15 Series)

### F15M6AL

stn.1  $\sim$  2 F15T0-A1-PS-J5 DC24V stn.3  $\sim$  5 F15T2-A1-PS-J6 DC24V

stn.6 F15BP-J6

Note: This order code example has no relationship to the illustration at upper right

### Muffler

KM - J

### Fitting size

**6:** Outer diameter  $\phi$  6 (for individual exhaust spacer)

8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

### Precautions for Order Codes

Manifold outlet specification

Select from among "dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, F  $\square$  **Z-J** (dual use fitting block), F  $\square$  **Z-J**  $\square$  (single use fitting block), or F  $\square$  **Z-M**  $\square$  (female thread block), on p. 163.

Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 66. Note, however, that the only available valve outlet type is A1. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

### Connector-related order codes

# JAZ - P - (for double use only) Valve Connector specification

specification For **T2**, **T3**, **T4**, **T5**, **TA**, **TB**, or

TC

CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\*
PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*
PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*
PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*
PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

※A common connector assembly.

Notes: 1. When the valve specification is **T1**, select the **JAZ0-P-** □ single dedicated type.

- When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type).
- double type).

  3. There is no white lead wire for the JAZ0-P- .
- It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.
   For information on use in locations/atmospheres subject to
- For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.
- reagents, contact your nearest KOGANEI sales office.

  6. For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.

### **JAZ0** - P - (for single use only)

Valve specification For T0/T1

#### Connector specification


CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\*
PA3: Positive common A type, lead wire length 3000 mm [11.8 in.]\*
PB: Positive common B type, lead wire length 3000 mm [11.8 in.]\*
PB3: Positive common B type, lead wire length 3000 mm [11.8 in.]\*
PC: Positive common C type, lead wire length 300 mm [11.8 in.] \*

 $\textbf{PC3:} \ \text{Positive common C type, lead wire length 3000 mm [118 in.]} \\ *$ 

\*A common connector assembly.

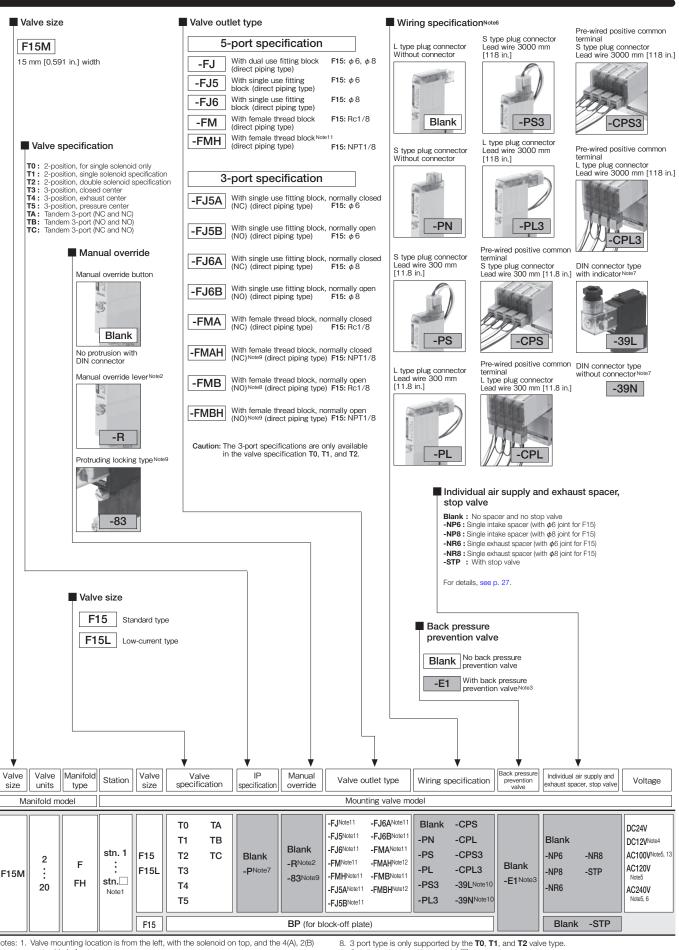

- - ports side in front.
  - 2. When the valve specification is  ${\bf T1}$  or  ${\bf T2}$ , the manual override lever is placed only on the A side. This is not available with **-39**
  - 3. Not available with the individual exhaust spacer.4. Not available in low-current type.

  - 5. Not available in low-current type and tandem 3-port valves.
    6. The -P ☐ (including when Blank) and -CP ☐ wiring specifications cannot be mixed. 7. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- 9. Only for wiring specification -39
- 10. Only for F15 series and not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2
- 11. Can be selected only when the manifold type is F.
  12. Can be selected only when the manifold type is FH.
- Not available with DIN connectors (-39 □).
- Remarks: 1. The external pilot type valve cannot be mounted on the F type manifold.
  - Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.


### Gasket (gasket and exhaust valve)


# F15Z - GS1 Valve size 15: 15 mm [0.591 in.] width

### Block-off plate (block-off plate and 2 mounting screws)




### Connector-related order codes



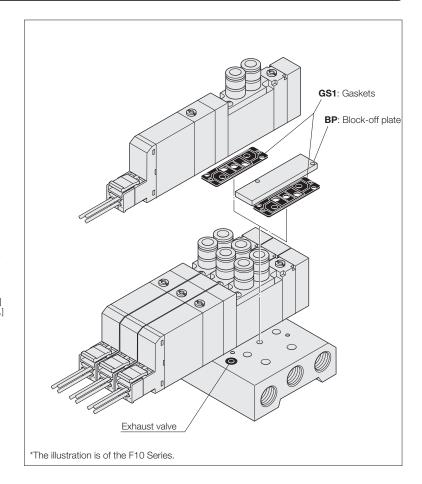



### Common connector assembly

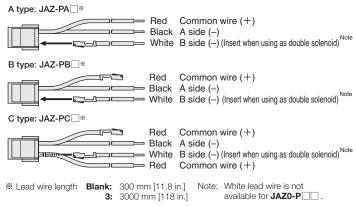

Remark: Connector for negative common type also available. For details, see p. 27.


### Back pressure prevention valve

(for monoblock type, 2 pieces)



## Individual air supply and exhaust spacer

Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws



※ For details, see p. 27.

# Manifold Order Code Example (4 units of F15 Series) F15M4F stn.1 ~ 2 F15T0-FJ5-PS DC24V

stn.1 ~ 2 F15T0-FJ5-PS DC24V stn.3 F15T2-FJ6-PS DC24V stn.4 F15BP

Note: This order code example has no relationship to the illustration at upper right.

### **Precautions for Order Codes**

### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 163.
Select from valve outlet types -FJ, -FJ5, -FJ6, -FM5, -FJ5B, -FJ6A, -FJ6B, -FMA, or -FMB. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

#### Connector-related order codes

TC

**JAZ - P -** (for double use only) Valve Connector specification specification

CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, For **T2**, **T3**, **T4**, white, for total of 3 lead wires) **T5, TA, TB,** or

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

PA : Positive common A type, lead wire length 300 mm [11.8 in.]\*\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB : Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*\* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P- single dedicated type.

2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and

double type).

3. There is no white lead wire for the **JAZ0-P-** .

4. It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.

5. For information on use in locations/atmospheres subject to

substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.

6. For information on replacing the waterproof seal, contact your

nearest KOGANEI sales office.

**JAZ0 - P -** (for single use only)

Valve specification For T0/T1

Connector specification


CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* **PC**: Positive common C type, lead wire length 300 mm [11.8 in.]  $\times$ PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

### F15 Series Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type) Order Codes

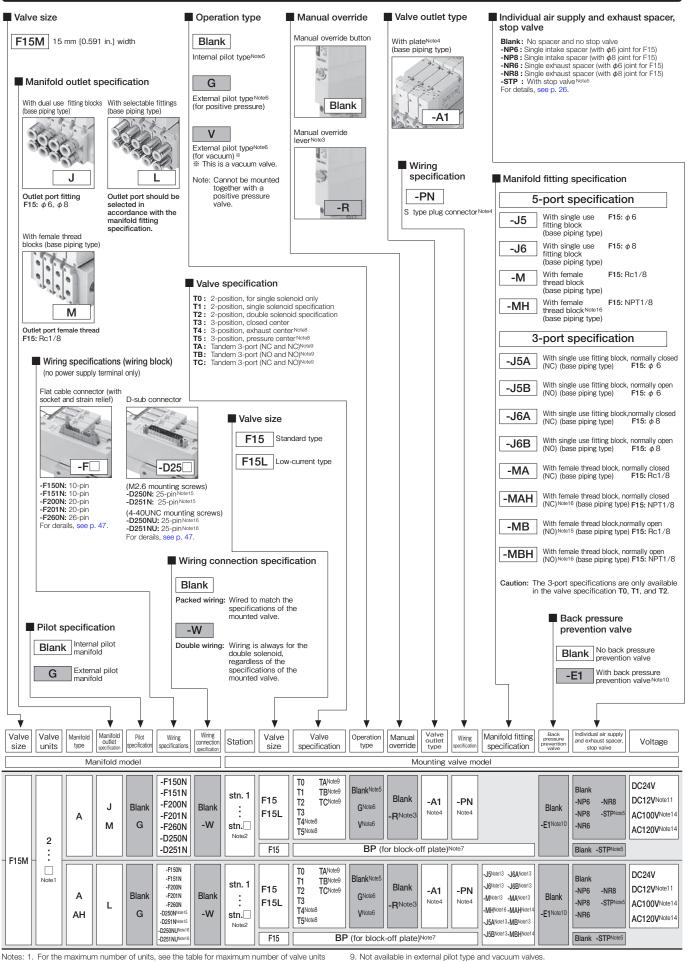

- by wiring specification, on p. 175.
  - Nalve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
     When the valve specification is **T1** or **T2**, the manual override lever is placed only on the A side.

  - Always enter **-A1** and **-PN**.
    Cannot be mounted on the external pilot manifold.

  - Cannot be mounted on the internal pilot manifold.

    Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For single wiring, see p. 175.
  - Not available in the vacuum valves.

- 9. Not available in external pilot type and vacuum valves
- Not available with the individual exhaust spacer and vacuum valve.
- 11. Not available in low-current type.
- 12. Not available in low-current type and tandem 3-port valves. In addition, only available when the wiring specification is a D-sub connector.

  13. 3 port type is only supported by the **T0**, **T1**, and **T2** valve type.
- 14. Not available in low-current type and tandem 3-port valves. In addition, only available when
- the wiring specification is a D-sub connector.

  15. Can be selected only when the manifold type is A
- 16. Can be selected only when the manifold type is AH

### Gasket (gasket and exhaust valve)

F15Z - GS1

Valve size

15: 15 mm [0.591 in.] width

### Block-off plate (block-off plate and 2 mounting screws)



Valve size

15: 15 mm [0.591 in.] width

### Back pressure prevention valve


(for monoblock type, 2 pieces)

F15Z - E1

15: 15 mm [0.591 in.] width

### Individual air supply and exhaust spacer

Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws



### Muffler



**6:** Outer diameter  $\phi$  6 (for individual exhaust spacer) 8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

### Manifold Order Code Example

(6 units of F15 Series)

### F15M6AL-F201N

stn.1 ~ 2 F15T0-A1-PN-J5 DC24V stn.3  $\sim$  5 F15T2-A1-PN-J6 DC24V

F15BP-J6

Note: This order code example has no relationship to the illustration at upper right.

### Table for maximum number of valve units by wiring specification

	Maximum number of units			
		Wiring connection specification		
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)	
F100N Flat cable (10P)	8	Varies depending on the	4 units	
F101N Flat cable (10P)	8	number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less.	4 units	
F200N Flat cable (20P)	16		8 units	
F201N Flat cable (20P)	16		8 units	
F260N Flat cable (26P)	20		10 units	
D250ND-sub connector (25P)	16		8 units	
D251ND-sub connector (25P)	20		10 units	

GS1: Gaskets

RP: Block-off plate

### **Precautions for Order Codes**

Manifold outlet specification

Select from among "dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, F \subset Z-J (dual use fitting block), F \subseteq Z-J \subseteq (single use fitting block), or F \subseteq Z-M \subseteq (female thread block), on p. 163.

\*The illustration is of the F10 Series.

Orders for valves only


Place orders from "Single Valve Unit Order Codes" on p. 162. Note, however, that the only available valve outlet type is A1.

Wiring connection specification
 Blank (packed wiring): Wired to match the specifications of the mounted valve.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

#### Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case.

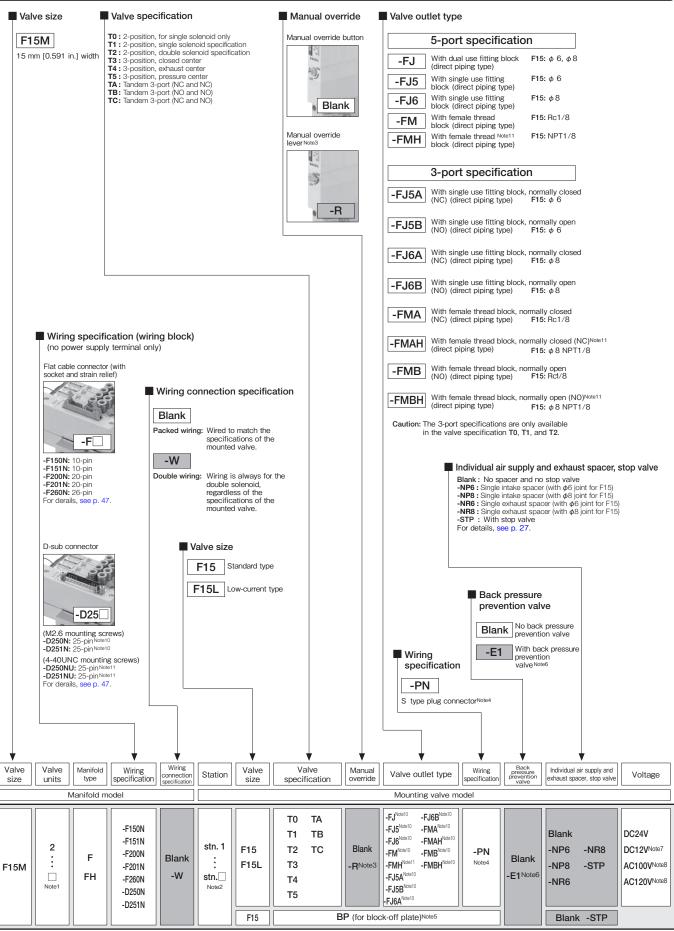

- Notes: 1. For the maximum number of units, see the table for maximum number of valve units
  - by wiring specification, on p. 53.

    2. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B)
  - ports side in front.

    3. When the valve specification is **T1** or **T2**, the manual override lever is placed only on

  - 4. Always enter -PN
  - Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For single wiring, see p. 177.
- 6. Not available with the individual exhaust spacer.
- 7. Not available in low-current type.
  8. Not available in low-current type and tandem 3-port valves. In addition, only available when
- the wiring specification is a D-sub connector.

  9. 3 port type is only supported by the T0, T1, and T2 valve type.
- Can be selected only when the manifold type is F.
   Can be selected only when the manifold type is FH

Remark: The external pilot type valve cannot be mounted on the F type manifold.

### Gasket (gasket and exhaust valve)

F15Z - GS1

Valve size 15: 15 mm [0.591 in.] width

Block-off plate (block-off plate and 2 mounting screws)




### Back pressure prevention valve

(for monoblock type, 2 pieces)




### Individual air supply and /Spacer for non-plug-in type, gasket, exhaust spacer

exhaust valve, and 2 mounting screws



### Muffler



**6:** Outer diameter  $\phi$  6 (for individual exhaust spacer) 8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

### Manifold Order Code Example

(4 units of F15 Series)

### F15M4F-F201

stn.1~2 F15T0-FJ5-PN DC24V F15T2-FJ6-PN DC24V stn.3

F15BP stn.4

Note: This order code example has no relationship to the illustration at upper right

### Table for maximum number of valve units by wiring specification

		Maximum number of units	
		Wiring connection specification	
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
F150N Flat cable (10P)	8	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less.	4 units
F151N Flat cable (10P)	8		4 units
F200N Flat cable (20P)	16		8 units
F201N Flat cable (20P)	16		8 units
F260N Flat cable (26P)	20		10 units
D250N D-sub connector (25P)	16		8 units
D251ND-sub connector (25P)	20		10 units

### **Precautions for Order Codes**

Orders for valves only


Place orders from "Single Valve Unit Order Codes" on p. 162.
Select from valve outlet types -FJ, -FJ5, -FJ6, -FM -FJ5A, -FJ5B, -FJ6A, -FJ6B, -FMA or -FMB

Wiring connection specification


Blank (packed wiring): Wired to match the specifications of the mounted valve.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case.

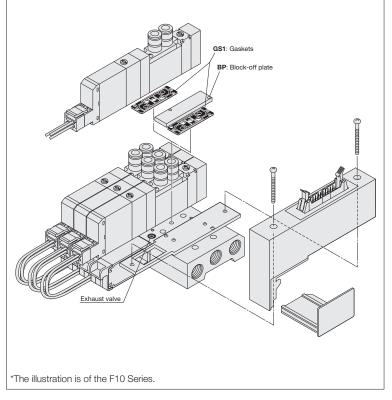


### F15 Series PC Board Manifold A Type (Base Piping Type) Order Codes

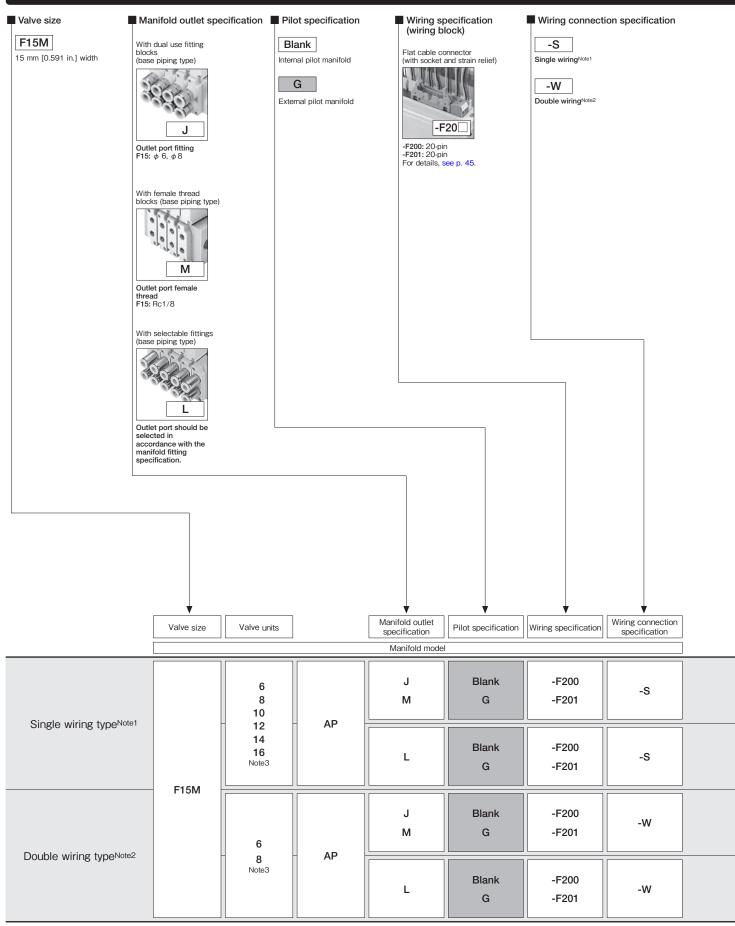

Notes: 1. Wiring is for the single solenoid only. Note that this is not the same as packed wiring. The mounting valves are limited to single solenoid only (T0, T1 specifications). Therefore, even if the T1 specification valve is switched over to a double solenoid, no power will be applied to the B side solenoid.

<sup>2.</sup> Wiring is always for the double solenoid, regardless of the specifications of the mounted valves.

3. In terms of wiring connection specifications, the number of units for single wiring is 6-16 (even numbers only) and for double wiring is 6 or 8.

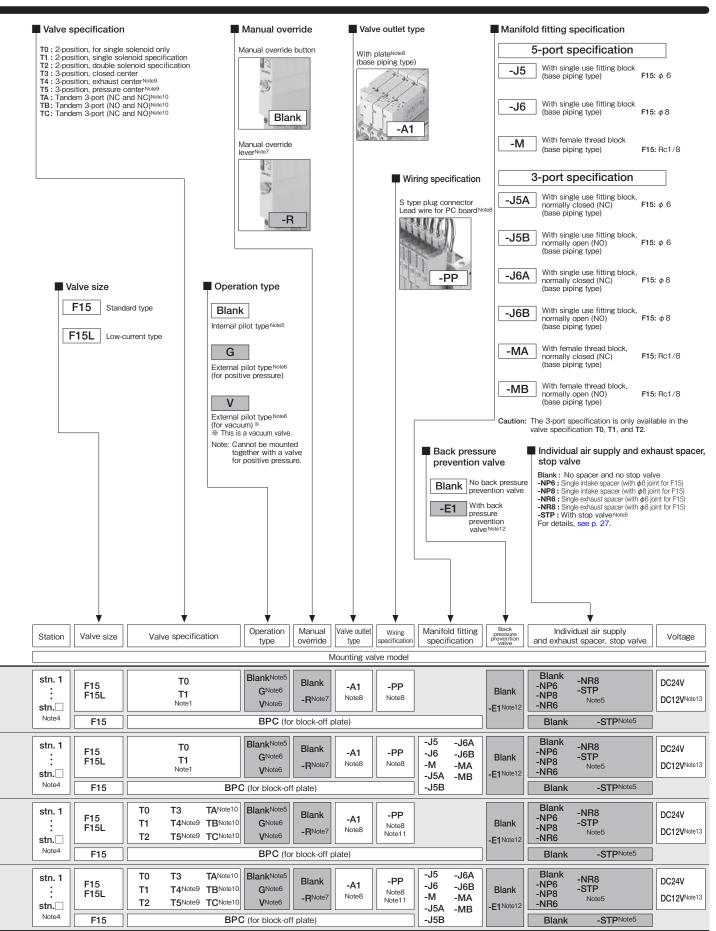

- 4. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front 5. Cannot be mounted on the external pilot manifold.

  - Cannot be mounted on the internal pilot manifold.

    When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

  - 8. Always enter -A1 and -PP.9. Not available in the vacuum valves.

  - 10. Not available in external pilot type and vacuum valves.11. The lead wire on the solenoid B side (white) is not available in valve specification T0.
  - Not available with the individual exhaust spacer and vacuum valve.
     Not available in low-current type.

#### Gasket (gasket and exhaust valve)





#### Block-off plate

(block-off plate, 2 mounting screws, and housing)



#### Connector-related order codes






Note: White lead wire is not available for JAZ0-P


### Back pressure prevention valve

(for monoblock type, 2 pieces)



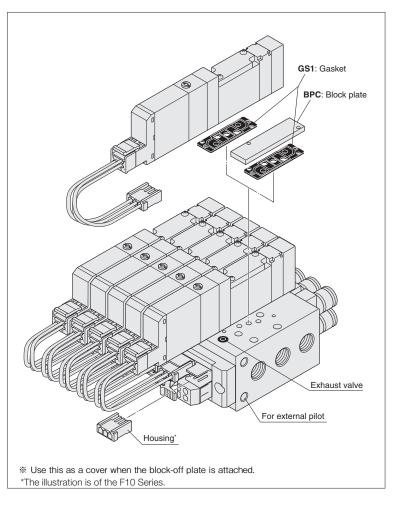

# Individual air supply and (Spacer for non-plug-in type, gasket, exhaust spacer (exhaust valve, and 2 mounting screws



#### Manifold Order Code Example

(8 units of F15 Series)

#### F15M8APL-F201-W

stn.1~4 F15T0-A1-PP-J5 DC24V stn.5~7 F15T2-A1-PP-J6 DC24V stn.8 F15BPC-J6

Note: This order code example has no relationship to the illustration at upper right

#### Muffler

#### Fitting size

6: Outer diameter  $\phi$  6 (for individual exhaust spacer) 8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

#### **Precautions for Order Codes**

Orders for valves only


Enter the code Valve size Valve specification Pilot specification Manual override - Valve outlet type - PP Voltage to order.

Wiring connection specification

When the lead wire for the PC board is not required, enter -PN.

-S (single wiring): Wiring for single solenoid only.-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

#### F15 Series PC Board Manifold F Type (Direct Piping Type) Order Codes

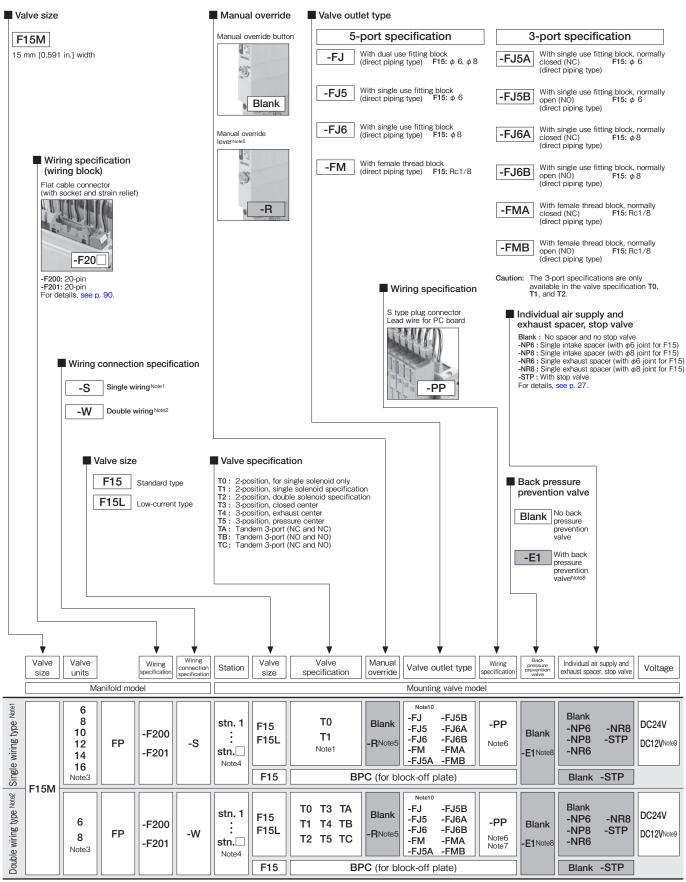

Notes: 1. Wiring is for the single solenoid only. Note that this is not the same as packed wiring. The mounting valves are limited to single solenoid only (T0, T1 specifications). Therefore, even if the T1 specification valve is switched over to a double solenoid, no power will be applied to the B side solenoid.

- Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

  In terms of wiring connection specifications, the number of units for single wiring is 6-16 (even numbers only) and for double wiring is 6 or 8. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

  When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

- Always enter -PP.
   The lead wire on the solenoid B side (white) is not available in valve specification T0.
- 8. Not available with the individual exhaust spacer
- 9. Not available in low-current type.

<sup>10.</sup> The 3-port specifications are only available in the valve specification T0, T1, and T2.

#### Gasket (gasket and exhaust valve)

F15Z - GS1 Valve size **15**: 15 mm [0.591 in.] width


#### Block-off plate

(block-off plate, 2 mounting screws, and housing)



#### Connector-related order code








Note: White lead wire is not available for JAZ0-P ...

## Back pressure prevention valve

(for monoblock type, 2 pieces)



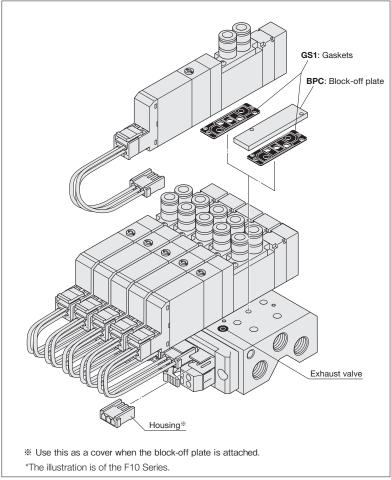



F15Z - [ Valve size Specification NP6: Single intake spacer (with  $\phi$  6 joint for F15) NP8: Single intake spacer (with  $\phi$  8 joint for F15) NR6: Single exhaust spacer (with  $\phi$  6 joint for F15) 15: 15 mm [0.591 in.] width \* For details, see p. 27. NR8: Single exhaust spacer (with  $\phi$  8 joint for F15)

#### Manifold Order Code Example

(8 units of F15 Series)

#### F15M8FP-F201-W

stn.1~4 F15T0-FJ5-PP DC24V stn.5~7 F15T2-FJ6-PP DC24V

F15BPC stn.8

Note: This order code example has no relationship to the illustration at upper right.

#### Muffler

**KM** - **J**[

6: Outer diameter  $\phi$  6 (for individual exhaust spacer) 8: Outer diameter  $\phi$  8 (for individual exhaust spacer)

(Sales unit: Set of 10 mufflers)

#### **Precautions for Order Codes**


Orders for valves only


Enter the code Valve size Valve specification Manual override - Valve outlet type - PP Voltage to order.

Wiring connection specification

When the lead wire for the PC board is not required, enter -PN.

-S (single wiring): Wiring for single solenoid only.
-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

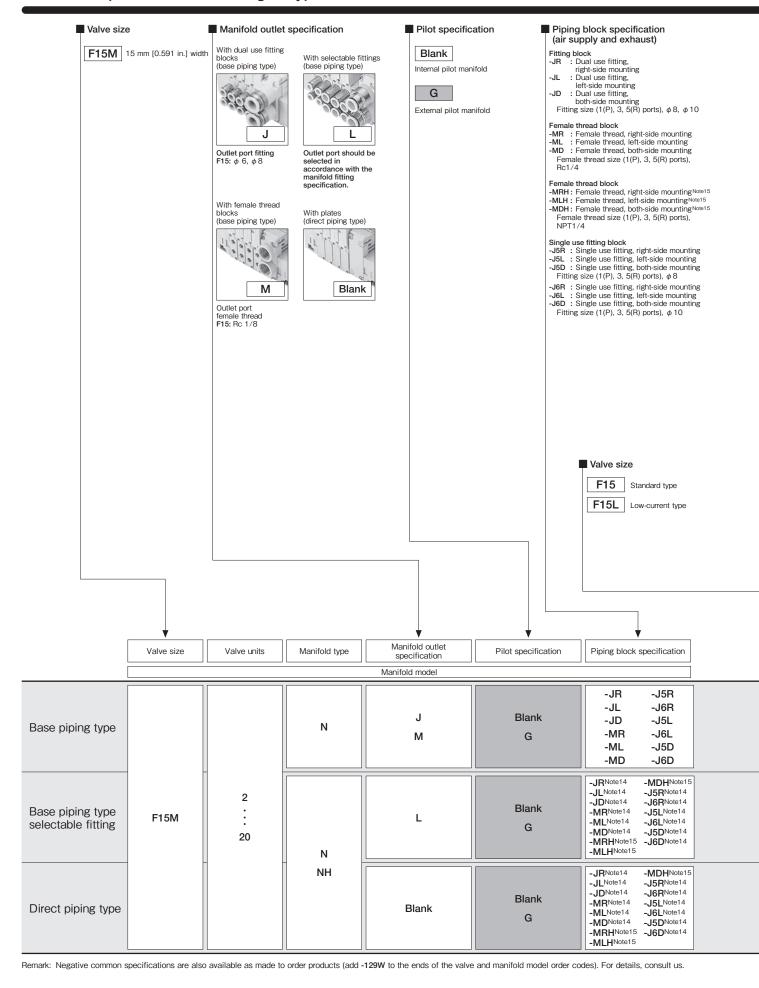

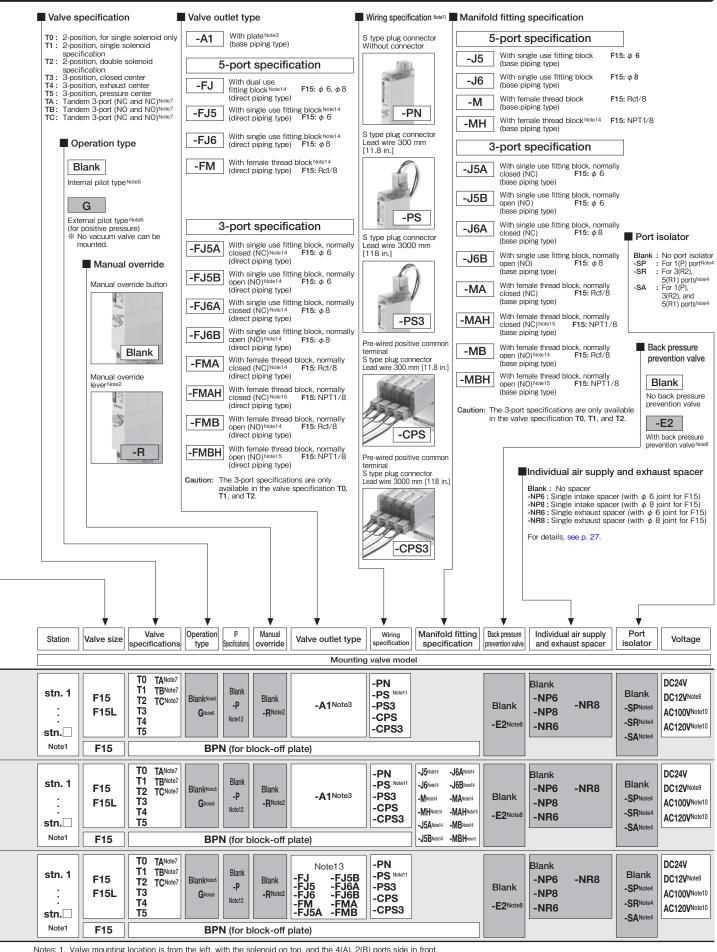

- Notes: 1. Valve mounting location is from the left, with the solenoid on top, and the Try, Ear, First 2. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

  2. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

  - When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.

    Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for
  - -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
  - Cannot be mounted on the external pilot manifold.
  - 6. Cannot be mounted on the internal pilot manifold.
  - 7. Not available in external pilot type.
  - 8. Not available with the individual exhaust spacer.
  - 9. Not available in low-current type


- 10.Not available in low-current type and tandem 3-port valves.
  11.Wiring specifications of -P □ and -CP □ cannot be mounted together.
  12.The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- 13. The 3-port specifications are only available in the valve specification T0, T1, and T2.
- 14.Can be selected only when the manifold type is **N**.

  15.Can be selected only when the manifold type is **N**H.

#### Parts for manifold


#### F15Z -Parts content Valve size 15: 15 mm [0.591 in.] GS2: Gasket (gasket and exhaust valve) : Port isolator (for 1(P) port) width : Port isolator (for 3(R2), 5(R1) ports) : Port isolator (for 1(P), 3(R2), 5(R1) ports)

#### Block-off plate (block-off plate, 2 mounting screws, and plug)




#### Connector-related order codes

\* For details, see p. 22.

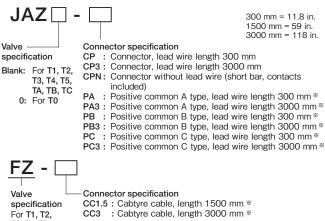


#### Common connector assembly


TA, TB, TC

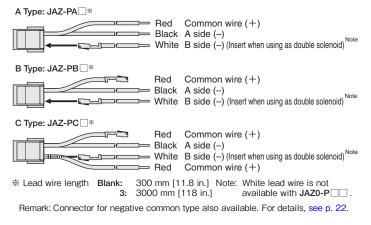

#### Piping block assembly



#### End blocks (one set of left and right)



#### Back pressure prevention valve

(2 pieces for split type, with dedicated gasket)



#### Individual air supply and ( Spacer for non-plug-in type, gasket, exhaust spacer

exhaust valve, and 2 mounting screws




#### Muffler




8: Outer diameter  $\phi$ 8 (for individual exhaust spacer) 10: Outer diameter φ10

(Sales unit: Set of 10 mufflers)

# DIN rail

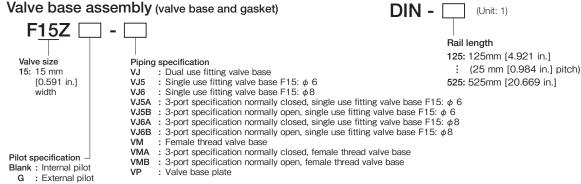

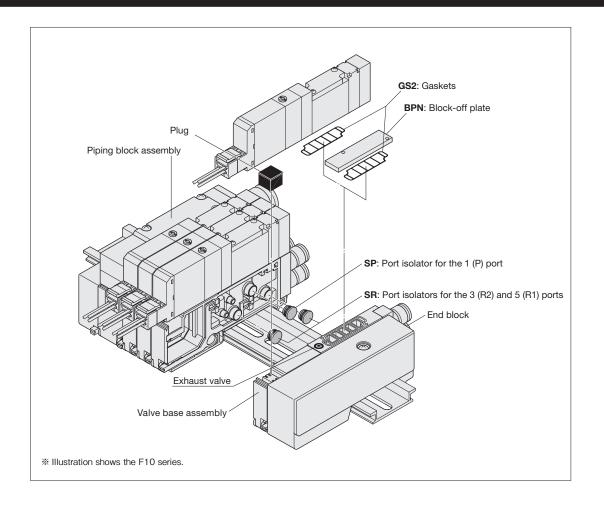

#### Manifold Order Code Example

(4 units of F15 Series)

#### F15M4NL-J5R

stn.1~2 F15T0-A1-PS-J5 DC24V stn.3 F15T2-A1-PS-J6 DC24V stn.4 F15BPN-J6

Note: This order code example has no relationship to the illustration above.

#### **Precautions for Order Codes**

Orders for valves only
Place orders from "Single Valve Unit Order Codes" on p. 162.
However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5B, F6B, and F6B cannot be selected for the valve outlet type. And for the wiring specification, Blank, PL, and PL3 cannot be selected. In addition, for common terminal wiring connections, separately order the common connector assemblies listed on the previous page.

#### Connector-related order codes

#### **JAZ - P -** (for double use only) Valve Connector specification CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, specification For **T2**, **T3**, **T4**, white, for total of 3 lead wires) T5, TA, TB, or CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, TC white, for total of 3 lead wires) PA : Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\* PB: Positive common B type, lead wire length 300 mm [11.8 in.]\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*

Notes: 1. When the valve specification is **T1**, select the **JAZ0-P-** □ single dedicated type.

\*A common connector assembly.

 When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type).

PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

- 3. There is no white lead wire for the **JAZ0-P-** .
- It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.
   For information on use in locations/atmospheres subject to
- For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.
- For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.

## **JAZ0** - P - (for single use only)

Valve specification For T0/T1


#### Connector specification

CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\*\*
PA3: Positive common A type, lead wire length 3000 mm [11.8 in.]\*\*
PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*\*
PC: Positive common B type, lead wire length 3000 mm [11.8 in.]\*\*
PC3: Positive common C type, lead wire length 3000 mm [11.8 in.]\*\*


\*A common connector assembly.

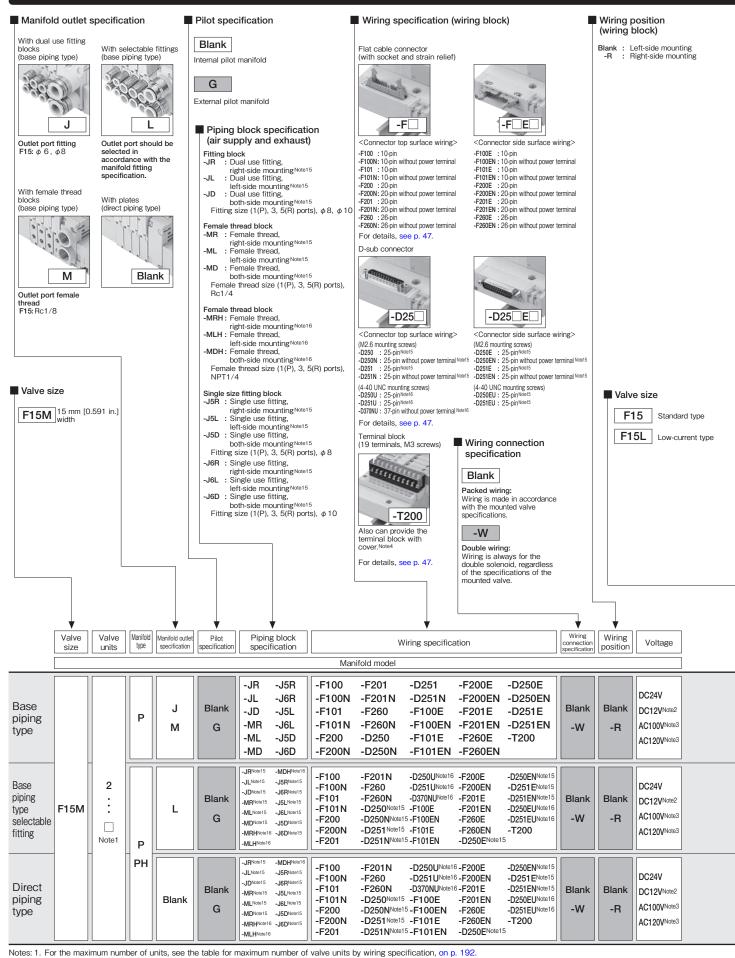

Por the maximum number of units
 Not available in low-current type.


AC100V, AC120V is available only for the -D250□, -D251□ (D-sub connector) and -T200 (terminal block) wiring specifications. In addition, not available in low-current type and tandem 3-port valves.

<sup>4.</sup> The terminal block with cover is also available as a made to order product (add -139W to the end of the manifold model order code). For details, consult us.

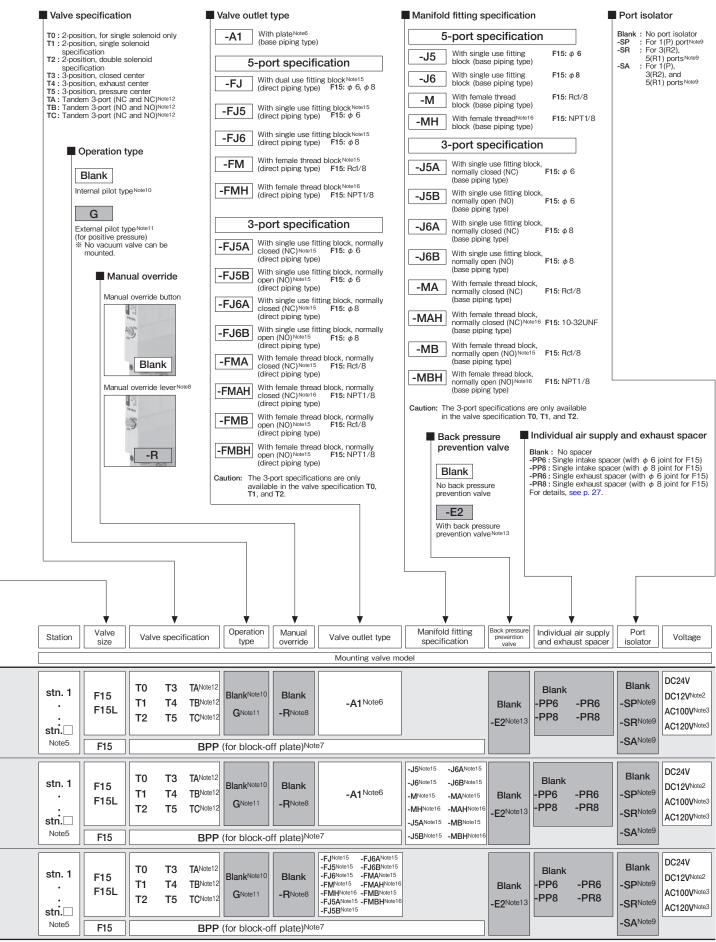

- 5 Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
  - $^{\dot{}}$  When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.
  - Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For wiring for a single solenoid, see p. 71.
  - 8. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  - 9. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
- Cannot be mounted on the external pilot manifold Cannot be mounted on the internal pilot manifold.
- 12. Not available in external pilot type.
- Not available with the individual exhaust spacer
- 14. The 3-port specifications are only available in the valve specification T0, T1, and T2.
- 15. Can be selected only when the manifold type is P
- 16. Can be selected only when the manifold type is PH


#### Parts for manifold



#### Block-off plate (block-off plate, 2 mounting screws, and plug)



#### Valve base assembly (valve base, gasket, lead wire, and plug-in connector)

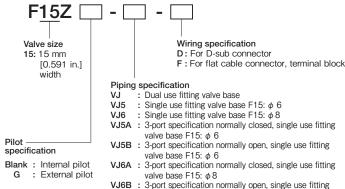

valve base F15: φ8 : Female thread valve base

: Valve base plate

# Back pressure prevention valve

Wiring block assembly (one set)

Piping specification

Voltage (Not required for T200 )

AC100 (for D250□, D251□ only)

: Flat cable connector (DC specification), without power terminal

: Flat cable connector (DC specification), without power terminal

: Flat cable connector (DC specification), without power terminal

: Flat cable connector (DC specification), without power terminal

: Flat cable connector (DC specification), without power terminal

DC24

: Flat cable connector (DC specification) : Flat cable connector (DC specification)

: Flat cable connector (DC specification)

: Flat cable connector (DC specification)

: Flat cable connector (DC specification)

: D-sub connector, without power terminal

: D-sub connector, without power terminal

: Terminal block for left-side mounting : Terminal block for right-side mounting

D-sub connector

: D-sub connector

F15Z - \_ \_ -

F150

F151

F201

F260

D250

D251

F150N

F151N F200N

F201N

F260N

D250N

D251N

T200L


Valve size

15: 15 mm

width

[0.591 in.]

(2 pieces for split type, with dedicated gasket)




#### Individual air supply and /Spacer for plug-in type, gasket, exhaust valve, and 2 mounting screws exhaust spacer




#### Piping block assembly

VMA




#### End blocks (one set of left and right)



#### Table for maximum number of valve units by wiring specification

		Maximum number of units	
		Wiring connection specification	
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
F100 ☐ Flat cable (10P)	8	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less.	4 units
F101 ☐ Flat cable (10P)	8		4 units
F200 ☐ Flat cable (20P)	16		8 units
F201 ☐ Flat cable (20P)	16		8 units
F260 ☐ Flat cable (26P)	20		10 units
D250 ☐ D-sub connector (25P)	16		8 units
D251 ☐ D-sub connector (25P)	20		10 units
T200 Terminal block (19 terminals)	18		9 units

Muffler **DIN** rail KM - J□ **DIN** - [ (Unit:1) Fitting size Rail length **6:** Outer diameter  $\phi$ 6 (for individual exhaust spacer) **125:** 125mm [4.921 in.] 8: Outer diameter  $\phi$ 8 (for individual exhaust spacer) 10: Outer diameter  $\phi$ 10 : (25 mm [0.984 in.] pitch) **525:** 525mm [20.669 in.] (Sales unit: Set of 10 mufflers)

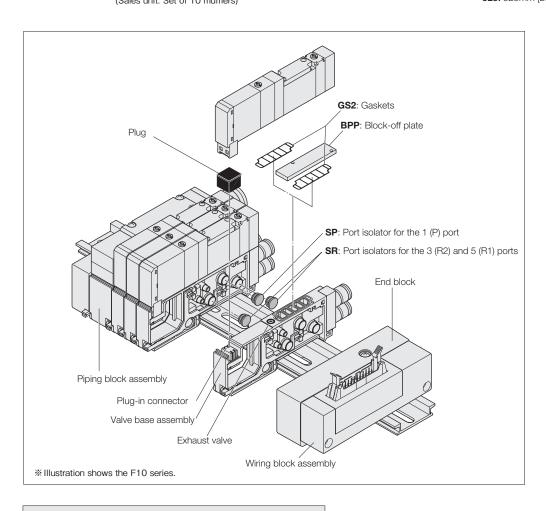

### Manifold Order Code Example

(12 units of F15 Series)

#### F15M12PL-J5R-F201 DC24V

stn.1~8 F15T0-A1-J5 DC24V stn.9~11 F15T2-A1-J6 DC24V F15BPP-J6

Note: This order code example has no relationship to the illustration above.

#### **Precautions for Order Codes**

Orders for valves only


Place orders from "Single Valve Unit Order Codes" on p. 162.
However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.

Wiring connection specification


Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.

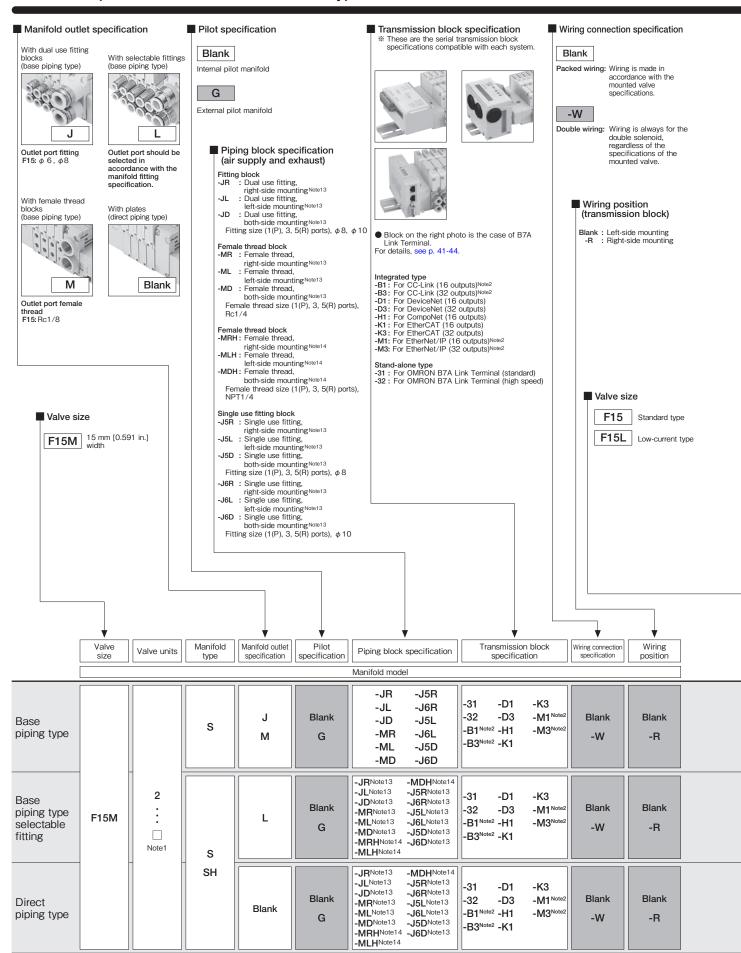

Notes: 1. To determine the maximum number of units, see the table for maximum number of valve units by transmission block specification, on p. 196. 2. Complies with the CE marking regulation.

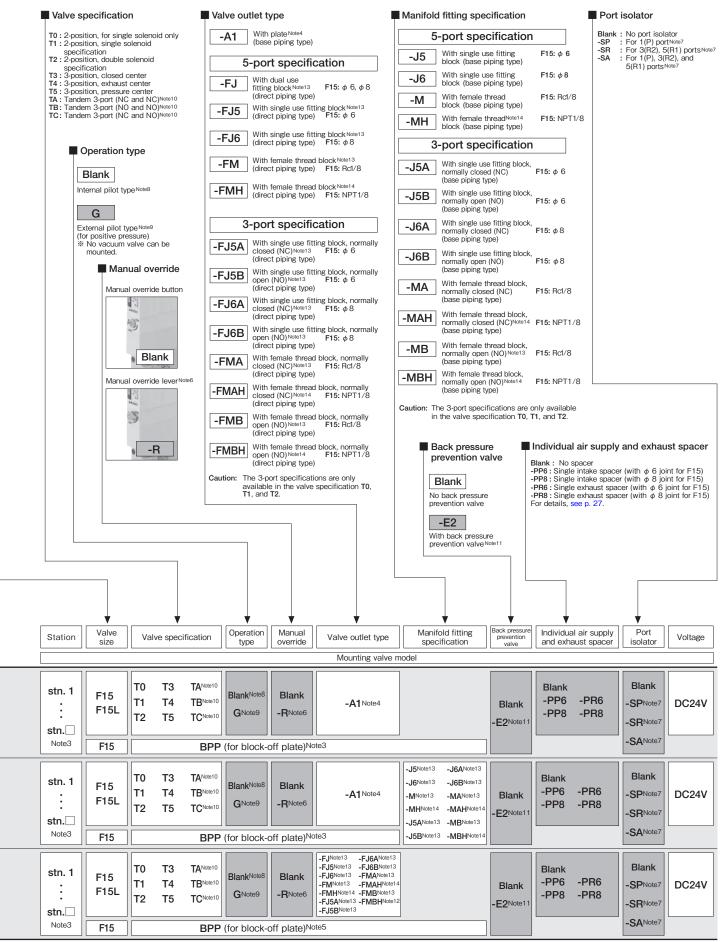


- Notes: 3. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
  - 4. When selecting J, M, or L (base piping type) for the manifold outlet specifications, always enter -A1 (with plate) for the valve outlet type.
  - 5. Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case.
  - 6. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  - 7. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each
- port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
- Cannot be mounted on the external pilot manifold.
- Cannot be mounted on the internal pilot manifold.
   Not available in external pilot type.

- 11.Not available with the individual exhaust spacer.

  12.The 3-port specifications are only available in the valve specification T0, T1, and T2.
- 13.Can be selected only when the manifold type is S. 14.Can be selected only when the manifold type is SH.

#### Parts for manifold




#### Block-off plate (block-off plate, 2 mounting screws, and plug)




#### Valve base assembly

(valve base, gasket, lead wire, and plug-in connector)

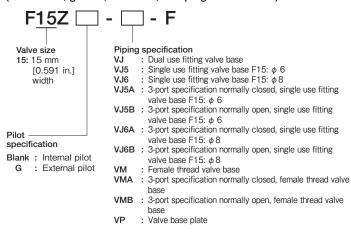


#### Piping block assembly

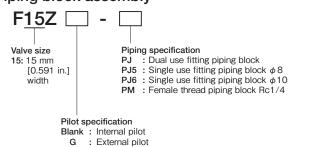


#### Back pressure prevention valve

(2 units for split type, with dedicated gasket)

# Individual air supply and (Spacer for plug-in type, gasket, exhaust spacer (exhaust valve, and 2 mounting screws



#### Serial transmission block (single unit)



# YS6 (Dedicated for manifold mounting)

Transmission block specification

A1 : For OMRON CompoBus/S (16 outputs) B1 : For CC-Link (16 outputs)

B1: For CC-Link (16 outputs)
B3: For CC-Link (32 outputs)
D1: For DeviceNet (16 outputs)
D3: For DeviceNet (32 outputs)
H1: For CompoNet (16 outputs)

M3: For EtherNet/IP (32 outputs)


YS7 (Dedicated for manifold mounting)

Wiring position
L: Left-side mounting
R: Right-side mounting
R: Right-side mounting
R: For EtherCAT (16 outputs)
M1: For EtherNet/IP (16 outputs)

# ■ Table for maximum number of valve units by transmission block specification

	Maximum number of units		
		Wiring connection specification	
Transmission block specifications	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
-31: For Omron B7A Link Terminal (standard)	16	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or lessB3, -D3, and -K3 are a maximum of 20 units.	8 units
-32: For Omron B7A Link Terminal (high speed)	16		8 units
-A1: For Omron CompoBus/S (16 outputs)	16		8 units
-B1: For CC-Link (16 outputs)	16		8 units
-B3: For CC-Link (32 outputs)	32		16 units
-D1: For DeviceNet (16 outputs)	16		8 units
-D3: For DeviceNet (32 outputs)	32		16 units
-H1: For CompoNet (16 outputs)	16		8 units
-K1: For EtherCAT (16 outputs)	16		8 units
-K3: For EtherCAT (32 outputs)	32		16 units
-M1: For EtherNet/IP (16 outputs)	16		8 units
-M3: For EtherNet/IP (32 outputs)	32		16 units

#### End blocks (one set of left and right)



#### Wiring block assembly \*

Valve size 15: 15 mm [0.591 in.] width

W Use this when the transmission block specification is -01, -02, -31, -32, -51, -52.


#### Muffler

KM - J

- exhaust spacer)
- 8: Outer diameter  $\phi$ 8 (for individual exhaust spacer)
- **10:** Outer diameter  $\phi$  10 (Sales unit: Set of 10 mufflers)



**125:** 125mm [4.921 in.] : (25 mm [0.984 in.] pitch) 525: 525mm [20.669 in.]

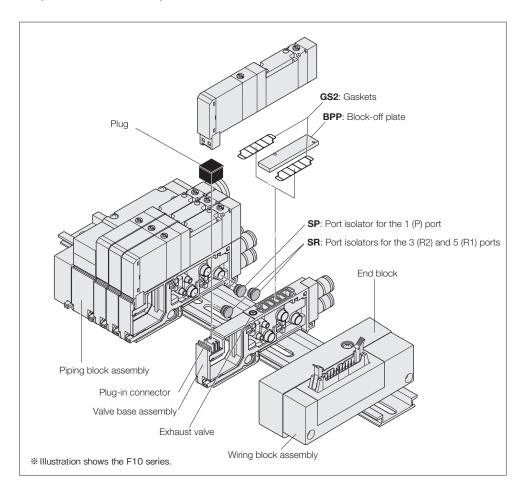

#### Manifold Order Code Example

(8 units of F15 Series)

#### F15M8SL-J5R-B1-W

stn.1~5 F15T0-A1-J5 DC24V stn.6~7 F15T2-A1-J6 DC24V stn.8 F15BPP-J6

Note: This order code example has no relationship to the illustration above.

#### **Precautions for Order Codes**

 Orders for valves only Place orders from "Single Valve Unit Order Codes" on p. 162. However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.


#### Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.


-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.

#### F15 Series Easy Assembly Type Manifold Non-Plug-in Type Order Codes

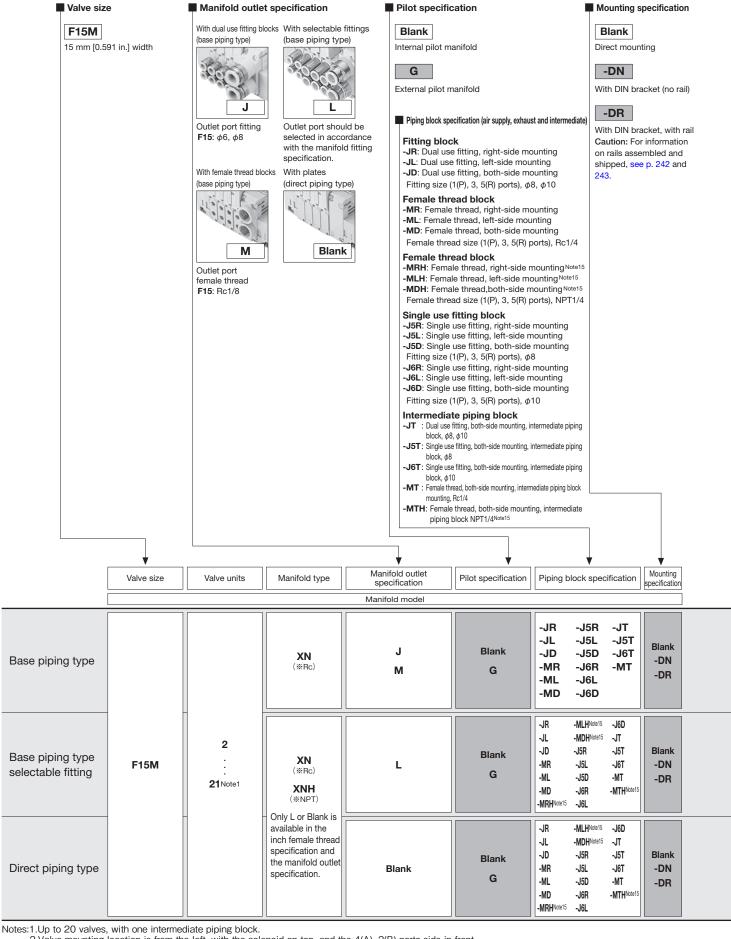

- 2. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
- When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
- 4. When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.

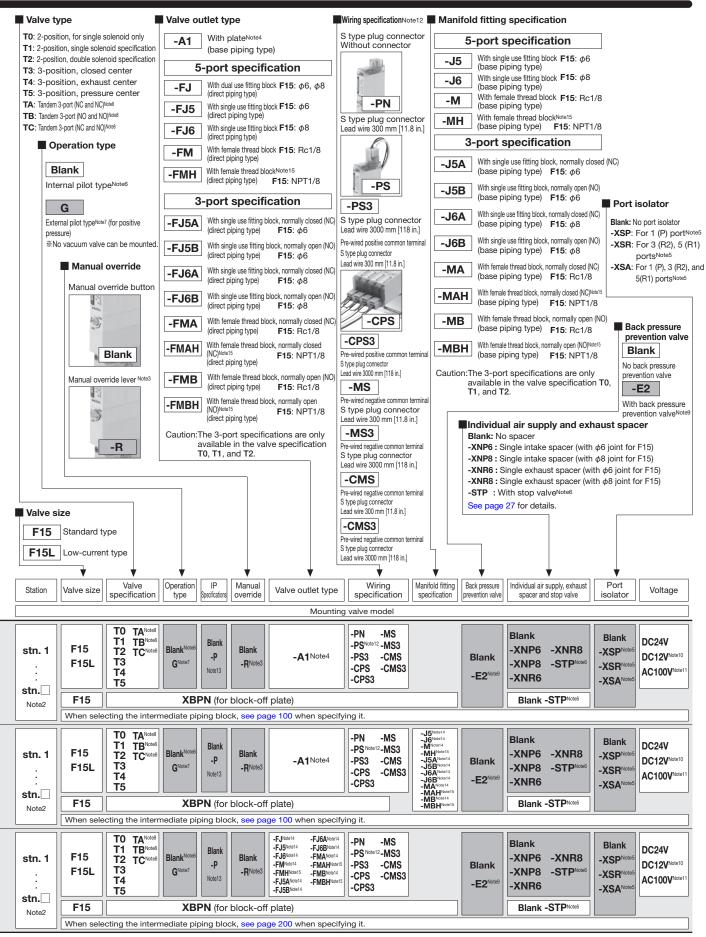


- Notes:5. Port isolators can be installed only when piping blocks are mounted on both sides In addition, only 1 port isolator can be mounted in 1 manifold for -XSA, or 1 each port isolator for -XSP and -XSR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
  - 6.Cannot be mounted on the external pilot manifold. Only direct mounting is available.
  - 7. Cannot be mounted on the internal pilot manifold.
  - Not available in external pilot type.
  - Not available with the individual exhaust spacer.

- Not available in low-current type.
- 11. Not available in low-current type and tandem 3-port valves.
- 12. Wiring specifications of -P□and -CP□, the -M□ and -CM□, positive common and negative common cannot be mounted together.
- 13. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- 14. The 3-port specifications are only available in the valve specification T0,
- 15. Can be selected only when the manifold type is XNH. KOGFNEI 199

#### Intermediate piping block

(When mounting an intermediate piping block to the manifold, complete the following type and specify the station specified on page 199.)

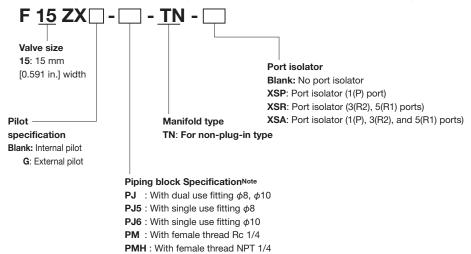

Note:See the following table for combinations of intermediate piping block port specifications and manifold piping block specifications.

Manifold piping specifications	Intermediate piping block	
JT	PJ	
J5T	PJ5	
J6T	PJ6	
MT	PM	
MTH	PMH	

### Parts for manifold

F 15 ZX - [

#### Valve size


width

Parts content

15: 15 mm [0.591 in.] GS2: Gasket (gasket and exhaust valve) GS3: Gasket (valve base side)

XSP: Port isolator (for 1(P) port) XSR: Port isolator (for 3(R2), 5(R1) ports) XSA: Port isolator (for 1(P), 3(R2), 5(R1) ports) **DN**: DIN mounting bracket (one set of two)

#### Block-off plate (block-off plate, 2 mounting screws, and plug)



Back pressure prevention valve (for divided type, two, with dedicated gasket)

F 15 Z - E2

Valve size

15: 15 mm [0.591 in.] width

Individual air supply and exhaust spacer / Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws F 15 ZX -

Specification

15: 15 mm [0.591 in.] XNPM: Individual air supply spacer (with M5 female thread for F15) width

XNRM: Individual exhaust spacer (with M5 female %For details, see p.27. thread for F15)

#### Valve base assembly (valve base, gasket, and 2 connecting rods for adding)

F 15 ZX -\*For use with both internal pilot and external pilot

Valve size

**15**: 15 mm [0.591 in.] width Piping specifications VJ : Dual use fitting valve base

**VJ5**: Single use fitting valve base F15: φ6 **VJ6**: Single diameter fitting valve base F15: φ8

VJ5A: 3-port specification normally closed, single use fitting valve base F15: φ6 **VJ5B**: 3-port specification normally open, single use fitting valve base F15: φ6 VJ6A: 3-port specification normally closed, single use fitting valve base F15: φ8 **VJ6B**: 3-port specification normally open, single use fitting valve base F15:  $\phi$ 8

VM : Female thread valve base F15: Rc1/8


VMA: 3-port specification normally closed, female thread valve base F15: Rc1/8 VMB: 3-port specification normally open, female thread valve base F15: Rc1/8

VMH: Female thread valve base F15: NPT1/8

VMAH: 3-port specification normally closed, female thread valve base F15: NPT1/8 VMBH: 3-port specification normally open, female thread valve base F15: NPT1/8

VP : Valve base plate

### Piping block assembly (non-plug-in)

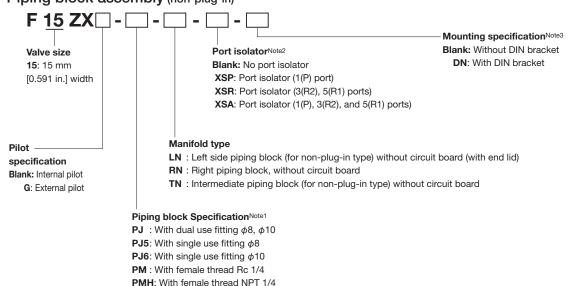

Notes:1.The fitting of the piping block is included. One set of two connecting rods is also included for a LN and TN type manifold.


2.Port isolator selection only available when the piping block name is TN.


PP: Plate (without fitting)

3. Only when the manifold type is LN or RN.

#### Muffler KM - J **6**: Outer diameter $\phi$ 6 (for piping block) 8: Outer diameter $\phi$ 8 (for piping block, for single exhaust spacer) **10**: Outer diameter $\phi$ 6 (for single exhaust spacer) (Sales unit: Set of 10 mufflers) Connecting rod (1 set of 2) F 15 ZX - - -Number of units $\mathbf{01} \sim \mathbf{20}$ : When type for valve base (RV) is selected Valve size 01: When type for left side piping block (RH) is selected 15: 15 mm 01: When type for intermediate piping block (RC) is selected [0.591 in.] width Specification RV: For valve base RH: For left piping block RC: For intermediate piping block DIN rail DIN -(Unit:1) Rail length 125: 125mm [4.921 in.] : (25 mm [0.984 in.] pitch) 525: 525mm [20.669 in.]

#### Connector-related order codes

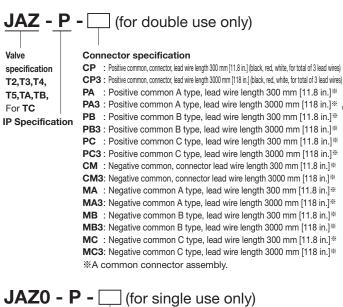

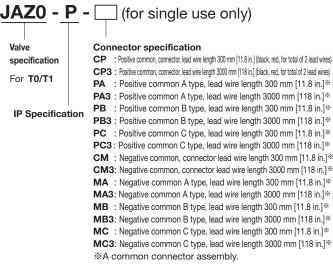

#### Connector-related order codes



Valve specification Connector type

0: For **T0** 

Blank:

T1, T2, T3 T4,T5,TA, For **TB/TC** 

CP : Positive common/connector, lead wire length 300 mm [11.8 in.] CP3 : Positive common/connector, lead wire length 3000 mm [118 in.] CPN : Positive common/connector, no lead wire (with shorting bar and contact) PA : Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3 : Positive common A type, lead wire length 3000 mm [118 in.]\*


\*For details, see p. 22.

PB : Positive common B type, lead wire length 300 mm [11.8 in.]\*\* PB3 : Positive common B type, lead wire length 3000 mm [118 in.]\* PC : Positive common C type, lead wire length 300 mm [11.8 in.]\* PC3 : Positive common C type, lead wire length 3000 mm [118 in.]\* CMN: Negative commonconnector, no lead wire (with shorting bar and contact) CM : Negative common, connector lead wire length 300 mm [11.8 in.]\*


CM3: Negative common, connector lead wire length 3000 mm [118 in.]\* MA : Negative common A type, lead wire length 300 mm [11.8 in.]\*\* MA3 : Negative common A type, lead wire length 3000 mm [118 in.]\* MB : Negative common B type, lead wire length 300 mm [11.8 in.]\* MB3: Negative common B type, lead wire length 3000 mm [118 in.]\* MC : Negative common C type, lead wire length 300 mm [11.8 in.]\*\*

MC3: Negative common C type, lead wire length 3000 mm [118 in.]\*

#### Common connector assembly

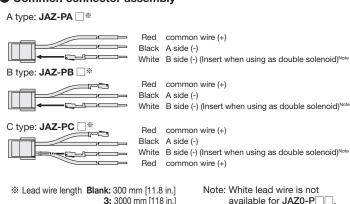


#### For negative common

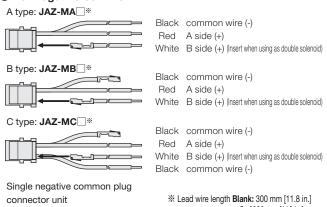

3: 3000 mm [118 in.]

Type: JAZ-CM□\*

3: 3000 mm [118 in.]




T4,T5,TA For TB/TC

Notes:

1. When the valve specification is **T1**, select the **JAZ0-P-**  $\square$  single

- dedicated type. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use the number of seal holes in the lead wire differs for the single and double type).
- 3. There is no white lead wire for the **JAZ0-P-** .
- It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.
- For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.
- For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.

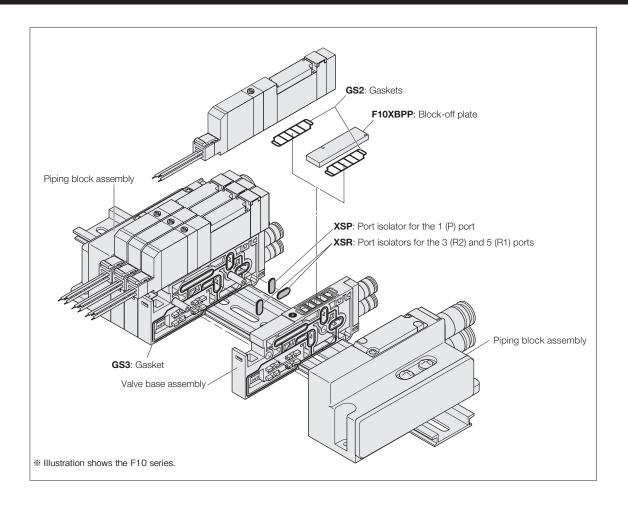

#### Manifold Order Code Example

(4 units of F15 Series)

#### F15M4XNJ-J6T-DR

stn.1 ~ 2 F15T0-A1-PS DC24V stn.3 F15ZX-PJ6-TN stn.4 F15T0-A1-PS DC24V

Note: This order code example has no relationship to the illustration above.


#### **Precautions for Order Codes**

#### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 162.


However, Blank, A2, F3, F4, F5, F6, F4A, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. And for the wiring specification, Blank, PL, and PL3 cannot be selected. In addition, for common terminal wiring connections, separately order the common connector assemblies listed on the left.

#### F15 Series Easy Assembly Type Manifold Plug-in Type Order Codes

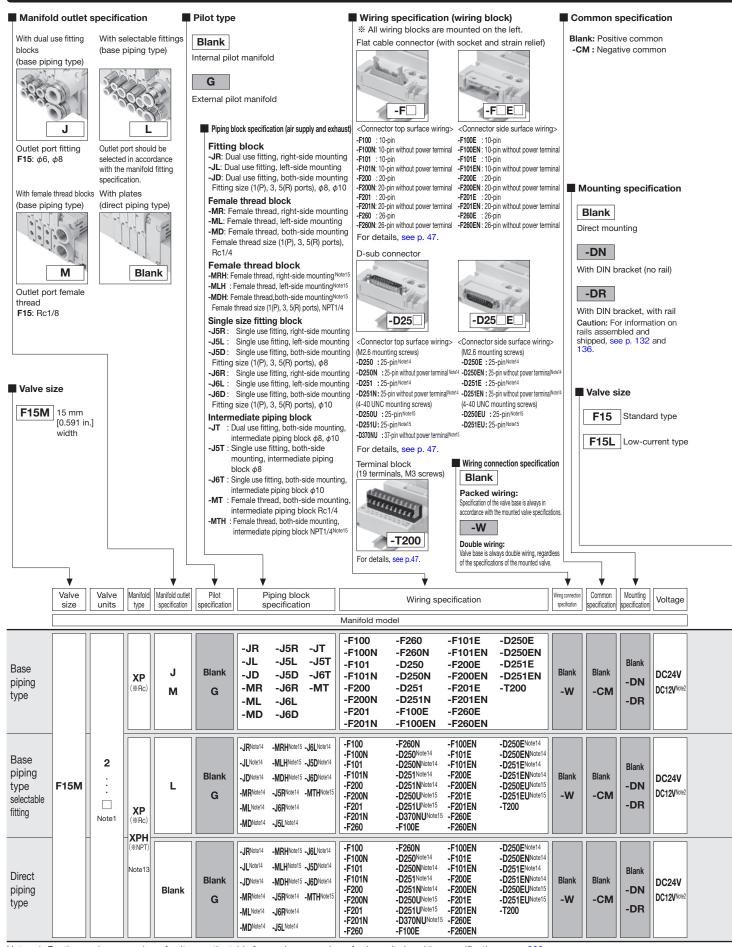

Notes: 1. For the maximum number of units, see the table for maximum number of valve units by wiring specification, on p. 208.

- 2. Not available in low-current type.
- 3. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
- 4. When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.

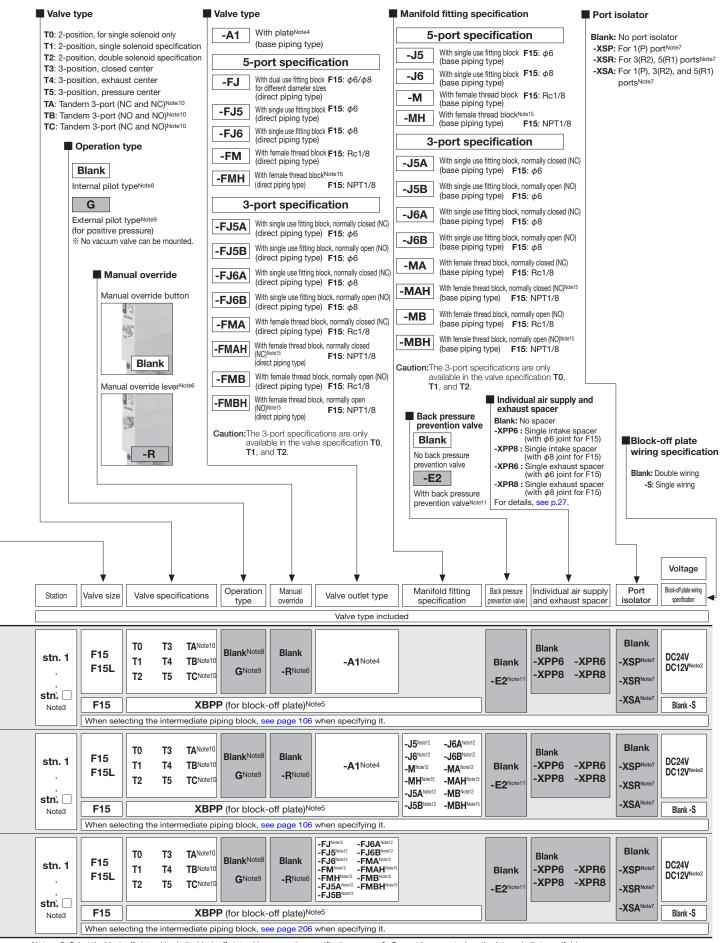


- Notes: 5. Select the block-off plate wiring in the block-off plate wiring connection specification.
  - When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  - 7. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -XSA, or 1 each port isolator for -XSP and -XSR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
  - Cannot be mounted on the external pilot manifold.

- 9. Cannot be mounted on the internal pilot manifold.
- 10. Not available in external pilot type.
- 11. Not available with the individual exhaust spacer.
- 12. The 3-port specifications are only available in the valve specification **T0**, **T1**, and **T2**.
- Only L or Blank is available in the inch female thread specification and the manifold outlet specification.
- 14. Can be selected only when the manifold type is XP.
- 15. Can be selected only when the manifold type is **XPH**.


#### Intermediate piping block


(When mounting an intermediate piping block to the manifold, complete the following type and specify the station specified on page 205.)

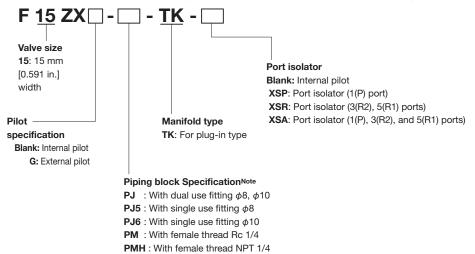

Note:See the following table for combinations of intermediate piping block port specifications and manifold piping block specifications.

Manifold piping specifications	Intermediate piping block	
JT	PJ	
J5T	PJ5	
J6T	PJ6	
MT	PM	
MTH	PMH	

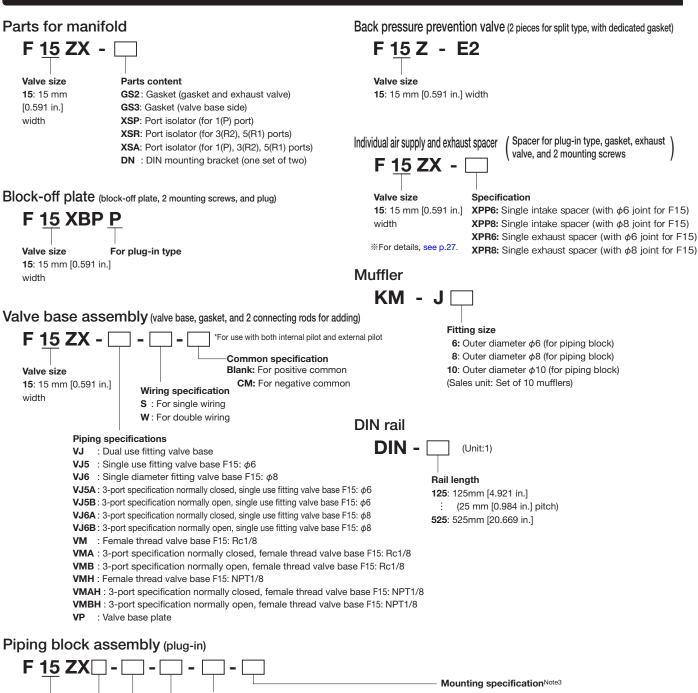


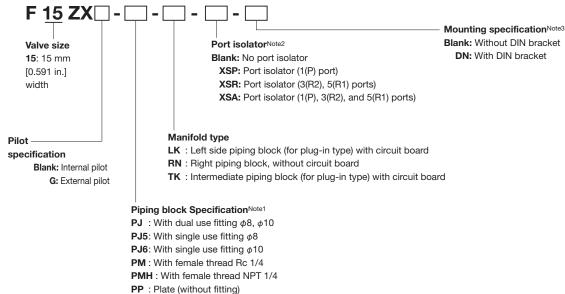


Notes: 1. The fitting of the piping block is included. One set of two connecting rods is also included for a LN and TN type manifold.

- 2. Port isolator selection only available when the piping block name is TK.
- 3. Only when the manifold type is LK or RN.

#### Connecting rod (1 set of 2)

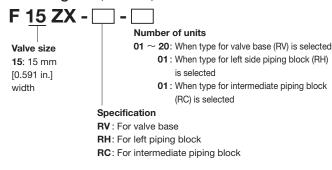

### Wiring block assembly (1 set)



#### Wiring specification

F100 : Flat cable connector (DC specification)
F101 : Flat cable connector (DC specification)
F200 : Flat cable connector (DC specification)
F201 : Flat cable connector (DC specification)
F260 : Flat cable connector (DC specification)
D250 : D-sub connector (M2.6 screws)

D251 : D-sub connector (M2.6 screws)

F100N: Flat cable connector (DC specification), without power terminal F101N: Flat cable connector (DC specification), without power terminal F200N: Flat cable connector (DC specification), without power terminal F201N: Flat cable connector (DC specification), without power terminal F260N: Flat cable connector (DC specification), without power terminal D250N: D-sub connector, without power terminal (M2.6 screws)

**D251N**: D-sub connector, without power terminal (M2.6 screws)

D250U: D-sub connector, (4-40UNC screws)

D250NU: D-sub connector, without power terminal (4-40UNC screws)

D251U: D-sub connector, (4-40UNC screws)

D251NU : D-sub connector, without power terminal (4-40UNC screws)
D370NU : D-sub connector, without power terminal (4-40UNC screws)


T200 : Terminal block, for left-side mounting

#### ■ Table for maximum number of valve units by wiring specification

		Maximum number of units *	
		Wiring connection specification	
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
<b>F100</b> ☐ Flat cable (10P)	8	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less. D370NU is a maxmum of 20 units.	4 units
<b>F101</b> ☐ Flat cable (10P)	8		4 units
<b>F200</b> ☐ Flat cable (20P)	16		8 units
<b>F201</b> ☐ Flat cable (20P)	16		8 units
<b>F260</b> ☐ Flat cable (26P)	20		10 units
<b>D250</b> D-sub connector (25P)	16		8 units
<b>D251</b> D-sub connector (25P)	20		10 units
<b>D370NU</b> D-sub connector (37P)	32		16 units
T200 Terminal block (19 terminals)	18		9 units

\*Note: When the intermediate piping block is selected, the maximum number of units will be added +1.

 $<sup>\</sup>ensuremath{\mathrm{\%}}$  The above flat cable connectors and D-sub connectors can be switched between the top and side type.

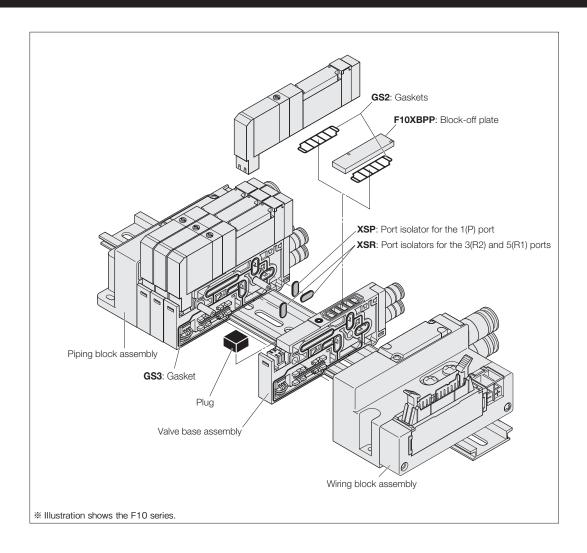

# Manifold Order Code Example (12 units of F15 Series)

#### F15M12XPL-J6T-F201-DR DC24V

stn.1  $\sim$  8 F15T1-A1-J5 DC24V F15ZX-PJ6-TK stn.9 stn.10  $\sim$  12 F15T1-A1-J5 DC24V

Note: This order code example has no relationship to the illustration above.

#### **Precautions for Order Codes**

#### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 162.

However, Blank, A2, F3, F4, F5, F6, F4A, F5B, F6B, F6B, or F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is


#### Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.


Single or double can also be selected as the block-off plate wiring specification separately from the manifold (valve) wiring specification.

#### F15 Series Easy Assembly Type Manifold Serial Transmission Type Order Codes

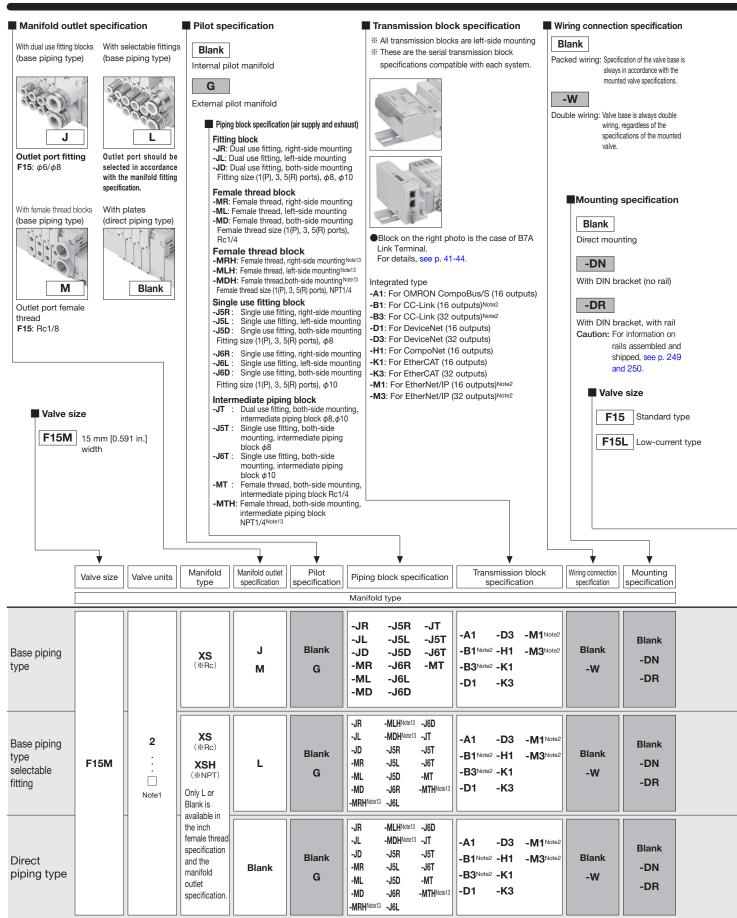

Notes 1. To determine the maximum number of units, see the table for maximum number of valve units by transmission block specification, on p. 214.


2. Complies with the CE marking regulation.

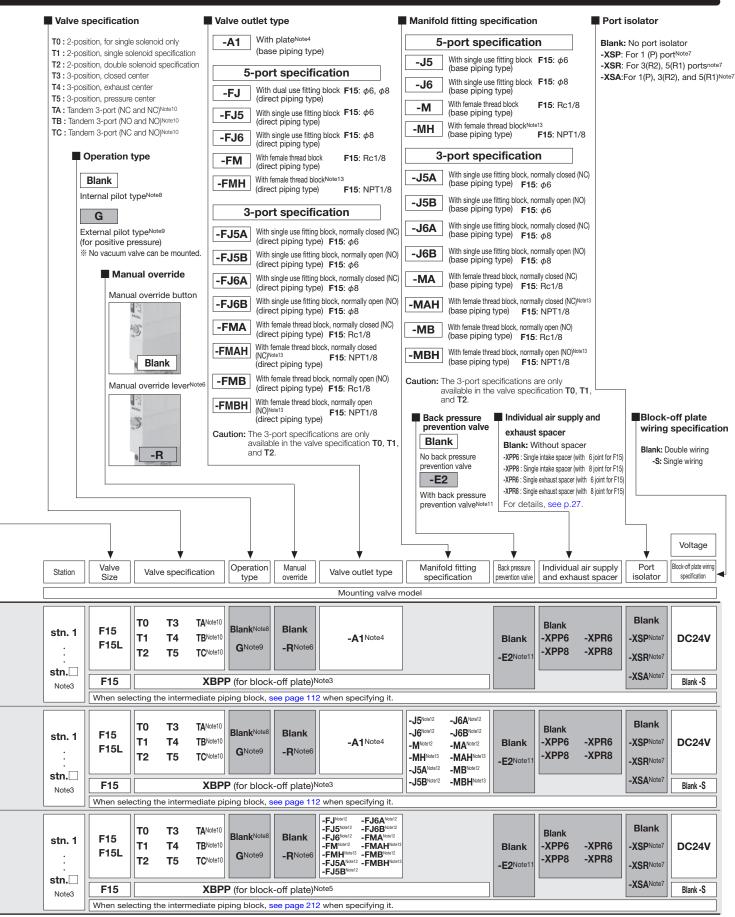

- Notes: 3. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
  - When selecting J, M, or L (base piping type) for the manifold outlet specifications, always enter -A1 (with plate) for the valve outlet type.
  - Sipecifications, aways enter An (with place) of the valve outer type.
     Single or double can also be selected as the block-off plate wiring specification separately from the manifold (valve) wiring specification.
  - 6. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
  - 7. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -XSA, or 1 each port isolator for -XSP and -XSR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
- 8. Cannot be mounted on the external pilot manifold.
- 9. Cannot be mounted on the internal pilot manifold.
- Not available in external pilot type.
- 11. Not available with the individual exhaust spacer.
- 12. The 3-port specifications are only available in the valve specification T0, T1, and T2.
- 13. Can be selected only when the manifold type is XSH.

#### Intermediate piping block

(When mounting an intermediate piping block to the manifold, complete the following type and specify the station specified on page 211.)

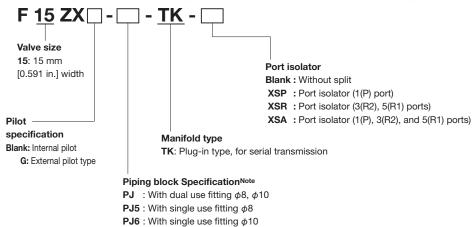

**PM**: With female thread Rc 1/4 **PMH**: With female thread NPT 1/4

Note:See the following table for combinations of intermediate piping block port specifications and manifold piping block specifications.

Manifold piping specifications	Intermediate piping block	
JT	PJ	
J5T	PJ5	
J6T	PJ6	
MT	PM	
MTH	PMH	

## Parts for manifold

F 15 ZX - [ Valve size

Parts content

15: 15 mm [0.591 in.] width

GS2: Gasket (gasket and exhaust valve)

GS3: Gasket (valve base side)

XSP: Port isolator (for 1(P) port)

XSR: Port isolator (for 3(R2), 5(R1) ports) XSA: Port isolator (for 1(P), 3(R2), 5(R1) ports)

**DN**: DIN mounting bracket (one set of two)

#### Block-off plate (block-off plate, 2 mounting screws, and plug)



Valve size

15: 15 mm [0.591 in.] width

Back pressure prevention valve (2 units for split type, with dedicated gasket)

F 15 Z - E2

Valve size

15: 15 mm [0.591 in.] width

/ Spacer for plug-in type, gasket, exhaust \ Individual air supply and exhaust spacer valve, and 2 mounting screws F 15 ZX -

Valve size

Specifications


**15**: 15 mm [0.591 in.] width

**XPP6:** Single intake spacer (with  $\phi$ 6 joint for F15) **XPP8:** Single intake spacer (with  $\phi$ 8 joint for F15) **XPR6:** Single exhaust spacer (with  $\phi$ 6 joint for F15)

\*For details, see p.27.

**XPR8:** Single exhaust spacer (with  $\phi$ 8 joint for F15)

#### Valve base assembly (valve base, gasket, and 2 connecting rods for adding)



#### Piping specification

VJ : Dual use fitting valve base

**VJ5**: Single use fitting valve base F15: φ6

**VJ6**: Single diameter fitting valve base F15: φ8

**VJ5A**: 3-port specification normally closed, single use fitting valve base F15: φ6 **VJ5B**: 3-port specification normally open, single use fitting valve base F15: φ6

**VJ6A**: 3-port specification normally closed, single use fitting valve base F15: φ8

**VJ6B**: 3-port specification normally open, single use fitting valve base F15: φ8

VM : Female thread valve base F15: Rc1/8

VMA: 3-port specification normally closed, female thread valve base F15: Rc1/8

VMB: 3-port specification normally open, female thread valve base F15: Rc1/8

VMH: Female thread valve base F15: NPT1/8

VMAH: 3-port specification normally closed, female thread valve base F15: NPT1/8

VMBH: 3-port specification normally open, female thread valve base F15: NPT1/8

VP : Valve base plate

#### Muffler

**KM** - **J**[ Fitting size


**6:** Outer diameter  $\phi$ 6 (for piping block)

**8:** Outer diameter  $\phi$ 8 (for piping block)

**10:** Outer diameter  $\phi$ 10 (for piping block)

(Sales unit: Set of 10 mufflers)

#### Connecting rod (1 set of 2)



selected [0.591 in.] width 01: When type for left side piping

block (RH) is selected


Specification -01: When type for intermediate piping RV: For valve base

block (RC) is selected

RC: For intermediate piping block

RH: For left piping block

#### Piping block assembly (plug-in)

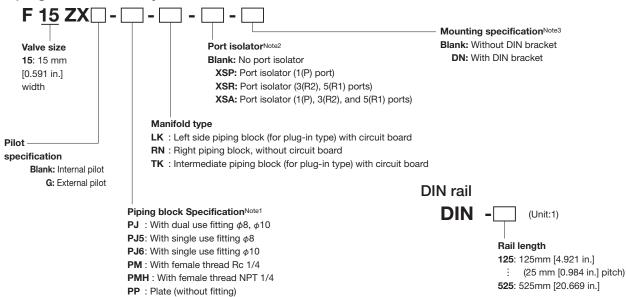

Notes: 1. The fitting of the piping block is included. One set of two connecting rods is also included for a LN and TN type manifold.

- 2. Port isolator selection only available when the piping block name is TK.
- 3. Only when the manifold type is LK or RN.

#### Serial transmission block (single unit)

YS6 (dedicated for manifold mounting)

#### Transmission block specification

B1: For CC-Link (16 outputs)

B3: For CC-Link (32 outputs)

D1: For DeviceNet (16 outputs)

D3: For DeviceNet (32 outputs)

H1: For CompoNet (16 outputs)



#### Transmission block specification

K1: For EtherCAT (16 outputs)

K3: For EtherCAT (32 outputs)


M1: For EtherNet/IP (16 outputs)

M3: For EtherNet/IP (32 outputs)

#### ■ Table for maximum number of valve units by transmission block specification

		Maximum number of units *	
		Wiring connection specification	
Transmission block specifications	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
-B1: For CC-Link (16 outputs)	16	Varies depending on the number of mounted single solenoids, double solenoids, and block-off plates.  The number of controlled solenoids should be designated as the maximum number of outputs or less.  -B3, -D3, -K3, and -M3 are	8 units
-B3: For CC-Link (32 outputs)	32		16 units
-D1: For DeviceNet (16 outputs)	16		8 units
-D3: For DeviceNet (32 outputs)	32		16 units
-H1: For CompoNet (16 outputs)	16		8 units
-K1: For EtherCAT (16 outputs)	16		8 units
-K3: For EtherCAT (32 outputs)	32		16 units
-M1: For EtherNet/IP (16 outputs)	16		8 units
-M3: For EtherNet/IP (32 outputs)	32	a maximum of 20 units.	16 units

Note: When the intermediate piping block is selected, the maximum number of units will be added +1.

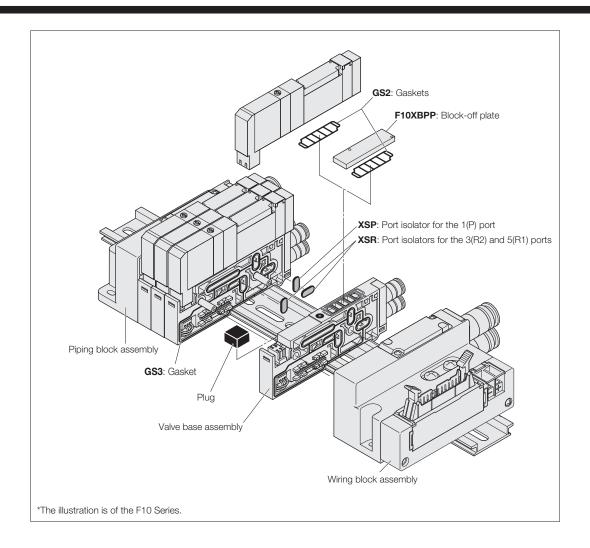

#### Manifold Order Code Example

(8 units of F15 Series)

#### F15M8XSL-J5R-B1-W

 $\begin{array}{lll} \mathrm{stn.1} \sim 5 & \mathrm{F15T0\text{-}A1\text{-}J5} \ \mathrm{DC24V} \\ \mathrm{stn.6} \sim 7 & \mathrm{F15T2\text{-}A1\text{-}J6} \ \mathrm{DC24V} \\ \mathrm{stn.8} & \mathrm{F15XBPP\text{-}J6} \end{array}$ 

Note: This order code example has no relationship to the illustration above.

#### **Precautions for Order Codes**

#### Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 162.

However, Blank, A2, F3, F4, F5, F6, F4A, F5B, F6A, or F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.

#### Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.


Caution

Single or double can also be selected as the block-off plate wiring specification separately from the manifold (valve) wiring specification.

#### F15T Valve specifications -F3-PS

With outlet port dual use fitting block With inlet port female thread block S type plug connector


\* For T0 Type dimensions, see p. 217.

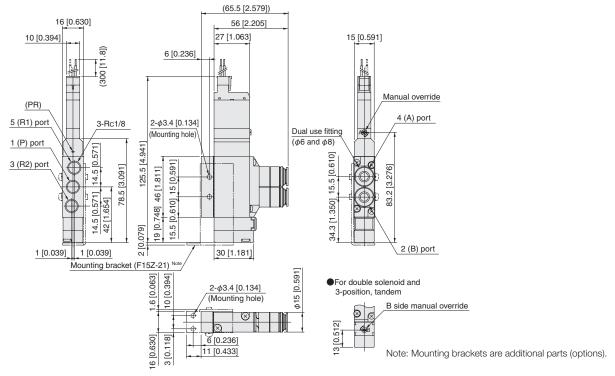

## F15T Valve specifications -F4-PS F15T Valve specifications -F4H-PS


With outlet port female thread block With inlet port female thread block S type plug connector

\* For T0 Type dimensions, see p. 217.

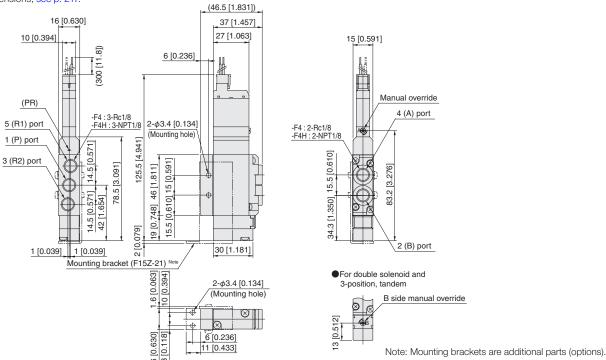


## F15T0-F □ -PS

With outlet port single use fitting block With inlet port female thread block S type plug connector

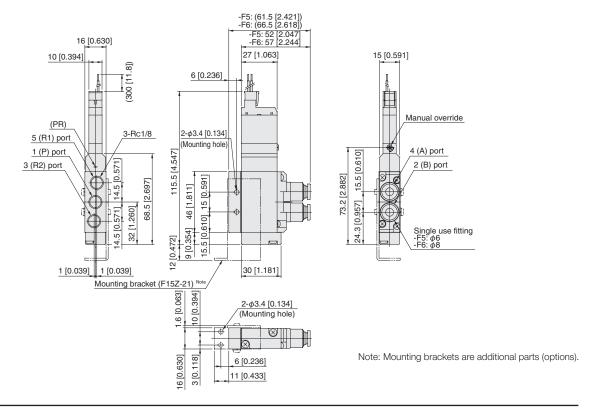

## **IP Specifications**

F15T Valve specifications Operation system -P-A2-PS

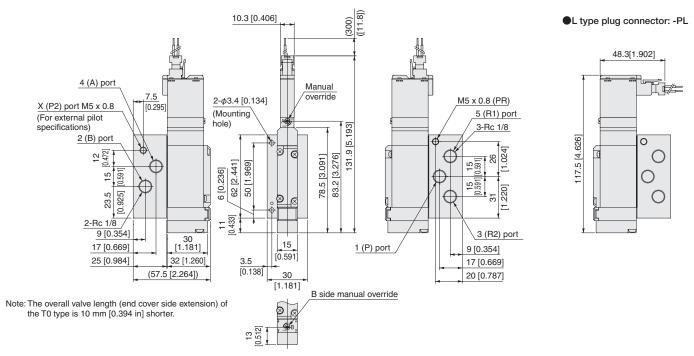


For double solenoid and 3-position, tandem

F15T Valve specifications Operation system -A2-PS

F15T Valve specifications Operation system -A2H-PS


With A-type sub-base S type plug connector

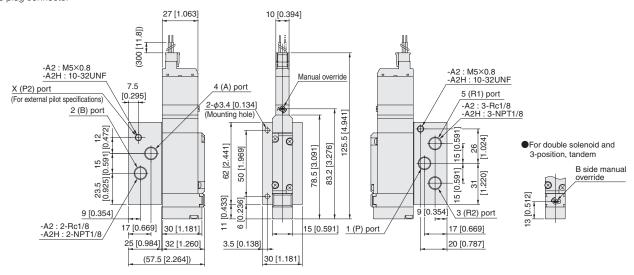



Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side extension is 10 mm [0.394 in] less).

#### **Options**


■L-type plug connector: -PL








■Manual lever: -R





Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side extension is 10 mm [0.394 in] less).


● Solenoid with DIN type connector: -39□

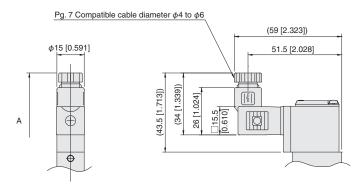

● Protruding lock type manual override: -83







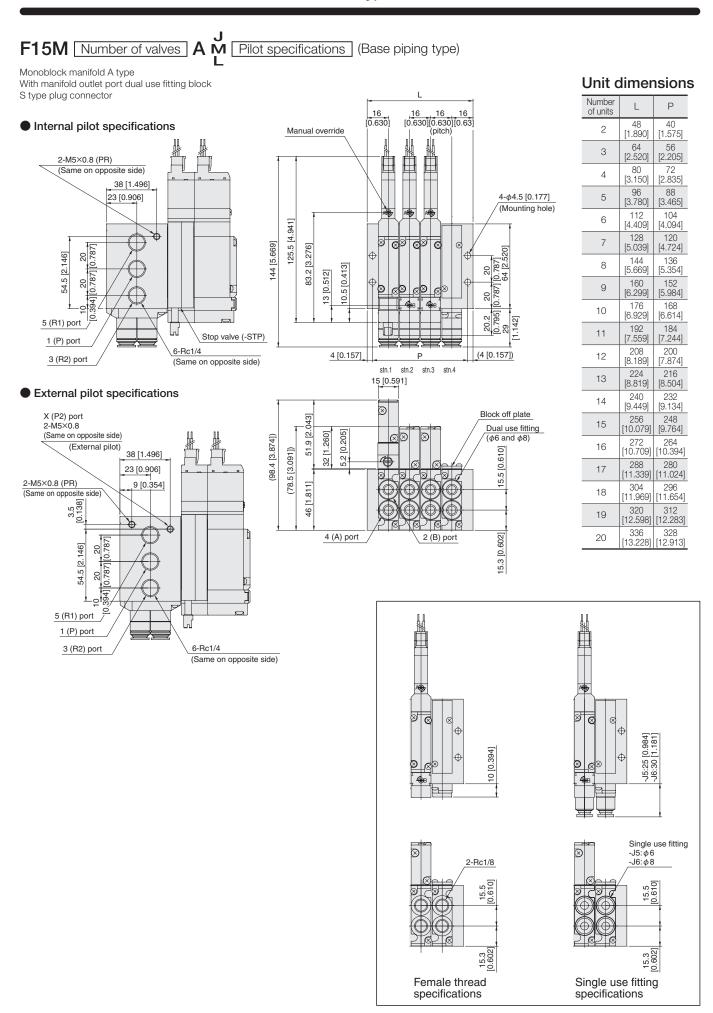


Monoblock manifold A type With manifold outlet port female thread block S type plug connector


#### Internal pilot specifications






#### External pilot specifications







#### Unit dimensions


Offic C	ııııeı	ISION
Number of units	L	Р
2	48 [1.890]	40 [1.575]
3	64 [2.520]	56 [2.205]
4	80 [3.150]	72 [2.835]
5	96 [3.780]	88 [3.465]
6	112 [4.409]	104 [4.094]
7	128 [5.039]	120 [4.724]
8	144 [5.669]	136 [5.354]
9	160 [6.299]	152 [5.984]
10	176 [6.929]	168 [6.614]
11	192 [7.559]	184 [7.244]
12	208 [8.189]	200 [7.874]
13	224 [8.819]	216 [8.504]
14	240 [9.449]	232 [9.134]
15	256 [10.079]	248 [9.764]
16	272 [10.709]	264 [10.394]
17	288 [11.339]	280 [11.024]
18	304 [11.969]	296 [11.654]
19	320 [12.598]	312 [12.283]
20	336 [13.228]	328 [12.913]

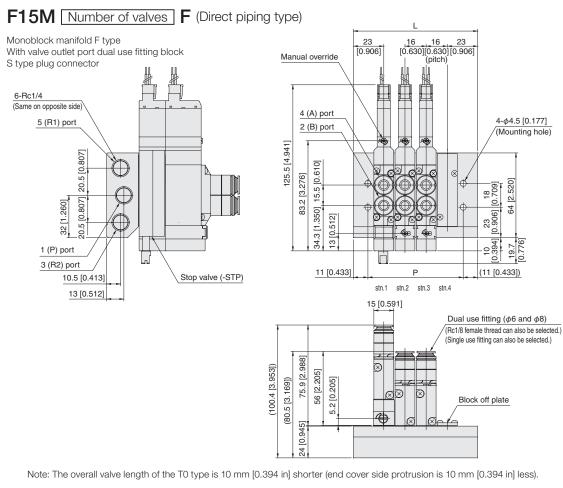

## F15M Number of valves FH (Direct piping type)








#### **Unit dimensions**

• • • • • • • • • • • • • • • • • • • •		
Number of units	L	Р
2	62 [2.441]	40 [1.575]
3	78 [3.071]	56 [2.205]
4	94 [3.701]	72 [2.835]
5	110 [4.331]	88 [3.465]
6	126 [4.961]	104 [4.094]
7	142 [5.591]	120 [4.724]
8	158 [6.220]	136 [5.354]
9	174 [6.850]	152 [5.984]
10	190 [7.480]	168 [6.614]
11	206 [8.110]	184 [7.244]
12	222 [8.740]	200 [7.874]
13	238 [9.370]	216 [8.504]
14	254 [10.000]	232 [9.134]
15	270 [10.630]	248 [9.764]
16	286 [11.260]	264 [10.394]
17	302 [11.890]	280 [11.024]
18	318 [12.520]	296 [11.654]
19	334 [13.150]	312 [12.283]
20	350 [13.780]	328 [12.913]

#### **Unit dimensions**

Offic difficultion				
Number of units	L	Р		
2	62 [2.441]	40 [1.575]		
3	78 [3.071]	56 [2.205]		
4	94 [3.701]	72 [2.835]		
5	110 [4.331]	88 [3.465]		
6	126 [4.961]	104 [4.094]		
7	142 [5.591]	120 [4.724]		
8	158 [6.220]	136 [5.354]		
9	174 [6.850]	152 [5.984]		
10	190 [7.480]	168 [6.614]		
11	206 [8.110]	184 [7.244]		
12	222 [8.740]	200 [7.874]		
13	238 [9.370]	216 [8.504]		
14	254 [10.000]	232 [9.134]		
15	270 [10.630]	248 [9.764]		
16	286 [11.260]	264 [10.394]		
17	302 [11.890]	280 [11.024]		
18	318 [12.520]	296 [11.654]		
19	334 [13.150]	312 [12.283]		
20	350 [13.780]	328 [12.913]		

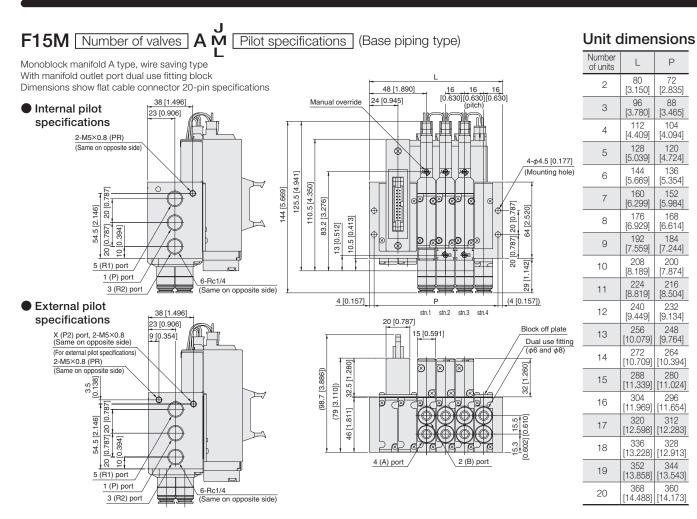


Monoblock manifold A type, wire saving type With manifold outlet port female thread block

> 54.5 [2.146] 20 [0.787] [0.394]

222 KOGANEI

5 (R1) port 1 (P) port 3 (R2) port

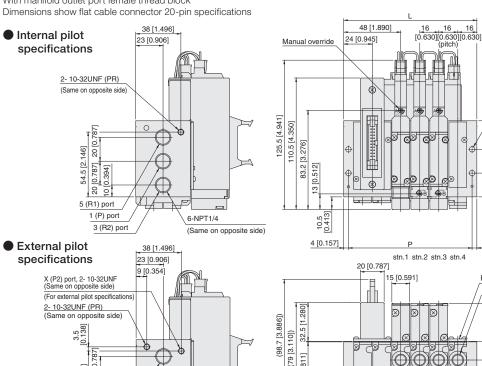

(Same on opposite side)

46 [1.811]

4 (A) port

## Unit dimensions

4-φ4.5 [0.177]

64 [2.520]

(4 [0.157])


Block off plate 2-NPT1/8

20

Unit c	dimer	nsions
Number of units	L	Р
2	80 [3.150]	72 [2.835]
3	96 [3.780]	88 [3.465]
4	112 [4.409]	104 [4.094]
5	128 [5.039]	120 [4.724]
6	144 [5.669]	136 [5.354]
7	160 [6.299]	152 [5.984]
8	176 [6.929]	168 [6.614]
9	192 [7.559]	184 [7.244]
10	208 [8.189]	200 [7.874]
11	224 [8.819]	216 [8.504]
12	240 [9.449]	232 [9.134]
13	256 [10.079]	248 [9.764]
14	272 [10.709]	264 [10.394]
15	288 [11.339]	280 [11.024]
16	304 [11.969]	296 [11.654]
17	320 [12.598]	312 [12.283]
18	336 [13.228]	328 [12.913]
19	352 [13.858]	344 [13.543]
20	368 [14.488]	360 [14.173]

## **F15M** Number of valves **F** (Direct piping type)

Monoblock manifold F type, wire saving type With valve outlet port dual use fitting block

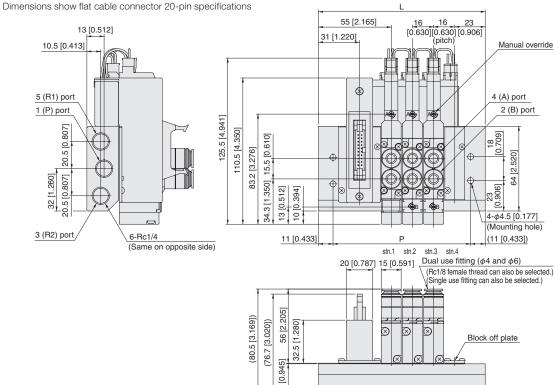



#### Unit dimensions

Offic C	ııııeı	ISION
Number of units	L	Р
2	94 [3.701]	72 [2.835]
3	110 [4.331]	88 [3.465]
4	126 [4.961]	104 [4.094]
5	142 [5.591]	120 [4.724]
6	158 [6.220]	136 [5.354]
7	174 [6.850]	152 [5.984]
8	190 [7.480]	168 [6.614]
9	206 [8.110]	184 [7.244]
10	222 [8.740]	200 [7.874]
11	238 [9.370]	216 [8.504]
12	254 [10.000]	232 [9.134]
13	270 [10.630]	248 [9.764]
14	286 [11.260]	264 [10.394]
15	302 [11.890]	280 [11.024]
16	318 [12.520]	296 [11.654]
17	334 [13.150]	312 [12.283]
18	350 [13.780]	328 [12.913]
19	366 [14.409]	344 [13.543]
20	382 [15.039]	360 [14.173]

## F15M Number of valves FH (Direct piping type)

Monoblock manifold F type, wire saving type With valve outlet port female thread block Dimensions show flat cable connector 20-pin specifications

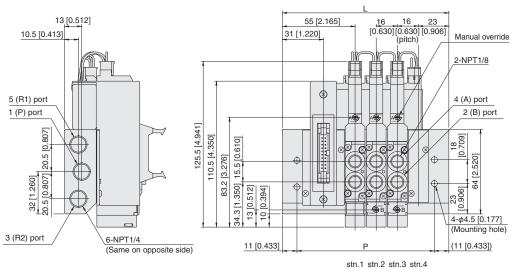





#### Unit dimensions

Unit dimensions				
Number of units	L	Р		
2	94 [3.701]	72 [2.835]		
3	110 [4.331]	88 [3.465]		
4	126 [4.961]	104 [4.094]		
5	142 [5.591]	120 [4.724]		
6	158 [6.220]	136 [5.354]		
7	174 [6.850]	152 [5.984]		
8	190 [7.480]	168 [6.614]		
9	206 [8.110]	184 [7.244]		
10	222 [8.740]	200 [7.874]		
11	238 [9.370]	216 [8.504]		
12	254 [10.000]	232 [9.134]		
13	270 [10.630]	248 [9.764]		
14	286 [11.260]	264 [10.394]		
15	302 [11.890]	280 [11.024]		
16	318 [12.520]	296 [11.654]		
17	334 [13.150]	312 [12.283]		
18	350 [13.780]	328 [12.913]		
19	366 [14.409]	344 [13.543]		
20	382 [15.039]	360 [14.173]		

PC board manifold A type With manifold outlet port dual use fitting block Note: Mounted valve example shows -W wiring specifications. In the case of -S wiring specifications, the mounted valve becomes T0 or T1 type.

#### Internal pilot specifications




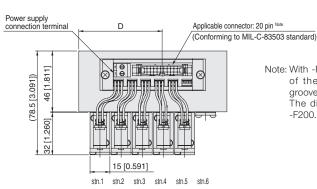


Note: With -F200 and -F201, the positions of the mis-insertion prevention grooves are reversed.

The dimentions show the case of -F200.

#### External pilot specifications





#### **Unit dimensions**

Number of units	L	Р	D
6	112	104	63
	[4.409]	[4.094]	[2.480]
8	144	136	68.5
	[5.669]	[5.354]	[2.697]
10	176	168	68.5
	[6.929]	[6.614]	[2.697]
12	208	200	79.5
	[8.189]	[7.874]	[3.130]
14	240	232	90
	[9.449]	[9.134]	[3.543]
16	272	264	90
	[10.709]	[10.394]	[3.543]

Note: Wiring specifications For -S: 6, 8, 10, 12, 14, 16 units For -W: Only 6 and 8 units selectable


## F15M Number of valves FP

#### (Direct piping type)

PC board manifold F type With valve outlet port dual use fitting block

Note: Mounted valve example shows -W wiring specifications.

In the case of -S wiring specifications, the





D

Note: With -F200 and -F201, the positions of the mis-insertion prevention grooves are reversed.

The dimentions show the case of

mounted valve becomes T0 or T1 type.



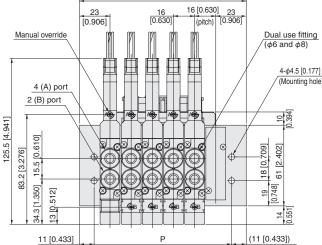


### **Unit dimensions**

Number of units	L	Р	D
6	126	104	70
	[4.961]	[4.094]	[2.756]
8	158	136	75.5
	[6.220]	[5.354]	[2.972]
10	190	168	75.5
	[7.480]	[6.614]	[2.972]
12	222	200	86.5
	[8.740]	[7.874]	[3.406]
14	254	232	92
	[10.000]	[9.134]	[3.622]
16	286	264	92
	[11.260]	[10.394]	[3.622]

Note: Wiring specifications For -S: 6, 8, 10, 12, 14, 16 units For -W: Only 6 and 8 units

With manifold outlet port dual use fitting block S type plug connector

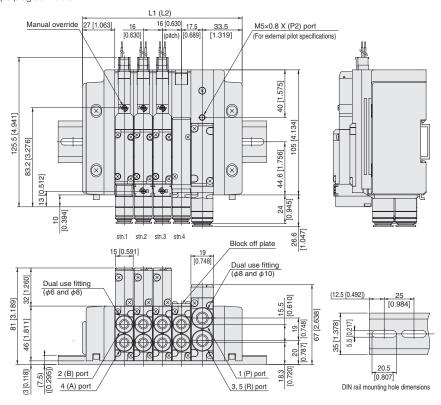


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]

Note: When two piping blocks are used.

## **F15M** Number of valves **N** Pilot specifications (Direct piping type)

With valve outlet port dual use fitting block S type plug connector

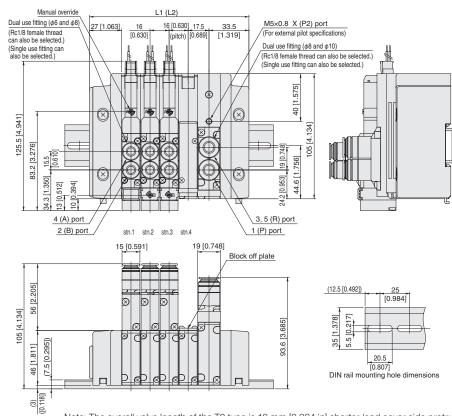


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]

Note: When two piping blocks are used.

Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side protrusion is 10 mm [0.394 in] less).

With manifold outlet port female thread block S type plug connector

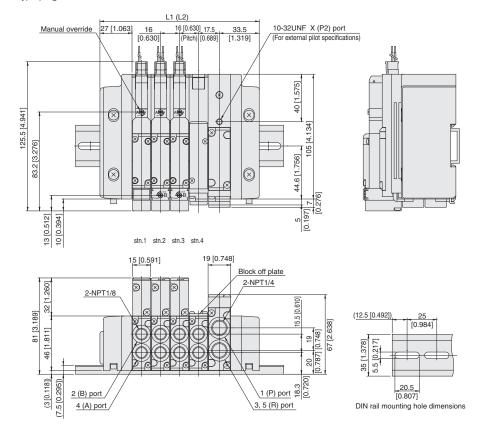


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]

Note: When two piping blocks are used.

## F15M Number of valves NH Pilot specifications (Direct piping type)

With valve outlet port female thread block S type plug connector

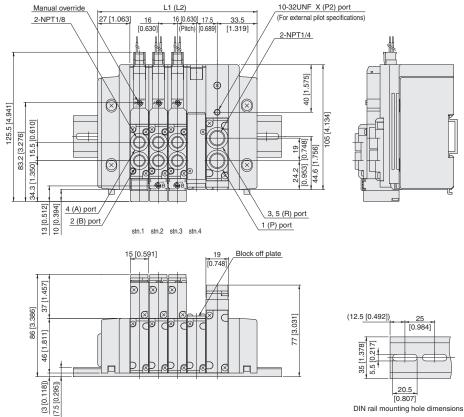



#### **Unit dimensions**

Offic difficition				
Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]

Note: When two piping blocks are used.

Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side protrusion is 10 mm [0.394 in] less).

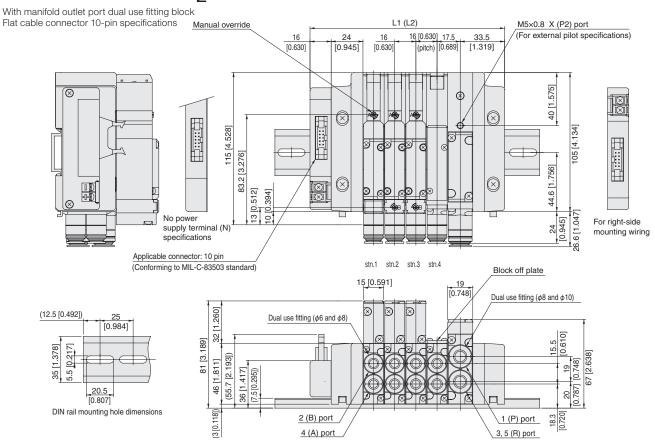

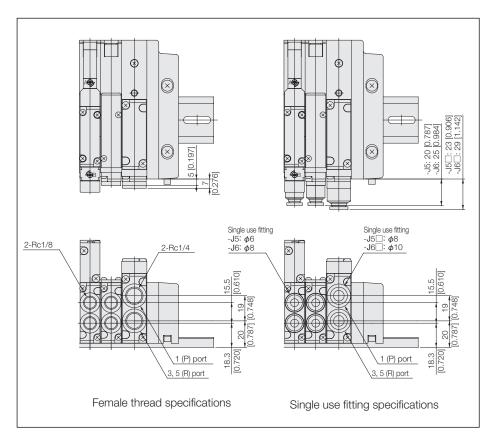

#### **Unit dimensions**


	Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
•	2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
	3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
	4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
Ī	5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
	6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
	7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
	8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add
3 mm [0.118 in] to the L1 (L2) dimension.



With manifold outlet port dual use fitting block Flat cable connector 20-pin specifications (side surface wiring)

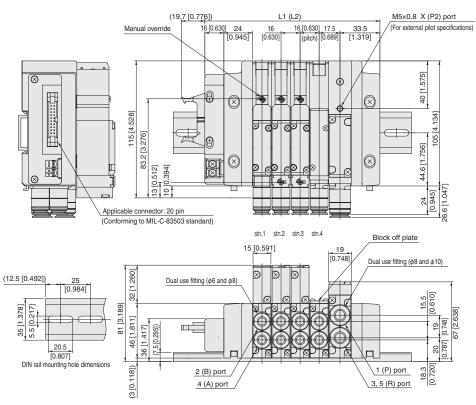

#### **Unit dimensions**


• · · · · · · · · · · · · · · · · · · ·					
Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]	
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]	
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]	
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]	
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]	
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]	
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]	
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]	
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]	
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]	
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]	
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]	
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]	
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]	
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]	

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

#### F15M Number of valves Pilot specifications (Base piping type) M

With manifold outlet port dual use fitting block Flat cable connector 26-pin specifications

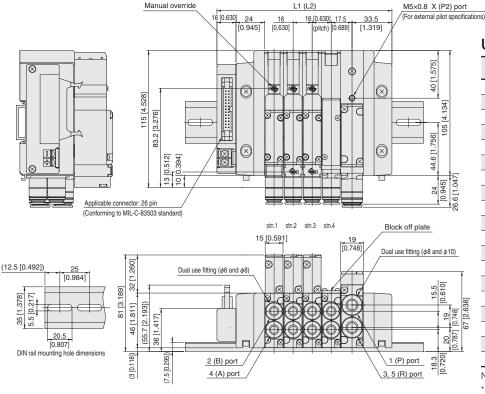


#### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]


Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.



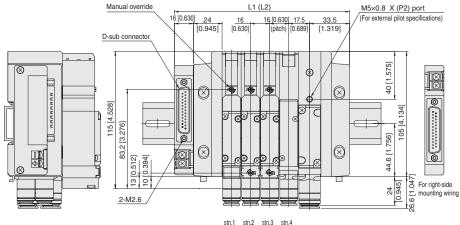

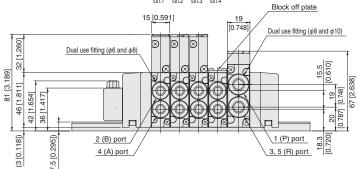



DIN rail mounting


#### **Unit dimensions**

Number		1		
of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2 1	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3 1	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4 1	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5 1	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6 1	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7 1	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8 2	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9 2	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10 2	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11 2	59 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12 2	75 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13 2	91 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14 3	07 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15 3	23 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16 3	39 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17 3	55 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18 3	71 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19 3	87 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20 4	03 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used.

### F15M Number of valves Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block Terminal block type

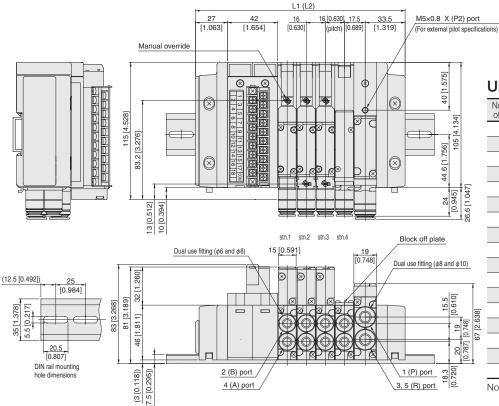


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	144 [5.669]	175 [6.890]	163 [6.417]	200 [7.874]
3	160 [6.299]	200 [7.874]	179 [7.047]	225 [8.858]
4	176 [6.929]	225 [8.858]	195 [7.677]	225 [8.858]
5	192 [7.559]	225 [8.858]	211 [8.307]	250 [9.843]
6	208 [8.189]	250 [9.843]	227 [8.937]	275 [10.827]
7	224 [8.819]	250 [9.843]	243 [9.567]	275 [10.827]
8	240 [9.449]	275 [10.827]	259 [10.197]	300 [11.811]
9	256 [10.079]	300 [11.811]	275 [10.827]	300 [11.811]
10	272 [10.709]	300 [11.811]	291 [11.457]	325 [12.795]
11	288 [11.339]	325 [12.795]	307 [12.087]	350 [13.780]
12	304 [11.969]	350 [13.780]	323 [12.717]	350 [13.780]
13	320 [12.598]	350 [13.780]	339 [13.346]	375 [14.764]
14	336 [13.228]	375 [14.764]	355 [13.976]	400 [15.748]
15	352 [13.858]	400 [15.748]	371 [14.606]	400 [15.748]
16	368 [14.488]	400 [15.748]	387 [15.236]	425 [16.732]
17	384 [15.118]	425 [16.732]	403 [15.866]	450 [17.717]
18	400 [15.748]	425 [16.732]	419 [16.496]	450 [17.717]

For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Flat cable connector 10-pin specifications

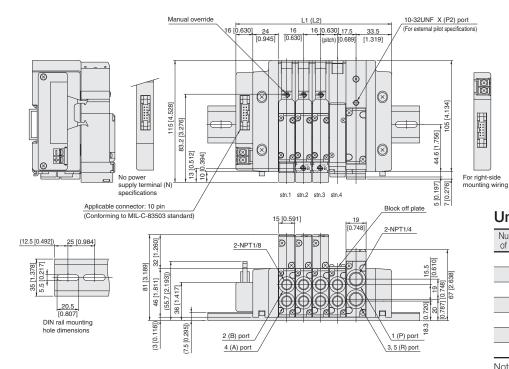

#### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add
3 mm [0.118 in] to the L1 (L2) dimension.

## F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 10-pin specifications

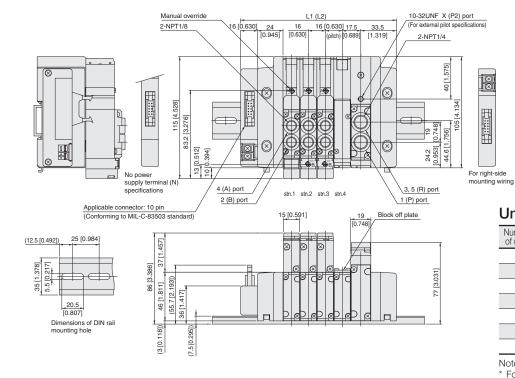


#### **Unit dimensions**

O i iii c	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	310110		
Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add
3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Flat cable connector 20-pin specifications (top surface wiring)

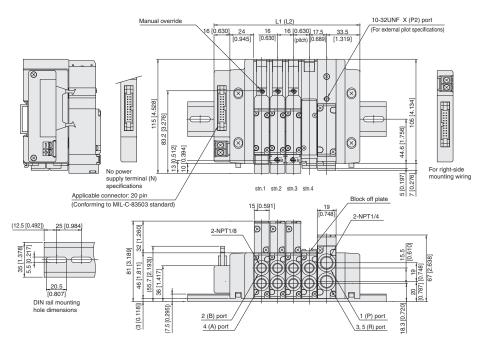

#### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]

Note: When two piping blocks are used.

## F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block

Flat cable connector 20-pin specifications (top surface wiring)

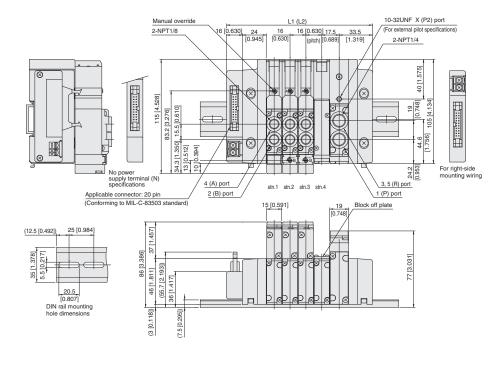


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]

<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Flat cable connector 26-pin specifications

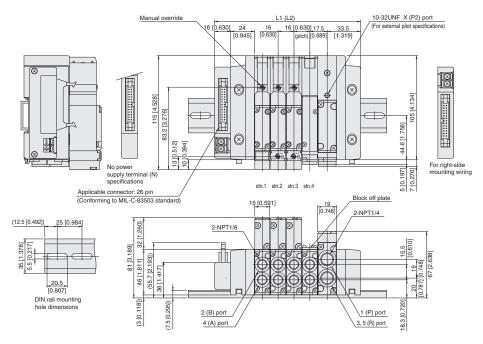


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used.

## F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 26-pin specifications

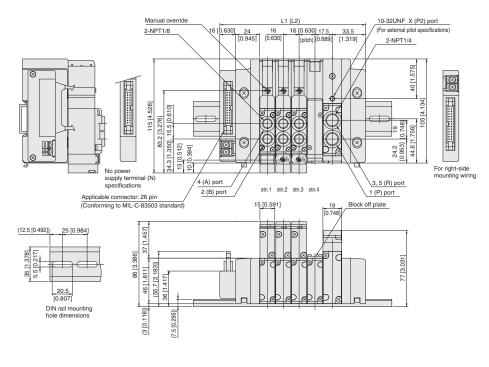


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]	
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]	
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]	
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]	
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]	
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]	
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]	
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]	
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]	
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]	
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]	
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]	
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]	
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]	
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]	
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]	
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]	
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]	
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]	

<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

 $<sup>^{\</sup>star}$  For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block D-sub connector 25-pin specifications

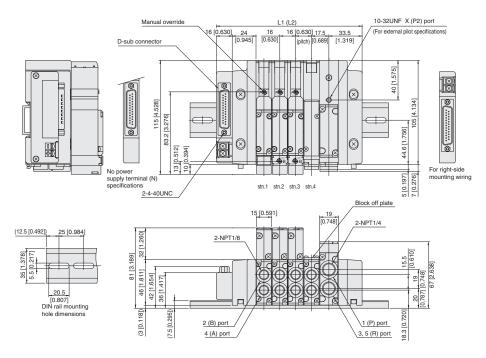


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used.

## F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block D-sub connector 25-pin specifications

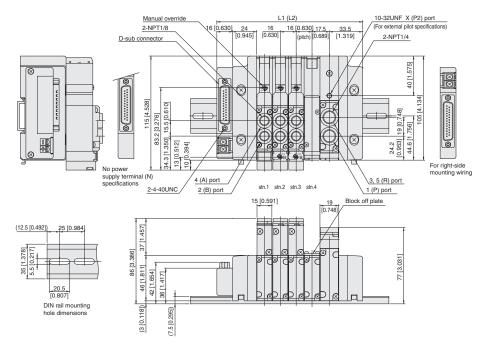

#### **Unit dimensions**


Number of units		L1	Length of DIN rail	L2 Note	Length of DIN rail Note
	2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
	3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
	4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
	5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
	6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
	7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
	8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
	9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
	10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
	11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
	12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
	13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
	14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
	15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
	16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
	17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
	18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
	19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
	20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block D-sub connector 37-pin specifications

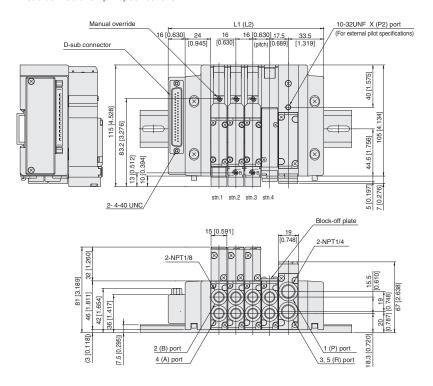

## Unit dimensions


Number of units			L2 Note	Length of DIN rail Note	
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]	
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]	
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]	
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]	
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]	
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]	
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]	
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]	
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]	
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]	
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]	
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]	
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]	
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]	
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]	
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]	
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]	
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]	
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]	

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

## F15M Number of valves PH Pilot specifications (Base piping type)

With valve outlet port female thread block D-sub connector 37-pin specifications

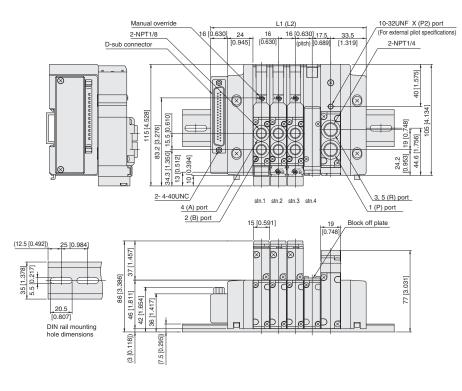


#### Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note		
2	115 [4.528] 150 [5.906] 134 [5.276]		175 [6.890]			
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]		
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]		
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]		
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]		
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]		
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]		
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]		
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]		
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]		
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]		
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]		
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]		
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]		
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]		
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]		
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]		
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]		
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]		
Note: When two pining blocks are used						

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Terminal block type

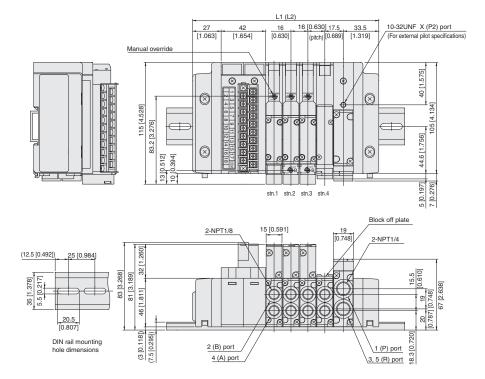


#### **Unit dimensions**

Number of units	L1	Length of L2		Length of DIN rail Note	
2	2 144 [5.669]		163 [6.417]	200 [7.874]	
3	160 [6.299]	200 [7.874]	179 [7.047]	225 [8.858]	
4	176 [6.929]	225 [8.858]	195 [7.677]	225 [8.858]	
5	192 [7.559]	225 [8.858]	211 [8.307]	250 [9.843]	
6	208 [8.189]	250 [9.843]	227 [8.937]	275 [10.827]	
7	224 [8.819]	250 [9.843]	243 [9.567]	275 [10.827]	
8	240 [9.449]	275 [10.827]	259 [10.197]	300 [11.811]	
9	256 [10.079]	300 [11.811]	275 [10.827]	300 [11.811]	
10	272 [10.709]	300 [11.811]	291 [11.457]	325 [12.795]	
11	288 [11.339]	325 [12.795]	307 [12.087]	350 [13.780]	
12	304 [11.969]	350 [13.780]	323 [12.717]	350 [13.780]	
13	320 [12.598]	350 [13.780]	339 [13.346]	375 [14.764]	
14	336 [13.228]	375 [14.764]	355 [13.976]	400 [15.748]	
15	352 [13.858]	400 [15.748]	371 [14.606]	400 [15.748]	
16	368 [14.488]	400 [15.748]	387 [15.236]	425 [16.732]	
17	384 [15.118]	425 [16.732]	403 [15.866]	450 [17.717]	
18	400 [15.748]	425 [16.732]	419 [16.496]	450 [17.717]	

Note: When two piping blocks are used.

## F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Terminal block type

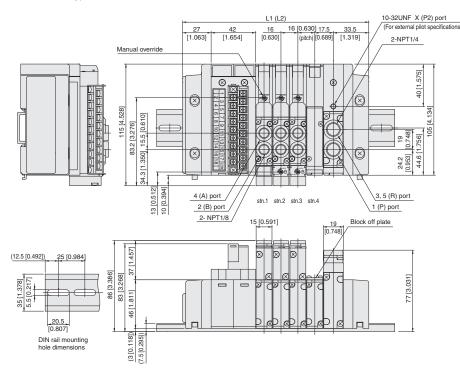


#### **Unit dimensions**

of L2 Lengt ail Note DIN rai	Length of DIN rail Note	
90] 163 [6.417] 200 [7.	.874]	
74] 179 [7.047] 225 [8	.858]	
58] 195 [7.677] 225 [8	.858]	
58] 211 [8.307] 250 [9	.843]	
43] 227 [8.937] 275 [10	).827]	
43] 243 [9.567] 275 [10	).827]	
27] 259 [10.197] 300 [11	.811]	
11] 275 [10.827] 300 [11	.811]	
11] 291 [11.457] 325 [12	2.795]	
95] 307 [12.087] 350 [13	3.780]	
80] 323 [12.717] 350 [13	3.780]	
80] 339 [13.346] 375 [14	1.764]	
64] 355 [13.976] 400 [15	.748]	
48] 371 [14.606] 400 [15	5.748]	
48] 387 [15.236] 425 [16	5.732]	
32] 403 [15.866] 450 [17	7.717]	
32] 419 [16.496] 450 [17	7.717]	
	ail Note DIN ra  200   163 [6.417]   200 [7  74]   179 [7.047]   225 [8  58]   195 [7.677]   225 [8  58]   211 [8.307]   250 [9  43]   227 [8.937]   275 [10  43]   243 [9.567]   275 [10  227]   259 [10.197]   300 [11  111]   275 [10.827]   300 [11  111]   291 [11.457]   325 [12  995]   307 [12.087]   350 [13  80]   323 [12.717]   350 [13  80]   339 [13.346]   375 [14  64]   355 [13.976]   400 [15  48]   371 [14.606]   400 [15  48]   371 [15.266]   455 [16  32]   403 [15.866]   450 [17	



With manifold outlet port dual use fitting block (Models that support integrated serial transmission block)

\*For dimensions of EtherCAT, see p. 240.

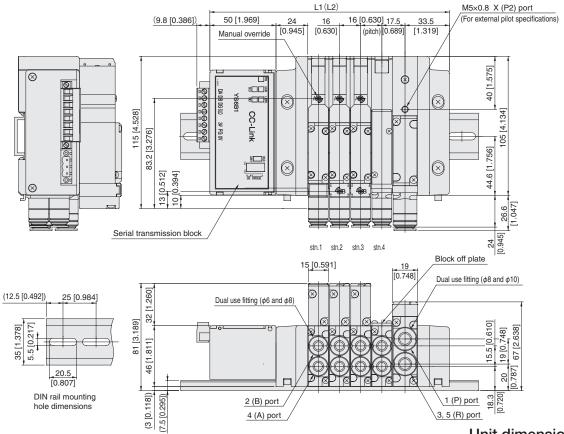


#### **Unit dimensions**

Number of units	-4 -4   L1   DIN -1   L2		L2 Note	Length of DIN rail Note
2	2   149 [5.866]		168 [6.614]	225 [8.858]
3	165 [6.496]	225 [8.858]	184 [7.244]	225 [8.858]
4	181 [7.126]	225 [8.858]	200 [7.874]	250 [9.843]
5	197 [7.756]	250 [9.843]	216 [8.504]	275 [10.827]
6	213 [8.386]	275 [10.827]	232 [9.134]	275 [10.827]
7	229 [9.016]	275 [10.827]	248 [9.764]	300 [11.811]
8	245 [9.646]	300 [11.811]	264 [10.394]	325 [12.795]
9	261 [10.276]	325 [12.795]	280 [11.024]	325 [12.795]
10	277 [10.906]	325 [12.795]	296 [11.654]	350 [13.780]
11	293 [11.535]	350 [13.780]	312 [12.283]	375 [14.764]
12	309 [12.165]	350 [13.780]	328 [12.913]	375 [14.764]
13	325 [12.795]	375 [14.764]	344 [13.543]	400 [15.748]
14	341 [13.425]	400 [15.748]	360 [14.173]	400 [15.748]
15	357 [14.055]	400 [15.748]	376 [14.803]	425 [16.732]
16	373 [14.685]	425 [16.732]	392 [15.433]	450 [17.717]
17	389 [15.315]	450 [17.717]	408 [16.063]	475 [18.701]
18	405 [15.945]	450 [17.717]	424 [16.693]	475 [18.701]
19	421 [16.575]	475 [18.701]	440 [17.323]	500 [19.685]
20	437 [17.205]	500 [19.685]	456 [17.953]	500 [19.685]

<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block

(Models that support integrated serial transmission block)

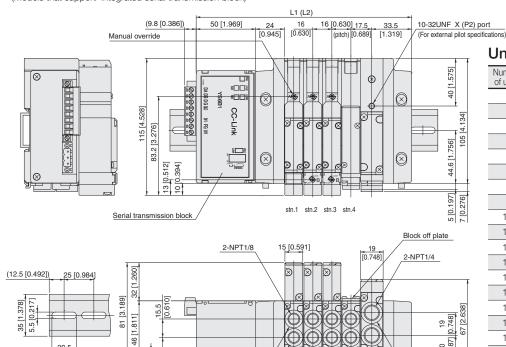

### **Unit dimensions**

•							
Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note			
2	149 [5.866]	200 [7.874]	168 [6.614]	225 [8.858]			
3	165 [6.496]	225 [8.858]	184 [7.244]	225 [8.858]			
4	181 [7.126]	225 [8.858]	200 [7.874]	250 [9.843]			
5	197 [7.756]	250 [9.843]	216 [8.504]	275 [10.827]			
6	213 [8.386]	275 [10.827]	232 [9.134]	275 [10.827]			
7	229 [9.016]	275 [10.827]	248 [9.764]	300 [11.811]			
8	245 [9.646]	300 [11.811]	264 [10.394]	325 [12.795]			
9	261 [10.276]	325 [12.795]	280 [11.024]	325 [12.795]			
10	277 [10.906]	325 [12.795]	296 [11.654]	350 [13.780]			
11	293 [11.535]	350 [13.780]	312 [12.283]	375 [14.764]			
12	309 [12.165]	350 [13.780]	328 [12.913]	375 [14.764]			
13	325 [12.795]	375 [14.764]	344 [13.543]	400 [15.748]			
14	341 [13.425]	400 [15.748]	360 [14.173]	400 [15.748]			
15	357 [14.055]	400 [15.748]	376 [14.803]	425 [16.732]			
16	373 [14.685]	425 [16.732]	392 [15.433]	450 [17.717]			
17	389 [15.315]	450 [17.717]	408 [16.063]	475 [18.701]			
18	405 [15.945]	450 [17.717]	424 [16.693]	475 [18.701]			
19	421 [16.575]	475 [18.701]	440 [17.323]	500 [19.685]			
20	437 [17.205]	500 [19.685]	456 [17.953]	500 [19.685]			

Note: When two piping blocks are used.

1 (P) port

3, 5 (R) port

## F15M Number of valves SH Pilot specifications (Direct piping type)

2 (B) port

4 (A) port


With valve outlet port female thread block

[0.807]
DIN rail mounting

hole dimensions

(Models that support integrated serial transmission block)

(3 [0.118])

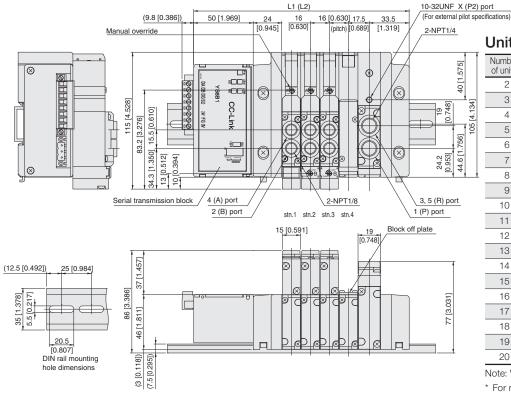


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	149 [5.866]	200 [7.874]	168 [6.614]	225 [8.858]
3	165 [6.496]	225 [8.858]	184 [7.244]	225 [8.858]
4	181 [7.126]	225 [8.858]	200 [7.874]	250 [9.843]
5	197 [7.756]	250 [9.843]	216 [8.504]	275 [10.827]
6	213 [8.386]	275 [10.827]	232 [9.134]	275 [10.827]
7	229 [9.016]	275 [10.827]	248 [9.764]	300 [11.811]
8	245 [9.646]	300 [11.811]	264 [10.394]	325 [12.795]
9	261 [10.276]	325 [12.795]	280 [11.024]	325 [12.795]
10	277 [10.906]	325 [12.795]	296 [11.654]	350 [13.780]
11	293 [11.535]	350 [13.780]	312 [12.283]	375 [14.764]
12	309 [12.165]	350 [13.780]	328 [12.913]	375 [14.764]
13	325 [12.795]	375 [14.764]	344 [13.543]	400 [15.748]
14	341 [13.425]	400 [15.748]	360 [14.173]	400 [15.748]
15	357 [14.055]	400 [15.748]	376 [14.803]	425 [16.732]
16	373 [14.685]	425 [16.732]	392 [15.433]	450 [17.717]
17	389 [15.315]	450 [17.717]	408 [16.063]	475 [18.701]
18	405 [15.945]	450 [17.717]	424 [16.693]	475 [18.701]
19	421 [16.575]	475 [18.701]	440 [17.323]	500 [19.685]
20	437 [17.205]	500 [19.685]	456 [17.953]	500 [19.685]

Note: When two piping blocks are used.

\* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.


<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

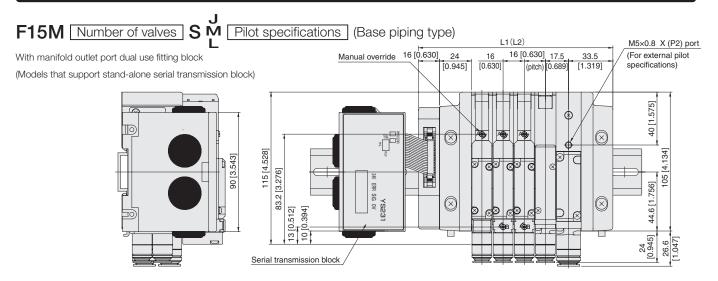


#### **Unit dimensions**

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	115 [4.528]	225 [8.858]	134 [5.276]	225 [8.858]	
3	131 [5.157]	225 [8.858]	150 [5.906]	250 [9.843]	
4	147 [5.787]	250 [9.843]	166 [6.535]	275 [10.827]	
5	163 [6.417]	275 [10.827]	182 [7.165]	275 [10.827]	
6	179 [7.047]	275 [10.827]	198 [7.795]	300 [11.811]	
7	195 [7.677]	300 [11.811]	214 [8.425]	325 [12.795]	
8	211 [8.307]	300 [11.811]	230 [9.055]	325 [12.795]	
9	227 [8.937]	325 [12.795]	246 [9.685]	350 [13.780]	
10	243 [9.567]	350 [13.780]	262 [10.315]	375 [14.764]	
11	259 [10.197]	350 [13.780]	278 [10.945]	375 [14.764]	
12	275 [10.827]	375 [14.764]	294 [11.575]	400 [15.748]	
13	291 [11.457]	400 [15.748]	310 [12.205]	400 [15.748]	
14	307 [12.087]	400 [15.748]	326 [12.835]	425 [16.732]	
15	323 [12.717]	425 [16.732]	342 [13.465]	450 [17.717]	
16	339 [13.346]	450 [17.717]	358 [14.094]	450 [17.717]	

Note: When two piping blocks are used.

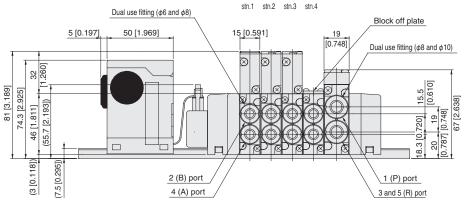





DIN rail mounting hole dimensions

## Additional Parts (available separately)


● Muffler: KM-J10 [for both plug-in and non-plug-in]




● Muffler: KM-J6 [for individual exhaust spacer only]




● Muffler: KM-J8 [for individual exhaust spacer only]





<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

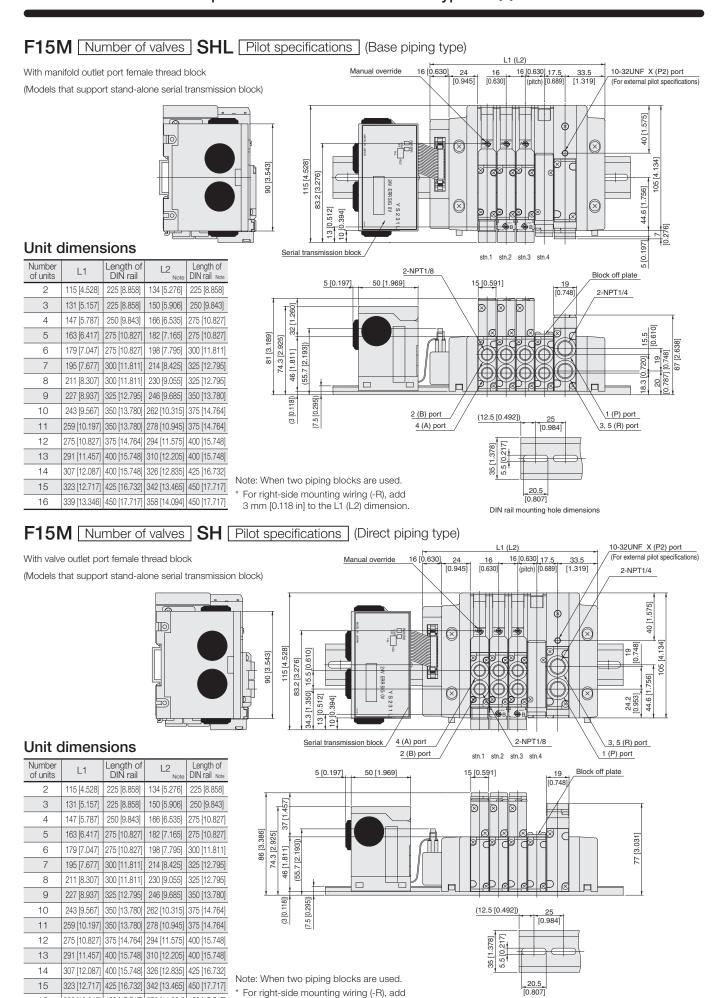

3 mm [0.118 in] to the L1 (L2) dimension.


16


339 [13.346] 450 [17.717] 358 [14.094] 450 [17.717]


DIN rail mounting hole dimensions


With manifold outlet port female thread block

(Ether CAT)



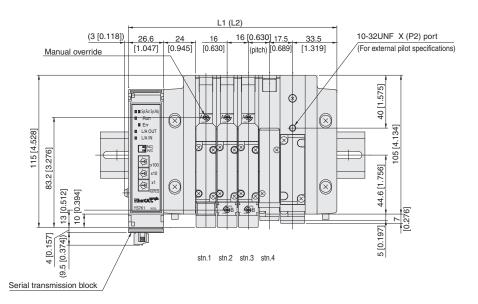



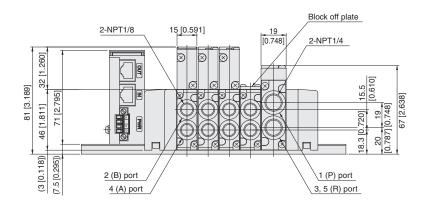


#### **Unit dimensions**


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	125.6 [4.945]	175 [6.890]	144.6 [5.693]	200 [7.874]
3	141.6 [5.575] 200 [7.874] 160.6 [6.323]		200 [7.874]	
4	157.6 [6.205]	200 [7.874]	176.6 [6.953]	225 [8.858]
5	173.6 [6.835]	225 [8.858]	192.6 [7.583]	250 [9.843]
6	189.6 [7.465]	250 [9.843]	208.6 [8.213]	250 [9.843]
7	205.6 [8.094]	250 [9.843]	224.6 [8.843]	275 [10.827]
8	221.6 [8.724]	275 [10.827]	240.6 [9.472]	300 [11.811]
9	237.6 [9.354]	300 [11.811]	256.6 [10.102]	300 [11.811]
10	253.6 [9.984]	300 [11.811]	272.6 [10.732]	325 [12.795]
11	269.6 [10.614]	325 [12.795]	288.6 [11.362]	350 [13.780]
12	285.6 [11.244]	325 [12.795]	304.6 [11.992]	350 [13.780]
13	301.6 [11.874]	350 [13.780]	320.6 [12.622]	375 [14.764]
14	317.6 [12.504]	375 [14.764]	336.6 [13.252]	375 [14.764]
15	333.6 [13.134]	375 [14.764]	352.6 [13.882]	400 [15.748]
16	349.6 [13.764]	400 [15.748]	368.6 [14.512]	425 [16.732]
17	365.6 [14.394]	425 [16.732]	384.6 [15.142]	450 [17.717]
18	381.6 [15.024]	425 [16.732]	400.6 [15.772]	450 [17.717]
19	397.6 [15.654]	450 [17.717]	416.6 [16.402]	475 [18.701]
20	413.6 [16.283]	475 [18.701]	432.6 [17.031]	475 [18.701]
Note: Wh	en two nir	ning block	s are used	


<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With valve outlet port female thread block

(Ether CAT)

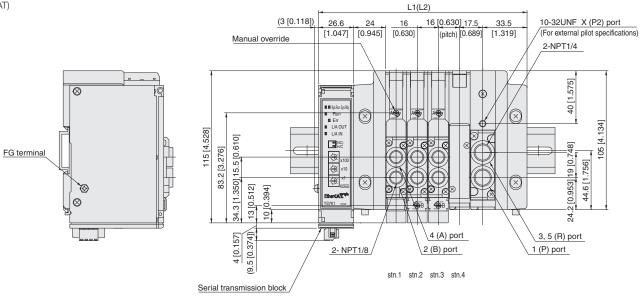



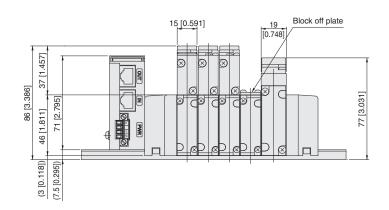


#### **Unit dimensions**

Number of units L1		Length of DIN rail	L2 Note	Length of DIN rail Note	
2	125.6 [4.945]	175 [6.890]	144.6 [5.693]	200 [7.874]	
3	141.6 [5.575]	200 [7.874]	160.6 [6.323]	200 [7.874]	
4	157.6 [6.205]	200 [7.874]	176.6 [6.953]	225 [8.858]	
5	173.6 [6.835]	225 [8.858]	192.6 [7.583]	250 [9.843]	
6	189.6 [7.465]	250 [9.843]	208.6 [8.213]	250 [9.843]	
7	205.6 [8.094]	250 [9.843]	224.6 [8.843]	275 [10.827]	
8	221.6 [8.724]	275 [10.827]	240.6 [9.472]	300 [11.811]	
9	237.6 [9.354]	300 [11.811]	256.6 [10.102]	300 [11.811]	
10	253.6 [9.984]	300 [11.811]	272.6 [10.732]	325 [12.795]	
11	269.6 [10.614]	325 [12.795]	288.6 [11.362]	350 [13.780]	
12	285.6 [11.244]	325 [12.795]	304.6 [11.992]	350 [13.780]	
13	301.6 [11.874]	350 [13.780]	320.6 [12.622]	375 [14.764]	
14	317.6 [12.504]	375 [14.764]	336.6 [13.252]	375 [14.764]	
15	333.6 [13.134]	375 [14.764]	352.6 [13.882]	400 [15.748]	
16	349.6 [13.764]	400 [15.748]	368.6 [14.512]	425 [16.732]	
17	365.6 [14.394]	425 [16.732]	384.6 [15.142]	450 [17.717]	
18	381.6 [15.024]	425 [16.732]	400.6 [15.772]	450 [17.717]	
19	397.6 [15.654]	450 [17.717]	416.6 [16.402]	475 [18.701]	
20	413.6 [16.283]	475 [18.701]	432.6 [17.031]	475 [18.701]	
	00 +110 01				

<sup>\*</sup> For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

# F15M Number of units XN M Pilot specifications - Piping block specifications (Base piping type)

With manifold outlet port dual use fitting block S type plug connector

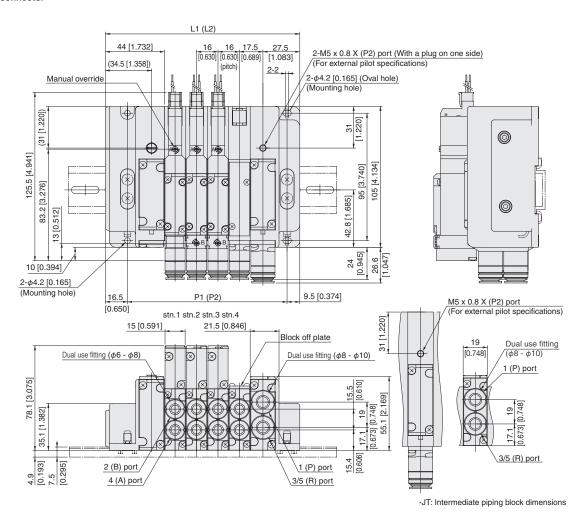


#### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2⁺	P2*	Length of DIN rail Note
2	113 [4.449]	87 [3.425]	175 [6.890]	-	-	-
3	129 [5.079]	103 [4.055]	175 [6.890]	148 [5.827]	122 [4.803]	175 [6.890]
4	145 [5.709]	119 [4.685]	200 [7.874]	164 [6.457]	138 [5.433]	200 [7.874]
5	161 [6.339]	135 [5.315]	225 [8.858]	180 [7.087]	154 [6.063]	225 [8.858]
6	177 [6.969]	151 [5.945]	225 [8.858]	196 [7.717]	170 [6.693]	225 [8.858]
7	193 [7.598]	167 [6.575]	250 [9.843]	212 [8.346]	186 [7.323]	250 [9.843]
8	209 [8.228]	183 [7.205]	250 [9.843]	228 [8.976]	202 [7.953]	275 [10.827]
9	225 [8.858]	199 [7.835]	275 [10.827]	244 [9.606]	218 [8.583]	275 [10.827]
10	241 [9.488]	215 [8.465]	300 [11.811]	260 [10.236]	234 [9.213]	300 [11.811]
11	257 [10.118]	231 [9.094]	300 [11.811]	276 [10.866]	250 [9.843]	325 [12.795]
12	273 [10.748]	247 [9.724]	325 [12.795]	292 [11.496]	266 [10.472]	325 [12.795]
13	289 [11.378]	263 [10.354]	350 [13.780]	308 [12.126]	282 [11.102]	350 [13.780]
14	305 [12.008]	279 [10.984]	350 [13.780]	324 [12.756]	298 [11.732]	350 [13.780]
15	321 [12.638]	295 [11.614]	375 [14.764]	340 [13.386]	314 [12.362]	375 [14.764]
16	337 [13.268]	311 [12.244]	400 [15.748]	356 [14.016]	330 [12.992]	400 [15.748]
17	353 [13.898]	327 [12.874]	400 [15.748]	372 [14.646]	346 [13.622]	400 [15.748]
18	369 [14.528]	343 [13.504]	425 [16.732]	388 [15.276]	362 [14.252]	425 [16.732]
19	385 [15.157]	359 [14.134]	450 [17.717]	404 [15.906]	378 [14.882]	450 [17.717]
20	401 [15.787]	375 [14.764]	450 [17.717]	420 [16.535]	394 [15.512]	450 [17.717]
21	-	-	-	436 [17.165]	410 [16.142]	475 [18.701]

Note: When the  $J \square \mathsf{T}$  or MT piping block specifications is selected.

## F15M Number of units XN Pilot specifications - Piping block specifications (Direct piping type)

With manifold outlet port dual use fitting block S type plug connector

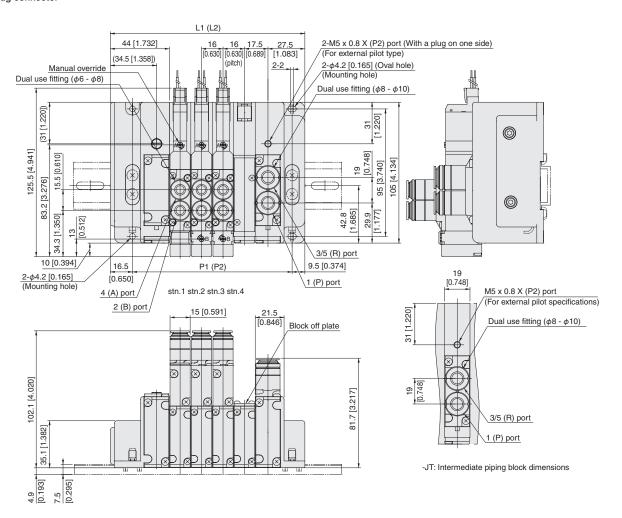



#### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2*	P2*	Length of DIN rail Note
2	113 [4.449]	87 [3.425]	175 [6.890]	-	-	-
3	129 [5.079]	103 [4.055]	175 [6.890]	148 [5.827]	122 [4.803]	175 [6.890]
4	145 [5.709]	119 [4.685]	200 [7.874]	164 [6.457]	138 [5.433]	200 [7.874]
5	161 [6.339]	135 [5.315]	225 [8.858]	180 [7.087]	154 [6.063]	225 [8.858]
6	177 [6.969]	151 [5.945]	225 [8.858]	196 [7.717]	170 [6.693]	225 [8.858]
7	193 [7.598]	167 [6.575]	250 [9.843]	212 [8.346]	186 [7.323]	250 [9.843]
8	209 [8.228]	183 [7.205]	250 [9.843]	228 [8.976]	202 [7.953]	275 [10.827]
9	225 [8.858]	199 [7.835]	275 [10.827]	244 [9.606]	218 [8.583]	275 [10.827]
10	241 [9.488]	215 [8.465]	300 [11.811]	260 [10.236]	234 [9.213]	300 [11.811]
11	257 [10.118]	231 [9.094]	300 [11.811]	276 [10.866]	250 [9.843]	325 [12.795]
12	273 [10.748]	247 [9.724]	325 [12.795]	292 [11.496]	266 [10.472]	325 [12.795]
13	289 [11.378]	263 [10.354]	350 [13.780]	308 [12.126]	282 [11.102]	350 [13.780]
14	305 [12.008]	279 [10.984]	350 [13.780]	324 [12.756]	298 [11.732]	350 [13.780]
15	321 [12.638]	295 [11.614]	375 [14.764]	340 [13.386]	314 [12.362]	375 [14.764]
16	337 [13.268]	311 [12.244]	400 [15.748]	356 [14.016]	330 [12.992]	400 [15.748]
17	353 [13.898]	327 [12.874]	400 [15.748]	372 [14.646]	346 [13.622]	400 [15.748]
18	369 [14.528]	343 [13.504]	425 [16.732]	388 [15.276]	362 [14.252]	425 [16.732]
19	385 [15.157]	359 [14.134]	450 [17.717]	404 [15.906]	378 [14.882]	450 [17.717]
20	401 [15.787]	375 [14.764]	450 [17.717]	420 [16.535]	394 [15.512]	450 [17.717]
21	-	-	-	436 [17.165]	410 [16.142]	475 [18.701]

Note: When the J T or MT piping block specifications is selected.

With manifold outlet port dual use fitting block Flat cable connector 10-pin specifications

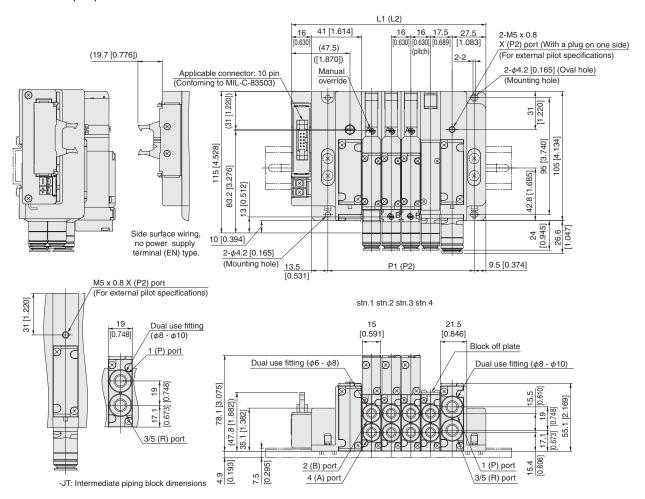


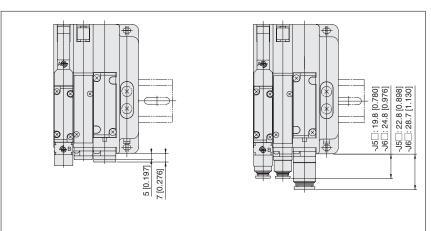


#### Unit dimensions

Number of units	L1	P1	Length of DIN rail	L2*	P2*	Length of DIN rail Note
2	126 [4.961]	87 [3.425]	175 [6.890]	-	-	-
3	142 [5.591]	103 [4.055]	200 [7.874]	161 [6.339]	122 [4.803]	200 [7.874]
4	158 [6.220]	119 [4.685]	200 [7.874]	177 [6.969]	138 [5.433]	225 [8.858]
5	174 [6.850]	135 [5.315]	225 [8.858]	193 [7.598]	154 [6.063]	225 [8.858]
6	190 [7.480]	151 [5.945]	250 [9.843]	209 [8.228]	170 [6.693]	250 [9.843]
7	206 [8.110]	167 [6.575]	250 [9.843]	225 [8.858]	186 [7.323]	250 [9.843]
8	222 [8.740]	183 [7.205]	275 [10.827]	241 [9.488]	202 [7.953]	275 [10.827]
9	-	-	-	257 [10.118]	218 [8.583]	300 [11.811]

Note: When the J□T or MT piping block specifications is selected.

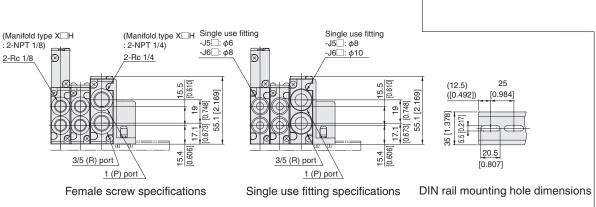

With manifold outlet port dual use fitting block Flat cable connector 20-pin specifications

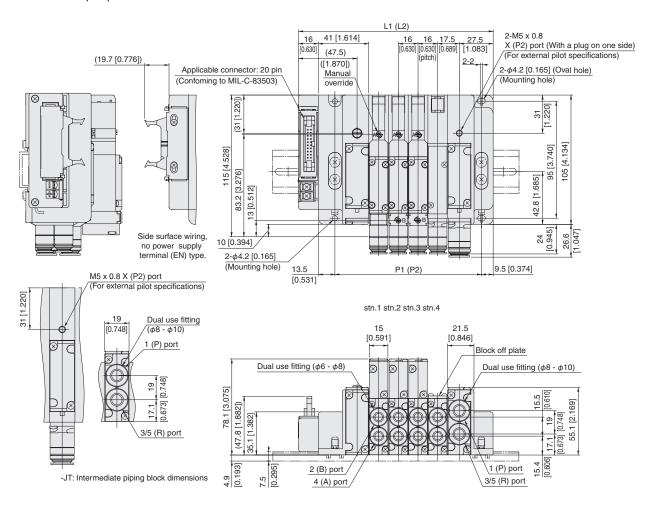


#### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2*	P2*	Length of DIN rail Note
2	126 [4.961]	87 [3.425]	175 [6.890]	-	-	-
3	142 [5.591]	103 [4.055]	200 [7.874]	161 [6.339]	122 [4.803]	200 [7.874]
4	158 [6.220]	119 [4.685]	200 [7.874]	177 [6.969]	138 [5.433]	225 [8.858]
5	174 [6.850]	135 [5.315]	225 [8.858]	193 [7.598]	154 [6.063]	225 [8.858]
6	190 [7.480]	151 [5.945]	250 [9.843]	209 [8.228]	170 [6.693]	250 [9.843]
7	206 [8.110]	167 [6.575]	250 [9.843]	225 [8.858]	186 [7.323]	250 [9.843]
8	222 [8.740]	183 [7.205]	275 [10.827]	241 [9.488]	202 [7.953]	275 [10.827]
9	238 [9.370]	199 [7.835]	300 [11.811]	257 [10.118]	218 [8.583]	300 [11.811]
10	254 [10.000]	215 [8.465]	300 [11.811]	273 [10.748]	234 [9.213]	300 [11.811]
11	270 [10.630]	231 [9.094]	325 [12.795]	289 [11.378]	250 [9.843]	325 [12.795]
12	286 [11.260]	247 [9.724]	350 [13.780]	305 [12.008]	266 [10.472]	350 [13.780]
13	302 [11.890]	263 [10.354]	350 [13.780]	321 [12.638]	282 [11.102]	350 [13.780]
14	318 [12.520]	279 [10.984]	375 [14.764]	337 [13.268]	298 [11.732]	375 [14.764]
15	334 [13.150]	295 [11.614]	375 [14.764]	353 [13.898]	314 [12.362]	400 [15.748]
16	350 [13.780]	311 [12.244]	400 [15.748]	369 [14.528]	330 [12.992]	400 [15.748]
17	-	-	-	385 [15.157]	346 [13.622]	425 [16.732]

Note: When the  $J \square \mathsf{T}$  or MT piping block specifications is selected.

With manifold outlet port dual use fitting block Flat cable connector 26-pin specifications

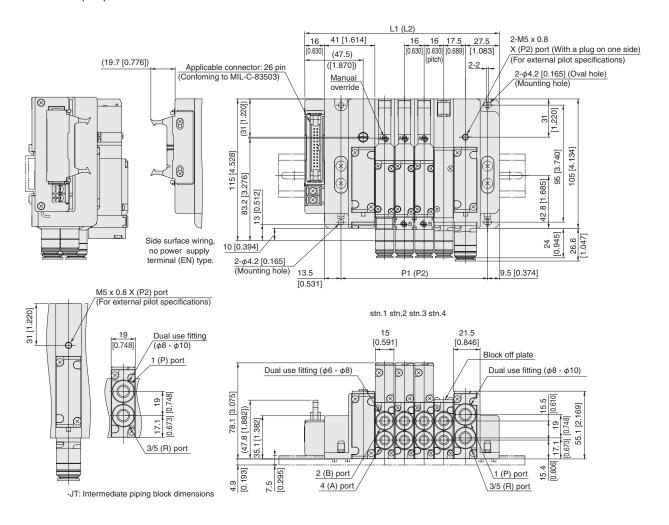


#### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2⁺	P2*	Length of DIN rail Note
2	126 [4.961]	87 [3.425]	175 [6.890]	-	-	-
3	142 [5.591]	103 [4.055]	200 [7.874]	161 [6.339]	122 [4.803]	200 [7.874]
4	158 [6.220]	119 [4.685]	200 [7.874]	177 [6.969]	138 [5.433]	225 [8.858]
5	174 [6.850]	135 [5.315]	225 [8.858]	193 [7.598]	154 [6.063]	225 [8.858]
6	190 [7.480]	151 [5.945]	250 [9.843]	209 [8.228]	170 [6.693]	250 [9.843]
7	206 [8.110]	167 [6.575]	250 [9.843]	225 [8.858]	186 [7.323]	250 [9.843]
8	222 [8.740]	183 [7.205]	275 [10.827]	241 [9.488]	202 [7.953]	275 [10.827]
9	238 [9.370]	199 [7.835]	300 [11.811]	257 [10.118]	218 [8.583]	300 [11.811]
10	254 [10.000]	215 [8.465]	300 [11.811]	273 [10.748]	234 [9.213]	300 [11.811]
11	270 [10.630]	231 [9.094]	325 [12.795]	289 [11.378]	250 [9.843]	325 [12.795]
12	286 [11.260]	247 [9.724]	350 [13.780]	305 [12.008]	266 [10.472]	350 [13.780]
13	302 [11.890]	263 [10.354]	350 [13.780]	321 [12.638]	282 [11.102]	350 [13.780]
14	318 [12.520]	279 [10.984]	375 [14.764]	337 [13.268]	298 [11.732]	375 [14.764]
15	334 [13.150]	295 [11.614]	375 [14.764]	353 [13.898]	314 [12.362]	400 [15.748]
16	350 [13.780]	311 [12.244]	400 [15.748]	369 [14.528]	330 [12.992]	400 [15.748]
17	366 [14.409]	327 [12.874]	425 [16.732]	385 [15.157]	346 [13.622]	425 [16.732]
18	382 [15.039]	343 [13.504]	425 [16.732]	401 [15.787]	362 [14.252]	450 [17.717]
19	398 [15.669]	359 [14.134]	450 [17.717]	417 [16.417]	378 [14.882]	450 [17.717]
20	414 [16.299]	375 [14.764]	475 [18.701]	433 [17.047]	394 [15.512]	475 [18.701]
21	-	-	-	449 [17.677]	410 [16.142]	475 [18.701]

Note: When the  $J \square T$  or MT piping block specifications is selected.

With manifold outlet port dual use fitting block Flat cable connector 26-pin specifications

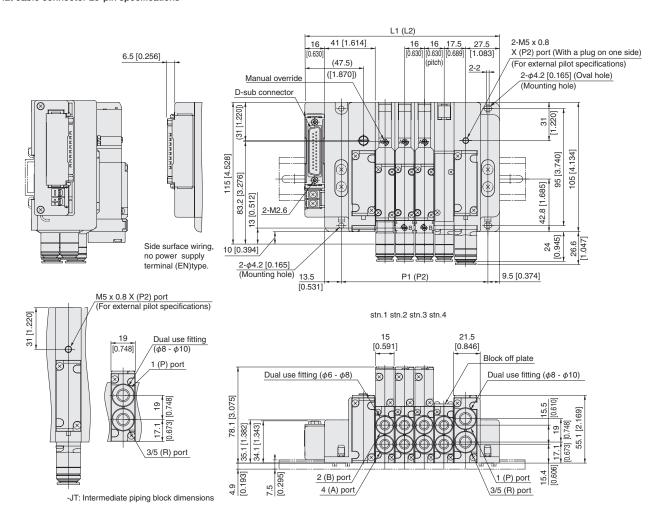


#### **Unit dimensions**

4 158 [6.20] 119 [4.685] 200 [7.874] 177 [6.969] 138 [5.433] 225 [8.689] 5 174 [6.860] 136 [5.315] 225 [8.858] 138 [7.598] 154 [6.063] 225 [8.689] 6 190 [7.480] 151 [5.945] 250 [8.843] 209 [8.228] 170 [6.633] 250 [9.843] 7 206 [8.110] 167 [6.575] 250 [9.843] 225 [8.858] 186 [7.323] 250 [9.843] 8 222 [8.740] 183 [7.205] 275 [10.827] 241 [9.488] 202 [7.953] 275 [10.827] 9 238 [9.370] 199 [7.835] 300 [11.811] 257 [10.118] 218 [8.583] 300 [11.811] 10 254 [10.000] 215 [8.465] 300 [11.811] 273 [10.748] 234 [9.213] 300 [11.811] 11 270 [10.630] 231 [9.094] 325 [12.795] 289 [11.378] 250 [9.843] 325 [12.795] 12 286 [11.260] 247 [9.724] 350 [13.780] 305 [12.008] 266 [10.472] 350 [13.780] 11 3 302 [11.890] 263 [10.354] 350 [13.780] 321 [12.638] 282 [11.102] 350 [13.780] 14 318 [12.520] 279 [10.984] 375 [14.764] 337 [13.268] 282 [11.102] 350 [13.780] 14 336 [13.780] 311 [12.244] 400 [15.748] 369 [14.528] 300 [12.992] 400 [15.748] 17 366 [14.409] 327 [12.874] 425 [16.732] 365 [15.777] 346 [13.622] 425 [16.732] 18 382 [15.039] 343 [13.504] 425 [16.732] 407 [15.787] 394 [15.512] 475 [18.701] 20 414 [16.299] 375 [14.764] 475 [16.701] 433 [17.7047] 394 [15.512] 475 [18.701] 20 414 [16.299] 375 [14.764] 475 [16.701] 433 [17.7047] 394 [15.512] 475 [18.701] 420 414 [16.299] 375 [14.764] 475 [16.701] 433 [17.7047] 394 [15.512] 475 [18.701] 420 414 [16.299] 375 [14.764] 475 [16.701] 433 [17.7047] 394 [15.512] 475 [18.701] 420 414 [16.299] 375 [14.764] 475 [16.701] 433 [17.7047] 394 [15.512] 475 [18.701] 420 414 [16.299] 375 [14.764] 475 [16.701] 433 [17.7047] 394 [15.512] 475 [18.701] 420 414 [16.299] 375 [14.764] 475 [16.701] 433 [17.7047] 394 [15.512] 475 [18.701] 475 [18.701] 433 [17.7047] 394 [15.512] 475 [18.701] 475 [18.701] 475 [18.701] 433 [17.7047] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.7047] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.7047] 394 [15.512] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [1	Number of units	L1	P1	Length of DIN rail	L2*	P2*	Length of DIN rail Note
4         158 [6.20]         119 [4.685]         200 [7.874]         177 [6.969]         138 [5.433]         225 [8.688]           5         174 [6.850]         133 [5.315]         225 [8.858]         133 [7.598]         154 [6.063]         225 [8.858]           6         190 [7.480]         151 [5.945]         250 [9.843]         209 [8.228]         170 [6.633]         250 [9.843]           7         206 [8.110]         167 [6.575]         250 [9.843]         225 [8.858]         186 [7.322]         250 [9.843]           8         222 [8.740]         188 [7.205]         275 [10.827]         244 [9.488]         202 [7.953]         275 [10.827]           9         238 [9.370]         199 [7.885]         300 [11.811]         257 [10.118]         218 [8.583]         300 [11.811]           10         254 [10.000]         215 [8.465]         300 [11.811]         273 [10.748]         234 [9.213]         301 [11.811]           11         270 [10.600]         231 [9.094]         325 [12.795]         289 [11.378]         250 [9.843]         325 [12.795]           12         286 [11.260]         247 [9.724]         350 [13.780]         305 [12.088]         282 [11.102]         350 [13.780]           13         302 [11.890]         263 [10.364]         350 [13.780] <td>2</td> <td>126 [4.961]</td> <td>87 [3.425]</td> <td>175 [6.890]</td> <td>-</td> <td>-</td> <td>-</td>	2	126 [4.961]	87 [3.425]	175 [6.890]	-	-	-
5         174 [6.80]         135 [5.315]         225 [8.858]         193 [7.589]         154 [6.03]         225 [8.858]           6         190 [7.480]         151 [5.945]         250 [8.843]         209 [8.228]         170 [6.683]         250 [9.843]           7         206 [8.110]         167 [6.575]         250 [9.843]         225 [8.858]         186 [7.323]         250 [9.843]           8         222 [8.740]         183 [7.205]         275 [10.827]         241 [9.488]         202 [7.953]         275 [10.827]           9         238 [9.370]         199 [7.835]         300 [11.811]         257 [10.118]         218 [8.583]         300 [11.811]           10         254 [10.000]         215 [8.465]         300 [11.811]         273 [10.748]         234 [9.213]         301 [11.811]           11         270 [10.600]         231 [9.094]         325 [12.795]         289 [11.378]         250 [9.843]         325 [12.795]           12         286 [11.260]         247 [9.724]         350 [13.780]         305 [13.780]         305 [12.088]         282 [11.102]         350 [13.780]           13         302 [11.890]         263 [10.364]         350 [13.780]         321 [12.638]         282 [11.102]         350 [13.780]           14         318 [12.520]         279 [10.9	3	142 [5.591]	103 [4.055]	200 [7.874]	161 [6.339]	122 [4.803]	200 [7.874]
6	4	158 [6.220]	119 [4.685]	200 [7.874]	177 [6.969]	138 [5.433]	225 [8.858]
7 206 [8.170] 167 [6.575] 250 [8.843] 225 [8.858] 186 [7.323] 250 [9.843] 8 222 [8.740] 183 [7.205] 275 [10.827] 241 [9.488] 202 [7.953] 275 [10.827] 9 288 [9.370] 199 [7.835] 300 [11.811] 257 [10.118] 218 [8.583] 300 [11.811] 10 254 [10.000] 215 [8.465] 300 [11.811] 273 [10.748] 224 [9.213] 300 [11.811] 11 270 [10.630] 231 [9.094] 325 [12.795] 289 [11.378] 250 [9.843] 325 [12.795] 12 286 [11.260] 247 [9.724] 350 [13.780] 305 [12.008] 266 [10.472] 350 [13.780] 302 [11.890] 263 [10.354] 350 [13.780] 321 [12.638] 282 [11.102] 350 [13.780] 14 318 [12.520] 279 [10.984] 375 [14.764] 337 [13.268] 299 [11.732] 375 [14.764] 15 334 [13.150] 295 [11.614] 375 [14.764] 389 [14.283] 300 [12.992] 400 [15.748] 17 366 [14.409] 327 [12.874] 425 [16.732] 365 [15.157] 346 [13.622] 425 [16.732] 18 382 [15.039] 343 [13.504] 425 [16.732] 407 [15.787] 392 [14.252] 450 [17.717] 19 398 [15.689] 359 [14.134] 450 [17.717] 417 [16.417] 378 [14.882] 450 [17.717] 20 414 [16.299] 375 [14.764] 475 [18.701] 433 [17.047] 394 [15.512] 475 [18.701] 20 414 [16.299] 375 [14.764] 475 [18.701] 433 [17.047] 394 [15.512] 475 [18.701] 20 414 [16.299] 375 [14.764] 475 [18.701] 433 [17.047] 394 [15.512] 475 [18.701] 475 [18.701] 433 [17.047] 394 [15.512] 475 [18.701] 475 [18.701] 433 [17.047] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 435 [17.747] 394 [15.512] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.701] 475 [18.70	5	174 [6.850]	135 [5.315]	225 [8.858]	193 [7.598]	154 [6.063]	225 [8.858]
8         222 [8.740]         183 [7.205]         275 [10.827]         241 [9.488]         202 [7.953]         275 [10.827]           9         238 [9.370]         199 [7.835]         300 [11.811]         257 [10.118]         218 [8.583]         300 [11.811]           10         254 [10.000]         215 [8.465]         300 [11.811]         273 [10.748]         234 [9.213]         300 [11.811]           11         270 [10.630]         231 [9.094]         325 [12.795]         289 [11.378]         250 [9.843]         325 [12.795]           12         286 [11.260]         247 [9.724]         350 [13.780]         305 [12.008]         286 [10.472]         350 [13.780]           13         302 [11.890]         263 [10.354]         350 [13.780]         321 [12.638]         282 [11.102]         350 [13.780]           14         318 [12.520]         279 [10.984]         375 [14.764]         337 [13.268]         289 [11.732]         375 [14.764]           15         334 [13.150]         295 [11.674]         405 [16.748]         389 [14.528]         330 [12.982]         400 [15.748]           16         350 [13.780]         311 [12.244]         405 [16.732]         365 [15.157]         346 [13.622]         425 [16.732]           17         366 [14.409]         327 [12.874] <td>6</td> <td>190 [7.480]</td> <td>151 [5.945]</td> <td>250 [9.843]</td> <td>209 [8.228]</td> <td>170 [6.693]</td> <td>250 [9.843]</td>	6	190 [7.480]	151 [5.945]	250 [9.843]	209 [8.228]	170 [6.693]	250 [9.843]
9         288 [9.370]         199 [7.885]         300 [11.811]         257 [10.118]         218 [8.583]         300 [11.811]           10         254 [10.000]         215 [8.465]         300 [11.811]         273 [10.748]         284 [9.213]         300 [11.811]           11         270 [10.630]         231 [9.094]         325 [12.795]         289 [11.378]         250 [9.843]         325 [12.795]           12         286 [11.260]         247 [9.724]         350 [13.780]         305 [12.008]         266 [10.472]         350 [13.780]           13         302 [11.890]         263 [10.364]         350 [13.780]         321 [12.638]         282 [11.102]         350 [13.780]           14         318 [12.520]         279 [10.984]         375 [14.764]         337 [13.288]         288 [11.732]         375 [14.764]         353 [13.898]         314 [12.982]         400 [15.748]           15         334 [13.150]         295 [11.614]         375 [14.764]         359 [14.528]         330 [12.992]         400 [15.748]           16         350 [13.780]         311 [12.244]         405 [15.748]         369 [14.528]         330 [12.992]         400 [15.748]           17         386 [14.409]         327 [12.874]         425 [16.732]         401 [15.787]         382 [14.252]         450 [17.717]	7	206 [8.110]	167 [6.575]	250 [9.843]	225 [8.858]	186 [7.323]	250 [9.843]
1 O         254 [10.000]         215 [8.465]         300 [11.811]         273 [10.748]         234 [82:3]         300 [11.811]           1 1         270 [10.630]         231 [9.094]         325 [12.795]         289 [11.378]         250 [9.843]         325 [12.795]           1 2         286 [11.260]         247 [9.724]         350 [13.780]         305 [12.008]         266 [10.472]         350 [13.780]           1 3         302 [11.890]         263 [10.364]         360 [13.780]         321 [12.638]         282 [11.102]         350 [13.780]           1 4         318 [12.520]         279 [10.984]         375 [14.764]         337 [13.288]         286 [11.732]         375 [14.764]           1 5         334 [13.150]         295 [11.614]         375 [14.764]         353 [13.898]         314 [12.362]         400 [15.748]           1 6         350 [13.780]         311 [12.244]         400 [15.748]         369 [14.528]         330 [12.992]         400 [15.748]           1 7         366 [14.409]         327 [12.874]         425 [16.732]         365 [15.157]         346 [13.622]         450 [17.717]           1 8         382 [15.039]         343 [13.504]         425 [16.732]         401 [15.787]         392 [14.282]         450 [17.717]           1 9         398 [16.669] <t< td=""><td>8</td><td>222 [8.740]</td><td>183 [7.205]</td><td>275 [10.827]</td><td>241 [9.488]</td><td>202 [7.953]</td><td>275 [10.827]</td></t<>	8	222 [8.740]	183 [7.205]	275 [10.827]	241 [9.488]	202 [7.953]	275 [10.827]
11         270 [10.600]         231 [9.094]         325 [12.795]         289 [11.376]         250 [9.843]         325 [12.795]           12         286 [11.260]         247 [9.724]         350 [13.780]         305 [12.008]         266 [10.472]         330 [13.780]           13         302 [11.800]         263 [10.364]         360 [13.780]         321 [12.638]         282 [11.102]         350 [13.780]           14         316 [12.520]         279 [10.984]         375 [14.764]         337 [13.268]         298 [11.732]         375 [14.764]           15         334 [13.150]         295 [11.614]         375 [14.764]         358 [13.898]         314 [12.362]         400 [15.748]           16         350 [13.780]         311 [12.244]         400 [15.748]         389 [14.528]         330 [12.992]         400 [15.748]           17         366 [14.409]         327 [12.874]         425 [16.732]         386 [15.157]         346 [13.622]         425 [16.732]           18         382 [15.039]         343 [13.504]         425 [16.732]         401 [15.787]         382 [14.252]         450 [17.717           19         398 [16.669]         359 [14.134]         460 [17.717]         417 [16.417]         375 [14.882]         450 [17.717           20         414 [16.299]         375 [14	9	238 [9.370]	199 [7.835]	300 [11.811]	257 [10.118]	218 [8.583]	300 [11.811]
12     286 [11.260]     247 [9.724]     350 [13.780]     305 [12.008]     266 [10.472]     350 [13.780]       13     302 [11.890]     263 [10.354]     350 [13.780]     321 [12.638]     282 [11.102]     350 [13.780]       14     318 [12.520]     279 [10.984]     375 [14.764]     337 [13.268]     296 [11.732]     375 [14.764]       15     334 [13.150]     295 [11.614]     375 [14.764]     353 [13.898]     314 [12.362]     400 [15.748]       16     350 [13.780]     311 [12.244]     400 [15.748]     389 [14.528]     330 [12.992]     400 [15.748]       17     366 [14.409]     327 [12.874]     425 [16.732]     385 [15.157]     346 [13.622]     425 [16.732]       18     382 [15.039]     343 [13.504]     425 [16.732]     401 [15.787]     362 [14.252]     450 [17.717]       19     398 [15.669]     359 [14.134]     450 [17.717]     417 [16.417]     375 [14.882]     450 [17.717]       20     414 [16.299]     375 [14.764]     475 [18.701]     433 [17.047]     394 [15.512]     475 [18.701]	10	254 [10.000]	215 [8.465]	300 [11.811]	273 [10.748]	234 [9.213]	300 [11.811]
13         302 [11.890]         263 [10.364]         350 [13.780]         321 [12.638]         282 [11.102]         350 [13.780]           14         318 [12.520]         279 [10.984]         375 [14.764]         337 [13.288]         289 [11.732]         375 [14.764]           15         334 [13.160]         295 [11.674]         375 [14.764]         363 [13.898]         314 [12.962]         400 [15.748]           16         350 [13.780]         311 [12.244]         400 [15.748]         369 [14.528]         330 [12.992]         400 [15.748]           17         366 [14.409]         327 [12.874]         425 [16.732]         385 [15.157]         346 [13.622]         425 [16.732]           18         382 [15.039]         343 [13.504]         425 [16.732]         401 [15.787]         362 [14.252]         450 [17.717]           19         398 [15.669]         359 [14.134]         450 [17.717]         417 [16.417]         378 [14.882]         450 [17.717]           20         414 [16.299]         375 [14.764]         475 [18.701]         433 [17.047]         394 [15.512]         475 [18.701]	11	270 [10.630]	231 [9.094]	325 [12.795]	289 [11.378]	250 [9.843]	325 [12.795]
1.4         318 [12.520]         279 [10.984]         375 [14.764]         337 [13.268]         298 [11.732]         375 [14.764]           1.5         334 [13.150]         295 [11.614]         375 [14.764]         353 [13.898]         314 [12.362]         400 [15.748]           1.6         350 [13.780]         311 [12.244]         400 [15.748]         399 [14.528]         330 [12.992]         400 [15.748]           1.7         366 [14.409]         327 [12.874]         425 [16.732]         305 [15.157]         346 [13.622]         425 [16.732]           1.8         382 [15.039]         343 [13.504]         425 [16.732]         401 [15.787]         362 [14.252]         450 [17.717]           1.9         398 [15.669]         359 [14.134]         450 [17.717]         417 [16.417]         378 [14.882]         450 [17.717]           2.0         414 [16.299]         375 [14.764]         475 [18.701]         433 [17.047]         394 [15.512]         475 [18.701]	12	286 [11.260]	247 [9.724]	350 [13.780]	305 [12.008]	266 [10.472]	350 [13.780]
15     334 [13.150]     295 [11.614]     375 [14.764]     353 [13.899]     314 [12.362]     400 [15.748]       16     350 [13.780]     311 [12.244]     400 [15.748]     369 [14.528]     330 [12.922]     400 [15.748]       17     366 [14.409]     327 [12.874]     425 [16.732]     365 [15.157]     346 [13.622]     425 [16.732]       18     382 [15.039]     343 [13.504]     425 [16.732]     401 [15.787]     362 [14.252]     450 [17.717]       19     398 [15.669]     359 [14.134]     450 [17.717]     417 [16.417]     376 [14.882]     450 [17.717]       20     414 [16.299]     375 [14.764]     475 [18.701]     433 [17.047]     394 [15.512]     475 [18.701]	13	302 [11.890]	263 [10.354]	350 [13.780]	321 [12.638]	282 [11.102]	350 [13.780]
16     350 [13.780]     311 [12.244]     400 [15.748]     369 [14.528]     330 [12.992]     400 [15.748]       17     366 [14.408]     327 [12.874]     425 [16.732]     365 [15.157]     346 [13.622]     425 [16.732]       18     382 [15.039]     343 [13.504]     425 [16.732]     401 [15.787]     382 [14.252]     450 [17.717]       19     398 [16.669]     359 [14.134]     450 [17.717]     417 [16.417]     376 [14.882]     450 [17.717]       20     414 [16.299]     375 [14.764]     475 [18.701]     433 [17.047]     394 [15.512]     475 [18.701]	14	318 [12.520]	279 [10.984]	375 [14.764]	337 [13.268]	298 [11.732]	375 [14.764]
17     386 [14.409]     327 [12.874]     425 [16.732]     386 [15.157]     346 [13.622]     425 [16.732]       18     382 [15.039]     343 [13.504]     425 [16.732]     401 [15.787]     382 [14.252]     450 [17.717]       19     398 [16.689]     359 [14.134]     450 [17.717]     417 [16.417]     378 [14.882]     450 [17.717]       20     414 [16.299]     375 [14.764]     475 [18.701]     433 [17.047]     394 [15.512]     475 [18.701]	15	334 [13.150]	295 [11.614]	375 [14.764]	353 [13.898]	314 [12.362]	400 [15.748]
18     382 [15.039]     343 [13.504]     425 [16.732]     401 [15.787]     382 [14.252]     450 [17.717]       19     398 [15.669]     359 [14.134]     450 [17.717]     417 [16.417]     376 [14.882]     450 [17.717]       20     414 [16.299]     375 [14.764]     475 [18.701]     433 [17.047]     394 [15.512]     475 [18.701]	16	350 [13.780]	311 [12.244]	400 [15.748]	369 [14.528]	330 [12.992]	400 [15.748]
19     398 [15.669]     359 [14.134]     450 [17.717]     417 [16.417]     378 [14.882]     450 [17.717       20     414 [16.299]     375 [14.764]     475 [18.701]     433 [17.047]     394 [15.512]     475 [18.701]	17	366 [14.409]	327 [12.874]	425 [16.732]	385 [15.157]	346 [13.622]	425 [16.732]
2O 414 [16.299] 375 [14.764] 475 [18.701] 433 [17.047] 394 [15.512] 475 [18.701	18	382 [15.039]	343 [13.504]	425 [16.732]	401 [15.787]	362 [14.252]	450 [17.717]
2 (1.14) 1.15 1.1 1.15 1.15 1.15 1.15 1.15 1.15	19	398 [15.669]	359 [14.134]	450 [17.717]	417 [16.417]	378 [14.882]	450 [17.717]
21 449[17.677] 410[16.149] 475[18.701	20	414 [16.299]	375 [14.764]	475 [18.701]	433 [17.047]	394 [15.512]	475 [18.701]
2.	21	-	-	-	449 [17.677]	410 [16.142]	475 [18.701]

Note: When the  $J \square \mathsf{T}$  or MT piping block specifications is selected.

With manifold outlet port dual use fitting blocks Terminal block type

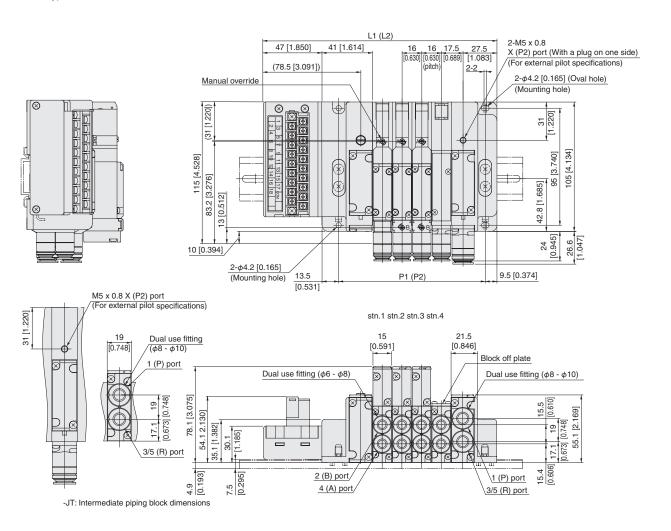


#### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2*	P2*	Length of DIN rail Note
2	157 [6.181]	87 [3.425]	200 [7.874]	-	-	-
3	173 [6.811]	103 [4.055]	225 [8.858]	192 [7.559]	122 [4.803]	225 [8.858]
4	189 [7.441]	119 [4.685]	250 [9.843]	208 [8.189]	138 [5.433]	250 [9.843]
5	205 [8.071]	135 [5.315]	250 [9.843]	224 [8.819]	154 [6.063]	250 [9.843]
6	221 [8.701]	151 [5.945]	275 [10.827]	240 [9.449]	170 [6.693]	275 [10.827]
7	237 [9.331]	167 [6.575]	300 [11.811]	256 [10.079]	186 [7.323]	300 [11.811]
8	253 [9.961]	183 [7.205]	300 [11.811]	272 [10.709]	202 [7.953]	300 [11.811]
9	269 [10.591]	199 [7.835]	325 [12.795]	288 [11.339]	218 [8.583]	325 [12.795]
10	285 [11.220]	215 [8.465]	350 [13.780]	304 [11.969]	234 [9.213]	350 [13.780]
11	301 [11.850]	231 [9.094]	350 [13.780]	320 [12.598]	250 [9.843]	350 [13.780]
12	317 [12.480]	247 [9.724]	375 [14.764]	336 [13.228]	266 [10.472]	375 [14.764]
13	333 [13.110]	263 [10.354]	375 [14.764]	352 [13.858]	282 [11.102]	400 [15.748]
14	349 [13.740]	279 [10.984]	400 [15.748]	368 [14.488]	298 [11.732]	400 [15.748]
15	365 [14.370]	295 [11.614]	425 [16.732]	384 [15.118]	314 [12.362]	425 [16.732]
16	381 [15.000]	311 [12.244]	425 [16.732]	400 [15.748]	330 [12.992]	425 [16.732]
17	397 [15.630]	327 [12.874]	450 [17.717]	416 [16.378]	346 [13.622]	450 [17.717]
18	413 [16.260]	343 [13.504]	475 [18.701]	432 [17.008]	362 [14.252]	475 [18.701]
19	-	-	-	448 [17.638]	378 [14.882]	475 [18.701]

Note: When the  $J \square T$  or MT piping block specifications is selected.

With manifold outlet port dual use fitting block

(Stand alone serial transmission block compatible minifold) \*The figure shows CC-Link.

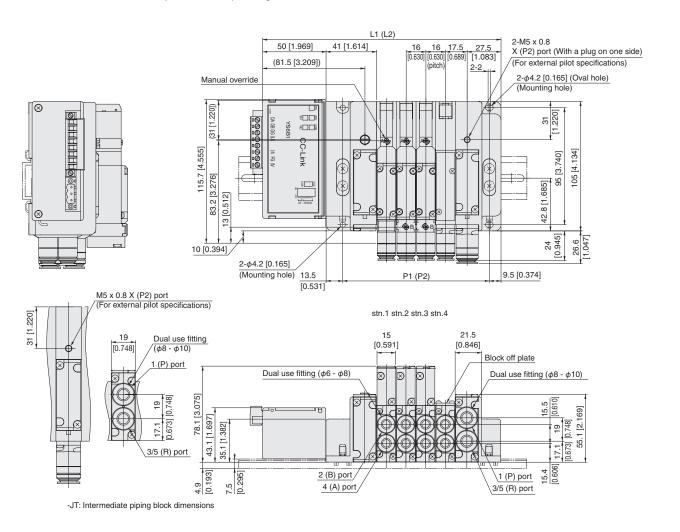


#### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2*	P2*	Length of DIN rail Note
2	160 [6.299]	87 [3.425]	225 [8.858]	-	-	-
3	176 [6.929]	103 [4.055]	225 [8.858]	195 [7.677]	122 [4.803]	225 [8.858]
4	192 [7.559]	119 [4.685]	250 [9.843]	211 [8.307]	138 [5.433]	250 [9.843]
5	208 [8.189]	135 [5.315]	250 [9.843]	227 [8.937]	154 [6.063]	275 [10.827]
6	224 [8.819]	151 [5.945]	275 [10.827]	243 [9.567]	170 [6.693]	275 [10.827]
7	240 [9.449]	167 [6.575]	300 [11.811]	259 [10.197]	186 [7.323]	300 [11.811]
8	256 [10.079]	183 [7.205]	300 [11.811]	275 [10.827]	202 [7.953]	300 [11.811]
9	272 [10.709]	199 [7.835]	325 [12.795]	291 [11.457]	218 [8.583]	325 [12.795]
10	288 [11.339]	215 [8.465]	350 [13.780]	307 [12.087]	234 [9.213]	350 [13.780]
11	304 [11.969]	231 [9.094]	350 [13.780]	323 [12.717]	250 [9.843]	350 [13.780]
12	320 [12.598]	247 [9.724]	375 [14.764]	339 [13.346]	266 [10.472]	375 [14.764]
13	336 [13.228]	263 [10.354]	400 [15.748]	355 [13.976]	282 [11.102]	400 [15.748]
14	352 [13.858]	279 [10.984]	400 [15.748]	371 [14.606]	298 [11.732]	400 [15.748]
15	368 [14.488]	295 [11.614]	425 [16.732]	387 [15.236]	314 [12.362]	425 [16.732]
16	384 [15.118]	311 [12.244]	425 [16.732]	403 [15.866]	330 [12.992]	450 [17.717]
17	400 [15.748]	327 [12.874]	450 [17.717]	419 [16.496]	346 [13.622]	450 [17.717]
18	416 [16.378]	343 [13.504]	475 [18.701]	435 [17.126]	362 [14.252]	475 [18.701]
19	432 [17.008]	359 [14.134]	475 [18.701]	451 [17.756]	378 [14.882]	500 [19.685]
20	448 [17.638]	375 [14.764]	500 [19.685]	467 [18.386]	394 [15.512]	500 [19.685]
21	-	-	-	483 [19.016]	410 [16.142]	525 [20.669]

Note: When the  $J \square \mathsf{T}$  or MT piping block specifications is selected.

With manifold outlet port dual use fitting block <EtherCAT/EtherNet/IP>\*The figure shows EtherCat.

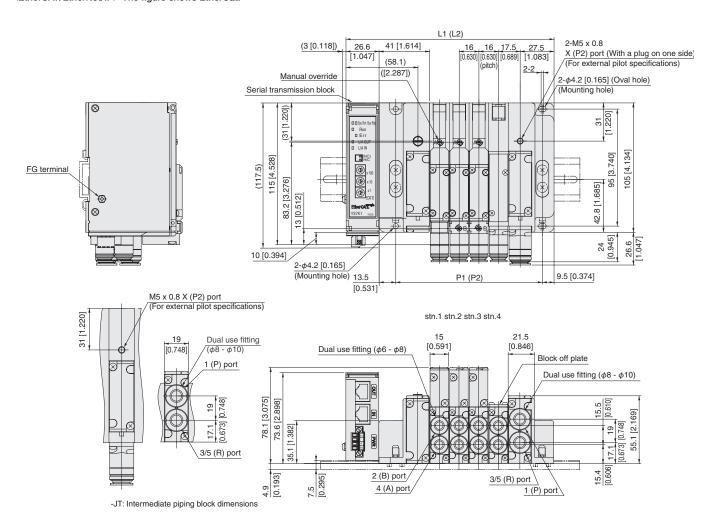


#### **Unit dimensions**

Number of units	L1	P1	Length of DIN rail	L2*	P2*	Length of DIN rail Note
2	136.6 [5.378]	87 [3.425]	200 [7.874]	-	-	-
3	152.6 [6.008]	103 [4.055]	200 [7.874]	171.6 [6.756]	122 [4.803]	200 [7.874]
4	168.6 [6.638]	119 [4.685]	225 [8.858]	187.6 [7.386]	138 [5.433]	225 [8.858]
5	184.6 [7.268]	135 [5.315]	250 [9.843]	203.6 [8.016]	154 [6.063]	250 [9.843]
6	200.6 [7.898]	151 [5.945]	250 [9.843]	219.6 [8.646]	170 [6.693]	250 [9.843]
7	216.6 [8.528]	167 [6.575]	275 [10.827]	235.6 [9.276]	186 [7.323]	275 [10.827]
8	232.6 [9.157]	183 [7.205]	275 [10.827]	251.6 [9.906]	202 [7.953]	300 [11.811]
9	248.6 [9.787]	199 [7.835]	300 [11.811]	267.6 [10.535]	218 [8.583]	300 [11.811]
10	264.6 [10.417]	215 [8.465]	325 [12.795]	283.6 [11.165]	234 [9.213]	325 [12.795]
11	280.6 [11.047]	231 [9.094]	325 [12.795]	299.6 [11.795]	250 [9.843]	325 [12.795]
12	296.6 [11.677]	247 [9.724]	350 [13.780]	315.6 [12.425]	266 [10.472]	350 [13.780]
13	312.6 [12.307]	263 [10.354]	375 [14.764]	331.6 [13.055]	282 [11.102]	375 [14.764]
14	328.6 [12.937]	279 [10.984]	375 [14.764]	347.6 [13.685]	298 [11.732]	375 [14.764]
15	344.6 [13.567]	295 [11.614]	400 [15.748]	363.6 [14.315]	314 [12.362]	400 [15.748]
16	360.6 [14.197]	311 [12.244]	425 [16.732]	379.6 [14.945]	330 [12.992]	425 [16.732]
17	376.6 [14.827]	327 [12.874]	425 [16.732]	395.6 [15.575]	346 [13.622]	425 [16.732]
18	392.6 [15.457]	343 [13.504]	450 [17.717]	411.6 [16.205]	362 [14.252]	450 [17.717]
19	408.6 [16.087]	359 [14.134]	450 [17.717]	427.6 [16.835]	378 [14.882]	475 [18.701]
20	424.6 [16.717]	375 [14.764]	475 [18.701]	443.6 [17.465]	394 [15.512]	475 [18.701]
21	-	-	-	459.6 [18.094]	410 [16.142]	500 [19.685]


Note: When the  $J \square \mathsf{T}$  or MT piping block specifications is selected.


## Additional parts (available separately)

● Muffler: KM-J10 [for both plug-in and non-plug-in]



●Muffler: **KM-J8** 



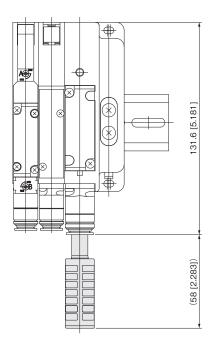


# **SOLENOID VALVES**

# F18 SERIES

## Contents

Spe	ecifications —	254
	Single Valve Unit	259
ORDER	Monoblock Manifold A Type (Base Piping Type)	261
E E	Monoblock Manifold F Type (Direct Piping Type)	263
CODE	Split Manifold Non-plug-in Type	<del>266</del>
РE	Split Manifold Plug-in Type	270
S	Split Manifold Serial Transmission Type	274
	Single Valve Unit —	278
	Monoblock Manifold A Type	281
DIMENSIONS	Monoblock Manifold F Type	282
SIS	Split Manifold Non-plug-in Type	283
SNC	Split Manifold Plug-in Type	284
	Split Manifold Serial Transmission Type	287

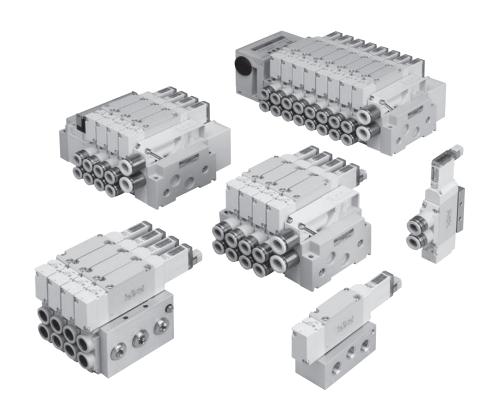

# F18 SERIES Specifications

#### **Specifications**

#### **Basic Models and Valve Functions**

Basic model	F18□T0	F18□T1 F18□T2	F18□T3 F18□T4 F18□T5	F18□TA F18□TB F18□TC
Number of positions	2 pos	sitions	3 positions	4 positions
Number of ports		5		Tandem 3-port
Valve function	Single solenoid only	Both single and double solenoid use	Closed center, Exhaust center, Pressure center	NC/NC, NO/NO, NC/NO

Remark: For the optional specifications and order codes, see p.259.

#### **Specifications**

Item		Basic model	F18□T0 F18□T1 F18□T2	F18□T3 F18□T4 F18□T5	F18□TA F18□TB F18□TC	F18□T0G F18□T1G F18□T2G	F18□T3G F18□T4G F18□T5G	F18_T0V F18_T1V F18_T2V	F18□T3V
Media	Media					Air			
Operatio	n type		I	nternal pilot type	)	External pilot type (	for positive pressure)	External pilot ty	pe (for vacuum)
Flow rate	Sonic conductar	nce C dm <sup>3</sup> /(s · bar) Note1	3.48	3.40	2.54	3.48	3.40	3.48	3.40
characteristics	Effective area	Note2 mm² (Cv)	17.4 (0.97)	17 (0.94)	12.7 (0.71)	17.4 (0.97)	17 (0.94)	17.4 (0.97)	17 (0.94)
Port size	Note3		Dual use fitting f	for $\phi$ 8 and $\phi$ 10,	Rc1/4, NPT1/4	M5×0.8,10-32U	NF, dual use fittin	ig for $\phi$ 8 and $\phi$ 10	, Rc1/4, NPT1/4
Lubricati	ion					Not required			
Operatin	ng pressure	Main valve	0.15~0	0.15~0.7 MPa [22~102 psi.]			~102 psi.] Note4	- 100 kPa~0.15 MPa [	- 29.53 in.Hg~22 psi.]
range		External pilot					0.2~0.7 MPa [29~102 psi.] Note4 0.2~0.7 MPa [29~102 psi.		
Proof pre	essure	MPa [psi.]				1.05 [152]			
Respons	se time Note5	12VDC, 24VDC	30/35 (40) or below	20/70 (75) or below	30/55 (60) or below	30/35 (40) or below	20/70 (75) or below	30/35 (40) or below	20/70 (75) or below
ON/OFF	= ms	100VAC	30/35 or below	20/70 or below		30/35 or below	20/70 or below	30/35 or below	20/70 or below
Maximur	m operating fr	equency Hz				5			
Minimum tir	Minimum time to energize for self holding Note6 ms		50	_	<u> </u>	50		50	
Operating ter	Operating temperature range (atmosphere and media) ° C [° F]			5~50 [41~122]					
Shock re	Shock resistance m/s² [G]		294.2 [30]						
Mounting	g direction					Any			

- Notes: 1. For details, see the flow rate characteristics on p.255.
  - 2. The effective area is a calculated value, and not a measured value.
  - 3. For details, see the port size on p.255.
  - 4. When the main valve pressure is  $0.2\sim0.7$  MPa [29 $\sim102$  psi.], set the external pilot pressure to the main valve pressure or higher, and to 0.7 MPa [102 psi.] or less.

Remark: Specification values are based on Koganei test standards.

- Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center. Values in parentheses ( ) are for low-current type.
  - 6. When used as a double solenoid valve. Excludes T0.

#### **Solenoid Specifications**

Ite	Ra	ted voltage	12VDC	24VDC (Standard type)	24VDC (Low-current type)	100'	VAC	120	VAC
Vo	Voltage range V		10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	21.6~26.4 (24±10%)	90~ (100±		108~ (120±	
Ra	ated frequency	Hz	_	_	_	50	60	50	60
Standard	Current (when rated voltage is applied	ed)mA (r.m.s)	33	17	_	8	3	8.	3
Stan	Power consumption	W	0.4	0.4	_	0.8	VA	1 \	<b>V</b> A
9	Current	Starting mA			17				
it t	(when rated voltage is applied)	Holding mA	_	_	4.2	_		_	
-ow-current type	Dower concumption	Starting W			0.4	_		_	
W-Cl	Power consumption	Holding W	_	_	0.1				
2	Starting time (standard)	ms	_	_	70	_	_	_	_
Al	lowable leakage current	mA	2.0	1.0	1.0	1.	0	1.	0
Ту	Type of insulation				Type B				
Ins	sulation resistance Note 1	ΜΩ			Over 100				
Co	olor of LED indicator Note2			14(	SA): Red, 12(SB): Gre	een			
Su	rge suppression (as standard	d)	Surge absorp	tion transistor	Flywheel diode		Bridge	diode	


Notes: 1. Value at 500VDC megger.

2. The color of the T0 indicator is red only.

Remark: Specification values are based on Koganei test standards.


#### **Cylinder Operating Speed**

#### How to obtain cylinder speed




#### Measuring conditions


- •Air pressure: 0.5 MPa [73 psi.]
- ●Piping (outer diameter x inner diameter x length) :  $\phi$ 10 x  $\phi$ 7.5 x 1000 mm [61 in.]
- ●Fitting: Quick fitting TS10-02
- ●Load ratio = Load Cylinder theoretical thrust (%)
- ●Cylinder stroke: 150 mm [5.91 in.]



#### Maximum operating speed




#### **Delay time**



Note: Delay time may vary according to the cylinder stroke.

#### **Flow Rate**



#### How to read the graph

When the supply pressure is 0.5 MPa [73 psi.] and flow rate is  $1000\,\ell$ /min [35.3 ft.3/min.] (ANR), the valve outlet pressure becomes 0.4 MPa [58 psi.].

- 1 mm/s = 0.0394 in./sec.
- 1 MPa = 145 psi.
- $1 \ell/min = 0.0353 \text{ft.}^3/min.$

#### **Port Size**

	Description/Piping specification	PR	X (P2)	4(A), 2(B)	1(P), 3(R2), 5(R1), 3, 5(R)
	With sub-base	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/4, NPT1/4	Rc1/4, NPT1/4
Φ	With female thread block	_	_	Rc1/4, NPT1/4	Rc1/4, NPT1/4
Single	With dual use fitting block	_	_	Dual use fitting for φ8 and φ10	Rc1/4, NPT1/4
ω <sup>-</sup>	With single use fitting block	_	_	φ8 or φ10	Rc1/4, NPT1/4
	Monoblock type with female thread block, and PC board type with female thread block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/4, NPT1/4	Rc3/8, NPT3/8
-	Monoblock type with fitting block, and PC board type with fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Dual use fitting for φ8 and φ10	Rc3/8, NPT3/8
ifolc	Monoblock type with single use fitting block, and PC board type with single use fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	φ8 or φ10	Rc3/8, NPT3/8
Manifold	Split type with female thread block, and serial transmission type with female thread block	_	M5×0.8, 10-32UNF	Rc1/4, NPT1/4	Rc3/8, NPT3/8
~	Split type with fitting block, and serial transmission type with fitting block	_	M5×0.8, 10-32UNF	Dual use fitting for φ8 and φ10	ŕ
	Split type with single use fitting block, and serial transmission type with single use fitting block	_	M5×0.8, 10-32UNF	φ8 or φ10	Single use fitting for $\phi$ 12

### Specifications for DIN Connector (-39□) Type

#### **Specifications** Remark: Specification values are the same as the Standard type, excluding the response time. See page 254.

Basic model Item	F18T0 F18T2	F18T3 F18T4 F18T5	F18T0G F18T2G	F18T3G F18T4G F18T5G	F18T0V F18T2V	F18T3V
Response time Note ON/OFF ms	20/30 or below	15/50 or below	20/30 or below	15/50 or below	20/30 or below	15/50 or below

Note: Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center.

### Solenoid Specifications for DIN Connector (-39□) Type

Rated voltage Item			12VDC	24VDC	120	VAC	240	VAC
Voltage range V		10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	90~	132	180~	~264	
	Frequency	Hz	_	_	50	60	50	60
Current	Starting	mA (r.m.s)	_	_	43	38	22	19
	Holding	mA (r.m.s)	140 (1.7W)	75 (1.8W)	29	24	14	12
Allowable leakage current mA		8	4	4	ļ	2	2	
Insulation resistance Note ΜΩ			Ove	r 100				
Surge sup	pression (as standar	d)	Surge absorp	tion transistor	Vari	stor	Vari	stor

Note: Value at 500VDC megger.

Remark: Specification values are based on Koganei test standards.

#### When used as a single unit

	1 (P)→2(B)	/1(P)→4(A)	2(B)→3(R2)	/4(A)→5(R1)
Basic model	Sonic conductance C	Critical pressure ratio	Sonic conductance C	Critical pressure ratio
	dm <sup>3</sup> /(s•bar)	b	dm <sup>3</sup> /(s•bar)	b
F18_T0-A2				
F18_T1-A2	3.48	0.11	3.42	0.23
F18_T2-A2				
F18_T3-A2				
F18 T4-A2	3.40	0.25	3.00	0.27
F18_T5-A2				
F18□TA-A2				
F18 TB-A2	2.53	0.33	2.54	0.34
F18 TC-A2				
F18_T0-F3				
F18_T1-F3	3.22	0.34	2.52	0.31
F18_T2-F3				
F18_T3-F3				
F18_T4-F3	3.04	0.35	2.93	0.26
F18_T5-F3				
F18_TA-F3				
F18 TB-F3	2.40	0.33	2.58	0.22
F18 TC-F3				
F18_T0-F4				
F18_T1-F4	3.39	0.36	3.27	0.30
F18 T2-F4				
F18 T3-F4				
F18 T4-F4	3.39	0.30	3.10	0.27
F18 T5-F4				
F18 TA-F4				
F18 TB-F4	2.52	0.34	2.70	0.31
F18 TC-F4				

	1(P)→2(B)	/1 (P)→4 (A)	2(B)→3(R2)	/4(A)→5(R1)
Basic model	Sonic conductance C	Critical pressure ratio	Sonic conductance C	Critical pressure ratio
	dm <sup>3</sup> /(s·bar)	b	dm <sup>3</sup> /(s•bar)	b
F18 T0-F5				
F18_T1-F5	3.14	0.41	3.00	0.33
F18□T2-F5				
F18 T3-F5				
F18 T4-F5	3.17	0.32	3.03	0.24
F18 T5-F5				
F18 TA-F5				
F18 TB-F5	2.38	0.35	2.61	0.28
F18 TC-F5				
F18 T0-F6				
F18_T1-F6	3.31	0.34	3.10	0.28
F18_T2-F6				
F18 T3-F6				
F18 T4-F6	3.21	0.35	3.01	0.25
F18_T5-F6				
F18 TA-F6				
F18 TB-F6	2.48	0.33	2.62	0.28
F18 TC-F6				

#### When mounted on a manifold

	F18M	F (FP)	F18M	anifold A type ] <b>A (AP</b> )	F18M□	anifold N (P) (S)
	1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)	1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)	1 (P) → 2 (B)/1 (P) → 4 (A)	2 (B) → 3 (R2)/4 (A) → 5 (R1)
	Sonic conductance C	dm3/(s/bar)	Sonic conductance C	dm3/(s/bar)	Sonic conductance C	dm3/(s/bar)
	3.31	3.05	3.03	2.94	3.05	2.99
	3.20	2.98	2.92	2.77	2.94	2.69
are the						
cases of						
φ10.	2.45	2.58	2.41	2.51	2.40	2.32
	2.02	2.00	0.00	0.05	0.00	3.02
	3.03	3.02	2.83	2.85	2.80	3.02
	2.99	2.96	2.68	2.75	2.80	2.82
$\phi$ 8 fitting						
	2.39	2.56	2.25	2.40	2.38	2.35
	3.15	3.12	2.94	2.96	2.90	3.13
Outlet port						
φ10 fitting	3.14	3.00	2.79	2.85	2.85	2.91
. 0						
	2.43	2 50	2 20	2.49	2.41	2.39
	2.40	2.03	2.23	2.43	2.41	2.09
	Outlet port dual use fitting for $\phi$ 8 and $\phi$ 10 **These are the cases of $\phi$ 10.  Outlet port $\phi$ 8 fitting	Sonic conductance C	Sonic conductance C         dm³/(s/bar)           Outlet port dual use fitting for φ 8 and φ10 **These are the cases of φ10.         3.20         2.98           3.20         2.98         2.58           3.03         3.02         3.03           Outlet port φ8 fitting         2.99         2.96           3.15         3.12           Outlet port φ10 fitting         3.14         3.00	Sonic conductance C         dm³/(s/bar)         Sonic conductance C           Outlet port dual use fitting for φ 8 and φ10 % These are the cases of φ10.         3.20         2.98         2.92           3.20         2.45         2.58         2.41           3.03         3.02         2.83           Outlet port φ8 fitting         2.99         2.96         2.68           2.39         2.56         2.25           3.15         3.12         2.94           Outlet port φ10 fitting         3.14         3.00         2.79	Sonic conductance C   dm³/(s/bar)   Sonic conductance C   dm³/(s/bar)	Sonic conductance C   dm³/(s/bar)   Sonic conductance C   dm³/(s/bar)   Sonic conductance C

Notes: 1. When the individual air supply spacer or the individual air exhaust spacer, the back pressure prevention valve, or the stop valve is used, sonic conductance decreases by about 30%.2: For the flow rate characteristics of other outlet ports, consult us.

Remark: Specification values are based on Koganei test standards.

#### Single Valve Unit Mass

g [oz.]

F18T□□	F18T□□-A1	F18T□□-A2	F18T□□-FJ	F18T□□-FJ5	F18T□□-FJ6
Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion
None	With plate	With plate	With dual use fitting block	With $\phi$ 8 fitting block	With $\phi$ 10 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	None	With A type sub-base	None	None	None
113 [3.99]	139 [4.90]	303 [10.69]	154 [5.43]	179 [6.31]	188 [6.63]

g [oz.]

F18T□□-FM	F18T□□-F3	F18T□□-F4	F18T□□-F5	F18T□□-F6
Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion
With female thread block	With dual use fitting block	With female thread block	With $\phi$ 8 fitting block	With $\phi$ 10 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	With female thread block	With female thread block	With female thread block	With female thread block
142 [5.01]	179 [6.31]	167 [5.89]	204 [7.20]	213 [7.51]

Basic Type F18T0 is 17 g [0.60 oz.] less than the mass shown above.

#### Monoblock Manifold Mass (single valve unit included)

g [oz.]

	, ,							
	Mass calculation of each unit							
Monoblock manifold	4(A), 2(B) ports outlet specifications							
	Female t	hread block	Dual use fitting block		φ8 fitting block		φ10 fitting block	
A type	(329×n) + 165	[(11.61×n) + 5.82]	(339×n) + 165	[(11.96×n) + 5.82]	(364×n) + 165	[(12.84×n) + 5.82]	(373×n) + 165	[(13.16×n) + 5.82]
F type	(217×n) + 70	[(7.65×n) + 2.47]	(227×n) + 70	[(8.01×n) + 2.47]	(252×n) + 70	[(8.89×n) + 2.47]	(261×n) + 70	[(9.21×n) + 2.47]

Calculation example: F18M8AM

stn.1~stn.8 F18T1-A1-PS DC24V

 $(329 \times 8) + 165 = 2797 g [98.66 oz.]$ 

When mounting a block-off plate, subtract 105 g [3.70 oz.] per unit from the above calculation result for the female thread specification; subtract 115 g [4.06 oz.] for the dual use fitting specification; subtract 140 g [4.94 oz.] for the  $\phi$ 8 fitting specification; and subtract 149 g [5.26 oz.] for the  $\phi$ 10 fitting specification.

When mounting the F18T0 specification valve, subtract 17 g [0.60 oz.] per unit from the above calculation result.

#### Mass of Split Manifold and Serial Transmission Compatible Manifold

Because the valve and manifold have the same output specifications, their mass is the same. The mass can only be changed by choosing a different type of inlet/outlet block

#### Mass of Split Manifold Non-Plug-in Type (single valve unit included)

g [oz.]

	Mass calculation of each unit							
Name along in tops	4(A), 2(B) ports outlet specifications							
Non-plug-in type	Female t	hread block	Dual use	fitting block	φ8 fitt	ing block	φ10 fit	ting block
	(236×n) + 234	[(8.33×n) + 8.25]	(246×n) + 234	[(8.68×n) + 8.25]	(271×n) + 234	[(9.56×n) + 8.25]	(280×n) + 234	[(9.88×n) + 8.25]

	g [oz.]			
Additional mass				
Piping block	specification			
Female thread block	Fitting block			
164 [5.78]	189 [6.67]			

Calculation example :F18M8N-MR

stn.1~stn.8 F18T1-A1-PS DC24V

 $(236\times8) + 234 + 164 = 2286 g [80.64 oz.]$ 

When mounting a block-off plate, subtract 105 g [3.70 oz.] per unit from the above calculation result for the female thread specification; subtract 115 g [4.06 oz.] for the dual use fitting specification; subtract 140 g [4.94 oz.] for the  $\phi$ 8 fitting specification; and subtract 149 g [5.26 oz.] for the  $\phi$ 10 fitting specification.

When mounting the F18T0 specification valve, subtract 17 g [0.60 oz.] per unit from the above calculation result.

#### Mass of Split Manifold Plug-in Type/ Serial Transmission Compatible Manifold (single valve unit included)

g [oz.]

	Mass calculation of each unit					
Plug-in type	4(A), 2(B) ports outlet specifications					
Serial transmission	Female thread block	Female thread block Dual use fitting block $\phi$ 8 fitting block $\phi$ 10 fitting block				
compatible manifold	(238×n) + 238 [(8.40×n) + 8.4	)] $(248\times n) + 238 [(8.75\times n) + 8.40]$	(273×n) + 238 [(9.63×n) + 8.40]	(282×n) + 238 [(9.95×n) + 8.40]		

g [oz.]

Additional mass				
Piping block specification				
Female thread block	Fitting block			
174 [6.14]	199 [7.02]			

g [oz.]

	Additional mass					
	Wiring block specification					
-F100, -F101	-F100, -F101 -F200, -F201, -F260 -D250, -D251 -T200					
69 [2.43]	71 [2.50]	72 [2.54]	154 [5.43]			

Additional mass						
Serial transmission block specification						
Integrated type (for B7A or CompoBus/ S, CC-Link)	Stand-alone type (for CompoNet)	Integrated type (for DeviceNet)	Integrated type (for EtherCAT)	Integrated type (for EtherNet/IP)		
160 [5.64]	236 [8.33]	243 [8.57]	205 [7.23]	215 [7.58]		


Calculation example : F18M8PM-MR-F201 DC24V

stn.1~stn.8 F18T1-A1 DC24V

(238×8)+238+174+71=2387 g [84.20 oz.]

When mounting the block-off plate, subtract 125 g  $\left[4.41\text{ oz}\right]$  per unit from the above calculation result.

When mounting the  $F18 \Box T0$  specification valve, subtract 17 g [0.60 oz.] per unit from the above calculation result.

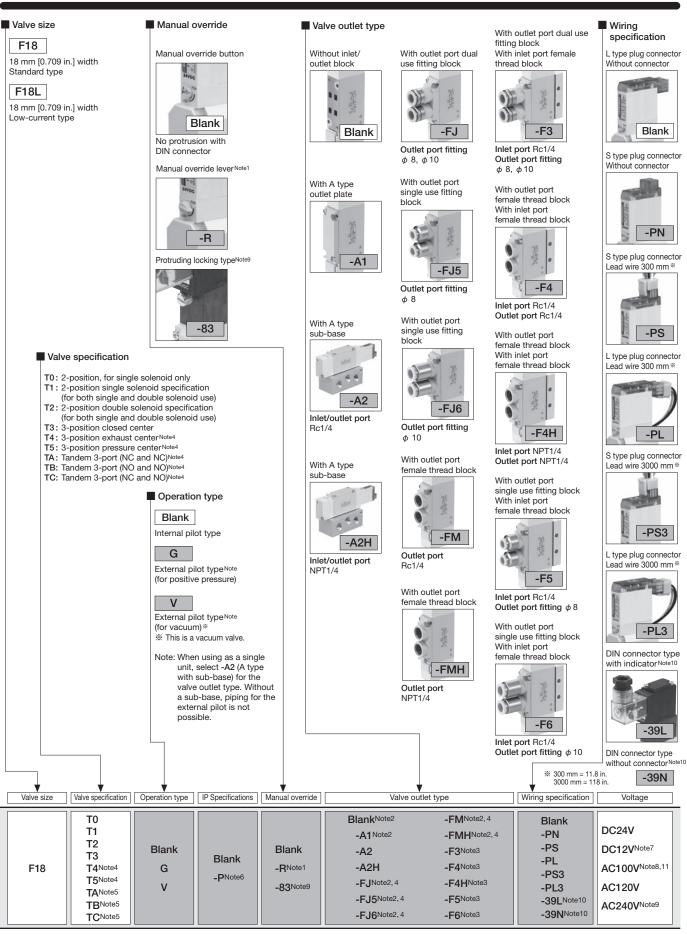

- Notes: 1. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39  $\Box$ .


  - 2. Two manifold mounting screws are included.

    3. "With inlet port female thread block" is compatible with the internal pilot type valve

  - 4. Not available in the vacuum valves. 5. Not available in external pilot type and vacuum valves.
  - 6. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- 7. Not available in low-current type.8. Not available in low-current type and tandem 3-port valves.
- 9. Only for wiring specification -39 □.
  10. Not available for valve specification T1. In addition, the valve is used only as a double solenoid for T2.
- 11. Not available with DIN connectors.

Remark: Negative common specifications are also available as made to order products (add -129W to the end of order code). For details, consult us

#### For internal pilot



18: 18 mm [0.709 in.] width

21 : Mounting bracket (mounting bracket, 2 mounting screws) : Sub-base Rc1/4 (sub-base body, gasket, exhaust valve)Note1 25 25H: Sub-base NPT1/4 (sub-base body, gasket, exhaust valve)Note1

Plate (plate, gasket, 2 mounting screws)

: Dual use fitting block (fitting block, gasket, 2 mounting screws)

: Single use fitting block  $\phi$  8 (fitting block, gasket, 2 mounting screws) : Single use fitting block  $\phi$  10 (fitting block, gasket, 2 mounting screws)

: Female thread block Rc1/4 (female thread block, gasket, 2 mounting screws) MH: Female thread block NPT1/4 (female thread block, gasket, 2 mounting screws) : P port female thread block Rc1/4 (P port female thread block, gasket)Note1


MPH: P port female thread block NPT1/4 (P port female thread block, gasket)Note1 MPP: IP dedicated P port female thread block (P port female thread block, gasket)

GS1: Gasket (gasket, exhaust valve)Note2

Notes: 1. Valve mounting screws are not included.

2. Caution should be exercised as this gasket is different from the GS2 gasket for the split-type manifolds.

#### For external pilot



Valve size **18:** 18 mm [0.709 in.] width

#### Parts content

: Plate (plate, gasket, 2 mounting screws)

: Dual use fitting block (fitting block, gasket, 2 mounting screws) : Single use fitting block  $\phi$  8 (fitting block, gasket, 2 mounting screws)

: Single use fitting block  $\phi$  10 (fitting block, gasket, 2 mounting screws) : Female thread block Rc1/4 (female thread block, gasket, 2 mounting screws)

MH : Female thread block NPT1/4 (female thread block, gasket, 2 mounting screws)

GS1: Gasket (gasket, exhaust valve)Note

Note: Caution should be exercised as this gasket is different from the GS2 gasket for the split type manifolds.

#### Sub-base for external pilot

F18 ZG - 25 (Sub-base Rc1/4)

F18 ZG - 25H (Sub-base NPT1/4)

#### Connector-related order codes



Valve specification For **T1**. **T2**. T3, T4, T5, TA. TB. TC

Connector specification

CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires) CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

CPN: Connector without lead wire (1 short bar and 3 contacts included)

Remarks: A connector for negative common is also available. See p. 19 for details. (UR is unsupported) 1. The lead wire thickness is 24AWG when Blank or 22AWG when UR is specified.



specification

Connector specification

: Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)

CPN: Connector without lead wire (1 short bar, 2 contacts included)



TA, TB, TC

Connector specification

specification CC1.5: Cabtyre cable length For T1, T2, T3, 1500 mm [59 in.] \* 1500 mm [59 in.] \* Cabtyre cable length 3000 mm [118 in.] \*

※ For details, see p. 22.

#### Connector-related order codes

## JAZ - P - (for double use only)

Valve specification For T2, T3, T4, **T5, TA, TB,** or

IP specification

Connector specification

: Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*

PB: Positive common B type, lead wire length 300 mm [11.8 in.]\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*

PC : Positive common C type, lead wire length 300 mm [11.8 in.]\* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

※A common connector assembly.

# **JAZ0 - P -** (for single use only)

Valve specification For T0/T1

IP specification

Connector specification

CP: Connector, lead wire length 300 mm [11.8 in.] (black, red. for total of 2 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*

PB: Positive common B type, lead wire length 300 mm [11.8 in.]\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*

PC: Positive common C type, lead wire length 300 mm [11.8 in.] \* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

※A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P- single dedicated type.

2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type).


3. There is no white lead wire for the **JAZ0-P-**  $\square$  .

4. It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.

For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office

For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.

### F18 Series Monoblock Manifold A Type (Base Piping Type) Order Codes

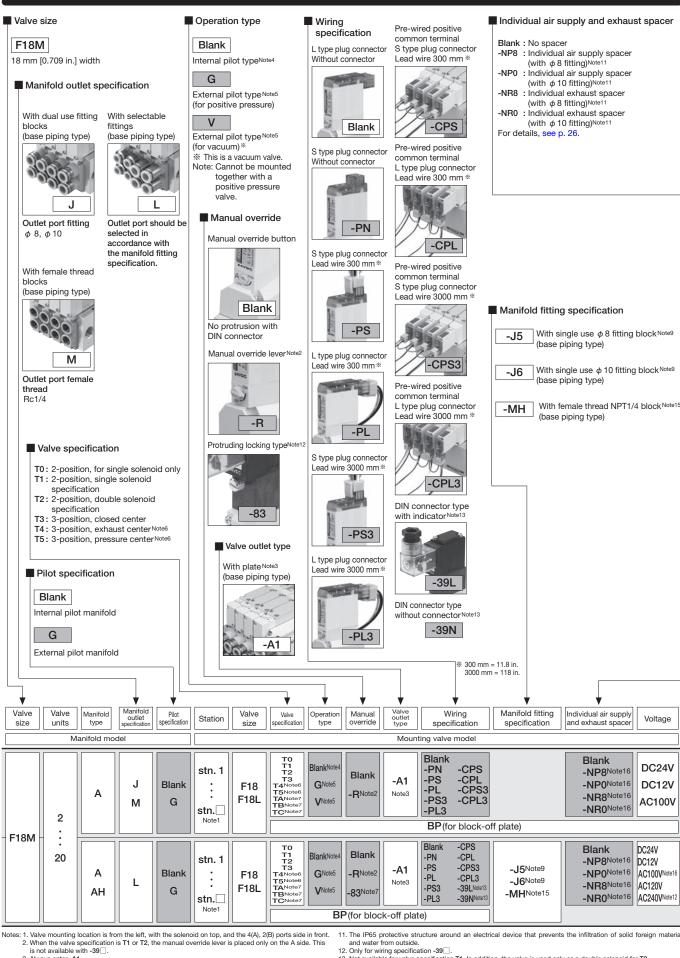

- - 3. Always enter -A1.
  - 4. Cannot be mounted on the external pilot manifold
  - 5. Cannot be mounted on the internal pilot manifold.

  - Not available in the vacuum valves.
     Not available in external pilot type and vacuum valves.
     Not available in low-current type.
  - Not available in the low current type and tandem 3-port valves.
     The -P ☐ (including when Blank) and -CP ☐ wiring specifications cannot be mixed.
- The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material
  and water from outside.
   Only for wiring specification -39 ...
   Not available for valve specification T1. In addition, the valve is used only as a double solenoid for T2.

- Can be selected only when the manifold type is A.
   Can be selected only when the manifold type is AH.
- Not available with DIN connectors (-39□). Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.


#### Gasket (gasket and exhaust valve)



#### Block-off plate (block-off plate and 2 mounting screws)




#### Connector-related order codes

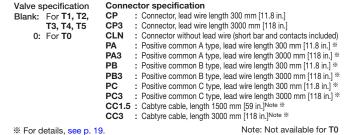

#### Common connector assembly

A type: FZ-PA□\*

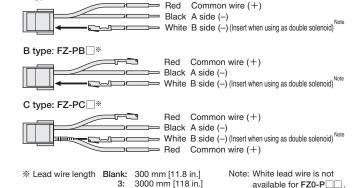

#### Manifold Order Code Example

(6 units of F18 Series)

#### F18M6AL

stn.1~2 F18T0-A1-PS-J5 DC24V stn.3~5 F18T2-A1-PS-J6 DC24V F18BP-J6 stn.6

#### Individual air supply and exhaust spacer

Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws



18: 18 mm

Specification

[0.709 in.] width

 $\dot{NP8}$ : Individual air supply spacer (with  $\phi$  8 fitting) NP0 : Individual air supply spacer (with  $\phi$  10 fitting) NR8: Individual exhaust spacer (with  $\phi$  8 fitting)

NR0: Individual exhaust spacer (with  $\phi$  10 fitting)

For details, see p. 26.

※ Not available with DIN connectors (-39□).


#### Muffler



Fitting size

8: Outer diameter  $\phi$  8 (for individual exhaust spacer) 10: Outer diameter  $\phi$  10 (for individual exhaust spacer) (Sales unit: Set of 10 mufflers)

#### Connector-related order codes



T5, TA, TB, or

IP specification

CP3 : Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires) : Positive common A type, lead wire length 300 mm [11.8 in.]\*

PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
PB: Positive common B type, lead wire length 300 mm [11.8 in.]\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*
PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P-  $\square$  single dedicated

type.


2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type). There is no white lead wire for the JAZ0-P- ...

It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.

For information on use in locations/atmospheres subject to substances

other than water, such as organic solvents, cutting oil, or reagents, contact our nearest KOGANEI sales office

For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.



Valve specification For **T0/T1** 

Connector specification

CP: Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)

IP specification

PA : Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
PB: Positive common B type, lead wire length 300 mm [11.8 in.]\* PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*

PC: Positive common C type, lead wire length 300 mm [11.8 in.]\* PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

※A common connector assembly.

#### **Precautions for Order Codes**


Manifold outlet specification

Select from among "dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, F18Z-J (dual use fitting block), F18Z-J 🗌 (single use fitting block), or F18Z-M 🗌 (female thread block), on p. 260.

Orders for valves only

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 259. Note, however, that the only available valve outlet type is A1. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

#### F18 Series Monoblock Manifold F Type (Direct Piping Type) Order Codes

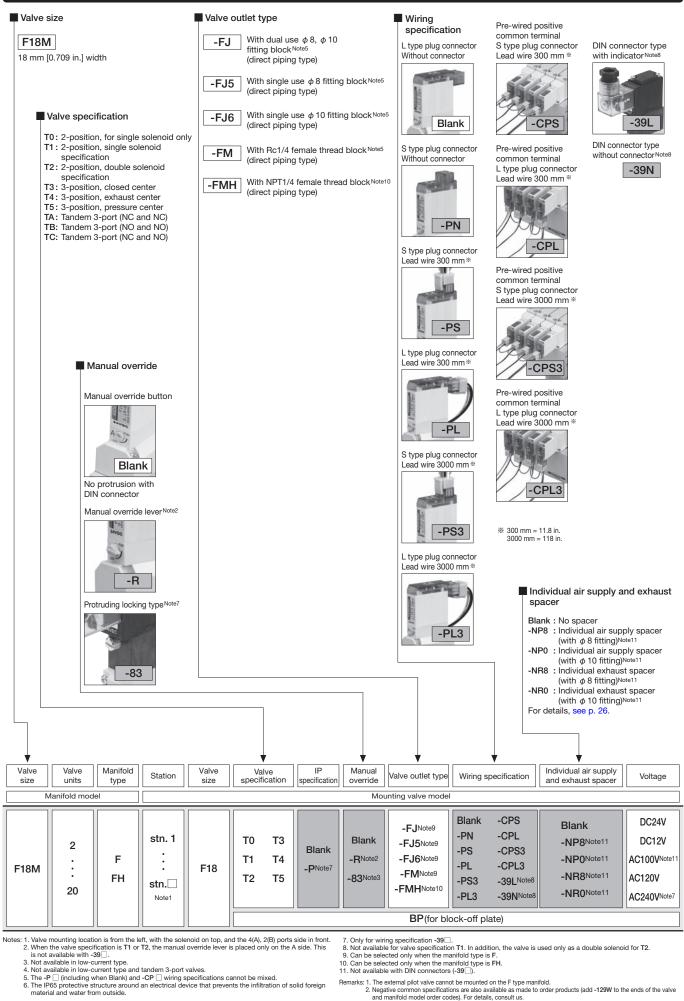

Remarks: 1. The external pilot valve cannot be mounted on the F type manifold.

2. Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

#### Gasket (gasket and exhaust valve)



#### Block-off plate (block-off plate and 2 mounting screws)




**FZ** □ - [

Valve specification

For details, see p. 19


#### Connector-related order codes

CP

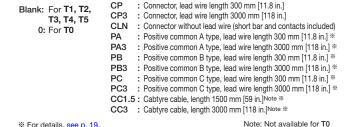

Connector specification

#### Common connector assembly

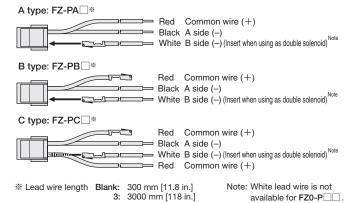

#### Manifold Order Code Example (4 units of F18 Series)

#### F18M4F

stn.1~2 F18T0-FJ5-PS DC24V F18T2-FJ6-PS DC24V stn.3 F18BP stn.4

Individual air supply and exhaust spacer

Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws



18: 18 mm  $\dot{\text{NP8}}$ : Individual air supply spacer (with  $\phi$  8 fitting) NP0 : Individual air supply spacer (with  $\phi$  10 fitting) NR8 : Individual exhaust spacer (with  $\phi$  8 fitting) [0.709 in.] width

NR0: Individual exhaust spacer (with  $\phi$  10 fitting)

※ Not available with DIN connectors (-39□).

#### Muffler



Fitting size

8: Outer diameter φ 8 (for individual exhaust spacer) 10: Outer diameter  $\phi$  10 (for individual exhaust spacer) (Sales unit: Set of 10 mufflers)

#### Connector-related order codes



For **T2, T3, T4**, T5, TA, TB, or

red, white, for total of 3 lead wires)

CP3 : Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires) : Positive common A type, lead wire length 300 mm [11.8 in.]\*

PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
PB: Positive common B type, lead wire length 300 mm [11.8 in.]\* IP specification

PB3: Positive common B type, lead wire length 3000 mm [118 in.]\* PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*
PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

\*A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P-  $\square$  single dedicated

type.


2. When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type). There is no white lead wire for the JAZ0-P- ...

It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.

For information on use in locations/atmospheres subject to substances

other than water, such as organic solvents, cutting oil, or reagents, contact our nearest KOGANEI sales office

For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.



#### Valve specification For T0/T1

#### Connector specification

: Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires)

CP3: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)

IP specification

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\* PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*
PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*

PC: Positive common C type, lead wire length 300 mm [11.8 in.]\*


PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

#### **Precautions for Order Codes**


Orders for valves only

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 259. Select from valve outlet types -FJ, -FJ5, -FJ6, or -FM 🗌 . In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

#### F18 Series Split Manifold Non-Plug-in Type Order Codes

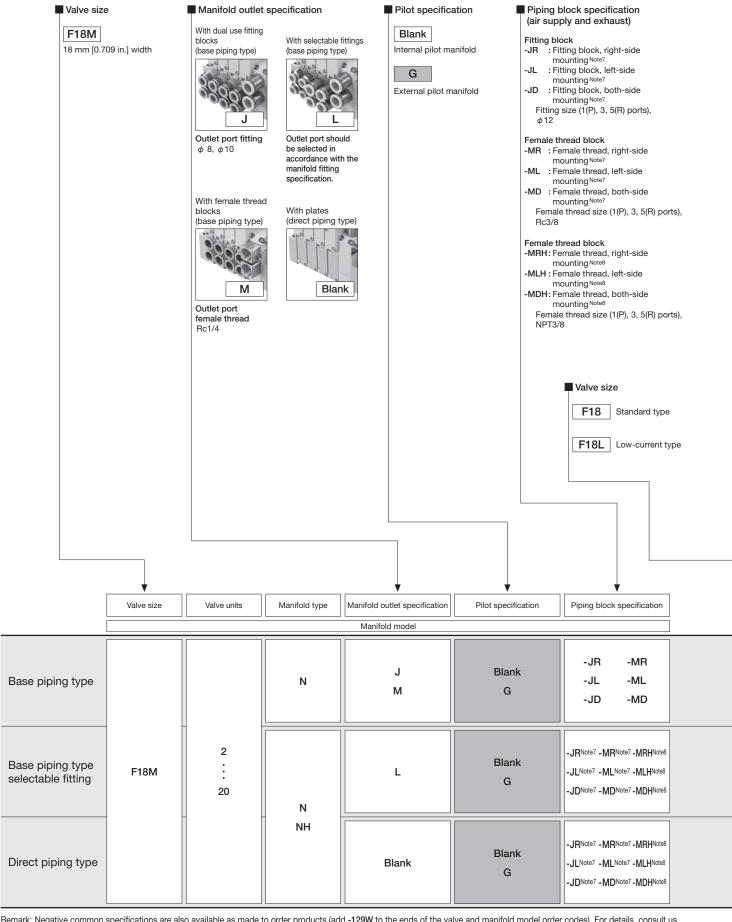

Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

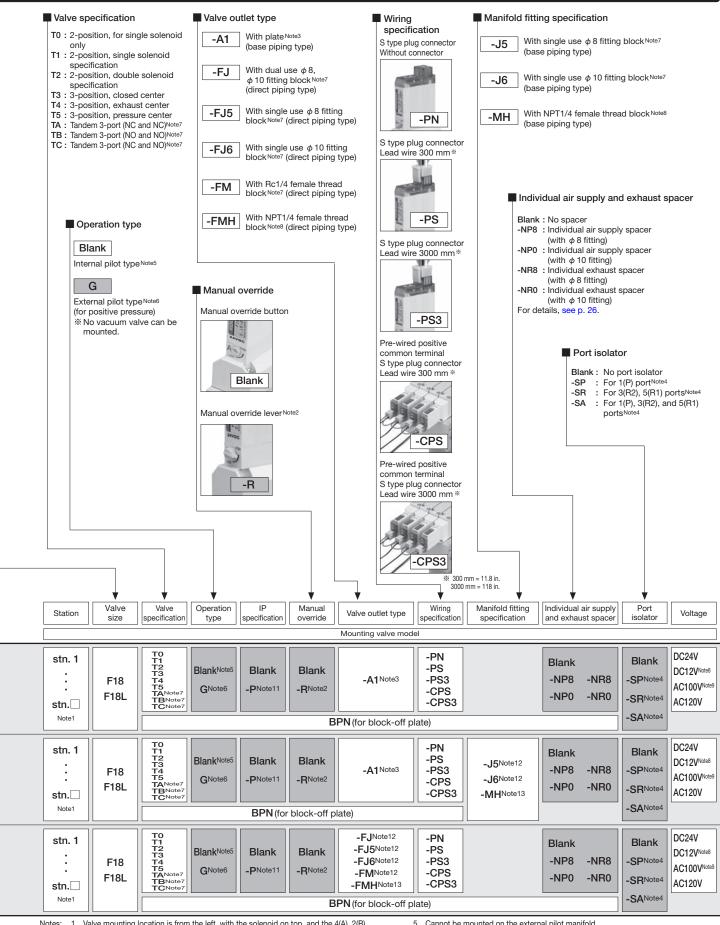

- Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

  When the valve specification is T1 or T2, the manual override lever is placed only on
  - 2.

  - the A side.

    When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.

    Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
- Cannot be mounted on the external pilot manifold. Cannot be mounted on the internal pilot manifold.
- Not available in external pilot type.

- 10. 11.
- Not available in low-current type.

  Not available in low-current type and tandem 3-port valves.

  The -P□ (including when Blank) and -CP□ wiring specifications cannot be mixed.

  The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.

  12. Can be selected only when the manifold type is N.

  13. Can be selected only when the manifold type is N.

#### Parts for manifold




[0.709 in.] width


GS2: Gasket (gasket and exhaust valve) SP : Port isolator (for 1(P) port)


: Port isolator (for 3(R2), 5(R1) ports) SR : Port isolator (for 1(P), 3(R2), 5(R1) ports)

#### Block-off plate (block-off plate, 2 mounting screws)




#### Connector-related order codes

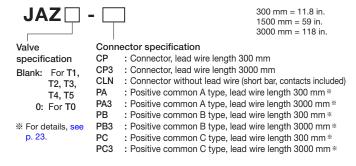





#### Common connector assembly

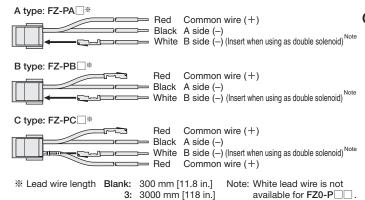

#### Valve base assembly (valve base and gasket)



#### Piping block assembly

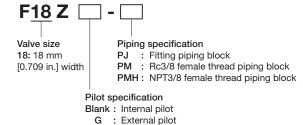


#### End blocks (one set of left and right)



18: 18 mm [0.709 in.] width

#### Individual air supply and exhaust spacer

Spacer for non-plug-in type, gasket, exhaust valve, and 2 mounting screws



For details, see p. 26.


#### Muffler



8: Outer diameter  $\phi$  8 (for individual exhaust spacer) 10: Outer diameter  $\phi$  10 (for individual exhaust spacer)

12: Outer diameter  $\phi$  12 (Sales unit: Set of 10 mufflers)

#### Connecting rod



#### Manifold Order Code Example

(4 units of F18 Series)

#### F18M4NL-JR

stn.1~2 F18T0-A1-PS-J5 DC24V F18T2-A1-PS-J6 DC24V stn.3 F18RPN-.16 stn.4

#### Precautions for Order Codes

#### Orders for valves only

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 72. However, Blank, A2 , F3, F4 , F5, and F6, cannot be selected for the valve outlet type. And for the wiring specification, Blank, PL, and PL3 cannot be selected. In addition, for common terminal wiring connections, separately order the common connector assemblies listed on the left.

#### Connector-related order codes

JAZ - P - (for double use only)

Valve specification For T2, T3, T4, Connector specification

**CP**: Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires)

T5, TA, TB, or CP3: Connector, lead wire length 3000 mm [118 in.] (black, TC red, white, for total of 3 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\*
PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
PB: Positive common B type, lead wire length 300 mm [11.8 in.]\*
PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*
PC: Positive common C type, lead wire length 3000 mm [11.8 in.]\*
PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*
\*\*A common connector assembly.

Notes: 1. When the valve specification is T1, select the JAZ0-P- ☐ single dedicated type.

- When switching between the single and double type (T1/T2), purchase and use a dedicated connector for single or double use (the number of seal holes in the lead wire differs for the single and double type).
- 3. There is no white lead wire for the JAZ0-P- .
- It is necessary to disassemble the connector to add a common connector assembly. Contact your nearest KOGANEI sales office.
- For information on use in locations/atmospheres subject to substances other than water, such as organic solvents, cutting oil, or reagents, contact your nearest KOGANEI sales office.
- For information on replacing the waterproof seal, contact your nearest KOGANEI sales office.

**JAZ0** - P - ☐ (for single use only)

Valve specification For T0/T1 Connector specification


**CP**: Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires)

**CP3**: Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires)

PA: Positive common A type, lead wire length 300 mm [11.8 in.]\*
PA3: Positive common A type, lead wire length 3000 mm [118 in.]\*
PB: Positive common B type, lead wire length 3000 mm [11.8 in.]\*
PB3: Positive common B type, lead wire length 3000 mm [118 in.]\*
PC: Positive common C type, lead wire length 3000 mm [11.8 in.] \*
PC3: Positive common C type, lead wire length 3000 mm [118 in.]\*

%A common connector assembly.


#### F18 Series Split Manifold Plug-in Type Order Codes

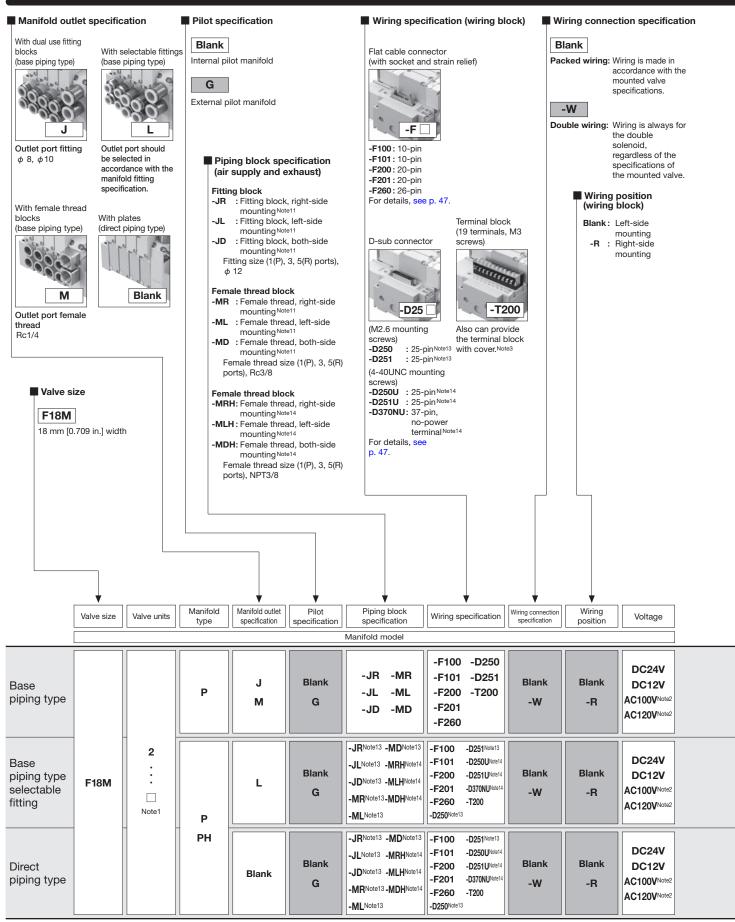

Notes: 1. For the maximum number of units, see the table for maximum number of valve units by wiring specification, on p. 272

- 2. AC100V, AC120V is available only for the **-D250**  $\square$ , **-D251**  $\square$ , **-D370NU** (D-sub connector) and **-T200** (terminal block) wiring specifications. 3. The terminal block with cover is also available as a made to order product (add **-139W** to the end of the manifold model order code).
- For details, consult us,


Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

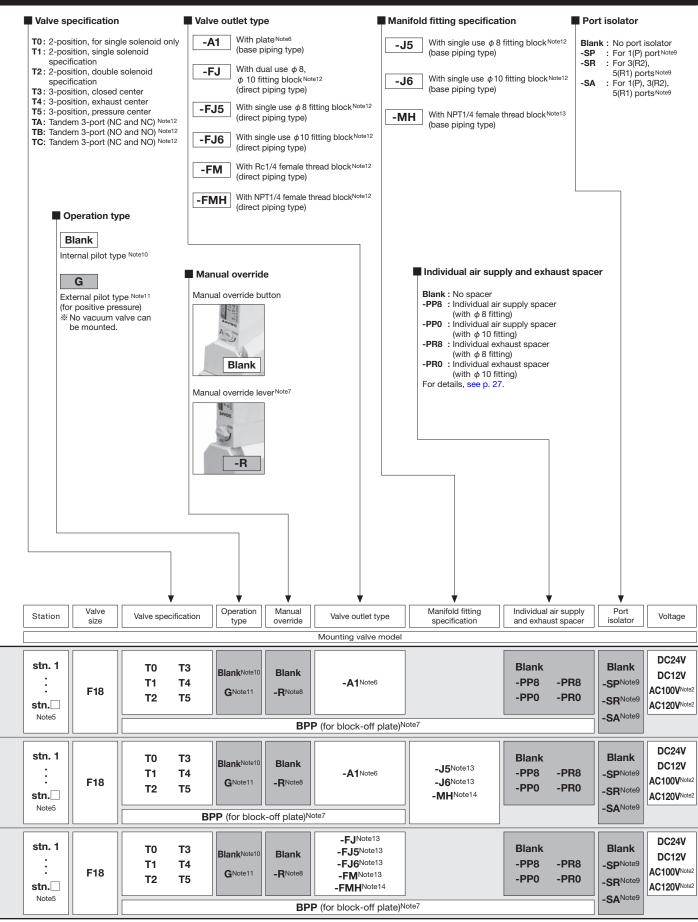


- 5. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.
  - When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.
  - Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For wiring for a single solenoid, see p. 273.
  - 8. When the valve specification is **T1** or **T2**, the manual override lever is placed only on the A side.
  - 9. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
  - Cannot be mounted on the external pilot manifold.
  - Cannot be mounted on the internal pilot manifold.
  - 12. Not available in external pilot type.

- 13. Can be selected only when the manifold type is P.
- 14. Can be selected only when the manifold type is PH.


#### Parts for manifold



#### Block-off plate (block-off plate, 2 mounting screws, and plug)




#### Valve base assembly (valve base, gasket, lead wire, and plug-in connector)

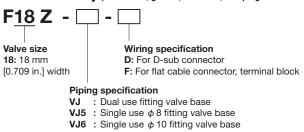

VM : Rc1/4 female thread valve base VMH: NPT1/4 female thread valve base

: Valve base plate


#### Piping block assembly

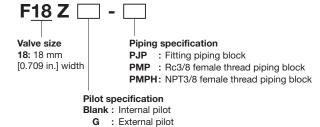

#### End blocks (one set of left and right)




#### Wiring block assembly (one set)

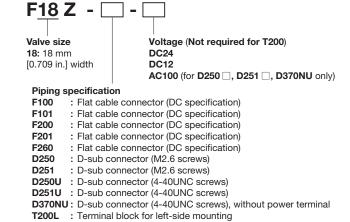


#### Individual air supply / Spacer for plug-in type, gasket, and exhaust spacer \ exhaust valve, and 2 mounting screws

T200R : Terminal block for right-side mounting




#### Muffler



**8:** Outer diameter  $\phi$  8 (for individual exhaust spacer) **10:** Outer diameter  $\phi$  10 (for individual exhaust spacer) **12:** Outer diameter  $\phi$  12

(Sales unit: Set of 10 mufflers)

#### Connecting rod



Specification

RV: For valve base

RH: For piping and wiring base

#### Table for maximum number of valve units by wiring specification

	Maximum number of units		
	Wiring connection specification		
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
<b>F100</b> Flat cable (10P)	8	Varies depending on	4 units
<b>F101</b> Flat cable (10P)	8	the number of mounted single solenoids, double solenoids, and block- off plates. The number of controlled solenoids	4 units
<b>F200</b> Flat cable (20P)	16		8 units
<b>F201</b> Flat cable (20P)	16		8 units
<b>F260</b> Flat cable (26P)	20		10 units
D250 ☐ D-sub connector (25P)	16	should be designated	8 units
<b>D251</b> ☐ D-sub connector (25P)	20	as the maximum number of outputs or	10 units
D370NU D-sub connector (37P)	32	less. D370NU is a	16 units
T200 Terminal block (19 terminals)	18	maximum of 20 units.	9 units

### Manifold Order Code Example

(12 units of F18 Series)

#### F18M12PL-JR-F201 DC24V

stn.1~8 F18T0-A1-J5 DC24V stn.9~11 F18T2-A1-J6 DC24V stn.12 F18BPP-J6 stn.12

#### **Precautions for Order Codes**

● Orders for valves only
Place orders from "F18 Series Single Valve Unit Order Codes" on p. 259.
However, Blank, A2 □, F3, F4 □, F5, and F6 cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.

#### Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.


-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

#### Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection

The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.


#### F18 Series Serial Transmission Compatible Manifold Order Codes

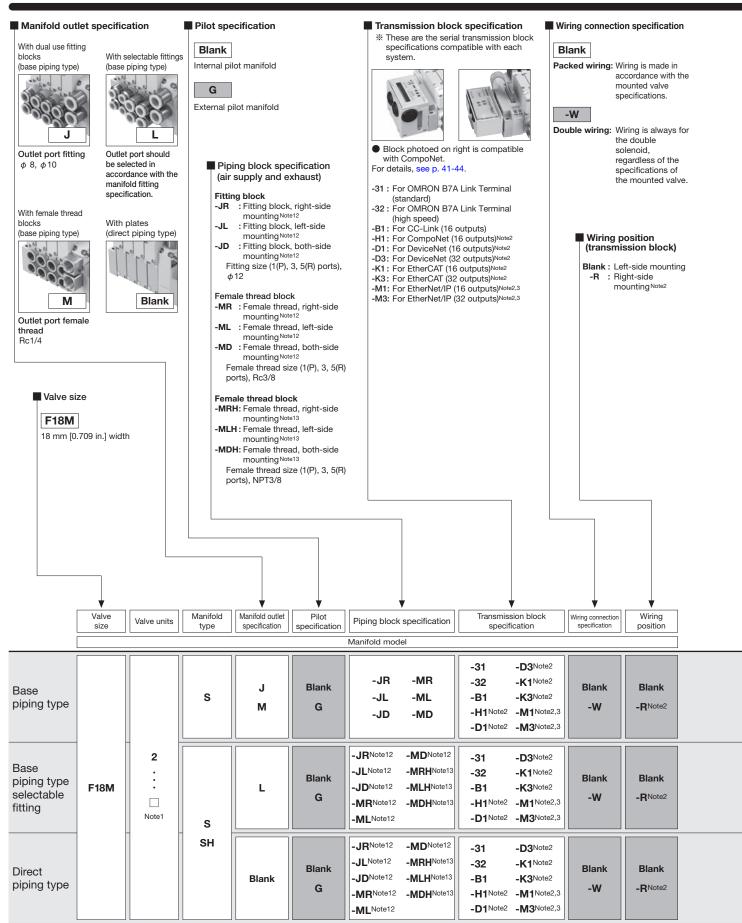

Notes: 1. To determine the maximum number of units, see the table for maximum number of valve units by transmission block specification, on p. 276.

3. Complies with the CE marking regulation.

<sup>2.</sup> The -H1, -D1, -D3, -K1, -K3, -M1, or -M3, transmission block is mountable on the left side only.

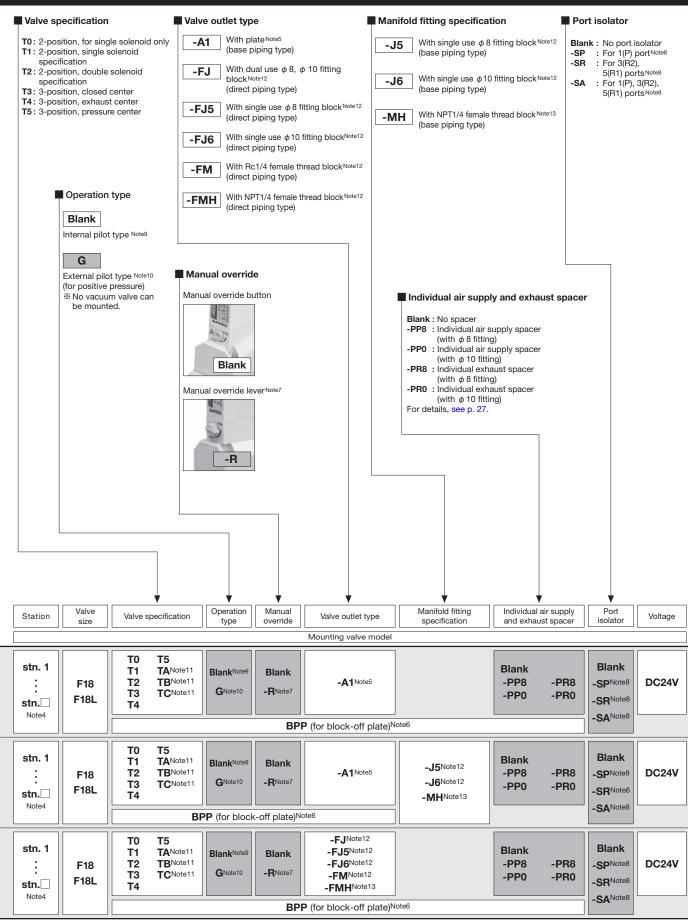

- 4. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

  - 5. When selecting **J**, **M**, or **L** (base piping type) for the manifold outlet specifications, always enter **-A**1 (with plate) for the valve outlet type.

    6. Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For

  - 8. Caution should be exercised that the block-on plate wiring is always double wiring (allocated 2 control pins at 1 strt.), regardless of the wiring connection specification. For wiring for a single solenoid, see p. 250.
    7. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
    8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).
  - Cannot be mounted on the external pilot manifold.
  - 10. Cannot be mounted on the internal pilot manifold.
  - 11. Not available in external pilot type.

- 12. Can be selected only when the manifold type is S.
- 13. Can be selected only when the manifold type is SH.

#### Parts for manifold

**F18 Z** - [ Valve size Parts content 18:18 mm GS2: Gasket (gasket and exhaust valve) [0.709 in.] width

#### Block-off plate (block-off plate, 2 mounting screws, and plug)

## F18 BPP

Valve size 18: 18 mm [0.709 in.] width

### Individual air supply / Spacer for plug-in type, gasket, and exhaust spacer \ exhaust valve, and 2 mounting screws



18: 18 mm

[0.709 in.] width

**PR0**: Individual exhaust spacer (with  $\phi$  10 fitting)

\* For details, see p. 27.

#### Specification

**PP8**: Individual air supply spacer (with  $\phi$  8 fitting) **PP0**: Individual air supply spacer (with  $\phi$  10 fitting) **PR8**: Individual exhaust spacer (with  $\phi$  8 fitting)

#### Muffler



**8**: Outer diameter  $\phi$  8 (for individual exhaust spacer) 10 : Outer diameter  $\phi$ 10 (for individual exhaust spacer)

**12**: Outer diameter  $\phi$  12 (Sales unit: Set of 10 mufflers)

### Manifold Order Code Example


(8 units of F18 Series)

#### F18M8SL-JR-B1-W

stn.1~5 F18T0-A1-J5 DC24V stn.6 $\sim$ 7 F18T2-A1-J6 DC24V

stn.8 F18BPP-J6

#### Serial transmission block (single unit)



#### Transmission block specification

31: For OMRON B7A Link Terminal (standard)

32: For OMRON B7A Link Terminal (high speed)

A1: For OMRON CompoBus/S (16 outputs)

B1: For CC-Link (16 outputs)


**YS5H1U** -For CompoNet (16 outputs) \* DIN rail included (length 75 mm [2.95 in.])

#### YS6 (Dedicated for manifold mounting)

#### Transmission block specification

D1: For DeviceNet (16 outputs) D3: For DeviceNet (32 outputs)

Note: The same wiring position is used for both the left-side and the right-side.



#### Transmission block specification

K1: For EtherCAT (16 outputs) K3: For EtherCAT (32 outputs) M1: For EtherNet/IP (16 outputs) M3: For EtherNet/IP (32 outputs)

#### ■ Table for maximum number of valve units by transmission block specification

	•		
	Maximum number of units		
Transmission block specifications	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
-31 : For OMRON B7A Link Terminal (standard)	16		8 units
-32 : For OMRON B7A Link Terminal (high speed)	16	Varies depending on the number of mounted single	8 units
-B1: For CC-LINK (16 Outputs)	16		8 units
-H1: For CompoNet (16 Outputs)	utputs) 16 solenoids, double solenoids, and		8 units
-D1: For DeviceNet (16 Outputs)	16	block-off plates. The number of controlled	8 units
-D3: For DeviceNet (32 Outputs)	32		16 units
-K1: For EtherCAT (16 Outputs)	rCAT (16 Outputs)  16 solenoids should be designated as		8 units
-K3: For EtherCAT (32 Outputs)	32	the maximum number of	16 units
-M1: For EtherNet/IP (16 Outputs)	16	outputs or less.	8 units
-M3: For EtherNet/IP (32 Outputs)	32		16 units

### **Precautions for Order Codes**

#### Orders for valves only

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 259.

However, Blank, A2 , F3, F4 , F5, and F6, cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.

#### Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.


#### Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us,

### F18T Valve specifications -F3-PS


With outlet port dual use fitting block With inlet port female thread block S type plug connector

\* For T0 Type dimensions, see page 279.

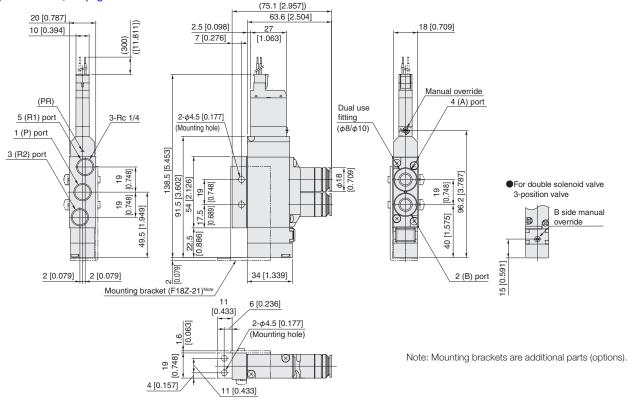


F18T Valve specifications -F4-PS F18T Valve specifications -F4H-PS

With outlet port female thread block With inlet port female thread block S type plug connector

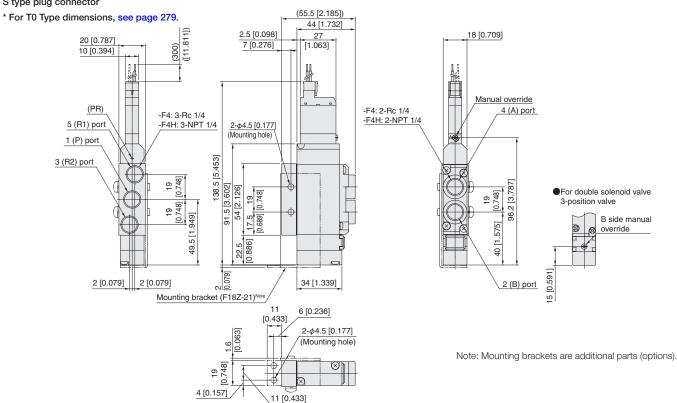

### F18T0-F □ -PS


With outlet port single use fitting block With inlet port female thread block S type plug connector

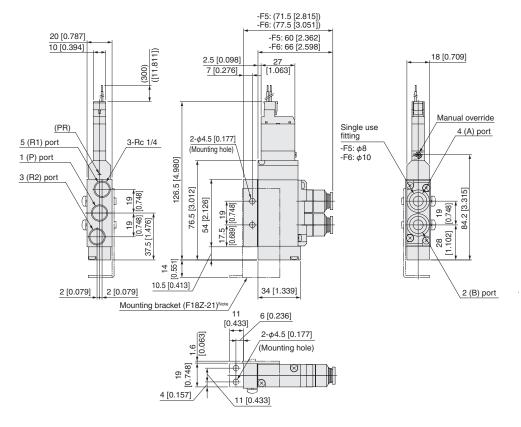

Note: Mounting brackets are additional parts (options).


## IP type

F18T Valve specifications Operation system -P-A2-PS

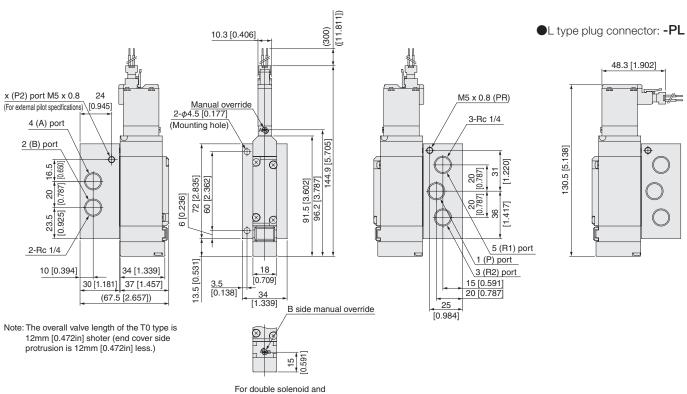


## F18T Valve specifications Operation system -A2-PS

With A-type sub-base S type plug connector

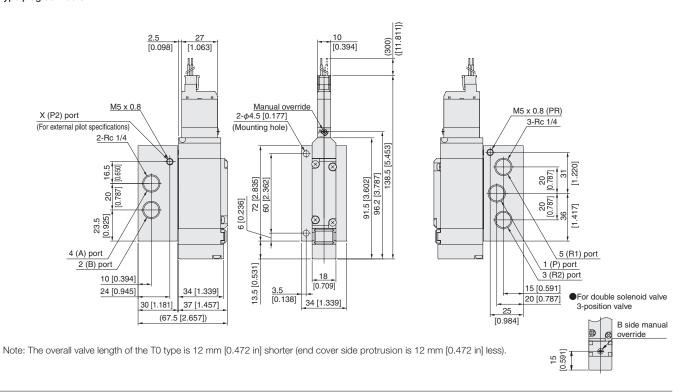


### **Options**

#### ●L type plug connector: -PL

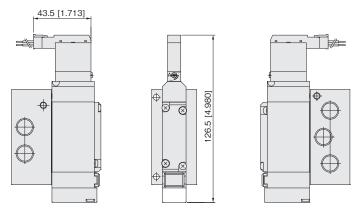


■Manual lever: -R




Note: The overall valve length of the T0 type is 12 mm [0.472 in] shorter (end cover side protrusion is 12 mm [0.472 in] less).

#### ● Solenoid with DIN type connector: -39 □

● Protruding locking type manual override: -83

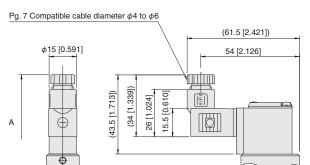


Symbol	A (Full length)
F18T0	127.7 [5.028]
F18T2	180.4 [7.102]
F18T2 to T5	192.4 [7.575]






Monoblock manifold A type With manifold outlet port dual use fitting block S type plug connector

### Internal pilot specifications 2-M5 x 0.8 (PR port) (Same on opposite side) 6-Rc 3/8 (Same on opposite side) 24.5 71 [2.795] 12 [0.472] 24.5 5 (R1) port 1 (P) port 25 [0.984] 3 (R2) port

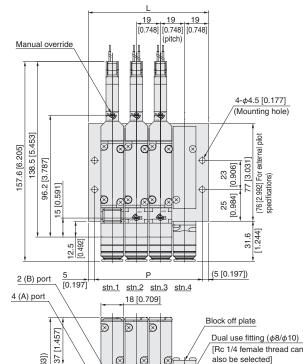

#### External pilot specifications<sup>Note</sup>



40 [1.575]

Note: For external pilot specifications, the shape of the monoblock manifold A type body is different from the internal pilot specifications

[Rc 1/4 female thread can also be selected]


[Single use fitting can also be selected]

[0.748] 19

[699.0]

#### Unit dimensions

Unit dimensions						
Number of units	L	Р				
2	57 [2.244]	47 [1.850]				
3	76 [2.992]	66 [2.598]				
4	95 [3.740]	85 [3.346]				
5	114 [4.488]	104 [4.094]				
6	133 [5.236]	123 [4.843]				
7	152 [5.984]	142 [5.591]				
8	171 [6.732]	161 [6.339]				
9	190 [7.480]	180 [7.087]				
10	209 [8.228]	199 [7.835]				
11	228 [8.976]	218 [8.583]				
12	247 [9.724]	237 [9.331]				
13	266 [10.472]	256 [10.079]				
14	285 [11.220]	275 [10.827]				
15	304 [11.969]	294 [11.575]				
16	323 [12.717]	313 [12.323]				
17	342 [13.465]	332 [13.071]				
18	361 [14.213]	351 [13.819]				
19	380 [14.961]	370 [14.567]				
20	399 [15.709]	389 [15.315]				

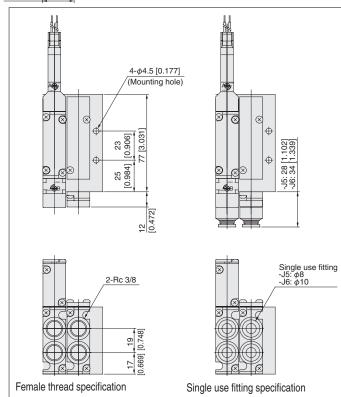

(90.5 [3.563])

53 [2.087]


F18M Number of valves F (Direct piping type)

#### Monoblock manifold F type With valve outlet port dual use fitting block S type plug connector 19 19 19 [0.748] [0.748] [0.748] (pitch) Manual override Dual use fitting $(\phi 8/\phi 10)$ [Rc 1/4 female thread can also be selected] [Single use fitting can also be selected] 2-M5 (PR port) 4 (A) port (Same on opposite side) 4-φ4.5 [0.177] (Mounting hole) 2 (B) port 6-Rc 3/8 (Same on opposite side) 138.5 [5.453] 34 [1.339] $\otimes$ 23 96.2 [3.787] 23 [0.906] 75 [2.953] 19 [0.748] 23 35 [1.378] 23.5 [0.925] 15 40 [1.575] 5 (R1) port (5 [0.197]) 5 [0.197] 3 (R2) port 1 (P) port 22 [0.866] <u>stn.1</u> <u>stn.2</u> <u>stn.3</u> <u>stn.4</u> 18 [0.709] 13 [0.512] 28 [1.102] 63.6 [2.504] (98.1 [3.862]) Block off plate 34 [1.339]

#### Note: The overall valve length of the T0 type is 12 mm [0.472 in] shorter (end cover side protrusion is 12 mm [0.472 in] less).

#### **Unit dimensions**

Number of units	L	Р			
2	57 [2.244]	47 [1.850]			
3	76 [2.992]	66 [2.598]			
4	95 [3.740]	85 [3.346]			
5	114 [4.488]	104 [4.094]			
6	133 [5.236]	123 [4.843]			
7	152 [5.984]	142 [5.591]			
8	171 [6.732]	161 [6.339]			
9	190 [7.480]	180 [7.087]			
10	209 [8.228]	199 [7.835]			
11	228 [8.976]	218 [8.583]			
12	247 [9.724]	237 [9.331]			
13	266 [10.472]	256 [10.079]			
14	285 [11.220]	275 [10.827]			
15	304 [11.969]	294 [11.575]			
16	323 [12.717]	313 [12.323]			
17	342 [13.465]	332 [13.071]			
18	361 [14.213]	351 [13.819]			
19	380 [14.961]	370 [14.567]			
20	399 [15.709]	389 [15.315]			

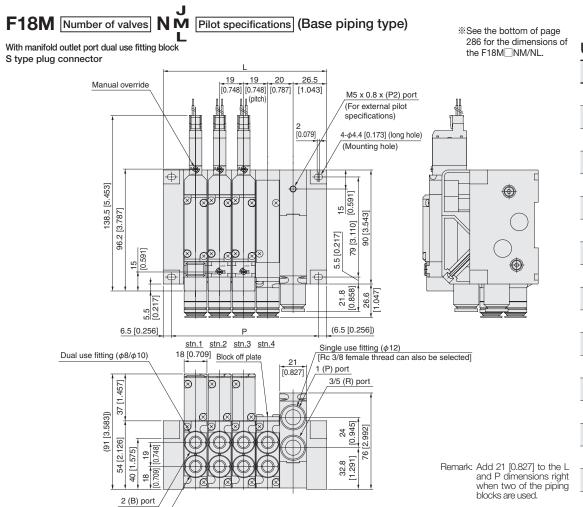


### **Unit dimensions**

Offic difficusions		
Number of units	L	Р
2	91 [3.583]	78 [3.071]
3	110 [4.331]	97 [3.819]
4	129 [5.079]	116 [4.567]
5	148 [5.827]	135 [5.315]
6	167 [6.575]	154 [6.063]
7	186 [7.323]	173 [6.811]
8	205 [8.071]	192 [7.559]
9	224 [8.819]	211 [8.307]
10	243 [9.567]	230 [9.055]
11	262 [10.315]	249 [9.803]
12	281 [11.063]	268 [10.551]
13	300 [11.811]	287 [11.299]
14	319 [12.559]	306 [12.047]
15	338 [13.307]	325 [12.795]
16	357 [14.055]	344 [13.543]
17	376 [14.803]	363 [14.291]
18	395 [15.551]	382 [15.039]
19	414 [16.299]	401 [15.787]
20	433 [17.047]	420 [16.535]

## F18M Number of valves N Pilot specifications (Direct piping type)

4 (A) port

With valve outlet port dual use fitting block S type plug connector

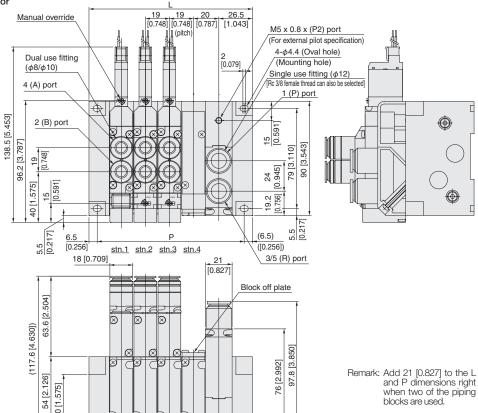

### Unit dimensions

Unit dimensions		
Number of units	L	Р
2	91 [3.583]	78 [3.071]
3	110 [4.331]	97 [3.819]
4	129 [5.079]	116 [4.567]
5	148 [5.827]	135 [5.315]
6	167 [6.575]	154 [6.063]
7	186 [7.323]	173 [6.811]
8	205 [8.071]	192 [7.559]
9	224 [8.819]	211 [8.307]
10	243 [9.567]	230 [9.055]
11	262 [10.315]	249 [9.803]
12	281 [11.063]	268 [10.551]
13	300 [11.811]	287 [11.299]
14	319 [12.559]	306 [12.047]
15	338 [13.307]	325 [12.795]
16	357 [14.055]	344 [13.543]
17	376 [14.803]	363 [14.291]
18	395 [15.551]	382 [15.039]
19	414 [16.299]	401 [15.787]
20	433 [17.047]	420 [16.535]


blocks are used.



≪See the bottom of page 286 for the dimensions
of the F18M

PM/PL.

With manifold outlet port dual use fitting block Flat cable connector 10-pin specifications

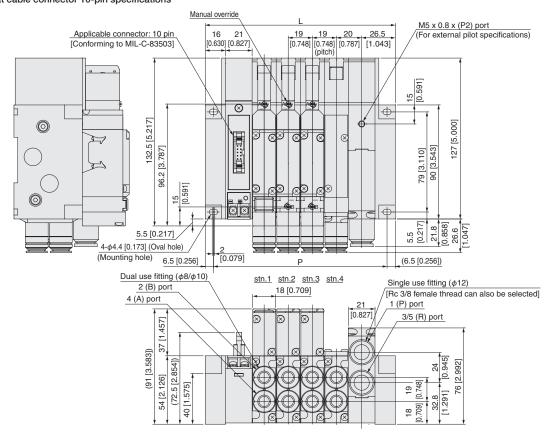


# F18M Number of valves PM Pilot specifications (Base piping type)

※See the bottom of page 286 for the dimensions of the F18M

☐PM/PL.

With manifold outlet port dual use fitting block

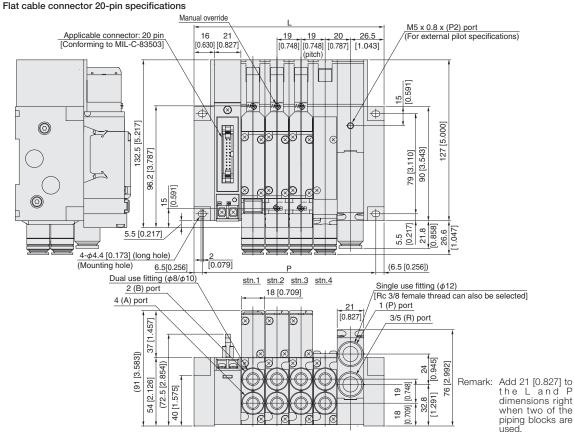

#### **Unit dimensions**

Number of units	L	Р
2	112 [4.409]	99 [3.898]
3	131 [5.157]	118 [4.646]
4	150 [5.906]	137 [5.394]
5	169 [6.654]	156 [6.142]
6	188 [7.402]	175 [6.890]
7	207 [8.150]	194 [7.638]
8	226 [8.898]	213 [8.386]

Remark: Add 21 [0.827] to the L and P dimensions above when two of the piping blocks are used.


#### **Unit dimensions**

P
9 398]
18 646]
37 394]
56 142]
75 390]
94 638]
13 386]
32 134]
51 382]
70 630
89 378
08 126
27 874
46 622
65 370

#### F18M Number of valves РМ Pilot specifications (Base piping type)

**%See the bottom of page 286** for the dimensions of the F18M PM/PL.

With manifold outlet port dual use fitting block Flat cable connector 26-pin specifications

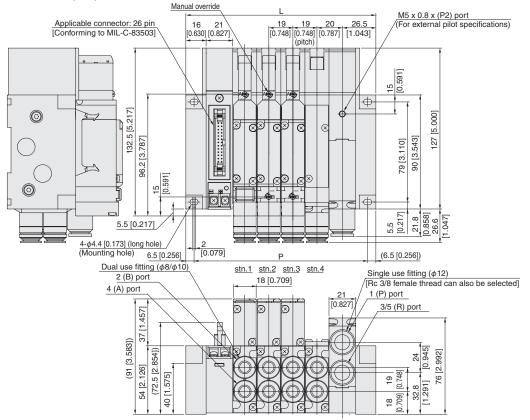


Remark: Add 21 [0.827] to the L and P dimensions right when two of the piping blocks are used.

#### F18M Number of valves Pilot specifications (Base piping type) РМ

%See the bottom of p286 for the dimensions of the F18M PM/PL.

With manifold outlet port dual use fitting block D-sub connector 25-pin specifications

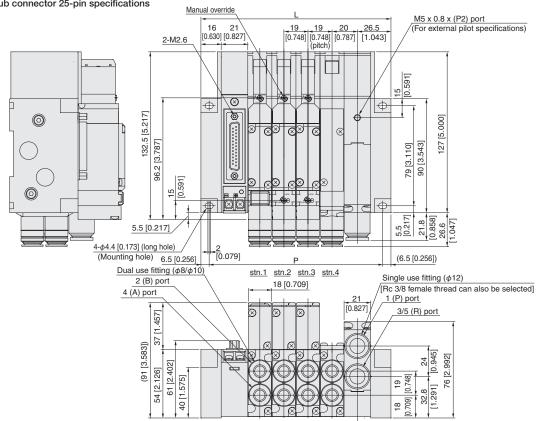

Remark: Add 21 [0.827] to the L and P dimensions right when two of the piping blocks are used.

#### **Unit dimensions**

Offit difficusions		
Number of units	L	Р
2	112 [4.409]	99 [3.898]
3	131 [5.157]	118 [4.646]
4	150 [5.906]	137 [5.394]
5	169 [6.654]	156 [6.142]
6	188 [7.402]	175 [6.890]
7	207 [8.150]	194 [7.638]
8	226 [8.898]	213 [8.386]
9	245 [9.646]	232 [9.134]
10	264 [10.394]	251 [9.882]
11	283 [11.142]	270 [10.630]
12	302 [11.890]	289 [11.378]
13	321 [12.638]	308 [12.126]
14	340 [13.386]	327 [12.874]
15	359 [14.134]	346 [13.622]
16	378 [14.882]	365 [14.370]
17	397 [15.630]	384 [15.118]
18	416 [16.378]	403 [15.866]
19	435 [17.126]	422 [16.614]
20	454 [17.874]	441 [17.362]

#### Unit dimensions

Number of units	L	Р
2	112 [4.409]	99 [3.898]
3	131 [5.157]	118 [4.646]
4	150 [5.906]	137 [5.394]
5	169 [6.654]	156 [6.142]
6	188 [7.402]	175 [6.890]
7	207 [8.150]	194 [7.638]
8	226 [8.898]	213 [8.386]
9	245 [9.646]	232 [9.134]
10	264 [10.394]	251 [9.882]
11	283 [11.142]	270 [10.630]
12	302 [11.890]	289 [11.378]
13	321 [12.638]	308 [12.126]
14	340 [13.386]	327 [12.874]
15	359 [14.134]	346 [13.622]
16	378 [14.882]	365 [14.370]
17	397 [15.630]	384 [15.118]
18	416 [16.378]	403 [15.866]
19	435 [17.126]	422 [16.614]
20	454 [17.874]	441 [17.362]

# F18M Number of valves P P Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block


Terminal block type


See the bottom of p.286 for the dimensions of the F18M
 PM/PL.

#### **Unit dimensions**

Unit dimensions		
Number of units	L	Р
2	133 [5.236]	120 [4.724]
3	152 [5.984]	139 [5.472]
4	171 [6.732]	158 [6.220]
5	190 [7.480]	177 [6.969]
6	209 [8.228]	196 [7.717]
7	228 [8.976]	215 [8.465]
8	247 [9.724]	234 [9.213]
9	266 [10.472]	253 [9.961]
10	285 [11.220]	272 [10.709]
11	304 [11.969]	291 [11.457]
12	323 [12.717]	310 [12.205]
13	342 [13.465]	329 [12.953]
14	361 [14.213]	348 [13.701]
15	380 [14.961]	367 [14.449]
16	399 [15.709]	386 [15.197]
17	418 [16.457]	405 [15.945]
18	437 [17.205]	424 [16.693]

Remark: Add 21 [0.827] to the L and P dimensions above when two of the piping blocks are used.

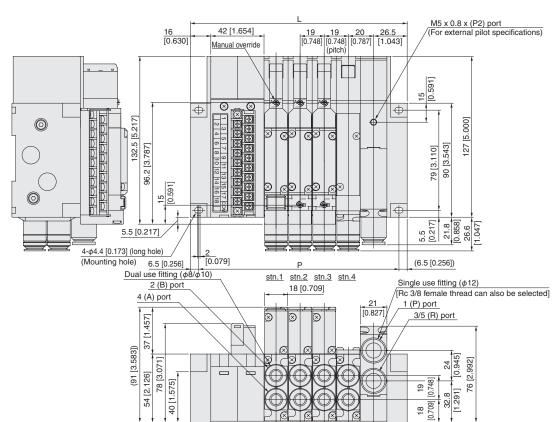


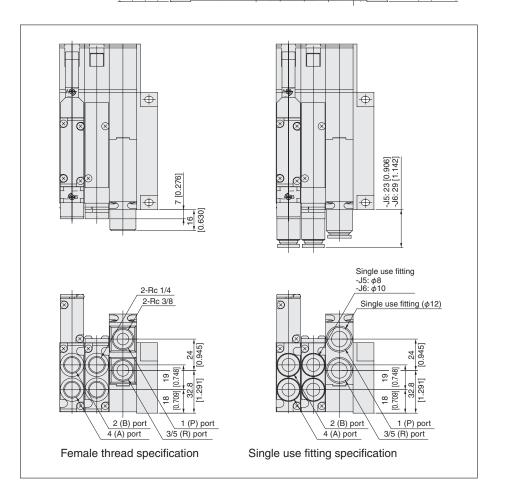


## Omron B7A, SandCC-Link supported

F18M Number of valves S M Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block

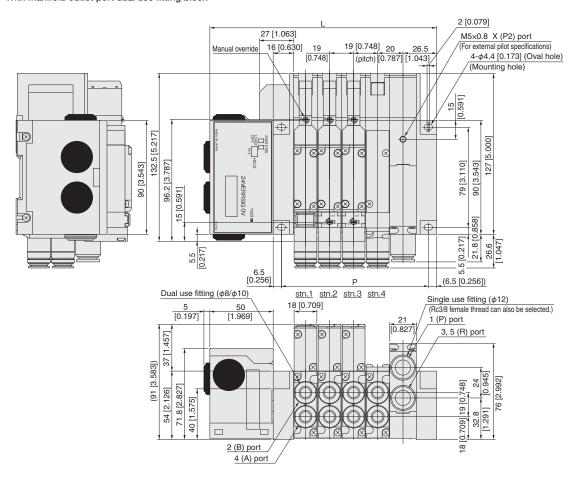

#### **CompoNet** supported

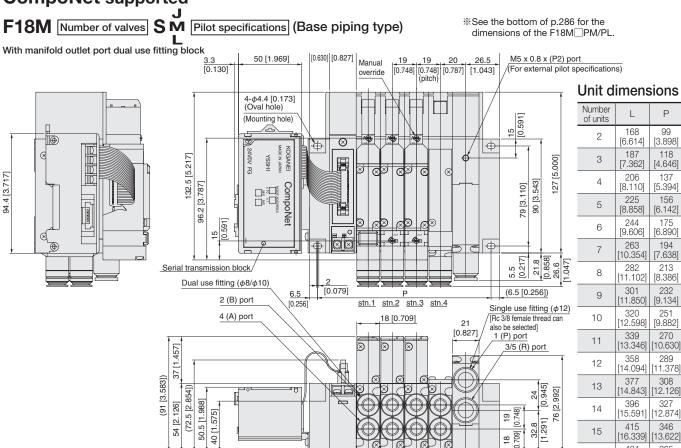

\* The communication connectors are sold by Omron Corporation. Contact Omron Corporation for details.

Remark:

[16.339]

434 [17.087]

15

16

Add 21 [0.827] to the L and F dimensions above when two of the piping blocks are

[13.622]

365 [14.370]

#### EtherCAT and EtherNet/IP supported

F18M Number of valves

% See the bottom of page 286 for the dimensions of the F18M $\square$ PM/PL.

**18** 

\*The dimension is of EtherCAT.

19 19 20 26.5 [0.748] | 0.748| | 0.787| | 1.043| With manifold outlet port dual use fitting block 26.6 [1.047] 29.5 [1.161] M5 x 0.8 x (P2) port (For external pilot specifications [0.079] Manual overrid 4-φ4.4 [0.173] (Oval hole) (Mounting hole)  $\Phi$ 132.5 [5.217] 15 [0.591] FG 108 [4.252] # NO # H ⊗  $\otimes$ terminal [3.787] 79 [3.110] 8 `⊗ 15 [0.591]  $\otimes$ 10 21.8 5.5 [0.217] Serial transmission block Dual use fitting  $(\phi 8/\phi 10)$ (6.5 [0.256]) 2 (B) port stn.2 stn.3 stn.4 Single use fitting ( $\phi$ 12) 18 [0.709] Rc 3/8 female thread can 4 (A) port 21 [0.827] 1 (P) port Ø 3/5 (R) port .457 (91 [3.583]) 24 [0.945] [2.992] 72 [2.835] 54 [2.126] 18 19 0.709] [0.748] 40 [1.575] [1.291] 32.8

**S M** Pilot specifications (Base piping type)

#### **Unit dimensions**

Number of units	L	Р
2	131.1 [5.161]	78 [3.071]
3	150.1 [5.909]	97 [3.819]
4	169.1 [6.657]	116 [4.567]
5	188.1 [7.406]	135 [5.315]
6	207.1 [8.154]	154 [6.063]
7	226.1 [8.902]	173 [6.811]
8	245.1 [9.650]	192 [7.559]
9	264.1 [10.398]	211 [8.307]
10	283.1 [11.146]	230 [9.055]
11	302.1 [11.894]	249 [9.803]
12	321.1 [12.642]	268 [10.551]
13	340.1 [13.390]	287 [11.299]
14	359.1 [14.138]	306 [12.047]
15	378.1 [14.886]	325 [12.795]
16	397.1 [15.634]	344 [13.543]
Remarks: \	When usi	na two


piping blocks, add 21 to the above I and P dimensions.

#### **DeviceNet** supported

F18M Number of valves S M (Base piping specifications)

\*See the bottom of page 286 for the dimensions of the F18M PM/PL.

With manifold outlet port dual use fitting block

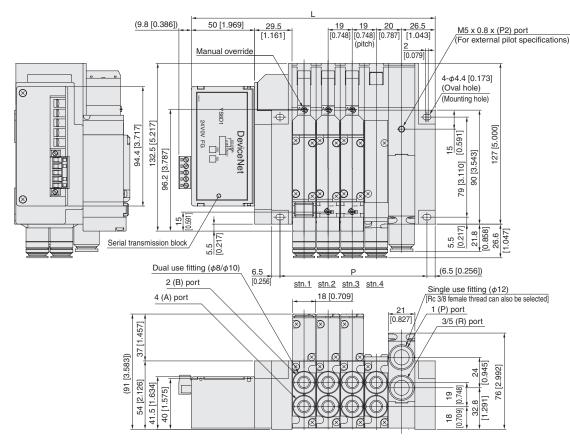


#### Unit dimensions

Offic difficusions						
Number of units	L	Р				
2	154.5 [6.083]	78 [3.071]				
3	173.5 [6.831]	97 [3.819]				
4	192.5 [7.579]	116 [4.567]				
5	211.5 [8.327]	135 [5.315]				
6	230.5 [9.074]	154 [6.063]				
7	249.5 [9.823]	173 [6.811]				
8	268.5 [10.571]	192 [7.559]				
9	287.5 [11.319]	211 [8.307]				
10	306.5 [12.067]	230 [9.055]				
11	325.5 [12.815]	249 [9.803]				
12	344.5 [13.563]	268 [10.551]				
13	363.5 [14.311]	287 [11.299]				
14	382.5 [15.059]	306 [12.047]				
15	401.5 [15.807]	325 [12.795]				
16	420.5 [16.555]	344 [13.543]				
D .	1A/I .					


Remarks: When using two piping blocks, add 21 to the above L and P dimensions.

#### Additional parts (sold separately)


●Muffler: KM-J12 [for both plug-in and non-plug-in type]




●Muffler: KM-J8 [for individual exhaust spacer only]



• Muffler: KM-J10 [for individual exhaust spacer only]



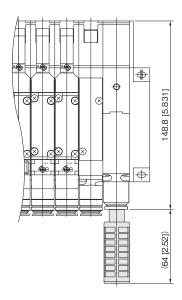

# SPECIFICATION CHECK SHEET

## F Series Specifications confirmation Form


#### **INDEX**

■F10, F15 Series	
Monoblock Manifold A Type (Base Piping Type) ————	<del>294</del>
Monoblock Manifold F Type (Direct Piping Type)	<del>296</del>
Monoblock Manifold A Type, Wire-Saving Type	
(Base Piping Type)	<u>     298                               </u>
Monoblock Manifold F Type, Wire-Saving Type	
(Direct Piping Type)	<del>3</del> 00
PC Board Manifold A Type (Base Piping Type) —	<del>302</del>
PC Board Manifold F Type (Direct Piping Type) ————	<del>304</del>
Split Manifold Non-Plug-in Type —	<del>306</del>
Split Manifold Plug-in Type —	<del>308</del>
Split Manifold Serial Transmission Type	<u>310</u>
Easy Asseembly Type Manifold Non-Plug-In Type ————	<u>312</u>
Easy Asseembly Type Manifold Plug-in Type	<u>314</u>
Easy Assembly Type Manifold Serial Transmission Type —	—316
■F18 Series	
Monoblock Manifold A Type (Base Piping Type)	—318
Monoblock Manifold F Type (Direct Piping Type)	<del>320</del>
Split Manifold Non-Plug-in Type —	<u>322</u>
Split Manifold Plug-in Type	324
Split Manifold Serial Transmission Type	<del>326</del>

#### **Example of Specifications Confirmation Form**

When ordering F series manifolds, use this specifications confirmation form for complex model configurations, for confirming specifications, etc.

Using the example below for reference, fill out the required items in the "Specifications confirmation Forms" found on p.202 and up, and send it. (Make copies of the Specifications Confirmation Form for your use.)

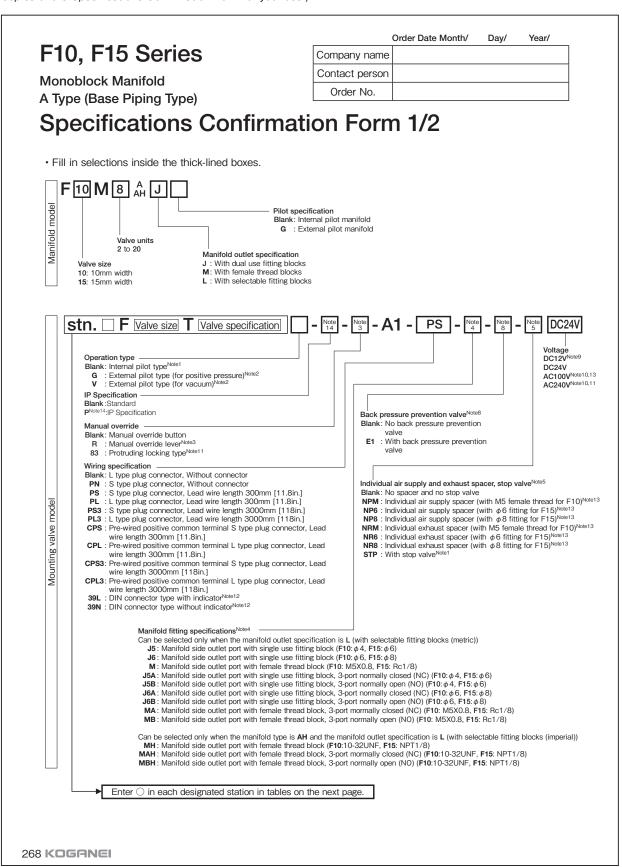

Monoblock Manifold A Type (Base Piping Type)

#### **Specifications Confirmation Form 2/2**

Mounting	valve, block-off plate Station	ղ 1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	2
F 🗌 T0	2-position, for single solenoid only																				Г
F 🗌 T1	2-position, single solenoid specification	n																			Г
F 🗌 T2	2-position, double solenoid specification	n																			Г
F 🗌 T3	3-position, closed center																				Г
F 🗌 T4 <sup>Note</sup>	6 3-position, exhaust center																				Г
F T5Note	6 3-position, pressure center																				Г
F   TA <sup>Note</sup>	<sup>7</sup> Tandem 3-port (NC and NC)																				Г
F   TB <sup>Not</sup>	<sup>7</sup> Tandem 3-port (NO and NO)																				Г
F   TC <sup>Not</sup>	<sup>7</sup> Tandem 3-port (NC and NO)																				Г
F 🗌 LT0	(Low current type) 2-position, for single solenoid only	,																			Г
F 🗌 LT1	(Low current type) 2-position, single solenoid specification	1																			Т
F 🗌 LT2	(Low current type) 2-position, double solenoid specification	n																			t
F 🗌 LT3	(Low current type) 3-position, closed cente	r																			T
F ☐ LT4 <sup>No</sup>	te6 (Low current type) 3-position, exhaust center																				t
F 🗌 LT5 <sup>No</sup>	te6 (Low current type) 3-position, pressure center																				T
F 🗌 LTA <sup>NO</sup>	te7 (Low current type) Tandem 3-port (NC and NC																				t
F □ LTB <sup>N</sup>	ote7 (Low current type) Tandem 3-port (NO and NO																				t
	ote7 (Low current type) Tandem 3-port (NC and NO	_																			t
F BP	Block-off plate																				t
P Note14	IP Specification	+																			t
Manual	R Manual override lever <sup>Note3</sup>	+																			t
override	83 Protruding locking type <sup>Note11</sup>																				t
	J5 With single use fitting block	+							_												t
	J6 With single use fitting block	+																			t
	M With female thread block	+																			t
	J5A With single use fitting block, 3-port normally closed (NC	)																			t
	J5B With single use fitting block, 3-port normally open (NC	_																			H
Manifold fitting specification <sup>Note4</sup>	J6A With single use fitting block, 3-port normally closed (NC	_	1																		t
(Manifold side	J6B With single use fitting block, 3-port normally open (NC	_	+																		H
outlet port)	MA With female thread block, 3-port normally closed (NC																				H
	MB With female thread block, 3-port normally open (NC	_																			H
	MH With female thread block	+	1																		H
	MAH With female thread block, 3-port normally closed (NC)	+																			H
	MBH With female thread block, 3-port normally open (NO	1	1																		+
E1 Note8pa	ck pressure prevention valve	1	+-						_											<del>                                     </del>	+
	ridual air supply spacer (with M5 female thread for F10	+	+						_											-	+
	vidual air supply spacer (with Ni5 ternale thread for F10 vidual air supply spacer (with $\phi$ 6 fitting for F15	_	+																		+
	vidual air supply spacer (with $\phi$ 6 litting for F15 vidual air supply spacer (with $\phi$ 8 fitting for F15		+								-										+
		_	-								-										+
	vidual exhaust spacer (with M5 female thread for F10	-	+-			_			_		-			_						-	+
	vidual exhaust spacer (with $\phi$ 6 fitting for F15	_	-								-										+
NR8 Ind	vidual exhaust spacer (with $\phi$ 8 fitting for F15	7 [	1																	<u> </u>	L

- Notes:1. Cannot be mounted on the external pilot manifold.
  2. Cannot be mounted on the internal pilot manifold.
  3. To designate a manual override lever, enter () in the manual override boxes of the designated station in the above table.

  When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39.

  4. When the manifold outlet specifications are L (with selectable fitting), select fitting specification for each station, and enter () in the manifold fitting specification boxes of the above table.

  The 3-port specifications are only available in valve specification T0, T1, and T2.

  5. When mounting the individual air supply or exhaust spacer or stop valve, enter () in the spacer or stop valve boxes of the designated stations in the above table.

  - the above table.

    6. Not available in the vacuum valves.

    7. Not available in external pilot type and vacuum valves.

    8. When mounting the back pressure prevention valve, enter O in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer and vacuum valve.

    9. Not available in low-current type.

    10. Not available in low-current type and tandem 3-port valves.

    11. Only for Wring specification -39 \( \)

    12. Only for \( \text{F15} \) series and not available for valve specification \( \text{T11}, \text{T14}, \text{T16}, \text{T16}, \text{T16} \)

    13. Not available with DiN connectors (-39 \( \text{T15}). \)

    14. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.

e. iii adaitioii, tiio	14110 10 4000	a orny do a dodbie obieriola iei
Quantity	set	Delivery


**KOGRNEI** 269


Monoblock Manifold A Type (Base Piping Type)

	Order Date Month/	рау/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 1/2**

· Fill in selections inside the thick-lined boxes.

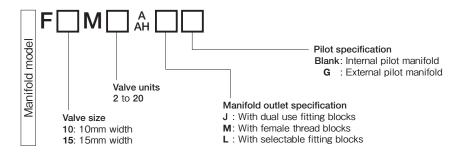

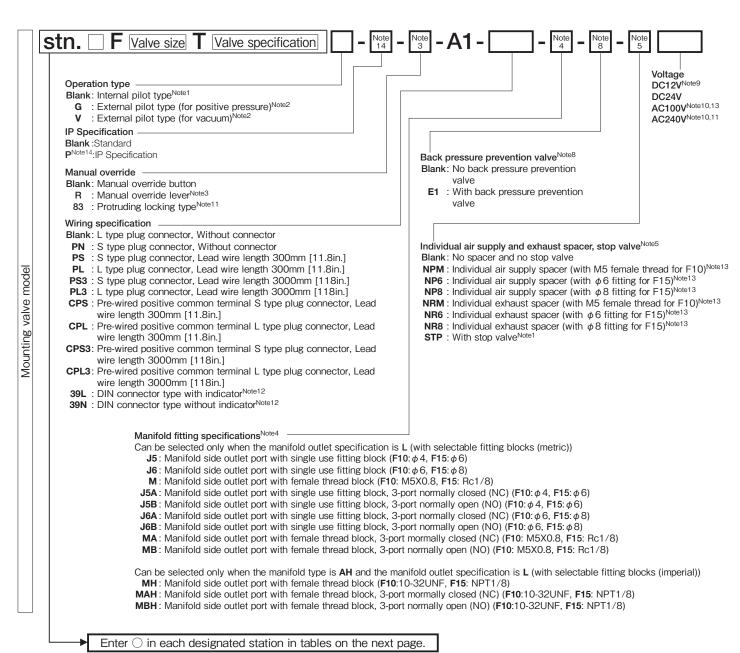

Monoblock Manifold A Type (Base Piping Type)

#### **Specifications Confirmation Form 2/2**

stFor specifying the valve and block-off plate to be mounted at each station, enter  $\odot$  in each applicable box below. 3 5 6 8 9 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 19 20 Mounting valve, block-off plate Station 2-position, for single solenoid only F 🗌 T1 2-position, single solenoid specification F 🗌 T2 2-position, double solenoid specification F 🗌 T3 3-position, closed center F T4<sup>Note6</sup> 3-position, exhaust center F ☐ T5<sup>Note6</sup> 3-position, pressure center F ☐ TA<sup>Note7</sup> Tandem 3-port (NC and NC) F ☐ TB<sup>Note7</sup> Tandem 3-port (NO and NO) F ☐ TC<sup>Note7</sup> Tandem 3-port (NC and NO) F 🗌 LT0 (Low current type) 2-position, for single solenoid only F 🗌 LT1 (Low current type) 2-position, single solenoid specification F 🗌 LT2 (Low current type) 2-position, double solenoid specification F III LT3 (Low current type) 3-position, closed center F \_ LT4<sup>Note6</sup> (Low current type) 3-position, exhaust center **F** LT5<sup>Note6</sup> (Low current type) 3-position, pressure center F ☐ LTA<sup>Note7</sup> (Low current type) Tandem 3-port (NC and NC) F ☐ LTB<sup>Note7</sup> (Low current type) Tandem 3-port (NO and NO) Mounting valve models F LTCNote7 (Low current type) Tandem 3-port (NC and NO) F 🗌 BP Block-off plate P Note14 IP Specification Manual override lever Note3 Manual override Protruding locking type<sup>Note11</sup> With single use fitting block With single use fitting block М With female thread block J5A With single use fitting block, 3-port normally closed (NC) J5B With single use fitting block, 3-port normally open (NO) Manifold fitting J6A With single use fitting block, 3-port normally closed (NC) specification Note (Manifold side J6B With single use fitting block, 3-port normally open (NO) outlet port) With female thread block, 3-port normally closed (NC) With female thread block, 3-port normally open (NO) MB MH With female thread block MAH With female thread block, 3-port normally closed (NC) MBH With female thread block, 3-port normally open (NO) E1 Note8 Back pressure prevention valve Individual air supply spacer (with M5 female thread for F10) NP6 Individual air supply spacer (with  $\phi$  6 fitting for F15) NP8 Individual air supply spacer (with  $\phi$  8 fitting for F15) NRM Individual exhaust spacer (with M5 female thread for F10) NR6 Individual exhaust spacer (with  $\phi$  6 fitting for F15) NR8 Individual exhaust spacer (with  $\phi$  8 fitting for F15)

Notes:1. Cannot be mounted on the external pilot manifold.

- . Cannot be mounted on the internal pilot manifold.
- 3. To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated station in the above table. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39
- 4. When the manifold outlet specifications are L (with selectable fitting), select fitting specification for each station, and enter  $\bigcirc$  in the manifold fitting specification boxes of the above table.

The 3-port specifications are only available in valve specification T0, T1, and T2.

- 5. When mounting the individual air supply or exhaust spacer or stop valve, enter  $\bigcirc$  in the spacer or stop valve boxes of the designated stations in the above table.
- 6. Not available in the vacuum valves.

With stop valve

- 7. Not availabale in external pilot type and vacuum valves.
- 8. When mounting the back pressure prevention valve, enter O in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer and vacuum valve.
- 9. Not available in low-current type.
- 10. Not available in low-current type and tandem 3-port valves.
- 11. Only for wiring specification -39.
  12. Only for F15 series and not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2.
- 13. Not available with DIN connectors (-39 ).
- 14. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.


		,
Quantity	set	Delivery


Monoblock Manifold F Type (Direct Piping Type)

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 1/2**

Fill in selections inside the thick-lined boxes.



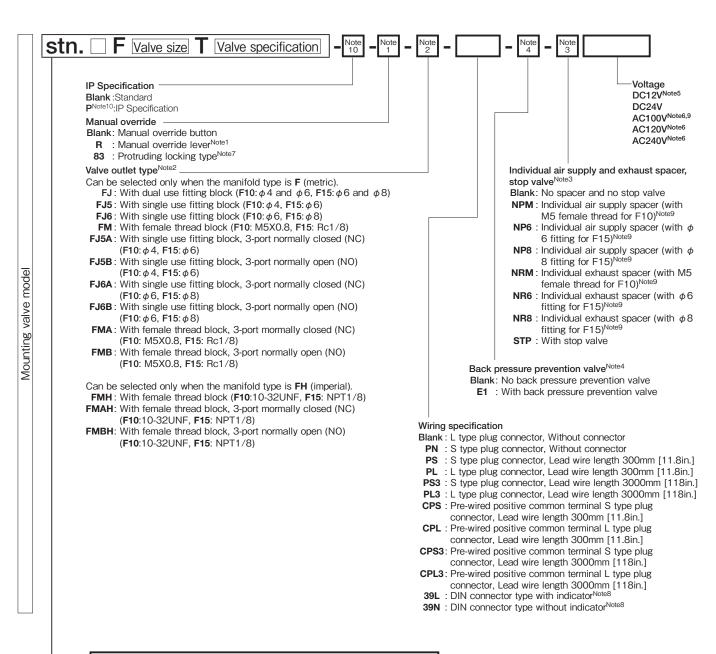

Enter  $\bigcirc$  in each designated station in tables on the next page.

Monoblock Manifold F Type (Direct Piping Type)

## **Specifications Confirmation Form 2/2**

≫ror sp	ecitying the valve and block-off p	nate	to D	e mo	ounte	ea ai	eac	ะท รเ	ation	, en	ter C	) in (	eacn	арр	nicai	ne b	OX D	elow	•		
Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F $\square$ T0	2-position, for single solenoid only																				
F 🗆 T1	2-position, single solenoid specification																				
F □ T2	2-position, double solenoid specification																				
F □ T3	3-position, closed center																				
F □ T4	3-position, exhaust center																				
F 🗆 T5	3-position, pressure center																				
F 🗆 TA	Tandem 3-port (NC and NC)																				
F $\square$ TB	Tandem 3-port (NO and NO)																				
F $\square$ TC	Tandem 3-port (NC and NO)																				
F 🗆 LT0	(Low current type) 2-position, for single solenoid only																				
F 🗆 LT1	(Low current type) 2-position, single solenoid specification																				
F 🗆 LT2	(Low current type) 2-position, double solenoid specification																				
F 🗆 LT3	(Low current type) 3-position, closed center																				
F 🗆 LT4	(Low current type) 3-position, exhaust center																				
F 🗆 LT5	(Low current type) 3-position, pressure center																				
F 🗆 LTA	(Low current type) Tandem 3-port (NC and NC)																				
F 🗆 LTB	(Low current type) Tandem 3-port (NO and NO)																				
F LTC	(Low current type) Tandem 3-port (NC and NO)																				
F 🗆 BP	Block-off plate																				
	IP Specification																				
P Note10  Manual	R Manual override lever <sup>Note1</sup>																				
	83 Protruding locking type <sup>Note7</sup>																				
	FJ With dual use fitting block																				
override	FJ5 With single use fitting block																				
	FJ6 With single use fitting block																				
	FM With female thread block																				
	FJ5A With single use fitting block, 3-port normally closed (NC)																				
Valve	FJ5B With single use fitting block, 3-port normally open (NO)																				
outlet	FJ6A With single use fitting block, 3-port normally closed (NC)																				
type <sup>Note2</sup>	FJ6B With single use fitting block, 3-port normally open (NO)																				
	FMA With female thread block, 3-port normally closed (NC)																				
	FMB With female thread block, 3-port normally open (NO)																				
	FMH With female thread block																				
	FMAH With female thread block, 3-port normally closed (NC)																				
	FMBH With female thread block, 3-port normally open (NO)																				
E1 <sup>Note4</sup> Ba	ack pressure prevention valve																				
NPM Ind	ividual air supply spacer (with M5 female thread for F10)																				
	dividual air supply spacer (with $\phi$ 6 fitting for F15)																				
NP8 Inc	dividual air supply spacer (with $\phi$ 8 fitting for F15)																				
NRM Ind	lividual exhaust spacer (with M5 female thread for F10)																				
	dividual exhaust spacer (with φ 6 fitting for F15)										1										
	dividual exhaust spacer (with φ 8 fitting for F15)										1										
	ith stop valve																				
			1	1			1	I	I	1	1	1		1	1	1	1	1	I	1	1

Notes:1.To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated station in the above table. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39

2. Select valve outlet type for each station, and enter O in the valve outlet type boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.

- 3. When mounting the individual air supply or exhaust spacer or stop valve, enter 🔾 in the spacer or stop valve boxes of the designated stations in the above table.
- 4. When mounting the back pressure prevention valve, enter  $\bigcirc$  in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer. 5. Not available in low-current type.
- 6. Not available in low-current type and tandem 3-port valves.
- 7. Only for wiring specification -39
- 8. Only for **F15** series and not available for valve specification **T1**, **TA**, **TB**, and **TC**. In addition, the valve is used only as a double solenoid for **T2**. 9. Not available with DIN connectors (-39□).

10. The IP protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.


Quantity	set	Delivery


Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type)

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 1/2**

Fill in selections inside the thick-lined boxes.

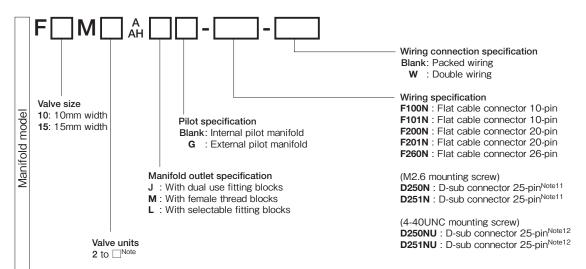

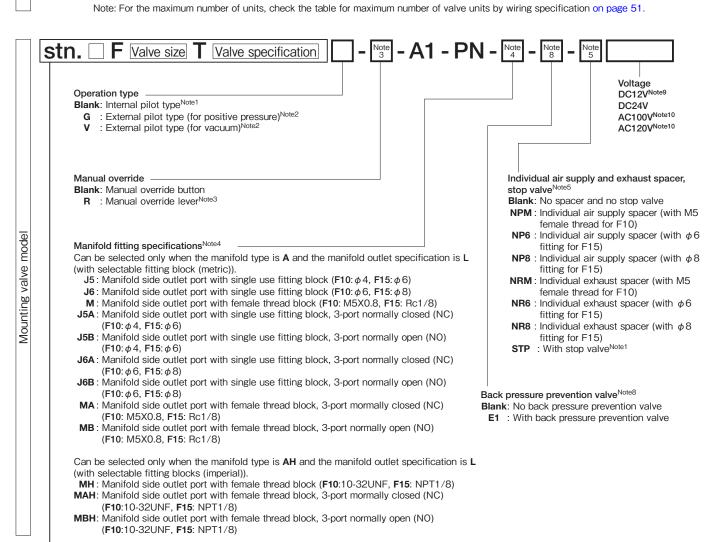

Enter  $\bigcirc$  in each designated station in tables on the next page.

# SPECIFICATION CHECK SHEE

#### F10, F15 Series

Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type)

#### **Specifications Confirmation Form 2/2**

stFor specifying the valve and block-off plate to be mounted at each station, enter  $\odot$  in each applicable box below. 3 6 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 19 20 Mounting valve, block-off plate Station 2-position, for single solenoid only F 🗌 T1 2-position, single solenoid specification F 🗌 T2 2-position, double solenoid specification F 🗌 T3 3-position, closed center F T4<sup>Note6</sup> 3-position, exhaust center F ☐ T5<sup>Note6</sup> 3-position, pressure center F ☐ TA<sup>Note7</sup> Tandem 3-port (NC and NC) F ☐ TB<sup>Note7</sup> Tandem 3-port (NO and NO) F ☐ TC<sup>Note7</sup> Tandem 3-port (NC and NO) F 🗌 LT0 (Low current type) 2-position, for single solenoid only F 🗌 LT1 (Low current type) 2-position, single solenoid specification F 🗌 LT2 (Low current type) 2-position, double solenoid specification F III LT3 (Low current type) 3-position, closed center F \_ LT4<sup>Note6</sup> (Low current type) 3-position, exhaust center F LT5<sup>Note6</sup> (Low current type) 3-position, pressure center  $\mathbf{F} \ \square \ \mathbf{LTA}^{\mathrm{Note7}}$  (Low current type) Tandem 3-port (NC and NC) Mounting valve models F ☐ LTB<sup>Note7</sup> (Low current type) Tandem 3-port (NO and NO) F LTCNote7 (Low current type) Tandem 3-port (NC and NO) F 🗌 BP Block-off plate Manual override (-R) Manual override lever Note3 With single use fitting block With single use fitting block With female thread block J5A With single use fitting block, 3-port normally closed (NC) J5B With single use fitting block, 3-port normally open (NO) Manifold fitting J6A With single use fitting block, 3-port normally closed (NC) specification-Note4 (Manifold J6B With single use fitting block, 3-port normally open (NO) side outlet port) With female thread block, 3-port normally closed (NC) With female thread block, 3-port normally open (NO) With female thread block MAH With female thread block, 3-port normally closed (NC) MBH With female thread block, 3-port normally open (NO) E1 Note8 Back pressure prevention valve

Notes:1 Cannot be mounted on the external pilot manifold

- Cannot be mounted on the internal pilot manifold.
- 3. To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated station in the above table.

When the valve specification is T1 or T2, the manual override lever is placed only on the A side

4. When the manifold outlet specifications are L (with selectable fitting), select fitting specification for each station, and enter  $\bigcirc$  in the manifold fitting specification boxes of the above table.

The 3-port specifications are only available in valve specification T0, T1, and T2.

- 5. When mounting the individual air supply or exhaust spacer or stop valve, enter O in the spacer or stop valve boxes of the designated stations in the above table.
- Not available in the vacuum valves.

NPM Individual air supply spacer (with M5 female thread for F10) Individual air supply spacer (with  $\phi$  6 fitting for F15)

Individual air supply spacer (with  $\phi$  8 fitting for F15) NRM Individual exhaust spacer (with M5 female thread for F10)

Individual exhaust spacer (with  $\phi$  6 fitting for F15)

Individual exhaust spacer (with  $\phi$  8 fitting for F15)

NP8

NR6

NR8

STP

- Not availabale in external pilot type and vacuum valves.
- 8. When mounting the back pressure prevention valve, enter O in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer and vacuum valve.
- 9. Not available in low-current type.
- 10. Not available in low-current type and tandem 3-port valves. In addtion, only available when the wiring specification is a D-sub connector.
- 11. Can be selected only when the manifold type is A.
- 12. Can be selected only when the manifold type is AH.


Quantity	set	Delivery


Monoblock Manifold F Type, Wire-Saving Type (Direct Piping Type)

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 1/2**

· Fill in selections inside the thick-lined boxes.

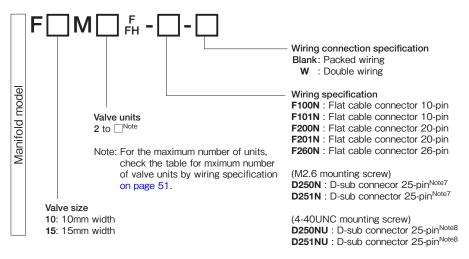

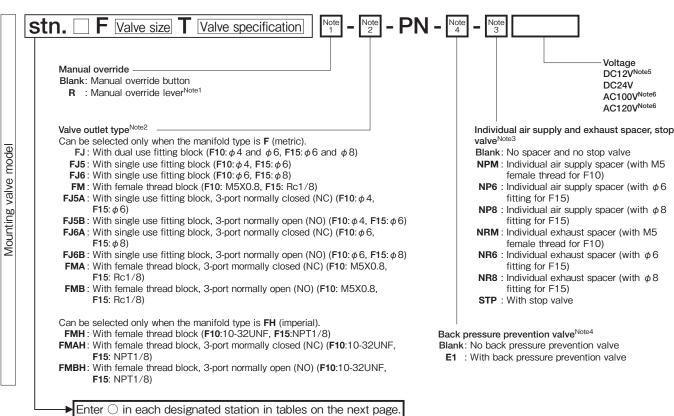

# SPECIFICATION CHECK SHEET

#### F10, F15 Series

Monoblock Manifold F Type Wire-Saving Type (Direct Piping Type)

## **Specifications Confirmation Form 2/2**

stFor specifying the valve and block-off plate to be mounted at each station, enter  $\odot$  in each applicable box below. 3 5 6 8 10 | 11 | 12 | 13 | 14 | 19 20 Mounting valve, block-off plate Station 2-position, for single solenoid only F 🗌 T1 2-position, single solenoid specification F 🗌 T2 2-position, double solenoid specification F 🗌 T3 3-position, closed center F □ T4 3-position, exhaust center F 🗌 T5 3-position, pressure center F  $\square$  TA Tandem 3-port (NC and NC) F □ TB Tandem 3-port (NO and NO) F  $\square$  TC Tandem 3-port (NC and NO) F 🗌 LT0 (Low current type) 2-position, for single solenoid only F 🗌 LT1 (Low current type) 2-position, single solenoid specification F 🗌 LT2 (Low current type) 2-position, double solenoid specification F LT3 (Low current type) 3-position, closed center F 🗌 LT4 (Low current type) 3-position, exhaust center F 🗌 LT5 (Low current type) 3-position, pressure center F 🗌 LTA (Low current type) Tandem 3-port (NC and NC)  $\mathsf{F} \; \square \; \mathsf{LTB}$ (Low current type) Tandem 3-port (NO and NO) Mounting valve model F 🗌 LTC (Low current type) Tandem 3-port (NC and NO) F 🗌 BP Block-off plate Manual override (-R) Manual override leverNote1 With dual use fitting block FJ5 With single use fitting block FJ6 With single use fitting block FM With female thread block FJ5A With single use fitting block, 3-port normally closed (NC) FJ5B With single use fitting block, 3-port normally open (NO) Valve outlet FJ6A With single use fitting block, 3-port normally closed (NC) type<sup>Note2</sup> FJ6B With single use fitting block, 3-port normally open (NO) With female thread block, 3-port normally closed (NC) **FMB** With female thread block, 3-port normally open (NO) FMH With female thread block FMAH With female thread block, 3-port normally closed (NC) FMBH With female thread block, 3-port normally open (NO) E1 Note4 Back pressure prevention valve NPM Individual air supply spacer (with M5 female thread for F10) NP6 Individual air supply spacer (with  $\phi$  6 fitting for F15) NP8 Individual air supply spacer (with  $\phi$  8 fitting for F15) NRM Individual exhaust spacer (with M5 female thread for F10)

Notes:1. To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated station in the above table.

When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

2. Select valve outlet type for each station, and enter  $\bigcirc$  in the valve outlet type boxes of the above table. In addition, the 3-port specifications are only available in valve specifications T0, T1, and T2.

3. When mounting the individual air supply or exhaust spacer or stop valve, enter O in the spacer or stop valve boxes of the designated stations in the above table.

4. When mounting the back pressure prevention valve, enter in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.

5. Not available in low-current type.

Individual exhaust spacer (with  $\phi$  6 fitting for F15)

Individual exhaust spacer (with  $\phi$  8 fitting for F15)

NR6

NR8

With stop valve

6. Not available in low-current type and tandem 3-port valves. In addtion, only available when the wiring specification is a D-sub connector.

7. Can be selected only when the manifold type is F.

8. Can be selected only when the manifold type is F.


Quantity	set	Delivery


PC Board Manifold A Type (Base Piping Type)

	Order Date Month/	Day/	rear/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 1/2**

Fill in selections inside the thick-lined boxes.

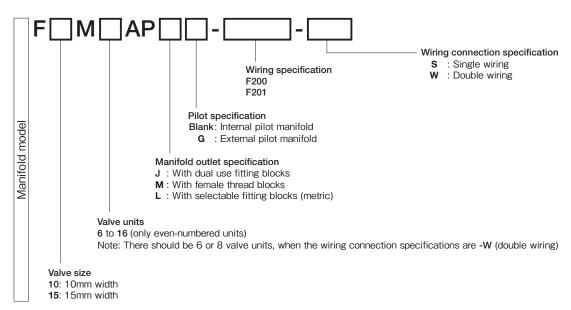

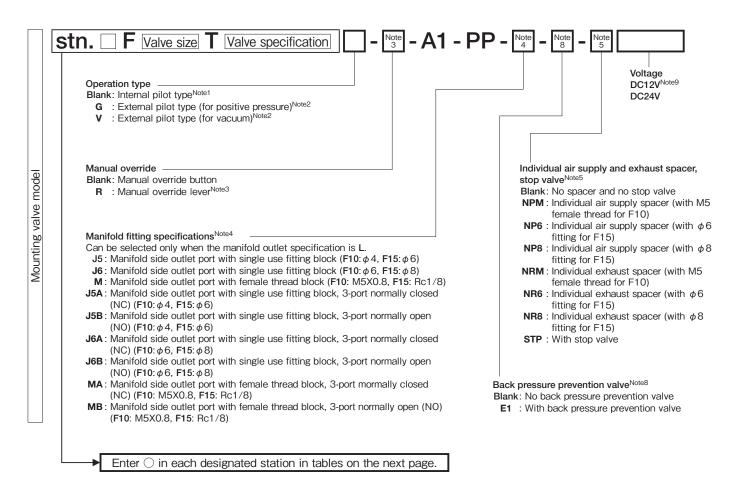

PC Board Manifold A Type (Base Piping Type)

## **Specifications Confirmation Form 2/2**

Wiring connection specifications are -S (for single wiring)

※For specifying the valve and block-off plate to be mounted at each station, enter ○ in each applicable box below.

tion 1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
on															
only															
ation															
(NC)															
(NO)															
(NC)															
(NO)															
(NC)															
(NO)															
F10)															
15)															
15)															
-15)															
15)															
	on only attion   1	on only attion	On only ation   I (NC)   I (NC	On only ation	On only altion	On only altion	On only altion								

Caution: Valve units can be selected from only the even-numbered units between 6 and 16.

Wiring connection specifications are -W (for double wiring)

Mounting valve, block-off plate

Mounting valve models

stFor specifying the valve and block-off plate to be mounted at each station, enter  $\bigcirc$  in each applicable box below. Station 1 2 3 4 5 6 7 8

111001111111111111111111111111111111111		otation	-	 _	 	_	 _
F 🗌 T0	2-pos	sition, for single solenoid only					
F 🗌 T1		sition, single solenoid specification					
F 🗌 T2	2-pos	sition, double solenoid specification					
F 🗌 T3		sition, closed center					
F  T4 <sup>Note</sup>	<sup>6</sup> 3-pos	sition, exhaust center					
F  T5 <sup>Note</sup>	<sup>6</sup> 3-pos	sition, pressure center					
F   TA <sup>Note</sup>	<sup>7</sup> Tand	em 3-port (NC and NC)					
F TB <sup>Note</sup>	<sup>7</sup> Tand	em 3-port (NO and NO)					
		em 3-port (NC and NO)					
F 🗌 LT0		urrent type) 2-position, for single solenoid only					
F 🗌 LT1		rrent type) 2-position, single solenoid specification					
F 🗌 LT2		rrent type) 2-position, double solenoid specification					
F LT3		current type) 3-position, closed center					
F LT4 <sup>Not</sup>	e6 (Low o	current type) 3-position, exhaust center					
		current type) 3-position, pressure center					
F LTANot	e/ (Low c	current type) Tandem 3-port (NC and NC)					
F LTB <sup>Not</sup>	te/(Low c	current type) Tandem 3-port (NO and NO)					
		current type) Tandem 3-port (NC and NO)					
F 🗌 BPC		c-off plate					
Manual ov		-R) Manual override lever Note3					
	J5	With single use fitting block					
	J6	With single use fitting block					
Manifold fitting	M	With female thread block					
specification-	J5A	With single use fitting block, 3-port normally closed (NC)					
Note4 (Manifold	J5B	With single use fitting block, 3-port normally open (NO)					
side outlet port)	J6A	With single use fitting block, 3-port normally closed (NC)					
	J6B	With single use fitting block, 3-port normally open (NO)					
	MA	With female thread block, 3-port normally closed (NC)					
= 4 Noto 9 D	MB	With female thread block, 3-port normally open (NO)					
		sure prevention valve					
		supply spacer (with M5 female thread for F10)					
		supply spacer (with $\phi$ 6 fitting for F15)					_
		supply spacer (with $\phi$ 8 fitting for F15)					
		aust spacer (with M5 female thread for F10)					
		chaust spacer (with $\phi$ 6 fitting for F15)					
		naust spacer (with φ 8 fitting for F15)					
STP Wit	n stop v	valve <sup>Note1</sup>					

Caution: There should be either 6 and 8 valves

- Notes: 1. Cannot be mounted on the external pilot manifold.
  - 2. Cannot be mounted on the internal pilot manifold.
  - 3. To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated station in the left table.
  - 4. When the manifold outlet specifications are  ${\bf L}$ (with selectable fitting), select fitting specification for each station, and enter  $\bigcirc$  in the manifold fitting specification boxes of the left
    - The 3-port specifications are only available in valve specification T0, T1, and T2.
  - 5. When mounting the individual air supply or exhaust spacer or stop valve, enter \( \cap \) in the spacer or stop valve boxes of the designated stations in the left table.
  - 6. Not available wiith vacuum valves.
  - 7. Not availabale in external pilot type and vacuum
  - 8. When mounting the back pressure prevention valve, enter  $\bigcirc$  in the back pressure prevention valve boxes of the designated stations in the left table. Not available with the individual exhaust spacer and vacuum valve.
  - 9. Not available in low-current type.


Quantity set Delivery


PC Board Manifold F Type (Direct Piping Type)

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 1/2**

Fill in selections inside the thick-lined boxes.

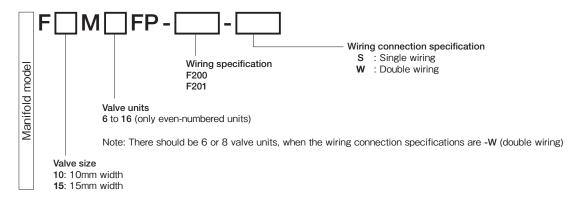

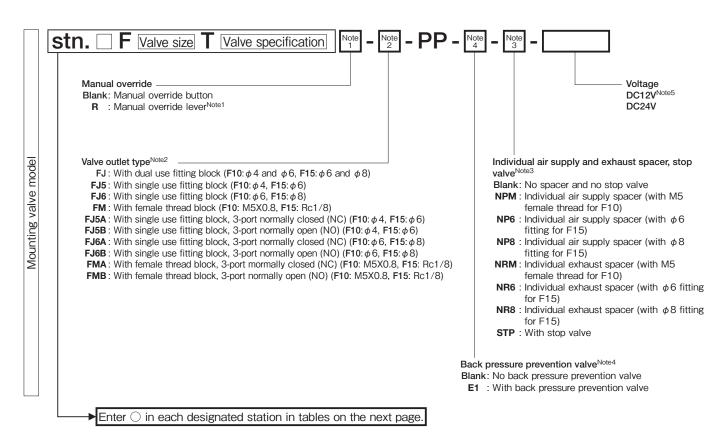

PC Board Manifold F Type (Direct Piping Type)

## **Specifications Confirmation Form 2/2**

Wiring connection specifications are -S (for single wiring)

※For specifying the valve and block-off plate to be mounted at each station, enter ○ in each applicable box below.

Mounting v	alve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
F 🗌 T0	2-position, for single solenoid only																
F 🗌 T1	2-position, single solenoid specification																
	Low current type) 2-position, for single solenoid only																
	Low current type) 2-position, single solenoid specification																
	Block-off plate																
Manual ove	erride (-R) Manual override lever <sup>Note1</sup>																
	FJ With dual use fitting block																
	FJ5 With single use fitting block																
	FJ6 With single use fitting block																
Valve	F With female thread block																
outlet	J5A With single use fitting block, 3-port normally closed (NC)																
type <sup>Note2</sup>	J5B With single use fitting block, 3-port normally open (NO)																
type	J6A With single use fitting block, 3-port normally closed (NC)																
	J6B With single use fitting block, 3-port normally open (NO)																
	MA With female thread block, 3-port normally closed (NC)																
	MB With female thread block, 3-port normally open (NO)																
	k pressure prevention valve																
NPM Individ	dual air supply spacer (with M5 female thread for F10)																
NP6 Indivi	dual air supply spacer (with $\phi$ 6 fitting for F15)																
NP8 Indiv	dual air supply spacer (with $\phi$ 8 fitting for F15)																
NRM Indivi	dual exhaust spacer (with M5 female thread for F10)																
NR6 Indiv	idual exhaust spacer (with $\phi$ 6 fitting for F15)																
NR8 Indiv	idual exhaust spacer (with $\phi$ 8 fitting for F15)																
STP With	stop valve																

Caution: Valve units can be selected from only the even-numbered units between 6 and 16.

Wiring connection specifications are -W (for double wiring)

Mounting valve models

\*\*For specifying the valve and block-off plate to be mounted at each station, enter () in each applicable box below.

| Mounting valve, block-off plate | Station | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | |

F 🗌 T0	2-position, for single solenoid only
F 🗌 T1	2-position, single solenoid specification
F 🗌 T2	2-position, double solenoid specification
F 🗌 T3	3-position, closed center
F 🗌 T4	3-position, exhaust center
F 🗌 T5	3-position, pressure center
F 🗌 TA	Tandem 3-port (NC and NC)
F 🗌 TB	Tandem 3-port (NO and NO)
F 🗆 TC	Tandem 3-port (NC and NO)
F 🗌 LT0	(Low current type) 2-position, for single solenoid only
F 🗌 LT1	(Low current type) 2-position, single solenoid specification
F 🗌 LT2	(Low current type) 2-position, double solenoid specification
F 🗌 LT3	(Low current type) 3-position, closed center
F 🗌 LT4	(Low current type) 3-position, exhaust center
F 🗌 LT5	(Low current type) 3-position, pressure center
F 🗌 LTA	(Low current type) Tandem 3-port (NC and NC)
F 🗌 LTB	(Low current type) Tandem 3-port (NO and NO)
F 🗆 LTC	(Low current type) Tandem 3-port (NC and NO)
F 🗌 BPC	Block-off plate
Manual ov	erride (-R) Manual override lever <sup>Note1</sup>
	FJ With dual use fitting block
	FJ5 With single use fitting block
	J6 With single use fitting block
Valve	FM With female thread block
outlet	FJ5A With single use fitting block, 3-port normally closed (NC)
type <sup>Note2</sup>	FJ5B With single use fitting block, 3-port normally open (NO)
Type	FJ6A With single use fitting block, 3-port normally closed (NC)
	FJ6B With single use fitting block, 3-port normally open (NO)
	FMA With female thread block, 3-port normally closed (NC)
	FMB With female thread block, 3-port normally open (NO)
	ck pressure prevention valve
	idual air supply spacer (with M5 female thread for F10)
	vidual air supply spacer (with φ 6 fitting for F15)
	vidual air supply spacer (with φ 8 fitting for F15)
NRM Indiv	ridual exhaust spacer (with M5 female thread for F10)
NR6 Indi	vidual exhaust spacer (with $\phi$ 6 fitting for F15)
NR8 Indi	vidual exhaust spacer (with φ 8 fitting for F15)
STP Wit	h stop valve

Caution: There should be either 6 and 8 valves units

- Notes:1. To designate a manual override lever, enter O in the manual override boxes of the designated station in the left table.
  - Select fitting for each station, and enter in the valve outlet type boxes of the above table. In addition, the 3-port specifications are only available in valve specifications T0, T1, and T2.
  - When mounting the individual air supply or exhaust spacer or stop valve, enter 
    in the spacer or stop valve boxes of the designated stations in the left table.
  - When mounting the back pressure prevention valve, enter 

    in the back pressure prevention valve boxes of the designated stations in the left table.
  - 5. Not available in low-current type.

Quantity	set	Delivery
----------	-----	----------

Split Manifold Non-Plug-in Type

# Specifications Confirmation Form 1/2

	1
Contact person	
Order No.	


Order Date Month/


Company name

Day/

Year/

· Fill in selections inside the thick-lined boxes.

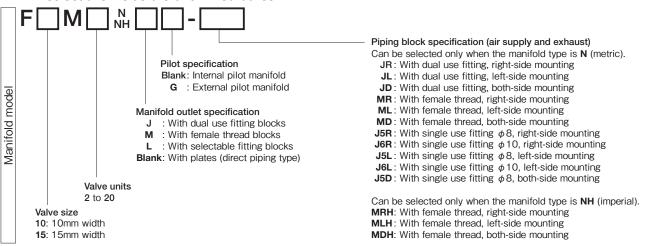

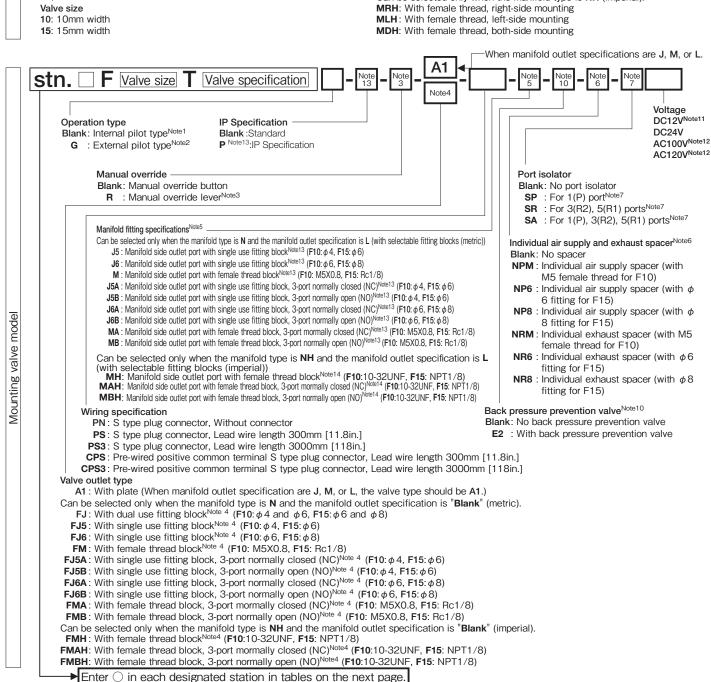

Split Manifold Non-Plug-in Type

## **Specifications Confirmation Form 2/2**

	ecifying the valve and block-off p	olate	to b	e mo	ounte	ed at	eac	h sta	ation	, ent	ter C	in e	each	арр	licak	ole b	ox b	elow			
	valve, block-off plate Station	1	2	3	4	5	6	7	8	9		11		13			16	17	18	19	20
F $\square$ T0	2-position, for single solenoid only			_	Ť	_	Ť	-													
F □ T1	2-position, single solenoid specification																				
F □ T2	2-position, double solenoid specification																				
F □ T3	3-position, closed center																				
F □ T4	3-position, exhaust center																				_
F □ T5	3-position, pressure center																				
	e9 Tandem 3-port (NC and NC)																				$\overline{}$
	te9 Tandem 3-port (NO and NO)																				_
	te9 Tandem 3-port (NC and NO)																				
F LT0	(Low current type) 2-position, for single solenoid only																				_
F LT1	(Low current type) 2-position, for single solenoid specification																				_
F LT2	(Low current type) 2-position, single solenoid specification																				_
F LT3	(Low current type) 3-position, closed center																				
F □ LT4																					
	(Low current type) 3-position, exhaust center																				<u> </u>
F LTANG	(Low current type) 3-position, pressure center (Low current type) Tandem 3-port (NC and NC)	-	-		_								_								
	ote9 (Low current type) Tandem 3-port (NC and NC)																				
F BPN	Clow current type) Tandem 3-port (NC and NO)												-								
P Note13	Block-off plate																				
11.	IP Specification verride (-R) Manual override lever <sup>Note3</sup>		-		_								_								
Iviariuai ov	FJ With dual use fitting block																				$\vdash$
ω    o	FJ5 With single use fitting block		1																		
<u> </u>																					_
	FJ6 With single use fitting block FM With female thread block																				<u> </u>
	FJ5A With single use fitting block, 3-port normally closed (NC)		1																		
<u> </u>																					-
ਰ Valve	FJ5B With single use fitting block, 3-port normally open (NO) FJ6A With single use fitting block, 3-port normally closed (NC)																				<u> </u>
outlet type <sup>Note4</sup>	FJ6B With single use fitting block, 3-port normally closed (NO)																				
≣   <sup>type</sup>	FMA With female thread block, 3-port normally closed (NC)																				
الخ	FMB With female thread block, 3-port normally closed (NO)				_								_								
Valve outlet type <sup>Note4</sup>	FMH With female thread block																				
	FMAH With female thread block, 3-port normally closed (NC)																				
	FMBH With female thread block, 3-port normally open (NO)																				
	J5 With single use fitting block																				
	J6 With single use fitting block																				
	M With female thread block																				
	J5A With single use fitting block, 3-port normally closed (NC)				-								-								
Marifold follow	J5B With single use fitting block, 3-port normally open (NO)																				_
Manifold fitting specification-	J6A With single use fitting block, 3-port normally closed (NC)																				
Note5 (Manifold	J6B With single use fitting block, 3-port normally closed (NO)																				
side outlet port)	MA With female thread block, 3-port normally closed (NC)				-								-								
	MB With female thread block, 3-port normally open (NO)				_								_								
	MH With female thread block																				
	MAH With female thread block, 3-port normally closed (NC)												_								
	MBH With female thread block, 3-port normally open (NO)												_								
E2Note10 F	Back pressure prevention valve																				
	ndividual air supply spacer (with M5 female thread for F10)																				
	ndividual air supply spacer (with $\phi$ 6 fitting for F15)																				
	ndividual air supply spacer (with $\phi$ 8 fitting for F15)																				
	ndividual exhaust spacer (with M5 female thread for F10)		1																		
	ndividual exhaust spacer (with $\phi$ 6 fitting for F15)		1																		
	ndividual exhaust spacer (with $\phi$ 8 fitting for F15)																				
	tor (-SP) For 1(P) port <sup>Note8</sup>																				
	tor (-SR) For 3(R2), 5(R1) ports <sup>Note8</sup>		1																		
Port isolate	or (-SA) For 1(P), 3(R2), 5(R1) ports <sup>Note8</sup>																				
	annot be mounted on the external nilot		r . I .I																		

Notes: 1. Cannot be mounted on the external pilot manifold.

- 2. Cannot be mounted on the internal pilot manifold.
  3. To designate a manual override lever, enter in the manual override boxes of the designated stations in the above table.
  4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter in the valve outlet type boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.
- 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter O in the manifold fitting specification boxes of the above table.
  - The 3-port specifications are only available in valve specifications T0, T1, and T2.

- 6. When mounting the individual air supply or exhaust spacer, enter in the spacer boxes of the designated stations in the above table.

  7. To designate a port isolator, enter in one box of the designated stations in the above table.


  8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).
- 9. Not availabale in external pilot type.
- 10. When mounting the back pressure prevention valve, enter O in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer. Quantity set Delivery
- 11. Not available in low-current type.
- 12. Not available in low-current type and tandem 3-port valves.
- 13. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.


Split Manifold Plug-in Type

# Specifications Confirmation Form 1/2

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

· Fill in selections inside the thick-lined boxes.

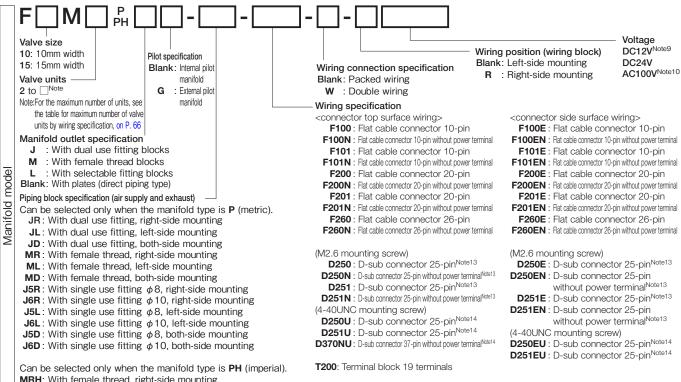

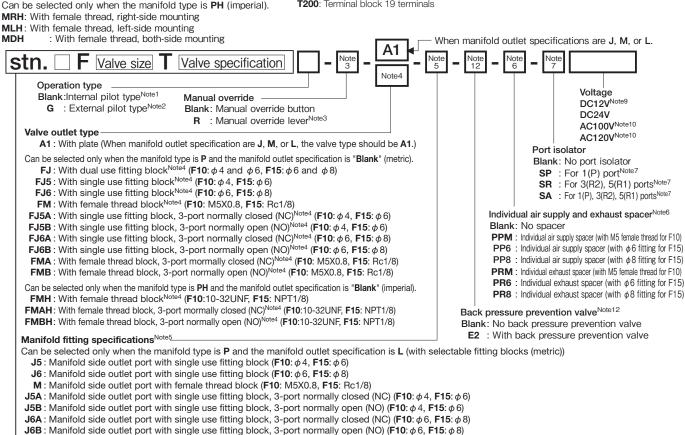

MA: Manifold side outlet port with female thread block, 3-port mormally closed (NC) (F10: M5X0.8, F15: Rc1/8) MB: Manifold side outlet port with female thread block, 3-port normally open (NO) (F10: M5X0.8, F15: Rc1/8)

MAH: Manifold side outlet port with female thread block, 3-port mormally closed (NC) (F10:10-32UNF, F15: NPT1/8)

MBH: Manifold side outlet port with female thread block, 3-port normally open (NO) (F10:10-32UNF, F15: NPT1/8)

MH: Manifold side outlet port with female thread block (F10:10-32UNF, F15: NPT1/8)

Enter  $\bigcirc$  in each designated station in tables on the next page

Can be selected only when manifold type is PH and manifold outlet specification is L (with selectable fitting blocks (imperial))

Mounting valve mode

Split Manifold Plug-in Type

## **Specifications Confirmation Form 2/2**

 $\mathbb{R}$   $\mathbb{R}$ 

Mounting valve, block-off plate	19	20
F□T0 2-position, for single solenoid specification F□T1 2-position, double solenoid specification F□T2 2-position, closed center F□T3 3-position, closed center F□T4 3-position, persure center F□T5 3-position, pressure center F□T6, Note11 Tandem 3-port (NC and NC) F□T8, Note11 Tandem 3-port (NC and NO) F□TC, Note11 Tandem 3-port (NC and NO) F□LT0 (Low current type) 2-position, for single solenoid only F□LT1 (Low current type) 2-position, for single solenoid specification F□LT2 (Low current type) 2-position, closed center F□LT3 (Low current type) 3-position, closed center F□LT5 (Low current type) 3-position, closed center F□LT5 (Low current type) 3-position, closed center F□LT6 (Low current type) 3-position, exhaust center F□LT7 (Low current type) 3-position, persure center F□LT8 (Low current type) 3-position, persure center F□LTB, Note11 (Low current type) 3-position, persure center F□LTB, Not		
F T1 2-position, single solenoid specification F T2 2-position, double solenoid specification F T3 3-position, closed center F T4 3-position, exhaust center F T5 3-position, pressure center F T5 3-position, pressure center F T6 TANotell Tandem 3-port (NC and NC) F T6Notell Tandem 3-port (NC and NO) F T70Notell Tandem 3-port (NC and NO) F T70 (Low current type) 2-position, for single solenoid only F LT1 (Low current type) 2-position, for single solenoid specification F LT2 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, exhaust center F LT6 (Low current type) 3-position, pressure center F LT7 (Low current type) Tandem 3-port (NC and NC) F LT7 (Low current type) Tandem 3-port (NC and NO) F LT7 (Low current type) Tandem 3-port (NC and NO) F LT7 (Low current type) Tandem 3-port (NC and NO) F LT7 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever (Notes) F With dual use fitting block		
F T2 2-position, double solenoid specification F T3 3-position, closed center F T4 3-position, exhaust center F T5 3-position, pressure center F T5 3-position, pressure center F T6 T8 Apole 11 Tandem 3-port (NC and NC) F T7 Revier 11 Tandem 3-port (NC and NO) F T0 (Low current type) 2-position, for single solenoid only F LT0 (Low current type) 2-position, for single solenoid specification F LT1 (Low current type) 2-position, double solenoid specification F LT2 (Low current type) 3-position, closed center F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, closed center F LT5 (Low current type) 3-position, pressure center F LT5 (Low current type) 3-position, pressure center F LT6 Note 11 (Low current type) 3-position, pressure center F LT7 (Low current type) 3-position, pressure center F LT7 (Low current type) 3-position, pressure center F LT8 Note 11 (Low current type) Tandem 3-port (NC and NC) F LT7 Note 11 (Low current type) Tandem 3-port (NC and NO) F LT7 Note 11 (Low current type) Tandem 3-port (NC and NO) F LT7 Note 11 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever Note 3 FJ With dual use fitting block		
F T3 3-position, closed center F T4 3-position, exhaust center F T5 3-position, pressure center F TANote11 Tandem 3-port (NC and NC) F TBNote11 Tandem 3-port (NC and NO) F TCNote11 Tandem 3-port (NC and NO) F LTO (Low current type) 2-position, for single solenoid only F LT1 (Low current type) 2-position, for single solenoid specification F LT2 (Low current type) 2-position, closed center F LT3 (Low current type) 3-position, chaust center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, pressure center F LT6 (Low current type) 3-position, pressure center F LT7 (Low current type) 3-position, pressure center F LT8 (Low current type) 3-position, pressure center F LT8 (Low current type) Tandem 3-port (NC and NC) F LT8 Note11 (Low current type) Tandem 3-port (NC and NO) F LTC Note11 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever Note3 FJ With dual use fitting block		
F T4 3-position, exhaust center F T5 3-position, pressure center F T5 3-position, pressure center F T5 3-position, pressure center F T6 TANote11 Tandem 3-port (NC and NC) F T7 T8 Tandem 3-port (NC and NO) F T7 T6 T0 (Low current type) 2-position, for single solenoid only F LT0 (Low current type) 2-position, for single solenoid specification F LT1 (Low current type) 3-position, closed center F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, pressure center F LT6 (Low current type) 3-position, pressure center F LT7 (Low current type) Tandem 3-port (NC and NC) F LT8 (Low current type) Tandem 3-port (NC and NO) F LT7 (Low current type) Tandem 3-port (NC and NO) F LT7 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever Note3 FJ With dual use fitting block		
F T5 3-position, pressure center F TANote11 Tandem 3-port (NC and NC) F TBNote11 Tandem 3-port (NO and NO) F TCNote11 Tandem 3-port (NC and NO) F TC Course (Low current type) 2-position, for single solenoid only F LT1 (Low current type) 2-position, for single solenoid specification F LT2 (Low current type) 3-position, closed center F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, closed center F LT5 (Low current type) 3-position, pressure center F LT5 (Low current type) 3-position, pressure center F LT6 (Low current type) 3-position, pressure center F LT7 (Low current type) 3-position, pressure center F LT7 (Low current type) 3-position, pressure center F LT7 (Low current type) Tandem 3-port (NC and NC) F LT6 (Low current type) Tandem 3-port (NC and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
F TANote11 Tandem 3-port (NC and NC) F TBNote11 Tandem 3-port (NO and NO) F TC Cole 11 Tandem 3-port (NC and NO) F LTO (Low current type) 2-position, for single solenoid only F LT1 (Low current type) 2-position, single solenoid specification F LT2 (Low current type) 2-position, double solenoid specification F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, persource center F LT6 (Low current type) 3-position, pressure center F LT7 (Low current type) Tandem 3-port (NC and NC) F LT8Note11 (Low current type) Tandem 3-port (NC and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
F TBNote11 Tandem 3-port (NO and NO)  F TC Note11 Tandem 3-port (NC and NO)  F LTO (Low current type) 2-position, for single solenoid only  F LT1 (Low current type) 2-position, single solenoid specification  F LT2 (Low current type) 2-position, double solenoid specification  F LT3 (Low current type) 3-position, closed center  F LT4 (Low current type) 3-position, exhaust center  F LT5 (Low current type) 3-position, pressure center  F LT5 (Low current type) 3-position, pressure center  F LT6 (Low current type) Tandem 3-port (NC and NC)  F LTBNote11 (Low current type) Tandem 3-port (NC and NO)  F LTC Note11 (Low current type) Tandem 3-port (NC and NO)  F LTC Note11 (Low current type) Tandem 3-port (NC and NO)  F BPP Block-off plate  F BPP-1W Block-off plate (wiring for single solenoid)  Manual override (-R) Manual override lever Note3  FJ With dual use fitting block		
F TCNote11 Tandem 3-port (NC and NO) F LT0 (Low current type) 2-position, for single solenoid only F LT1 (Low current type) 2-position, single solenoid specification F LT2 (Low current type) 2-position, double solenoid specification F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, pressure center F LTANote11 (Low current type) Tandem 3-port (NC and NC) F LTBNote11 (Low current type) Tandem 3-port (NO and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
F LTO (Low current type) 2-position, for single solenoid only F LT1 (Low current type) 2-position, single solenoid specification F LT2 (Low current type) 2-position, double solenoid specification F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, pressure center F LTA (Low current type) 3-position, pressure center F LTANote11 (Low current type) Tandem 3-port (NC and NC) F LTBNote11 (Low current type) Tandem 3-port (NO and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
F LT1 (Low current type) 2-position, single solenoid specification F LT2 (Low current type) 3-position, double solenoid specification F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, pressure center F LT5 (Low current type) 3-position, pressure center F LT6 (Low current type) Tandem 3-port (NC and NC) F LT6 (Low current type) Tandem 3-port (NC and NO) F LT7 (Low current type) Tandem 3-port (NC and NO) F LT7 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever (Notes) FJ With dual use fitting block		
F LT2 (Low current type) 2-position, double solenoid specification F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, pressure center F LT5 (Low current type) 3-position, pressure center F LT6 (Low current type) 1-position, pressure center F LT7 (Low current type) 1-position, pressure center F LT6 (Low current type) 1-position, pressure center F LT7 (Low current type) 1-position, pressure center F LT8 (Low current type) 1-position, pressure center F LT8 (Low current type) 2-position, closed center F LT7 (Low current type) 3-position, closed center F LT7 (Low current t		
F LT3 (Low current type) 3-position, closed center F LT4 (Low current type) 3-position, exhaust center F LT5 (Low current type) 3-position, pressure center F LTA (Low current type) 1-position, pressure center F LTB (Low current type) 1-position, pressure center F LTB (Low current type) 1-position, pressure center F LTC Note11 (Low current type) 1-position, pressure center F LTC Note11 (Low current type) 1-position, pressure center F LTD Note11 (Low current type) 1-position, pressur		
F LT4 (Low current type) 3-position, exhaust center  F LT5 (Low current type) 3-position, pressure center  F LTANote11 (Low current type) Tandem 3-port (NC and NC)  F LTBNote11 (Low current type) Tandem 3-port (NO and NO)  F LTCNote11 (Low current type) Tandem 3-port (NC and NO)  F BPP Block-off plate  F BPP-1W Block-off plate (wiring for single solenoid)  Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
F LT5 (Low current type) 3-position, pressure center  F LTA <sup>Note11</sup> (Low current type) Tandem 3-port (NC and NC)  F LTB <sup>Note11</sup> (Low current type) Tandem 3-port (NO and NO)  F LTC <sup>Note11</sup> (Low current type) Tandem 3-port (NC and NO)  F BPP Block-off plate  F BPP-1W Block-off plate (wiring for single solenoid)  Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
F LTA <sup>Note11</sup> (Low current type) Tandem 3-port (NC and NC) F LTB <sup>Note11</sup> (Low current type) Tandem 3-port (NO and NO) F LTC <sup>Note11</sup> (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		$\vdash$
F LTB <sup>Note11</sup> (Low current type) Tandem 3-port (NO and NO)  F LTC <sup>Note11</sup> (Low current type) Tandem 3-port (NC and NO)  F BPP Block-off plate  F BPP-1W Block-off plate (wiring for single solenoid)  Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
F LTCNote11 (Low current type) Tandem 3-port (NC and NO) F BPP Block-off plate F BPP-1W Block-off plate (wiring for single solenoid) Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block	-	₩
F □ BPP       Block-off plate         F □ BPP-1W Block-off plate (wiring for single solenoid)         Manual override (-R) Manual override lever <sup>Note3</sup> FJ       With dual use fitting block		$\vdash$
F □ BPP-1W Block-off plate (wiring for single solenoid)         Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block	$\rightarrow$	<del></del>
Manual override (-R) Manual override lever <sup>Note3</sup> FJ With dual use fitting block		
FJ With dual use fitting block		$\vdash$
		<u> </u>
FJ5 With single use fitting block FJ6 With single use fitting block FM With female thread block FJ5A With single use fitting block, 3-port normally closed (NC)  Valve outlet FJ6A With single use fitting block, 3-port normally open (NO)  FJ6A With single use fitting block, 3-port normally open (NO)  Valve outlet FJ6A With single use fitting block, 3-port normally open (NO)		▙
FJ6 With single use fitting block FM With female thread block FJ5A With single use fitting block, 3-port normally closed (NC)  Valve FJ5B With single use fitting block, 3-port normally closed (NC)  Valve outlet FJ6A With single use fitting block, 3-port normally closed (NC)		$\vdash$
FM With remaile thread block  FJ5A With single use fitting block, 3-port normally closed (NC)  Valve outlet FJ6A With single use fitting block, 3-port normally open (NO)  SSOCIAL STATES A With single use fitting block, 3-port normally open (NO)  Utilet FJ6A With single use fitting block, 3-port normally closed (NC)		⊢
Valve outlet FJ6A With single use fitting block, 3-port normally closed (NC)  Valve FJ5B With single use fitting block, 3-port normally closed (NC)  FJ6A With single use fitting block, 3-port normally closed (NC)		▙
Valve outlet FJ5B With single use fitting block, 3-port normally closed (NC)		$\vdash$
Outlet FJ6A Win single use inting block, 3-port normally closed (NC)		⊢
WILL		₩
typeNote4 FJ6B With single use fitting block, 3-port normally open (NO)		$\vdash$
FMA With female thread block, 3-port normally closed (NC)		$\vdash$
FMB With female thread block, 3-port normally open (NO)		₩
Time Trial critical and a section		$\vdash$
FMAH With female thread block, 3-port normally closed (NC)		⊢
FMBH With female thread block, 3-port normally open (NO)		▙
J5 With single use fitting block		ـــ
J6 With single use fitting block		⊢
M With female thread block		▙
J5A With single use fitting block, 3-port normally closed (NC)		$\vdash$
Manifold fitting J5B With single use fitting block, 3-port normally open (NO)		<u> </u>
specification—  J6A With single use fitting block, 3-port normally closed (NC)  Mith single use fitting block, 3-port normally closed (NC)		$\vdash$
Note (Manifold J6B With single use fitting block, 3-port normally open (NO)		<u> </u>
side outlet port)  MA With female thread block, 3-port normally closed (NC)		<u> </u>
MB With female thread block, 3-port normally open (NO)		<u> </u>
MH With female thread block		$\vdash$
MAH With female thread block, 3-port normally closed (NC)		$oxed{igspace}$
MBH With female firread block, Sport normally open (NO)		<u> </u>
E2 <sup>Note12</sup> Back pressure prevention valve		_
PPM Individual air supply spacer (with M5 female thread for F10)		<u> </u>
PP6 Individual air supply spacer (with \$\phi\$ 6 fitting for F15)		$\vdash$
PP8 Individual air supply spacer (with \( \phi \) 8 fitting for F15)		₩
PRM Individual exhaust spacer (with M5 female thread for F10)	$\rightarrow$	$\vdash$
PR6 Individual exhaust spacer (with \$\phi\$ 6 fitting for F15)		$\vdash$
PR8 Individual exhaust spacer (with \$\phi\ 8\ fitting for F15)		$\vdash$
Port isolator (-SP) For 1(P) port <sup>Note8</sup>		
Port isolator (-SR) For 3(R2), 5(R1) ports <sup>Note8</sup>		<u> </u>
Port isolator (-SA) For 1(P), 3(R2), 5(R1) ports Note8		

Notes:1. Cannot be mounted on the external pilot manifold.

- 2. Cannot be mounted on the internal pilot manifold.
- 3. To designate a manual override lever, enter in the manual override boxes of the designated stations in the above table.

  4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter in the valve outlet type boxes of the above table. The 3-port specifications are only available in valve specifications TO, T1, and T2.

  5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter in the manifold fitting specification boxes of the above table.
- The 3-port specifications are only available in valve specifications T0, T1, and T2.
- 6. When mounting the individual air supply or exhaust spacer, enter  $\bigcirc$  in the spacer boxes of the designated stations in the above table. 7. To designate a port isolator, enter  $\bigcirc$  in one port isolator box of the designated stations in the above table.
- 8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).
- 9. Not available in low-current type.
- 10. AC100V and AC120V can only be used when wiring specifications are -D250, -D251 (D-sub connector), or -T200 (terminal). In addition, not available in low-current type and tandem 3-port valves 11. Not availabate in external pilot type.
- 12. When mounting the back pressure prevention valve, enter O in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer. set Delivery Quantity
- 13. Can be selected only when the manifold type is P
- 14. Can be selected only when the manifold type is PH.

Split Manifold Serial Transmission Type

# Specifications Confirmation Form 1/2

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

· Fill in selections inside the thick-lined boxes. Valve size Wiring position (transmission block) Wiring connection specification 10: 10mm width Blank: Packed wiring Blank: Left-side mounting 15: 15mm width W : Double wiring R : Right-side mounting Valve units Piping block specification (air supply and exhaust) Transmission block specification Note: For the maximum number Can be selected only when the manifold type is S (metric). 31: For OMRON B7A Link Terminal of units, see the table for JR: With dual use fitting, right-side mounting Manifold model (standard) maximum number of valve JL: With dual use fitting, left-side mounting For OMRON B7A Link Terminal units by wiring JD: With dual use fitting, both-side mounting (high speed) specification, on P. 70. MR: With female thread, right-side mounting B1: For CC-Link (16 outputs) ML : With female thread, left-side mounting Manifold outlet specification B3: For CC-Link (32 outputs) MD: With female thread, both-side mounting : With dual use fitting blocks D1: For DeviceNet (16 outputs) **J5R**: With single use fitting  $\phi$ 8, right-side mounting : With female thread blocks М D3: For DeviceNet (32 outputs) **J6R**: With single use fitting  $\phi$  10, right-side mounting : With selectable fitting H1: For CompoNet (16 outputs) **J5L**: With single use fitting  $\phi$  8, left-side mounting K1: For EtherCAT (16 outputs) blocks **J6L**: With single use fitting  $\phi$  10, left-side mounting Blank: With plates (direct piping K3: For EtherCAT (32 outputs) **J5D**: With single use fitting  $\phi$ 8, both-side mounting M1: For EtherNet/IP (16 point output) Note11 type) **J6D**: With single use fitting  $\phi$  10, both-side mounting M3: For EtherNet/IP (32 point output) Note11 Can be selected only when the manifold type is SH (imperial). Pilot specification MRH: With female thread, right-side mounting Blank: Internal pilot manifold MLH: With female thread, left-side mounting : External pilot manifold MDH: With female thread, both-side mounting

When manifold outlet specifications are J. M. or L. stn. F Valve size DC24V Valve specification Operation type Blank:Internal pilot typeNote1 Manual override Port isolator G: External pilot type Note2 Blank: Manual override button Blank: No port isolator R : Manual override lever<sup>Note3</sup> SP : For 1(P) port<sup>Note7</sup> SR: For 3(R2), 5(R1) ports<sup>Note7</sup> Valve outlet type **SA**: For 1(P), 3(R2), 5(R1) ports<sup>Note7</sup> A1: With plate (When manifold outlet specification are J, M, or L, the valve type should be A1.) Can be selected only when the manifold type is S and the manifold outlet spec. is "Blank" (metric). Individual air supply and exhaust spacer Note6 **FJ**: With dual use fitting block (**F10**:  $\phi$  4 and  $\phi$  6, **F15**:  $\phi$  6 and  $\phi$  8) Blank: No spacer **FJ5**: With single use fitting block (**F10**:  $\phi$  4, **F15**:  $\phi$  6) PPM: Individual air supply spacer (with **FJ6**: With single use fitting block (**F10**:  $\phi$  6, **F15**:  $\phi$  8) M5 female thread for F10) FM: With female thread block (F10: M5X0.8, F15: Rc1/8) PP6: Individual air supply spacer (with FJ5A: With single use fitting block, 3-port normally closed (NC) (F10: φ4, F15: φ6)  $\phi$  6 fitting for F15) **FJ5B**: With single use fitting block, 3-port normally open (NO) (**F10**:  $\phi$ 4, **F15**:  $\phi$ 6) PP8: Individual air supply spacer (with **FJ6A**: With single use fitting block, 3-port normally closed (NC) (**F10**:  $\phi$  6, **F15**:  $\phi$  8) Mounting valve model **FJ6B**: With single use fitting block, 3-port normally open (NO) (**F10**:  $\phi$  6, **F15**:  $\phi$  8)  $\phi$ 8 fitting for F15) PRM: Individual exhaust spacer (with FMA: With female thread block, 3-port mormally closed (NC) (F10: M5X0.8, F15: Rc1/8) M5 female thread for F10) FMB: With female thread block, 3-port normally open (NO) (F10: M5X0.8, F15: Rc1/8) **PR6** : Individual exhaust spacer (with  $\phi$ Can be selected only when the manifold type is **SH** and the manifold outlet spec, is "Blank" 6 fitting for F15) (imperial). **PR8** : Individual exhaust spacer (with  $\phi$ FMH: With female thread block (F10:10-32UNF, F15: NPT1/8) 8 fitting for F15) FMAH: With female thread block, 3-port mormally closed (NC) (F10:10-32UNF, F15: NPT1/8) Back pressure prevention valve<sup>Note10</sup> FMBH: With female thread block, 3-port normally open (NO) (F10:10-32UNF, F15: NPT1/8) Blank: No back pressure prevention valve E2: With back pressure prevention valve Manifold fitting specifications<sup>Note5</sup> Can be selected only when the manifold type is S and the manifold outlet specification is L (with selectable fitting blocks (metric)) **J5**: Manifold side outlet port with single use fitting block (**F10**: φ 4, **F15**: φ 6) **J6**: Manifold side outlet port with single use fitting block (**F10**: φ 6, **F15**: φ 8) M : Manifold side outlet port with female thread block (F10: M5X0.8, F15: Rc1/8) **J5A** : Manifold side outlet port with single use fitting block, 3-port normally closed (NC) (**F10**:  $\phi$  4, **F15**:  $\phi$  6) **J5B**: Manifold side outlet port with single use fitting block, 3-port normally open (NO) (F10:  $\phi$  4, F15:  $\phi$  6) **J6A** : Manifold side outlet port with single use fitting block, 3-port normally closed (NC) (**F10**:  $\phi$  6, **F15**:  $\phi$  8) **J6B**: Manifold side outlet port with single use fitting block, 3-port normally open (NO) (**F10**:  $\phi$  6, **F15**:  $\phi$  8)

► Enter ○ in each designated station in tables on the next page.

MH: Manifold side outlet port with female thread block (F10:10-32UNF, F15: NPT1/8)

MA: Manifold side outlet port with female thread block, 3-port mormally closed (NC) (F10: M5X0.8, F15: Rc1/8)

MB: Manifold side outlet port with female thread block, 3-port normally open (NO) (F10: M5X0.8, F15: Rc1/8)

MAH: Manifold side outlet port with female thread block, 3-port mormally closed (NC) (F10:10-32UNF, F15: NPT1/8) MBH: Manifold side outlet port with female thread block, 3-port normally open (NO) (F10:10-32UNF, F15: NPT1/8)

Can be selected only when the manifold type is SH and the manifold outlet specification is L (with selectable fitting blocks (imperial))

Split Manifold Serial Transmission Type

## **Specifications Confirmation Form 2/2**

₹ For specifying the valve and block-off plate to be mounted at each station, enter ○ in each applicable box below

	ecifying the valve an	d block-off p	olate	to b	e mo	ounte	ed at	eac	ch sta	ation	, ent	ter (	) in (	each	app	licat	ole b	ox b	elow			
Mounting	valve, block-off plate	Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F $\square$ T0	2-position, for single s																					
F 🗆 T1	2-position, single soleno																					
F $\square$ T2	2-position, double soleno																					
F 🗆 T3	3-position, closed cen																					
F 🗆 T4	3-position, exhaust ce																				<b>—</b>	
F 🗆 T5	3-position, pressure of																				_	_
	<sup>169</sup> Tandem 3-port (NC ar	eriter																				
F D TRNO	te9 Tandem 3-port (NO ar	id NO)																			-	
F D TONO	teg Tandem 3-port (NO ar	10 NO)																			<u> </u>	
	te9 Tandem 3-port (NC ar																					
F LT0	(Low current type) 2-position, for																				-	-
F LT1	(Low current type) 2-position, single																				<u> </u>	
F 🗆 LT2	(Low current type) 2-position, double																				<u> </u>	
F 🗆 LT3	(Low current type) 3-position																					<u> </u>
F 🗌 LT4	(Low current type) 3-position																					
F 🗌 LT5	(Low current type) 3-position																					
F 🗌 LTA	(Low current type) Tandem 3-p																					
F 🗌 LTB	(Low current type) Tandem 3-p																					
F 🗆 LTC	(Low current type) Tandem 3-p	ort (NC and NO)																				
F 🗌 BPP																						
Manual o	verride (-R) Manual overr	ide lever <sup>Note3</sup>																				
	FJ With dual use fit	tting block																				
ω	FJ5 With single use	fitting block																				
<u>    6</u>	FJ6 With single use	fitting block																				
8	FM With female thre	ead block																				
Valve outlet type <sup>Note4</sup>	FJ5A With single use fitting block, 3-	port normally closed (NC)																				
ນ∐ <sub>Valve</sub>	FJ5B With single use fitting block, 3	-port normally open (NO)																				
outlet	FJ6A With single use fitting block, 3-	port normally closed (NC)																				
typeNote4	FJ6B With single use fitting block, 3	3-port normally open (NO)																				
<b>≘</b>	FMA With female thread block, 3-p	ort normally closed (NC)																				
SII	FMB With female thread block, 3-	oort normally open (NO)																				
<b>♀</b>	FMH With female thre	ad block																				
-	FMAH With female thread block, 3-p																					
	FMBH With female thread block, 3-																					
	J5 With single use																					
	J6 With single use																					
	M With female three																					
	J5A With single use fitting block, 3-																					
Manifold fitting	J5B With single use fitting block, 3																					
specification-	J6A With single use fitting block, 3-																					
Note5 (Manifold	J6B With single use fitting block, 3																					
side outlet port)	MA With female thread block, 3-p																					
	MB With female thread block, 3-p																					
	MH With female three	, , , ,																			$\overline{}$	
	MAH With female thread block, 3-port																				<b>—</b>	
Ш	MBH With female thread block, 3-port	, , ,																				<u> </u>
E2 <sup>Note10</sup> E	Back pressure prevention																				<b>—</b>	
	ndividual air supply spacer (with M5 fe																					
	ndividual air supply spacer (with o	· · · · · · · · · · · · · · · · · · ·																				
	ndividual air supply spacer (with a																					
	ndividual exhaust spacer (with M5 fe																					-
	ndividual exhaust spacer (with $\phi$																				<u> </u>	
	ndividual exhaust spacer (with $\phi$																	-			_	
	tor (-SP) For 1(P) port <sup>Not</sup>																					-
	tor (- <b>SR</b> ) For 1(P) port <sup>1</sup>		-	-		-			-			-		-				-	-	-	<del></del>	$\vdash$
																					<u> </u>	<u> </u>
	or (-SA) For 1(P), 3(R2), 5																					

Notes:1. Cannot be mounted on the external pilot manifold. 2. Cannot be mounted on the internal pilot manifold.

- 3.To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated stations in the above table.

  4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter  $\bigcirc$  in the valve outlet type boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.
- 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter O in the manifold fitting specification boxes of the above table.

The 3-port specifications are only available in valve specifications T0, T1, and T2.

6. When mounting the individual air supply or exhaust spacer, enter ○ in the spacer boxes of the designated stations in the above table.


7. To designate a port isolator, enter ○ in one port isolator box of the designated stations in the above table.

8. Port isolators can be installed only when piping blocks are installed on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations.

When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).

9. Not availabale in external pilot type.

- 10. When mounting the back pressure prevention valve, enter O in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.
- 11. Complies with the CE marking regulations.

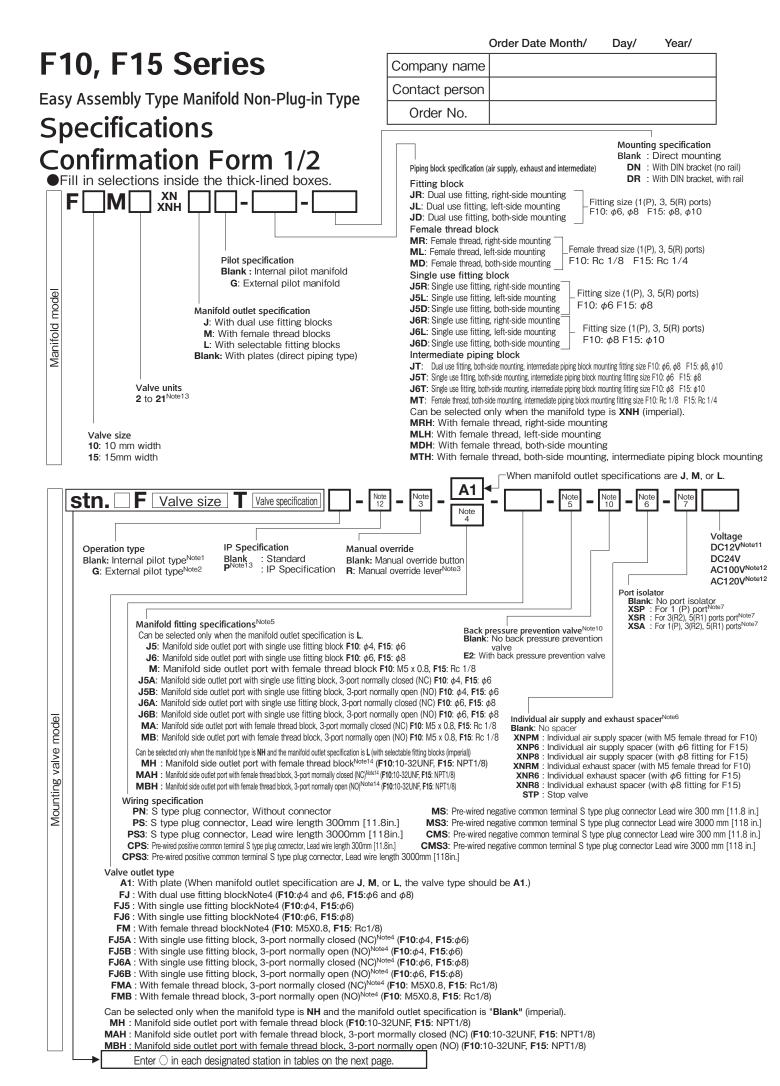

Easy Assembly Type Manifold Non-Plug-in Type

## **Specifications Confirmation Form 2/2**

 $\rceil$  %For specifying the valve and block-off plate to be mounted at each station, enter  $\bigcirc$  in each applicable box below.

	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	2
F TO	2-position, for single solenoid only																			<u> </u>	+
F 🗆 T1	2-position, single solenoid specification																			├	+
F T2	2-position, double solenoid specification																			_	$\perp$
F 🗌 T3	3-position, closed center																			├─	+
F 🗌 T4	3-position, exhaust center																			ــــــ	+
F 🗌 T5	3-position, pressure center																			<u> </u>	╀
	e9 Tandem 3-port (NC and NC)																				1
	e9 Tandem 3-port (NO and NO)																			ــــــ	1
	e9 Tandem 3-port (NC and NO)																			<u> </u>	1
F  LT0	(Low current type) 2-position, for single solenoid only																				
F 🗌 LT1	(Low current type) 2-position, single solenoid specification																			<u> </u>	$\perp$
F 🗌 LT2	(Low current type) 2-position, double solenoid specification																				┸
F 🗌 LT3	(Low current type) 3-position, closed center																				
F 🗌 LT4	(Low current type) 3-position, exhaust center																				$\perp$
F 🗌 LT5	(Low current type) 3-position, pressure center																				
	te9 (Low current type) Tandem 3-port (NC and NC)																				
	ote9 (Low current type) Tandem 3-port (NO and NO)																				Ţ
	ote9 (Low current type) Tandem 3-port (NC and NO)																				
	Block-off plate																				Ĺ
F ZXNote	e14 Intermediate piping block																				Γ
P <sup>Note13</sup>	IP Specifications																				Γ
Manual ov	erride (-R) Manual override lever <sup>Note3</sup>																				Γ
	FJ With dual use fitting block																				T
	FJ5 With single use fitting block																				Τ
	FJ6 With single use fitting block																				Т
	FM With female thread block																				T
	FJ5A With single use fitting block, 3-port normally closed (NC)																				T
Valve	FJ5B With single use fitting block, 3-port normally open (NO)																				Ť
outlet	FJ6A With single use fitting block, 3-port normally closed (NC)																				Ť
type <sup>Note4</sup>	FJ6B With single use fitting block, 3-port normally open (NO)																				Ť
	FMA With female thread block, 3-port normally closed (NC)																				Ť
	FMB With female thread block, 3-port normally open (NO)																				Ť
	FMH With female thread block																				Ť
	FMAH With female thread block, 3-port normally closed (NC)																				t
	FMBH With female thread block, 3-port normally open (NO)																				t
	J5 With single use fitting block																				$^{+}$
	J6 With single use fitting block																				+
	M With female thread block																				$^{+}$
	J5A With single use fitting block, 3-port normally closed (NC)																			<u> </u>	+
Manifold fitting	J5B With single use fitting block, 3-port normally open (NO)																				+
specification <sup>Note5</sup>	J6A With single use fitting block, 3-port normally closed (NC)																				+
(Manifold side	J6B With single use fitting block, 3-port normally open (NO)																				+
outlet port)	MA With female thread block, 3-port normally closed (NC)															_				$\vdash$	+
/	MB With female thread block, 3-port normally closed (NO)																			<u> </u>	+
	MH With female thread block															_				$\vdash$	+
	MAH With female thread block, 3-port normally closed (NC)															_				$\vdash$	+
	MBH With female thread block, 3-port normally closed (NC)																			<del></del>	+
<b>⊏o</b> Note10 □	Back pressure prevention valve																			$\vdash$	+
	dividual air supply spacer (with M5 female thread for F10)															_	-			$\vdash$	+
	dividual air supply spacer (with $\phi$ 6 fitting for F15)																			<del></del>	+
																	-			$\vdash$	+
	dividual air supply spacer (with $\phi$ 8 fitting for F15)																			<u> </u>	+
	dividual exhaust spacer (with M5 female thread for F10)																			<del></del>	+
	dividual exhaust spacer (with $\phi$ 6 fitting for F15)		-	-								_	-		-		-	-	-	<del></del>	+
	dividual exhaust spacer (with φ 8 fitting for F15)																			<u> </u>	+
	ith stop valve																			<u> </u>	+
Port isolate	or (-XSP) For 1(P) portNote8																_			<u> </u>	+
	or (-XSR) For 3(R2), 5(R1) ports <sup>Note8</sup>		1	1	1				1	1	I	1	1	1	1	1	1	1	1	1	1

Notes:1. Cannot be mounted on the external pilot manifold.

- 2. Cannot be mounted on the external pilot manifold.
  3. To designate a manual override lever, enter in the manual override boxes of the designated stations in the above table.
  4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter in the valve outlet type boxes of the above table.
- The 3-port specifications are only available in valve specifications  ${\bf 70}$ ,  ${\bf 71}$ , and  ${\bf 72}$ . 5. When the manifold outlet specifications are L (with selectable fitting), select manifold
- fitting specification for each station, and enter  $\bigcirc$  in the manifold fitting specification boxes of the above table
- 6. When mounting the individual air supply or exhaust spacer, enter in the spacer boxes of the desigated stations in the above table.
  7. To designate a port isolator, enter in one box of the designated stations in the above table.
- 8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations.

When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller

- exhaust spacer.
- 11. Not available in low-current type.
- Not available in low-current type. And tandem 3-port valves.

  The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. The 3-port specifications are only available in valve specifications are only availabl

Quantity	set	Delivery

Easy Assembly Type Manifold Plug-in Type

	Order Date Month/	рау/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 1/2**

• Fill in selections inside the thick-lined boxes. XP XPH Voltage DC12V<sup>Note9</sup> Valve size Mounting specification 10: 10mm width DC24V Pilot specification Blank: Direct mounting Wiring connection specification AC100V<sup>Note10</sup> 15: 15mm width DN: With DIN bracket (no rail) Blank: Internal pilot Blank: Packed wiring DR: With DIN bracket, with rail manifold W: Double wiring Valve units : External pilot 2 to □No Common specification manifold Note: For the maximum number of units, see the Blank: Positive common table for maximum number of valve units CM: Negative common Wiring specification by wiring specification, on P. 66 <connector top surface wiring> <connector side surface wiring> Manifold outlet specification F100E: Flat cable connector 10-pin F100: Flat cable connector 10-pin : With dual use fitting blocks F100N: Flat cable connector 10-pin without power terminal F100EN: Flat cable connector 10-pin without power terminal : With female thread blocks F101: Flat cable connector 10-pin F101E: Flat cable connector 10-pin : With selectable fitting blocks F101N: Flat cable connector 10-pin without power terminal F101EN: Flat cable connector 10-pin without power terminal Blank: With plates (direct piping type) F200: Flat cable connector 20-pin F200E: Flat cable connector 20-pin Manifold Piping block specification (air supply and exhaust) F200N: Flat cable connector 20-pin without power terminal F200EN: Flat cable connector 20-pin without power terminal Can be selected only when the manifold type is P (metric). F201: Flat cable connector 20-pin F201E: Flat cable connector 20-pin JR: With dual use fitting, right-side mounting F201N: Flat cable connector 20-pin without power terminal F201EN: Flat cable connector 20-pin without power terminal JL: With dual use fitting, left-side mounting F260: Flat cable connector 26-pin F260E: Flat cable connector 26-pin JD: With dual use fitting, both-side mounting F260N: Flat cable connector 26-pin without power terminal F260EN: Flat cable connector 26-pin without power terminal MR: With female thread, right-side mounting ML: With female thread, left-side mounting (M2.6 mounting screw) (M2.6 mounting screw) MD: With female thread, both-side mounting D250: D-sub connector 25-pinNote13 D250E: D-sub connector 25-pinNote13 **J5R**: With single use fitting  $\phi$ 8, right-side mounting D250N: D-sub connector 25-pin without power terminal Note13 D250EN: D-sub connector 25-pin **J6R**: With single use fitting  $\phi$  10, right-side mounting D251: D-sub connector 25-pin<sup>Note13</sup> without power terminal Note13 **J5L**: With single use fitting  $\phi$  8, left-side mounting D251N: D-sub connector 25-pin without power terminal Note13 D251E: D-sub connector 25-pinNote13 **J6L**: With single use fitting  $\phi$  10, left-side mounting (4-40UNC mounting screw) D251EN: D-sub connector 25-pin **J5D**: With single use fitting  $\phi$  8, both-side mounting D250U: D-sub connector 25-pinNote14 without power terminal Note13 **J6D**: With single use fitting  $\phi$  10, both-side mounting D251U: D-sub connector 25-pin Note14 (4-40UNC mounting screw) D250EU: D-sub connector 25-pinNote14 D370NU: D-sub connector 37-pin without power terminal Note14 Can be selected only when the manifold type is PH (imperial). D251EU: D-sub connector 25-pinNote14 MRH: With female thread, right-side mounting T200: Terminal block 19 terminals MLH: With female thread, left-side mounting : With female thread, both-side mounting When the manifold output type is **J**, **M**, or **L** stn. Valve size Valve specifications Operation type Blank: Internal pilot type<sup>Note1</sup> Manual mechanism Voltage DC12VNote9 Blank: Manual button G: External pilot typeNote2 R: Manual lever<sup>Note3</sup> DC24V Valve outlet type AC100V<sup>Note10</sup> AC120V<sup>Note10</sup> A1: With plate (When manifold outlet specification are J, M, or L, the valve type should be A1.) Port isolator Can be selected only when the manifold type is P and the manifold outlet specification is "Blank" (metric). Blank: Without split an be selected only when the manifold type is P and the manifold outlet specification FJ: With dual use fitting block<sup>Note4</sup> (F10:  $\phi$  4 and  $\phi$  6, F15:  $\phi$  6 and  $\phi$  8) FJ5: With single use fitting block<sup>Note4</sup> (F10:  $\phi$  4, F15:  $\phi$  6) FJ6: With single use fitting block<sup>Note4</sup> (F10:  $\phi$  6, F15:  $\phi$  8) FM: With female thread block<sup>Note4</sup> (F10: M5X0.8, F15: Rc1/8) XSP: For 1 (P) portNote7 **XSR**: For 3 (R2)/5 (R1) port<sup>Note7</sup> XSA: For 1 (P)/3 (R2)/5 (R1) portNote7 Indibidual air supply and exhaust spacer Note6 **FJ5A**: With single use fitting block, 3-port normally closed (NC)<sup>Note4</sup> (**F10**:  $\phi$  4, **F15**:  $\phi$  6) **FJ5B**: With single use fitting block, 3-port normally open (NO)<sup>Note4</sup> (**F10**:  $\phi$  4, **F15**:  $\phi$  6) Blank: Without spacer XPPM: Single intake spacer (with M5 female screw for F10) FJ6A: With single use fitting block, 3-port normally closed (NC)<sup>Note4</sup> (F10: \$\phi\$ 6, F15: \$\phi\$ 8) **XPP6**: Single intake spacer (with  $\phi$ 6 joint for F15) FJ6B: With single use fitting block, 3-port normally open (NO)<sup>Note4</sup> (F10: \$\phi\$6, F15: \$\phi\$8) **XPP8**: Single intake spacer (with  $\phi$ 8 joint for F15) **FMA**: With female thread block, 3-port normally closed (NC)<sup>Note4</sup> (**F10**: M5X0.8, **F15**: Rc1/8) **FMB**: With female thread block, 3-port normally open (NO)<sup>Note4</sup> (**F10**: M5X0.8, **F15**: Rc1/8) valve XPRM: Single exhaust spacer (with M5 female screw for F10) **XPR6**: Single exhaust spacer (with  $\phi$ 6 joint for F15) Can be selected only when the manifold type is PH and the manifold outlet specification is "Blank" (imperial). **XPR8**: Single exhaust spacer (with φ8 joint for F15) Mounting FMH: With female thread block Note4 (F10:10-32UNF, F15: NPT1/8) Back pressure prevention valve<sup>Note12</sup> FMAH: With female thread block, 3-port mormally closed (NC)Note4 (F10:10-32UNF, F15: NPT1/8) Blank: Without back pressure prevention valve FMBH: With female thread block, 3-port normally open (NO)<sup>Note4</sup> (F10:10-32UNF, F15: NPT1/8) **E2**: With back pressure prevention valve Manifold fitting specifications<sup>Note5</sup> Can be selected only when the manifold type is P and the manifold outlet specification is L (with selectable fitting blocks (metric)) **J5**: Manifold side outlet port with single use fitting block (**F10**: φ 4, **F15**: φ 6) **J6**: Manifold side outlet port with single use fitting block (**F10**:  $\phi$  6, **F15**:  $\phi$  8) M: Manifold side outlet port with female thread block (F10: M5X0.8, F15: Rc1/8) J5A: Manifold side outlet port with single use fitting block, 3-port normally closed (NC) (F10: φ4, F15: φ6) J5B: Manifold side outlet port with single use fitting block, 3-port normally open (NO) (F10:  $\phi$ 4, F15:  $\phi$ 6)

Enter  $\bigcirc$  in each designated station in tables on the next page.

J6A: Manifold side outlet port with single use fitting block, 3-port normally closed (NC) (F10: \$\phi\$ 6, F15: \$\phi\$ 8) **J6B**: Manifold side outlet port with single use fitting block, 3-port normally open (NO) (**F10**:  $\phi$  6, **F15**:  $\phi$  8) MA: Manifold side outlet port with female thread block, 3-port mormally closed (NC) (F10: M5X0.8, F15: Rc1/8) MB: Manifold side outlet port with female thread block, 3-port normally open (NO) (F10: M5X0.8, F15: Rc1/8)

Easy Assembly Type Manifold Plug-in Type

#### **Specifications Confirmation Form 2/2**

※For specifying the valve and block-off plate to be mounted at each station, enter ○ in each applicable box below.

Mounting valve, block-of plate			ig the valve and block on p										,			.1-1							
F	Mounting	g valve, l	olock-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F   T1 2 - position, single solemoid specification F   T3 3 - position, closed center F   T4   Sample   Specification   S																							
F   T2   2-constion, double sclerator																							
F   T3   3-position, closed center   F   T5   3-position, pressure center   F   T6   3-position, pressure center   F   T7   3-position, pressure center   T   3-position, pressure center   T   3-position, pressure center   T   3-position, pressure center   T   3-position, pressure center																							
F   TA   3-position, pechasust center   F   TA   Section   Topical Content   F   TA   Section   Tandem 3-port (NC and NC)   F   TOpical Tandem 3-port (NC and NC)   F   TTO   Section   Tandem 3-port (NC and NC)   F   TTO   Tandem 3-port (NC and NC)   TTO   Tandem 3-port (NC and NC)   TTO   Tandem 3-port (NC and NC)   TTO   TTO   Tandem 3-port (NC and NC)   TTO   TTO																					_		
F   Ta   3-position, prossure center																							
F   TA <sup>Nover1</sup>   Tandem 3-port (NC and NC)																							
F   TD   Tandem 3-port (NO and NO)   F   LTO   Lor owner type 3-position, present selection   F   LTO   Lor owner type 3-position, ethicat center   LTO   Lor owner type 3-position, ethicat center   LTO   Lor owner type 3-position, ethicat center   LTO   LT			* *																				
F TO Country 1 Tandem 3-port (NC and NO) F LT1																							
F   LTO   Low curret type 2-position, for single sellowed only																							
F																							
Fig. 1172   Low current type  3-position, closed center																							
F   LT3   Low current type) 3-position, closed center			current type) 2-position, single solenoid specification																				
F	F 🗌 LT2	(Low	current type) 2-position, double solenoid specification																				
UTS	F 🗆 LT3	(Lov	current type) 3-position, closed center																				
F   LTA   Nover   Curve current type  Tandem 3-port (NC and NC)	F □ LT4	(Low	current type) 3-position, exhaust center																				
F	F 🗌 LT5	(Low	current type) 3-position, pressure center																				
F	F 🗆 LTA	Note11 (Low	current type) Tandem 3-port (NC and NC)																				
F	F □ LTB	Note11 (Low	current type) Tandem 3-port (NO and NO)																				
Sappa   Block-off plate    Sappa   Block-off plate    Sappa																							
F   ZXPNovis   Intermediate plping block																							
Manual override (=R] Manual override lever-Notes																							
Manual override (-R) Manual override lever**  With dual use fitting block FJS With single use fitting block FM With single use fitting block FMS With single use fitting block FMS With single use fitting block FMA With single use fitting block Aport normally open (NO) FMM With female thread block Aport normally open (NO) FMM With female thread block Aport normally open (NO) FMH With female thread block Aport normally open (NO) FMH With female thread block Aport normally open (NO) FMH With female thread block Aport normally open (NO) JS With single use fitting block M With female thread block Aport normally open (NO) JS With single use fitting block JS W																							
FJ																							
Valve Outlet type Notes   FJSB With single use fitting block, 3-port normally open NO   FJGB With single use fitting block, 3-port normally open NO   FMA With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   JS With single use fitting block   JG With single use f	Φ   Iviaridar C																						
Valve Outlet type Notes   FJSB With single use fitting block, 3-port normally open NO   FJGB With single use fitting block, 3-port normally open NO   FMA With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   JS With single use fitting block   JG With single use f	8																						
Valve Outlet type Notes   FJSB With single use fitting block, 3-port normally open NO   FJGB With single use fitting block, 3-port normally open NO   FMA With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   JS With single use fitting block   JG With single use f	돈	_																					
Valve Outlet type Notes   FJSB With single use fitting block, 3-port normally open NO   FJGB With single use fitting block, 3-port normally open NO   FMA With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   JS With single use fitting block   JG With single use f	\e																						
Valve Outlet type Notes   FJSB With single use fitting block, 3-port normally open NO   FJGB With single use fitting block, 3-port normally open NO   FMA With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   FMH With female thread block, 3-port normally open NO   JS With single use fitting block   JG With single use f	<u> </u>																						
FMB With female thread block, 3-port normally open [NO]  FMH With female thread block, 3-port normally open [NO]  FMBH With female thread block, 3-port normally open [NO]  J5 With single use fitting block  J6 With single use fitting block  J5A With single use fitting block  J5A With single use fitting block  J5B With single use fitting block aport normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  MA With female thread block aport normally open [NO]  MB With female thread block, 3-port normally open [NO]  E2Note 12 Back pressure prevention valve  XPPM Individual air supply spacer (with 46 fitting for F15)  XPRB Individual air supply spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  Port isolator (~XSR) For 1(P) port Note8																							
FMB With female thread block, 3-port normally open [NO]  FMH With female thread block, 3-port normally open [NO]  FMBH With female thread block, 3-port normally open [NO]  J5 With single use fitting block  J6 With single use fitting block  J5A With single use fitting block  J5A With single use fitting block  J5B With single use fitting block aport normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  MA With female thread block aport normally open [NO]  MB With female thread block, 3-port normally open [NO]  E2Note 12 Back pressure prevention valve  XPPM Individual air supply spacer (with 46 fitting for F15)  XPRB Individual air supply spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  Port isolator (~XSR) For 1(P) port Note8	∐ Valve		0 0 1 7 1 7																				
FMB With female thread block, 3-port normally open [NO]  FMH With female thread block, 3-port normally open [NO]  FMBH With female thread block, 3-port normally open [NO]  J5 With single use fitting block  J6 With single use fitting block  J5A With single use fitting block  J5A With single use fitting block  J5B With single use fitting block aport normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  MA With female thread block aport normally open [NO]  MB With female thread block, 3-port normally open [NO]  E2Note 12 Back pressure prevention valve  XPPM Individual air supply spacer (with 46 fitting for F15)  XPRB Individual air supply spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  Port isolator (~XSR) For 1(P) port Note8	S   outlet	FJ6A																					
FMB With female thread block, 3-port normally open [NO]  FMH With female thread block, 3-port normally open [NO]  FMBH With female thread block, 3-port normally open [NO]  J5 With single use fitting block  J6 With single use fitting block  J5A With single use fitting block  J5A With single use fitting block  J5B With single use fitting block aport normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  J6B With single use fitting block, 3-port normally open [NO]  MA With female thread block aport normally open [NO]  MB With female thread block, 3-port normally open [NO]  E2Note 12 Back pressure prevention valve  XPPM Individual air supply spacer (with 46 fitting for F15)  XPRB Individual air supply spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 46 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  XPRB Individual exhaust spacer (with 67 fitting for F15)  Port isolator (~XSR) For 1(P) port Note8	€  type <sup>note4</sup>																						
FMH With female thread block FMAH With female thread block, 3-port normally open (NO)  J5 With single use fitting block J6 With single use fitting block M With female thread block J5A With single use fitting block J5B With single use fitting block J5B With single use fitting block, 3-port normally open (NO) J5B With single use fitting block, 3-port normally open (NO) J5B With single use fitting block, 3-port normally open (NO) J6B With single use fitting block, 3-port normally open (NO) MA With female thread block, 3-port normally open (NO) MB With female thread block, 3-port normally open (NO)  E2Note12 Back pressure prevention valve XPPM Individual air supply spacer (with \$6 fitting for F15) XPP8 Individual exhaust spacer (with \$6 fitting for F15) XPR8 Individual exhaust spacer (with \$6 fitting for F15) XPR8 Individual exhaust spacer (with \$6 fitting for F15) XPR8 Individual exhaust spacer (with \$6 fitting for F15) Port isolator (-XSP) For 1(P) port Note8 Port isolator (-XSP) For 1(P) port Note8 Port isolator (-XSP) For 1(P) port Note8	<b>-</b>																						
FMAH With female thread block, 3-port normally closed (NC) FMBH With female thread block, 3-port normally open (NO)  J5 With single use fitting block M With female thread block   J5A With single use fitting block   M With female thread block   J5A With single use fitting block   M With female thread block   J5A With single use fitting block   M With single use fitting block 3-port normally closed (NC)   J5B With single use fitting block, 3-port normally closed (NC)   J6A With single use fitting block, 3-port normally closed (NC)   J6A With single use fitting block, 3-port normally closed (NC)   MA With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With female thread block, 3-port normally closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   MB With single use fitting block with closed (NC)   M																							
FMBH With female thread block, 3-port normally open (NO)  J6 With single use fitting block M With female thread block J5A With single use fitting block M With female thread block J5A With single use fitting block W  J5A With single use fitting block W  J5A With single use fitting block W  J5A With single use fitting block 3-port normally closed (NC) J5B With single use fitting block, 3-port normally closed (NC) J6A With single use fitting block, 3-port normally closed (NC) J6B With single use fitting block, 3-port normally closed (NC) MA With female thread block, 3-port normally closed (NC) MB With female thread block, 3-port normally open (NO)  E2^Note12 Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with M5 female thread for F15)  XPP8 Individual exhaust spacer (with M6 fitting for F15)  XPRM Individual exhaust spacer (with M6 fitting for F15)  XPR8 Individual exhaust spacer (with M6 fitting for F15)  Port isolator (-XSP) For 1(P) port Note8  Port isolator (-XSP) For 3(R2), 5(R1) ports Note8		FMH	With female thread block																				
Marifold fitting specification-Nate (Marifold side outlet port)   Mith single use fitting block 3-port normally closed (NC)   J5A   With single use fitting block 3-port normally closed (NC)   J5B   With single use fitting block, 3-port normally closed (NC)   J6A   With single use fitting block, 3-port normally closed (NC)   J6B   With single use fitting block, 3-port normally closed (NC)   J6B   With single use fitting block, 3-port normally closed (NC)   MB   With female thread block, 3-port normally closed (NC)   MB   With female thread block, 3-port normally closed (NC)   MB   With female thread block, 3-port normally closed (NC)   W		FMAH	■ With female thread block, 3-port normally closed (NC)																				
Marifold fitting specification- Natifold fitting specification- Natifold fitting specification- Natifold fitting specification- Natifold Marifold side outlet port)  JSB With single use fitting block, 3-port normally open (NO) JGA With single use fitting block, 3-port normally open (NO) JGB With single use fitting block, 3-port normally open (NO) MA With female thread block, 3-port normally open (NO) MB With female thread block, 3-port normally open (NO)  MB With female thread block, 3-port normally open (NO)  E2^Note12 Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with \$6 fitting for F15)  XPP8 Individual exhaust spacer (with \$6 fitting for F15)  XPRM Individual exhaust spacer (with \$6 fitting for F15)  XPR8 Individual exhaust spacer (with \$6 fitting for F15)  XPR8 Individual exhaust spacer (with \$6 fitting for F15)  Port isolator (-XSP) For 1(P) port^Note8  Port isolator (-XSR) For 3(R2), 5(R1) ports^Note8		FMBH	■ With female thread block, 3-port normally open (NO)																				
Manifold fitting specification- Nets (Manifold side outlet port)  Manifold fitting specification- Nets (Manifold side outlet port)  J5B With single use fitting block, 3-port normally closed (NC)  J6B With single use fitting block, 3-port normally closed (NC)  J6B With single use fitting block, 3-port normally open (NO)  MA With female thread block, 3-port normally closed (NC)  MB With female thread block, 3-port normally closed (NC)  MB With female thread block, 3-port normally open (NO)  E2Note12 Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with 4 6 fitting for F15)  XPP8 Individual exhaust spacer (with 4 6 fitting for F15)  XPRM Individual exhaust spacer (with 4 6 fitting for F15)  XPR8 Individual exhaust spacer (with 4 6 fitting for F15)  XPR8 Individual exhaust spacer (with 4 6 fitting for F15)  Port isolator (-XSP) For 1(P) port <sup>Note8</sup> Port isolator (-XSR) For 3(R2), 5(R1) ports <sup>Note8</sup>		J5	With single use fitting block																				
Manifold fitting specification- Nets (Manifold side outlet port)  J5A With single use fitting block, 3-port normally closed (NC)  J6B With single use fitting block, 3-port normally closed (NC)  J6B With single use fitting block, 3-port normally closed (NC)  J6B With single use fitting block, 3-port normally closed (NC)  MB With female thread block, 3-port normally closed (NC)  MB With female thread block, 3-port normally open (NO)  E2Note12  Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with φ 8 fitting for F15)  XPP8 Individual exhaust spacer (with φ 6 fitting for F15)  XPR8 Individual exhaust spacer (with φ 8 fitting for F15)  XPR8 Individual exhaust spacer (with φ 8 fitting for F15)  Port isolator (-XSP) For 1(P) port <sup>Note8</sup> Port isolator (-XSR) For 3(R2), 5(R1) ports <sup>Note8</sup>		J6	With single use fitting block																				
specification- Natis (Manifold side outlet port)  J5B With single use fitting block, 3-port normally open (NO)  J6A With single use fitting block, 3-port normally open (NO)  MA With female thread block, 3-port normally open (NO)  MB With single use fitting block, 3-port normally open (NO)  MB With female thread block, 3-port normally open (NO)  E2Note12 Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with \$6 fitting for F15)  XPR8 Individual exhaust spacer (with \$6 fitting for F15)  XPR6 Individual exhaust spacer (with \$6 fitting for F15)  XPR8 Individual exhaust spacer (with \$6 fitting for F15)  XPR8 Individual exhaust spacer (with \$6 fitting for F15)  Port isolator (-XSP) For 1(P) portNote8  Port isolator (-XSR) For 3(R2), 5(R1) portsNote8			With female thread block																				
Specification- Note (Manifold side outlet port)  J5B With single use fitting block, 3-port normally open (NO)  J6A With single use fitting block, 3-port normally open (NO)  MA With female thread block, 3-port normally open (NO)  MB With female thread block, 3-port normally open (NO)  MB With female thread block, 3-port normally open (NO)  E2Note12 Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with 6 6 fitting for F15)  XPP8 Individual exhaust spacer (with M5 female thread for F10)  XPR6 Individual exhaust spacer (with M6 female thread for F10)  XPR8 Individual exhaust spacer (with M 6 fitting for F15)  XPR8 Individual exhaust spacer (with M 6 fitting for F15)  Port isolator (-XSP) For 1(P) portNote8  Port isolator (-XSR) For 3(R2), 5(R1) portsNote8		J5A	With single use fitting block, 3-port normally closed (NC)																				
Side outlet port    J6A   With single use fitting block, 3-port normally closed (NC)   J6B   With single use fitting block, 3-port normally closed (NC)   MA   With female thread block, 3-port normally open (NO)		J5B																					
J6B   With single use fitting block, 3-port normally open (NO)   MA   With female thread block, 3-port normally open (NO)   MB   With female thread block, 3-port normally open (NO)   E2 <sup>Note12</sup>   Back pressure prevention valve     Individual air supply spacer (with M5 female thread for F10)     XPPM   Individual air supply spacer (with 46 fitting for F15)     XPP8   Individual air supply spacer (with 48 fitting for F15)     XPRM   Individual exhaust spacer (with 46 fitting for F15)     XPRM   Individual exhaust spacer (with 46 fitting for F15)     XPR8   Individual exhaust spacer (with 46 fitting for F15)     XPR8   Individual exhaust spacer (with 46 fitting for F15)     XPR8   Individual exhaust spacer (with 48 fitting for F15)     XPR8   Individual exhaust spacer (with 48 fitting for F15)	11 '	164	0 0 1 1 1 1 1																				
MA With female thread block, 3-port normally closed (NC) MB With female thread block, 3-port normally open (NO)  E2 <sup>Note12</sup> Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with $\phi$ 6 fitting for F15)  XPP8 Individual exhaust spacer (with $\phi$ 8 fitting for F15)  XPRM Individual exhaust spacer (with $\phi$ 6 fitting for F15)  XPR6 Individual exhaust spacer (with $\phi$ 6 fitting for F15)  XPR8 Individual exhaust spacer (with $\phi$ 8 fitting for F15)  Port isolator (-XSP) For 1(P) port <sup>Note8</sup> Port isolator (-XSR) For 3(R2), 5(R1) ports <sup>Note8</sup>	side outlet port																						
MB With female thread block, 3-port normally open (NO)  E2Notes12 Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with \$6\$ fitting for F15)  XPP8 Individual air supply spacer (with \$6\$ fitting for F15)  XPRM Individual exhaust spacer (with \$6\$ fitting for F10)  XPR6 Individual exhaust spacer (with \$6\$ fitting for F15)  XPR8 Individual exhaust spacer (with \$6\$ fitting for F15)  XPR8 Individual exhaust spacer (with \$6\$ fitting for F15)  Port isolator (-XSP) For 1(P) portNote8  Port isolator (-XSR) For 3(R2), 5(R1) portsNote8																							
E2Note12 Back pressure prevention valve  XPPM Individual air supply spacer (with M5 female thread for F10)  XPP6 Individual air supply spacer (with \$6\$ fitting for F15)  XPP8 Individual air supply spacer (with \$6\$ fitting for F15)  XPRM Individual exhaust spacer (with \$6\$ fitting for F10)  XPR6 Individual exhaust spacer (with \$6\$ fitting for F15)  XPR8 Individual exhaust spacer (with \$6\$ fitting for F15)  XPR8 Individual exhaust spacer (with \$6\$ fitting for F15)  Port isolator (-XSP) For 1(P) portNote8  Port isolator (-XSR) For 3(R2), 5(R1) portsNote8			, , , , ,																				
XPPM     Individual air supply spacer (with M5 female thread for F10)       XPP6     Individual air supply spacer (with \$\phi\$ 6 fitting for F15)       XPP8     Individual air supply spacer (with \$\phi\$ 8 fitting for F15)       XPRM     Individual exhaust spacer (with \$\phi\$ 6 fitting for F15)       XPR6     Individual exhaust spacer (with \$\phi\$ 6 fitting for F15)       XPR8     Individual exhaust spacer (with \$\phi\$ 8 fitting for F15)       Port isolator (-XSP) For 1(P) portNote8       Port isolator (-XSR) For 3(R2), 5(R1) portsNote8	F2Note12																						
XPP6       Individual air supply spacer (with φ 6 fitting for F15)         XPP8       Individual air supply spacer (with φ 8 fitting for F15)         XPRM       Individual exhaust spacer (with M5 female thread for F10)         XPR6       Individual exhaust spacer (with φ 6 fitting for F15)         XPR8       Individual exhaust spacer (with φ 8 fitting for F15)         Port isolator (-XSP) For 1(P) portNote8       Port isolator (-XSR) For 3(R2), 5(R1) portsNote8																							
XPP8 Individual air supply spacer (with \$\phi\$ fitting for F15)  XPRM Individual exhaust spacer (with \$\phi\$ fitting for F10)  XPR6 Individual exhaust spacer (with \$\phi\$ 6 fitting for F15)  XPR8 Individual exhaust spacer (with \$\phi\$ 8 fitting for F15)  Port isolator (-XSP) For 1(P) portNote8  Port isolator (-XSR) For 3(R2), 5(R1) portsNote8	1 11 1 111		1171 (													-					_		
XPRM Individual exhaust spacer (with M5 female thread for F10) XPR6 Individual exhaust spacer (with \$\phi\$ 6 fitting for F15) XPR8 Individual exhaust spacer (with \$\phi\$ 8 fitting for F15) Port isolator (-XSP) For 1(P) portNote8 Port isolator (-XSR) For 3(R2), 5(R1) portsNote8			1171 ( )													_							
XPR6 Individual exhaust spacer (with \$\phi\$ 6 fitting for F15)  XPR8 Individual exhaust spacer (with \$\phi\$ 8 fitting for F15)  Port isolator (-XSP) For 1(P) portNote8  Port isolator (-XSR) For 3(R2), 5(R1) portsNote8																-							
XPR8 Individual exhaust spacer (with $\phi$ 8 fitting for F15)  Port isolator (-XSP) For 1(P) port <sup>Note8</sup> Port isolator (-XSR) For 3(R2), 5(R1) ports <sup>Note8</sup>			1 1	-								-					-	-					-
Port isolator (-XSP) For 1(P) portNote8 Port isolator (-XSR) For 3(R2), 5(R1) portsNote8																							
Port isolator (-XSR) For 3(R2), 5(R1) ports <sup>Note8</sup>													-				<u> </u>					_	
																	_						<u> </u>
Port isolator (-XSA) For 1(P), 3(R2), 5(R1) ports <sup>Note8</sup>																							<u> </u>
	Port isola	ator (-XS	A) For 1(P), 3(R2), 5(R1) ports <sup>Note8</sup>																				

Notes:1. Cannot be mounted on the external pilot manifold.

- 2. Cannot be mounted on the internal pilot manifold.
- 3. To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated stations in the above table.

  4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter  $\bigcirc$  in the valve outlet type boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.
- 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter O in the manifold fitting specification boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.
- 6. When mounting the individual air supply or exhaust spacer, enter O in the spacer boxes of the designated stations in the above table.

  7. To designate a port isolator, enter O in one port isolator box of the designated stations in the above table.

  8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations.
- When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.). 9. Not available in low-current type.
- 10. AC100V and AC120V can only be used when wiring specifications are -D250 , -D251 (D-sub connector), or -T200 (terminal). In addition, not available in low-current type and tandem 3-port valves
- 11. Not availabale in external pilot type.
- 12. When mounting the back pressure prevention valve, enter  $\bigcirc$  in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.
- 13. Can be selected only when the manifold type is XP.
- 14. Can be selected only when the manifold type is **XPH**.
- 15. Only one intermediate piping block can be installed. For information on the type, see page 100 for F10 or page 198 for F15.

Quantity set Delivery
-----------------------

Easy Assembly Type Manifold Serial Transmission Type

	Ordor Bato Months	Duyi	rour,
Company name			
Contact person			
Order No.			


Day/


Year/

Order Date Month/

## **Specifications Confirmation Form 1/2**

Fill in selections inside the thick-lined boxes.

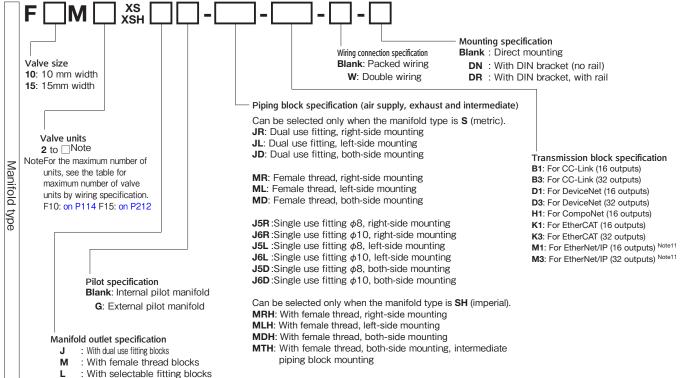

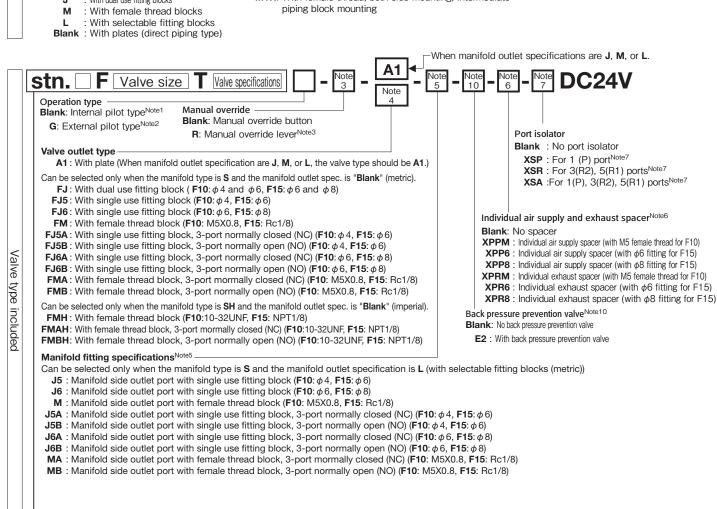

Enter \( \) in each designated station in tables on the next page.

Easy Assembly Type Manifold Serial Transmission Type

#### **Specifications Confirmation Form 2/2**

 $\rceil$  %For specifying the valve and block-off plate to be mounted at each station, enter  $\bigcirc$  in each applicable box below.

		ecifying the valve and block-off p	late	to be	e mo	unte	d at	eacr	ı sta	tion,	ente	er 🔾	ın ea	ach a	ppii	cable	e pox	( bei	ow.			
	Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
	F 🗆 T0	2-position, for single solenoid only																				
	F 🗆 T1	2-position, single solenoid specification																				
	F □ T2	2-position, double solenoid specification																				
	F 🗌 T3	3-position, closed center																				
	F 🗌 T4	3-position, exhaust center																				
	F T5	3-position, pressure center																				
		e9 Tandem 3-port (NC and NC)																				
		te9 Tandem 3-port (NO and NO)																			$\overline{}$	
	F TCNot	te9 Tandem 3-port (NC and NO)																			-	
	F LT0	(Low current type) 2-position, for single solenoid only																			$\vdash$	
	F LT1	(Low current type) 2-position, single solenoid specification																			$\vdash$	
	F LT2	(Low current type) 2-position, double solenoid specification																			-	
	F LT3	(Low current type) 3-position, closed center																			$\vdash$	
	F LT4	(Low current type) 3-position, exhaust center																			$\vdash$	
	F LT5	(Low current type) 3-position, pressure center																			$\vdash$	
	F LTA	(Low current type) Tandem 3-port (NC and NC)																				
	F LTB	(Low current type) Tandem 3-port (NO and NO)					$\vdash$															
	F LTC	(Low current type) Tandem 3-port (NC and NO)					$\vdash \vdash$															
		P Block-off plate																				
		P-S Block-off plate(wiring for single solenoid)																				
		te12 Intermediate piping block																				
<u>s</u>		verride (-R) Manual override lever <sup>Note3</sup>																				
models	manaa or	FJ With dual use fitting block																				
2		FJ5 With single use fitting block																			-	
<u></u>		FJ6 With single use fitting block																			$\vdash$	
valve		FM With female thread block																			$\vdash$	
A		FJ5A With single use fitting block, 3-port normally closed (NC)																			$\vdash$	
Mounting	Valve	FJ5B With single use fitting block, 3-port normally open (NO)																				
量	outlet	FJ6A With single use fitting block, 3-port normally closed (NC)																			$\vdash$	
ই	type <sup>Note4</sup>	FJ6B With single use fitting block, 3-port normally open (NO)																			-	
S	,,	FMA With female thread block, 3-port normally closed (NC)																			$\vdash$	
-		FMB With female thread block, 3-port normally open (NO)																			$\vdash$	
		FMH With female thread block																			$\vdash$	
		FMAH With female thread block, 3-port normally closed (NC)																			$\vdash$	
		FMBH With female thread block, 3-port normally open (NO)																			$\vdash$	
		J5 With single use fitting block					$\vdash \vdash$															
		J6 With single use fitting block																				
		M With female thread block					$\vdash$															
	Manifold fitting	J5A With single use fitting block, 3-port normally closed (NC)																			$\Box$	
	specification-	J5B With single use fitting block, 3-port normally open (NO)																				
	Note5 (Manifold	J6A With single use fitting block, 3-port normally closed (NC)					$\vdash$															
	side outlet port)	J6B With single use fitting block, 3-port normally open (NO)																			$\Box$	
		MA With female thread block, 3-port normally closed (NC)																				
		MB With female thread block, 3-port normally open (NO)																				
	E2 <sup>Note10</sup> R	Back pressure prevention valve																				
		idividual air supply spacer (with M5 female thread for F10)																				
		ndividual air supply spacer (with $\phi$ 6 fitting for F15)					$\Box$															
		ndividual air supply spacer (with $\phi$ 8 fitting for F15)																				
		ndividual exhaust spacer (with M5 female thread for F10)																				
		ndividual exhaust spacer (with $\phi$ 6 fitting for F15)																				
		ndividual exhaust spacer (with $\phi$ 8 fitting for F15)																				
		or (-XSP) For 1(P) port <sup>Note8</sup>																				
	Port isolate	cor (- <b>XSR</b> ) For 3(R2), 5(R1) ports <sup>Note8</sup>																				
		or ( <b>-XSA</b> ) For 1(P), 3(R2), 5(R1) ports <sup>Note8</sup>																				
$\Box$		, , , , , , , , , , , , , , , , , , , ,					$\overline{}$															

Notes:1. Cannot be mounted on the external pilot manifold.

- 2. Cannot be mounted on the internal pilot manifold.
- To designate a manual override lever, enter () in the manual override boxes of the designated stations in the above table.
   When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter () in the valve outlet type boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.
- 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter O in the manifold fitting specification boxes of the above table. The 3-port specifications are only available in valve specifications TO, T1, and T2.
- 6. When mounting the individual air supply or exhaust spacer, enter () in the spacer boxes of the designated stations in the above table.

  7. To designate a port isolator, enter () in one port isolator box of the designated stations in the above table.
- 8. Port isolators can be installed only when piping blocks are installed on both sides. In addtion, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations.
  - When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).
- 9. Not availabale in external pilot type.
- 10. When mounting the back pressure prevention valve , enter in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.
- 11. Complies with the CE marking regulations.
- 12. Only one intermediate piping block can be installed. For information on the type, see page 100 for F10 or page 198 for F15.

Quantity	set	Delivery

Monoblock Manifold A Type (Base Piping Type)


	Order Date Month/	рау/	Year/
Company name			
Contact person			
Order No.			

MH: Manifold side outlet port with NPT1/4 female thread block

## **Specifications Confirmation Form 1/2**

Enter  $\bigcirc$  in each designated station in tables on the next page.

· Fill in selections inside the thick-lined boxes.

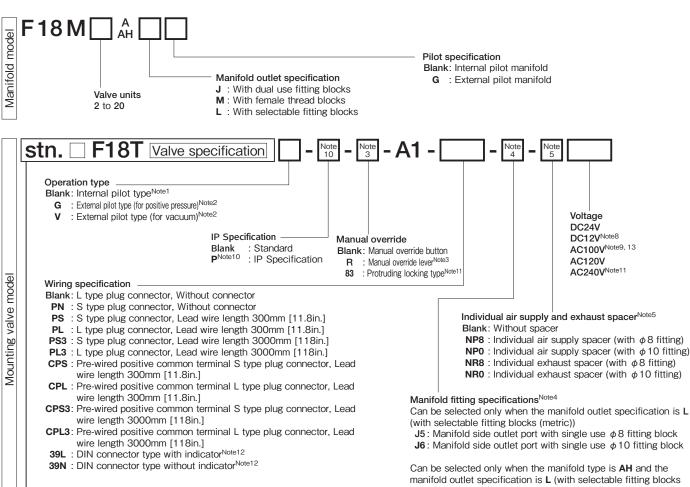

Monoblock Manifold A Type (Base Piping Type)

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 2/2**

Mounting va	alve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F18T0	2-position, for single solenoid only																				
F18T1	2-position, single solenoid specification																				
F18T2	2-position, double solenoid specification																				
F18T3	3-position, closed center																				
F18T4 <sup>Note6</sup>	3-position, exhaust center																				
F18T5 <sup>Note6</sup>	3-position, pressure center																				
F18TA <sup>Note7</sup>	Tandem 3-port (NC and NC)																				
F18TB <sup>Note7</sup>	Tandem 3-port (NO and NO)																				
F18TC <sup>Note7</sup>	Tandem 3-port (NC and NO)																				
F18LT0	(Low current type) 2-position, for single solenoid only																				
F18LT1	(Low current type) 2-position, single solenoid specification																				
F18LT2	(Low current type) 2-position, double solenoid specification																				
F18LT3	(Low current type) 3-position, closed center																				
F18LT4 <sup>Note6</sup>	(Low current type) 3-position, exhaust center																				
F18LT5 <sup>Note6</sup>	(Low current type) 3-position, pressure center																				
F18LTA <sup>Note7</sup>	(Low current type) Tandem 3-port (NC and NC)																				
F18LTB <sup>Note7</sup>	(Low current type) Tandem 3-port (NO and NO)																				
F18LTC <sup>Note7</sup>	(Low current type) Tandem 3-port (NC and NO)																				
F18BP	Block-off plate																				
P Note10	IP Specification																				
Manual med	chanism (-R) manual lever <sup>Note3</sup>																				
	83 Protruding locking type <sup>Note7</sup>																				
Manifold fitting specification Note4	J5 With single use fitting block																				
(Manifold side outlet port)	J6 With single use fitting block																				
	MH With female thread block																				
	dual air supply spacer (with $\phi$ 8 fitting)																				_
	tual air supply spacer (with $\phi$ 10 fitting)																				
NR8 Individ	dual exhaust spacer (with $\phi$ 8 fitting)																				$\perp$
NR0 Individ	dual exhaust spacer (with $\phi$ 10 fitting)																				

- Notes:1. Cannot be mounted on the external pilot manifold.

  - Cannot be mounted on the internal pilot manifold.
     To designate a manual override lever, enter in the manual override boxes of the designated station in the above table.
     When the manifold outlet specifications are L (with selectable fitting), select fitting specification for each station, and enter in the manifold fitting specification boxes of the above table.
  - The 3-port specifications are only available in valve specification T0, T1, and T2. 5. When mounting the individual air supply or exhaust spacer or stop valve, enter O in the spacer or stop valve boxes of the designated stations in the above table.
  - 6. Not available in the vacuum valves.
  - 7. Not available in external pilot type and vacuum valves.
  - 8. Not available in low-current type.

  - Not available in low-current type and tandem 3-port valves.
     The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
  - 11. Only for wiring specification -39□.
  - 12. Not available for valve specification T1. In addition, the valve is used only as a double solenoid for T2.
  - 13. Not available with DIN connectors (-39□).


Quantity	, set	Delivery


Monoblock Manifold F Type (Direct Piping Type)

	Order Date Month/	Day/	Year/	
Company name				
Contact person				
Order No.				

## **Specifications Confirmation Form 1/2**

· Fill in selections inside the thick-lined boxes.



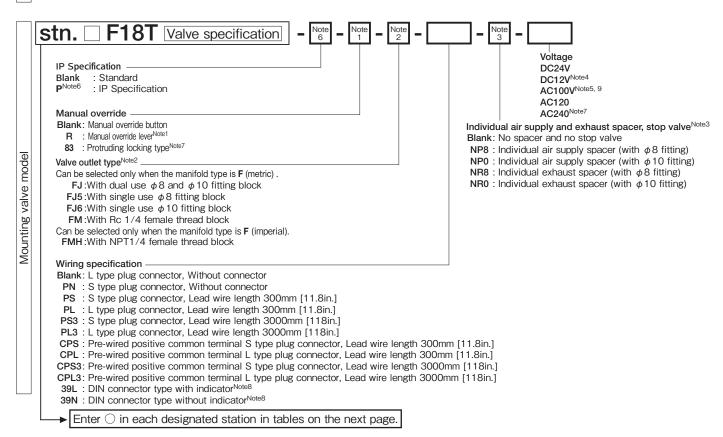

Monoblock Manifold F Type (Direct Piping Type)

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

## **Specifications Confirmation Form 2/2**

Mounting va	alve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F18T0	2-position, for single solenoid only																				
F18T1	2-position, single solenoid specification																				
F18T2	2-position, double solenoid specification																				
F18T3	3-position, closed center																				
F18T4	3-position, exhaust center																				
F18T5	3-position, pressure center																				
F18TA	Tandem 3-port (NC and NC)																				
F18TB	Tandem 3-port (NO and NO)																				
F18TC	Tandem 3-port (NC and NO)																				
F18LT0	(Low current type) 2-position, for single solenoid only																				
F18LT1	(Low current type) 2-position, single solenoid specification																				
F18LT2	(Low current type) 2-position, double solenoid specification																				Г
F18LT3	(Low current type) 3-position, closed center																				
F18LT4	(Low current type) 3-position, exhaust center																				
F18LT5	(Low current type) 3-position, pressure center																				
F18LTA	(Low current type) Tandem 3-port (NC and NC)																				
F18LTB	(Low current type) Tandem 3-port (NO and NO)																				
F18LTC	(Low current type) Tandem 3-port (NC and NO)																				
F18BP	Block-off plate																				
P Note6	IP Specification																				
Manual med	chanism (-R) manual lever <sup>Note1</sup>																				Г
	83 Protruding locking type <sup>Note7</sup>																				
	FJ With dual use fitting block																				
Valve type <sup>Note2</sup>	FJ5 With single use fitting block																				
valve type	FJ6 With single use fitting block																				
	FM With female thread block																				
	FMH With female thread block																				
NP8 Individ	ual air supply spacer (with $\phi$ 8 fitting)																				
NP0 Individ	ual air supply spacer (with $\phi$ 10 fitting)																				
NR8 Individ	lual exhaust spacer (with $\phi$ 8 fitting)																				
NR0 Individ	lual exhaust spacer (with $\phi$ 10 fitting)																				

Notes:1. To designate a manual override lever, enter  $\bigcirc$  in the manual override boxes of the designated station in the above table.

- 2. Select valve outlet type for each station, and enter O in the valve outlet type boxes of the above table. Note that the three port type only supports the **T0**, **T1**, and **T2** valve type.
- 3. When mounting the individual air supply or exhaust spacer or stop valve, enter O in the spacer or stop valve boxes of the designated stations in the above table.
- 4. Not available in low-current type.
- 5. Not available in low-current type and tandem 3-port valves.
  6. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.
- Only for wiring specification -39□.
- 8. Not available for valve specification **T1**. In addition, the valve is used omly as a double solenoid for **T2**. 9. Not available with DIN connectors (-39□).


Quantity	set	Delivery


Split Manifold Non-Plug-in Type

# Specifications Confirmation Form 1/2

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

Fill in selections inside the thick-lined boxes.

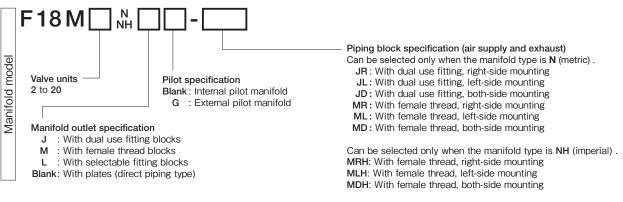

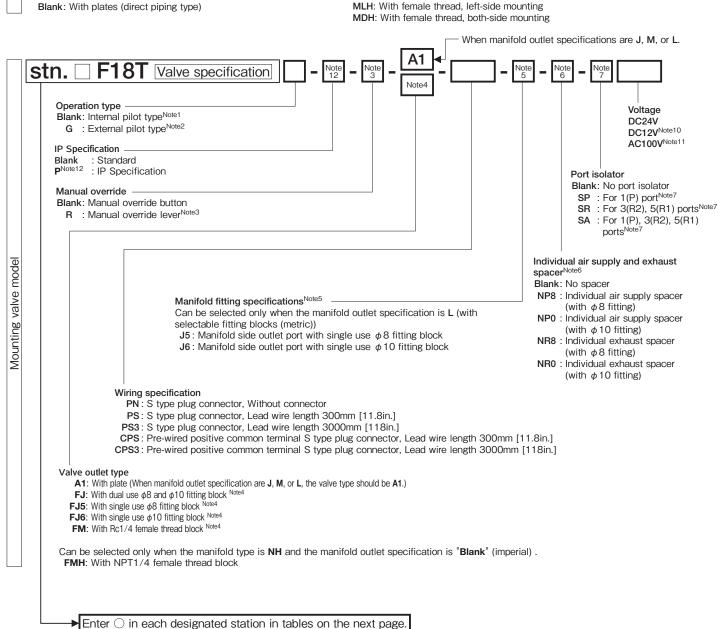

#### Split Manifold Non-Plug-in Type

## **Specifications Confirmation Form 2/2**

∑ \*For specifying the valve and block-off plate to be mounted at each station, enter ○ in each applicable box below.

Mounting v	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F18T0	2-position, for single solenoid only																				
F18T1	2-position, single solenoid specification																				
F18T2	2-position, double solenoid specification																				
F18T3	3-position, closed center																				
F18T4	3-position, exhaust center																				
F18T5	3-position, pressure center																				
F18TA <sup>Note9</sup>	Tandem 3-port (NC and NC)																				
F18TBNote9	Tandem 3-port (NO and NO)																				
F18TC <sup>Note9</sup>	Tandem 3-port (NC and NO)																				
F18LT0	(Low current type) 2-position, for single solenoid only																				
F18LT1	(Low current type) 2-position, single solenoid specification																				
F18LT2	(Low current type) 2-position, double solenoid specification																				
F18LT3	(Low current type) 3-position, closed center																				
F18LT4	(Low current type) 3-position, exhaust center																				
F18LT5	(Low current type) 3-position, pressure center																				
F18LTA <sup>Note9</sup>	(Low current type) Tandem 3-port (NC and NC)																				
F18LTB <sup>Note9</sup>	(Low current type) Tandem 3-port (NO and NO)																				
F18LTC <sup>Note9</sup>	(Low current type) Tandem 3-port (NC and NO)																				
F18BPN	Block-off plate																				
P Note12	IP Specification																				
Manual ov	erride (-R) Manual override lever <sup>Note3</sup>																				
	A1 With plate																				
	FJ With dual use fitting block																				
Valve	FJ5 With single use fitting block																				
outlet type <sup>Note4</sup>	FJ6 With single use fitting block																				
1,500	FM With female thread block																				
	FMH With female thread block																				
Manifold fitting	J5 With single use fitting block																				
specification <sup>Note5</sup>	J6 With single use fitting block																				
(Manifold side outlet port)	MH With female thread block																				
NP8 Indivi	dual air supply spacer (with $\phi$ 8 fitting)																				
NP0 Indivi	dual air supply spacer (with $\phi$ 10 fitting)																				
NR8 Indivi	dual exhaust spacer (with $\phi$ 8 fitting)																				
NR0 Indivi	dual exhaust spacer (with $\phi$ 10 fitting)																				
Port isolate	or (-SP) For 1(P) port <sup>Note8</sup>																				
Port isolate	or (-SR) For 3(R2), 5(R1) ports <sup>Note8</sup>																				
Port isolato	r (-SA) For 1(P), 3(R2), 5(R1) ports <sup>Note8</sup>																				

Notes:1. Cannot be mounted on the external pilot manifold.

- 2. Cannot be mounted on the internal pilot manifold.
- To designate a manual override lever, enter in the manual override boxes of the designated stations in the above table.
   When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter in the valve outlet type boxes of the above table.

The 3-port specifications are only available in valve specifications T0, T1, and T2.

5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter  $\bigcirc$  in the manifold fitting specification boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.

6. When mounting the individual air supply or exhaust spacer, enter  $\bigcirc$  in the one spacer box of the desigated stations in the above table. 7. To designate a port isolator box of the designated station, enter  $\bigcirc$  in the port isolator box in the above table.

8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator dor -SP and -SR for a total of 2 locations.

When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller

- 9. Not availabale in external pilot type.
- 10. Not available in low-current type.
- 11. Not available in low-current type and tandem 3-port valves.
- 12. The IP65 protective structure around an electrical device that prevents the infiltration of solid foreign material and water from outside.


Quantity	, set	Delivery


Split Manifold Plug-in Type

# Specifications Confirmation Form 1/2

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			

Fill in selections inside the thick-lined boxes.

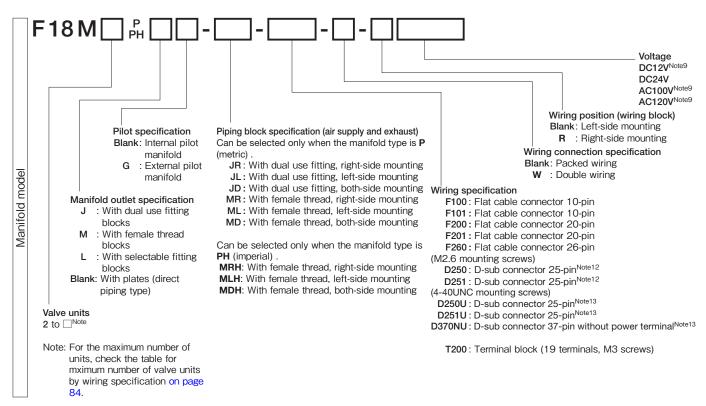

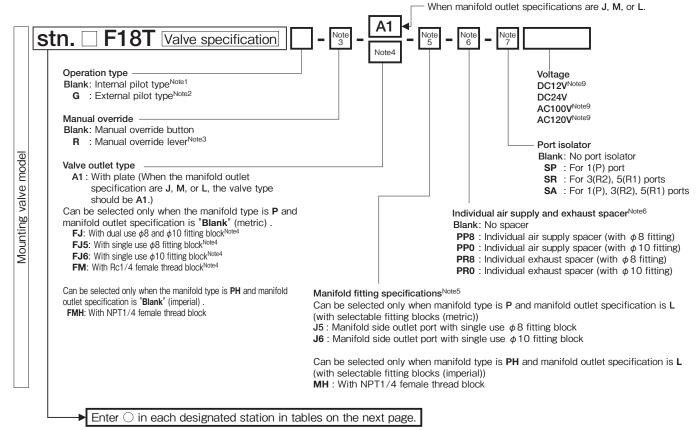

Split Manifold Plug-in Type

## **Specifications Confirmation Form 2/2**

	For specific	cifying the valve and block-off p	late	to be	moi	unte	d at	each	n sta	tion,	ente	er 🔾	in e	ach	appli	icabl	e bo	x be	low.			
	Mounting v	alve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
	F18T0	2-position, for single solenoid only																				
	F18T1	2-position, single solenoid specification																				
	F18T2	2-position, double solenoid specification																				
	F18T3	3-position, closed center																				
	F18T4	3-position, exhaust center																				
	F18T5	3-position, pressure center																				
	F18TANote11	Tandem 3-port (NC and NC)																				
	F18TBNote11	Tandem 3-port (NO and NO)																				
	F18TC <sup>Note11</sup>	Tandem 3-port (NC and NO)																				
	F18LT0	(Low current type) 2-position, for single solenoid only																				
	F18LT1	(Low current type) 2-position, single solenoid specification																				
	F18LT2	(Low current type) 2-position, double solenoid specification																				
	F18LT3	(Low current type) 3-position, closed center																				
8	F18LT4	(Low current type) 3-position, exhaust center																				
model	F18LT5	(Low current type) 3-position, pressure center																				
E	F18LTA <sup>Note11</sup>	(Low current type) Tandem 3-port (NC and NC)																				
valve	F18LTB <sup>Note11</sup>	(Low current type) Tandem 3-port (NO and NO)																				
	F18LTC <sup>Note11</sup>	(Low current type) Tandem 3-port (NC and NO)																				
ij	F18BPP	Block-off plate																				
Mounting	F18BPP-1W	Block-off plate (wiring for single solenoid)																				
Ĭ	Manual ove	erride (-R) Manual override lever <sup>Note3</sup>																				
		FJ With dual use fitting block																				
	Valve out-	FJ5 With single use fitting block																				
	let type- Note4	FJ6 With single use fitting block																				
	Note4	FM With female thread block																				
		FMH With female thread block																				
	Manifold fitting specifi-	J5 With single use fitting block																				
	cation <sup>Note5</sup> (Manifold	J6 With single use fitting block																				
	side outlet port)	MH With female thread block																				
	PP8 Individ	dual air supply spacer (with $\phi$ 8 fitting)																				
	PP0 Individ	dual air supply spacer (with $\phi$ 10 fitting)																				
	PR8 Individ	dual exhaust spacer (with $\phi$ 8 fitting)																				
	PR0 Individ	dual exhaust spacer (with $\phi$ 10 fitting)																				
	Port isolato	r (-SP) For 1(P) port <sup>Note8</sup>																				
		or (-SR) For 3(R2), 5(R1) ports <sup>Note8</sup>																				
	Port isolator	(-SA) For 1(P), 3(R2), 5(R1) ports <sup>Note8</sup>																				
		ennot be mounted on the external nilot	:	اماما						_					_							

Notes: 1. Cannot be mounted on the external pilot manifold.

- Cannot be mounted on the internal pilot manifold.
   To designate a manual override lever, enter \( \) in the manual override boxes of the designated stations in the above table.
   When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter \( \) in the valve outlet type boxes of

The 3-port specifications are only available in valve specifications T0, T1, and T2.

- 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter O in the manifold fitting specification boxes of the above table The 3-port specifications are only available in valve specifications T0, T1, and T2.

- 6. When mounting the individual air supply or exhaust spacer, enter in the spacer boxes of the designated stations in the above table.

  7. To designate a port isolator, enter in one port isolator box of the designated stations in the above table.

  8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller
- stn. No.). 9. Not available in low-current type.
- 10. AC100V and AC120V can only be used when wiring specifications are -D250, -D251 (D-sub connector), or -T200 (terminal). In addition, not available in low-current type and tandem 3-port valves
- 11. Not availabale in external pilot type.
- 12. Can be selected only when the manifold type is P.
- 13. Can be selected only when the manifold type is PH.


	Quantity	set	Delivery
- 1	-,		


Split Manifold Serial Transmission Type

# Specifications Confirmation Form 1/2

	Order Date Month/	Day/	Year/
Company name			
Contact person			
Order No.			·

Fill in selections inside the thick-lined boxes.

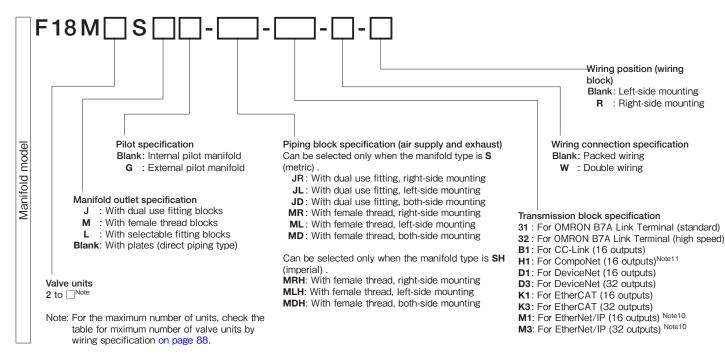

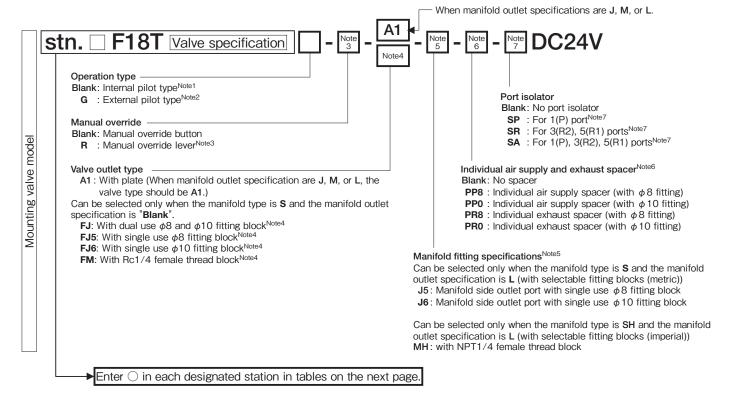

Split Manifold Serial Transmission Type

## **Specifications Confirmation Form 2/2**

∑ \*For specifying the valve and block-off plate to be mounted at each station, enter ○ in each applicable box below.

Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F18T0	2-position, for single solenoid only																				
F18T1	2-position, single solenoid specification																				
F18T2	2-position, double solenoid specification																				
F18T3	3-position, closed center																				
F18T4	3-position, exhaust center																				
F18T5	3-position, pressure center																				
F18TA <sup>Note9</sup>	Tandem 3-port (NC and NC)																				
F18TB <sup>Note9</sup>	Tandem 3-port (NO and NO)																				
F18TC <sup>Note9</sup>	Tandem 3-port (NC and NO)																				
F18LT0	(Low current type) 2-position, for single solenoid only																				
F18LT1	(Low current type) 2-position, single solenoid specification																				
F18LT2	(Low current type) 2-position, double solenoid specification																				
F18LT3	(Low current type) 3-position, closed center																				
F18LT4	(Low current type) 3-position, exhaust center																				
F18LT4	(Low current type) 3-position, pressure center																				
	(Low current type) Tandem 3-port (NC and NC)																				
F18LTA <sup>Note9</sup>	(Low current type) Tandem 3-port (NO and NO)																				
	(Low current type) Tandem 3-port (NC and NO)																				
F18LTC <sup>Note9</sup> F18BPP Manual ov	Block-off plate																				
Manual o	verride (-R) Manual override lever <sup>Note3</sup>																				
≥	FJ With dual use fitting block																				
Valve	FJ5 With single use fitting block																				
outlet	FJ6 With single use fitting block																				
type <sup>Note4</sup>	FM With female thread block																				
	FMH With female thread block																				
Manifold fitting speci-	J5 With single use fitting block																				
fication <sup>Note5</sup> (Manifold	J6 With single use fitting block																				
side outlet port)	MH With female thread block																				
PP8 Indiv	ridual air supply spacer (with $\phi$ 8 fitting)																				
PP0 Indiv	ridual air supply spacer (with $\phi$ 10 fitting)																				
PR8 Indiv	vidual exhaust spacer (with $\phi$ 8 fitting)																				
PR0 Indiv	vidual exhaust spacer (with $\phi$ 10 fitting)																				
Port isola	tor (-SP) For 1(P) port <sup>Note8</sup>																				
Port isola	tor (-SR) For 3(R2), 5(R1) ports <sup>Note8</sup>																				
Port isolate	or (-SA) For 1(P), 3(R2), 5(R1) ports <sup>Note8</sup>																				

Notes:1. Cannot be mounted on the external pilot manifold.

- Cannot be mounted on the internal pilot manifold.
   To designate a manual override lever, enter in the manual override boxes of the designated stations in the above table.
   When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter in the valve outlet type boxes of the above table.

- The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**.

  5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter  $\bigcirc$  in the manifold fitting specification boxes of the above table. The 3-port specifications are only available in valve specifications T0, T1, and T2.
- 6. When mounting the individual air supply or exhaust spacer, enter O in the spacer boxes of the designated stations in the above table.
  7. To designate a port isolator, enter O in one port isolator box of the designated stations in the above table.
  8. Port isolators can be installed only when piping blocks are installed on both sides. In addition, only 1 port isolator can be mounted in 1 manifold

- for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller
- 9. Not availabale in external pilot type.
- 10. Complies with the CE marking regulations.
- 11. The -H1 (for CompoNet (16 outputs)) transmission block is mountable on the left side only.


- 1			
	Quantity	set	Delivery

#### 1. Changes in the monoblock manifold (aluminum manifold) gasket


Along with the back pressure prevention valve becoming an option, the gasket configuration has also been changed. Note that a new gasket type cannot be fitted onto and used on an old type manifold.

When replacing a mounted valve, order an old type gasket if you need to replace the gasket of an old type manifold. (Old type gasket model for the F10 Series: Q-F10Z-GS1, old type gasket model for the F15 Series: Q-F15Z-GS1)

## For new type manifold



#### For old type manifold




Mounted valve	New/old type gasket	New type manifold	Old type manifold
New type valve	New type gasket		×
Trow type valve	Old type gasket	×	0
Old type velve	New type gasket		×
Old type valve	Old type gasket	×	0


Note:There is no gasket replacement for a split manifold or serial transmission compatible manifold.

2. Determining whether a monoblock manifold A type or F type, or PC board manifold A type or F type is an old type or new type

New type manifold



#### Old type manifold



If you have any questions regarding the above, contact your nearest KOGANEI sales office.

## MEMO


#### MEMO

## **Limited Warranty**

KOGANEI CORP. warrants its products to be free from defects in material and workmanship subject to the following provisions.

#### **Warranty Period**

The warranty period is 180 days from the date of delivery.

#### Koganei Responsibility

If a defect in material or workmanship is found during the warranty period, KOGANEI CORP. will replace any part proved defective under normal use free of charge and will provide the service necessary to replace such a part.

#### Limitations

This warranty is in lieu of all other warranties, expressed or implied, and is limited to the original cost of the product and shall not include any transportation fee, the cost of installation or any liability for direct, indirect or consequential damage or delay resulting from the defects.

- KOGANEI CORP. shall in no way be liable or responsible for injuries or damage to persons or property arising out of the use or operation of the manufacturer's product.
- This warranty shall be void if the engineered safety devices are removed, made inoperative or not periodically checked for proper functioning.
- Any operation beyond the rated capacity, any improper use or application, or any improper installation of the product, or any substitution upon it with parts not furnished or approved by KOGANEI CORP., shall void this warranty.
- This warranty covers only such items supplied by KOGANEI CORP. The products of other manufacturers are covered only by such warranties made by those original manufacturers, even though such items may have been included as the components.

The specifications are subject to change without notice.

URL: http://www.koganeiusa.com

E-mail: sales@koganeiusa.com



#### KOGANEI CORPORATION

#### OVERSEAS DEPARTMENT

3-11-28, Midori-cho, Koganei City, Tokyo 184-8533, Japan Tel: 81-42-383-7271 Fax: 81-42-383-7276

#### KOGANEI INTERNATIONAL AMERICA, INC.

48860 Milmont Dr., Suite 108C, Fremont, CA 94538, U.S.A. Tel: 1-510-744-1626 Fax: 1-510-744-1676

#### SHANGHAI KOGANEI INTERNATIONAL TRADING CORPORATION

Room 2606-2607, Tongda Venture Building No.1, Lane 600, Tianshan Road, Shanghai, 200051, China Tel: 86-21-6145-7313 Fax: 86-21-6145-7323

#### TAIWAN KOGANEI TRADING CO., LTD.

Rm. 2, 13F., No88, Sec. 2, Zhongxiao E. Rd., Zhongzheng Dist., Taipei City 100, Taiwan (ROC)
Tel: 886-2-2393-2717 Fax: 886-2-2393-2719

#### KOGANEI KOREA CO., LTD.

6F-601, Tower Bldg., 1005, Yeongdeo-dong, Giheung-gu, Yongin-si, Gyeonggi-do, 446-908, Korea
Tel: 82-31-246-0414 Fax: 82-31-246-0415

#### KOGANEI (THAILAND) CO., LTD.

3300/90, Tower B, Elephant Tower,16th Fl., Phaholyothin Road, Chomphon, Chatuchak, Bangkok 10900, Thailand Tel: 66-2-937-4250 Fax: 66-2-937-4254

#### KOGANEI AUTOMATION (MALAYSIA) SDN.BHD.

Suite 29-2, Level 29, Menara 1MK, No.1, Jalan Kiara, Mont Kiara 50480, Kuala Lumpur, Malaysia Tel: 60-12-537-7086

#### KOGANEI ASIA PTE. LTD.

69 Ubi Road 1, #05-18 Oxley Bizhub, Singapore 408731 Tel: 65-6293-4512 Fax: 65-6293-4513